

2019 Annual Groundwater Monitoring and Corrective Action Report

Secondary Pond
Columbia Energy Center
Pardeeville, Wisconsin

Prepared for:



Wisconsin Power and Light Company
4902 N. Biltmore Lane
Madison, Wisconsin 53718

SCS ENGINEERS

25220067.00 | August 3, 2020

2830 Dairy Drive
Madison, WI 53718-6751
608-224-2830

Table of Contents

Section	Page
1.0 Introduction.....	1
2.0 §257.100(e)(5) Groundwater Monitoring and Corrective Action for Inactive CCR Surface Impoundments	1
3.0 §257.90(e) Annual Report Requirements.....	1
3.1 §257.90(e)(1) Site Map.....	2
3.2 §257.90(e)(2) Monitoring System Changes.....	2
3.3 §257.90(e)(3) Summary of Sampling Events.....	2
3.4 §257.90(e)(4) Monitoring Transition Narrative.....	2
3.5 §257.90(e)(5) Other Requirements.....	3
3.5.1 §257.90(e) General Requirements.....	3
3.5.2 §257.94(d) Alternative Detection Monitoring Frequency.....	4
3.5.3 §257.94(e)(2) Alternative Source Demonstration for Detection Monitoring	4
3.5.4 §257.95(c) Alternative Assessment Monitoring Frequency	4
3.5.5 §257.95(d)(3) Assessment Monitoring Results and Standards	4
3.5.6 §257.95(g)(3)(ii) Alternative Source Demonstration for Assessment Monitoring ..	5
3.5.7 §257.96(a) Extension of Time for Corrective Measures Assessment	5

Tables

Table 1. CCR Rule Groundwater Samples Summary

Figures

Figure 1. Site Location Map
Figure 2. Site Plan and Monitoring Well Locations

Appendices

Appendix A Laboratory Reports
A1 April 2019 Detection Monitoring
A2 October 2019 Detection Monitoring
A3 December 2019 Assessment Monitoring

I:\25220067.00\Deliverables\2019 Federal Annual Report - COL - SP\200803_2019 Annual CCR GW Report COL Sec Pond_Final.docx

[This page left blank intentionally]

1.0 INTRODUCTION

This 2019 Annual Groundwater Monitoring and Corrective Action Report was prepared to support compliance with the groundwater monitoring requirements of the “Coal Combustion Residuals (CCR) Final Rule” (Rule) published by the U.S. Environmental Protection Agency (USEPA) in the *Hazardous and Solid Waste Management System; Disposal of Coal Combustion Residuals from Electric Utilities*; Final Rule, dated April 17, 2015 (USEPA, 2015) and subsequent amendments. Specifically, this report was prepared to fulfill the requirements of 40 CFR 257.100 and 40 CFR 257.90(e) for inactive CCR surface impoundments. The applicable sections of the Rule are provided below in *italics*, followed by applicable information relative to the 2019 Annual Groundwater Monitoring and Corrective Action Report for the CCR unit.

This report covers the period of groundwater monitoring from January 1, 2019, through December 31, 2019.

The groundwater monitoring system for the Secondary Pond at the Columbia Energy Center (COL) monitors a single inactive CCR unit:

- COL Secondary Pond (inactive surface impoundment)

The system is designed to detect monitored constituents at the waste boundary of the COL Secondary Pond as required by 40 CFR 257.91(d). The groundwater monitoring system consists of two background wells and three downgradient monitoring wells.

Other CCR units at the COL facility include the COL Primary Ash Pond and Dry Ash Disposal Facility (Modules 1-4). Annual groundwater monitoring and corrective action reports for these existing CCR units are submitted separately on January 31 of each year in accordance with 40 CFR 257.90(e).

2.0 §257.100(E)(5) GROUNDWATER MONITORING AND CORRECTIVE ACTION FOR INACTIVE CCR SURFACE IMPOUNDMENTS

The owner or operator of the inactive CCR surface impoundment must: (i) No later than April 17, 2019, comply with groundwater monitoring requirements set forth in §§ 257.90(b) and 257.94(b); and (ii) No later than August 1, 2019, prepare the initial groundwater monitoring and corrective action report as set forth in § 257.90(e).

This report is submitted to fulfill the report requirement.

3.0 §257.90(E) ANNUAL REPORT REQUIREMENTS

Annual groundwater monitoring and corrective action report. . . For the preceding calendar year, the annual report must document the status of the groundwater monitoring and corrective action program for the CCR unit, summarize key actions completed, describe any problems encountered, discuss actions to resolve the problems, and project key activities for the upcoming year. For purposes of this section, the owner or operator has prepared the annual report when the report is placed in the facility’s operating record as required by § 257.105(h)(1). At a minimum, the annual groundwater monitoring and corrective action report must contain the following information, to the extent available:

3.1 §257.90(E)(1) SITE MAP

A map, aerial image, or diagram showing the CCR unit and all background (or upgradient) and downgradient monitoring wells, to include the well identification numbers, that are part of the groundwater monitoring program for the CCR unit;

A map of the location of the site is provided as **Figure 1**. A map showing the Secondary Pond and all background (or upgradient) and downgradient monitoring wells with identification numbers for the groundwater monitoring program is provided as **Figure 2**. Other CCR units are also shown on **Figure 2**.

3.2 §257.90(E)(2) MONITORING SYSTEM CHANGES

Identification of any monitoring wells that were installed or decommissioned during the preceding year, along with a narrative description of why those actions were taken;

No new monitoring wells were installed, and no wells were decommissioned as part of the groundwater monitoring programs for the CCR unit in 2019.

3.3 §257.90(E)(3) SUMMARY OF SAMPLING EVENTS

In addition to all the monitoring data obtained under §§ 257.90 through 257.98, a summary including the number of groundwater samples that were collected for analysis for each background and downgradient well, the dates the samples were collected, and whether the sample was required by the detection monitoring or assessment monitoring programs;

Three groundwater sampling events were completed for the inactive COL Secondary Pond in 2019. The established semiannual sampling for the site was followed and sampling occurred in April 2019 and October 2019. As described in **Section 3.4**, the site transitioned to an assessment monitoring program in 2019. The first round of assessment monitoring sampling was completed in December 2019.

Groundwater samples collected in April and October 2019 were analyzed for Appendix III constituents. The groundwater samples collected in December 2019 were analyzed for both Appendix III and Appendix IV constituents. A summary including the number of groundwater samples that were collected, and whether the sample was required by the detection monitoring or assessment monitoring program is included in **Table 1**. The results of the analytical laboratory analyses are provided in the laboratory reports in **Appendix A1** through **Appendix A3**.

3.4 §257.90(E)(4) MONITORING TRANSITION NARRATIVE

A narrative discussion of any transition between monitoring programs (e.g., the date and circumstances for transitioning from detection monitoring to assessment monitoring in addition to identifying the constituent(s) detected at a statistically significant increase over background levels);

Detection monitoring for the COL Secondary Pond was initiated in April 2019. The statistical evaluation of the April 2019 detection monitoring results completed on July 15, 2019, identified statistically significant increases (SSIs) in detection monitoring constituents at the downgradient wells. SSIs were identified for boron, chloride, and sulfate at one or more wells based on the April 2019 detection monitoring event. Wisconsin Power and Light Company (WPL) collected the first

round of assessment monitoring samples in December 2019 and established an assessment monitoring program on January 13, 2020, in accordance with §257.95(b).

3.5 §257.90(E)(5) OTHER REQUIREMENTS

Other information required to be included in the annual report as specified in §§ 257.90 through 257.98.

Additional potentially applicable requirements for the annual report, and the location of the requirement within the Rule, are provided in the following sections. For each cited section of the Rule, the portion referencing the annual report requirement is provided below in *italics*, followed by applicable information relative to the 2019 Annual Groundwater Monitoring and Corrective Action Report for the CCR units.

3.5.1 §257.90(e) General Requirements

For the preceding calendar year, the annual report must document the status of the groundwater monitoring and corrective action program for the CCR unit, summarize key actions completed, describe any problems encountered, discuss actions to resolve the problems, and project key activities for the upcoming year.

Status of Groundwater Monitoring and Corrective Action Program. The groundwater monitoring and corrective action program transitioned from detection monitoring to assessment monitoring in 2019.

Summary of Key Actions Completed.

- Statistical evaluation and determination of SSIs for the April 2019 monitoring event, completed July 15, 2019.
- First annual groundwater monitoring and corrective action report completed on August 1, 2019.
- Two semiannual detection monitoring sampling and analysis events (April and October 2019).
- First assessment monitoring sampling and analysis event (December 2019).

Description of Any Problems Encountered. No problems were encountered in 2019.

Discussion of Actions to Resolve the Problems. Not applicable.

Projection of Key Activities for the Upcoming Year (2020).

- Transmittal of the results for the October 2019 detection monitoring event and notification of the initial round of assessment monitoring sampling in December 2019 (January 13, 2020).
- Establishment of assessment monitoring program (January 13, 2020).
- Establishment of groundwater protection standards (April 2020).

- Statistical evaluation and determination of any statistically significant levels exceeding the GPS for the December 2019, February 2020, and April 2020 monitoring events (July 2020).
- If one or more Appendix IV constituents is detected at a statistically significant level above the GPS, then within 30 days WPL will prepare a notification in accordance with §257.95(g) and within 90 days complete an alternative source demonstration or initiate an assessment of corrective measures (§257.95(g)(3)). WPL will also characterize the release (§257.95(g)(1)) and notify property owners (§257.95(g)(2)).
- Two semiannual groundwater sampling and analysis events (April and October 2020).

3.5.2 §257.94(d) Alternative Detection Monitoring Frequency

The owner or operator must include the demonstration providing the basis for the alternative monitoring frequency and the certification by a qualified professional engineer in the annual groundwater monitoring and corrective action report required by § 257.90(e).

Not applicable. No alternative frequency proposed.

3.5.3 §257.94(e)(2) Alternative Source Demonstration for Detection Monitoring

The owner or operator must also include the demonstration in the annual groundwater monitoring and corrective action report required by § 257.90(e), in addition to the certification by a qualified professional engineer.

Not applicable. No alternative source demonstration was completed in 2019.

3.5.4 §257.95(c) Alternative Assessment Monitoring Frequency

The owner or operator must include the demonstration providing the basis for the alternative monitoring frequency and the certification by a qualified professional engineer in the annual groundwater monitoring and corrective action report required by § 257.90(e).

Not applicable. Assessment monitoring has been initiated, and no alternative assessment monitoring frequency has been proposed at this time.

3.5.5 §257.95(d)(3) Assessment Monitoring Results and Standards

Include the recorded concentrations required by paragraph (d)(1) of this section, identify the background concentrations established under § 257.94(b), and identify the groundwater protection standards established under paragraph (d)(2) of this section in the annual groundwater monitoring and corrective action report required by § 257.90(e).

Not applicable. Although the first round of assessment monitoring samples was collected in December 2019, the complete results were received and the assessment monitoring program was established in January 2020. The requirements of §257.95(d)(1)-(2) must be met by April 15, 2020, and included in the 2020 annual groundwater monitoring and corrective action report to be completed in 2021.

3.5.6 §257.95(g)(3)(ii) Alternative Source Demonstration for Assessment Monitoring

The owner or operator must also include the demonstration in the annual groundwater monitoring and corrective action report required by § 257.90(e), in addition to the certification by a qualified professional engineer.

Not applicable. No alternative source demonstration for assessment monitoring was completed in 2019.

3.5.7 §257.96(a) Extension of Time for Corrective Measures Assessment

The assessment of corrective measures must be completed within 90 days, unless the owner or operator demonstrates the need for additional time to complete the assessment of corrective measure due to site-specific conditions or circumstances. The owner or operator must obtain a certification from a qualified professional engineer attesting that the demonstration is accurate. The 90-day deadline to complete the assessment of corrective measures may be extended for longer than 60 days. The owner or operator must also include the demonstration in the annual groundwater monitoring and corrective action report required by § 257.90(e), in addition to the certification by a qualified professional engineer.

Not applicable. Corrective measures assessment has not been initiated.

[This page left blank intentionally]

Table 1
CCR Rule Groundwater Samples Summary

Table 1. CCR Rule Groundwater Samples Summary
Columbia Energy Center Secondary Pond /
SCS Engineers Project #25220067.00

Sample Dates	Downgradient Wells			Background Wells	
	MW-306	MW-307	MW-308	MW-84A	MW-301
4/1-3/2019	D	D	D	D*	D*
10/7-9/2019	D	D	D	D*	D*
12/3/2019	A	A	A		
Total Samples	3	3	3	3	3

Abbreviations:

D = Detection Monitoring Program Sampling Event

A = Assessment Monitoring Program Sampling Event

Notes:

* = MW-84A and MW-301 are shared background wells with other CCR units.


These wells were in detection monitoring for the Secondary Pond CCR unit, but were sampled for assessment monitoring parameters in April and October 2019 as part of assessment monitoring for the COL Primary Pond CCR unit; therefore, they were not re-sampled in December 2019.

Created by:	ACW	Date: 11/18/2019
Last revision by:	LWJ	Date: 6/26/2020
Checked by:	NDK	Date: 6/26/2020

I:\25220067.00\Deliverables\2019 Federal Annual Report - COL - SP\Tables\[Table 1_2019_GW_Samples_Summary_Table_COL_SecPond.xlsx]GW Summary

Figures


- 1 Site Location Map
- 2 Site Plan and Monitoring Well Locations

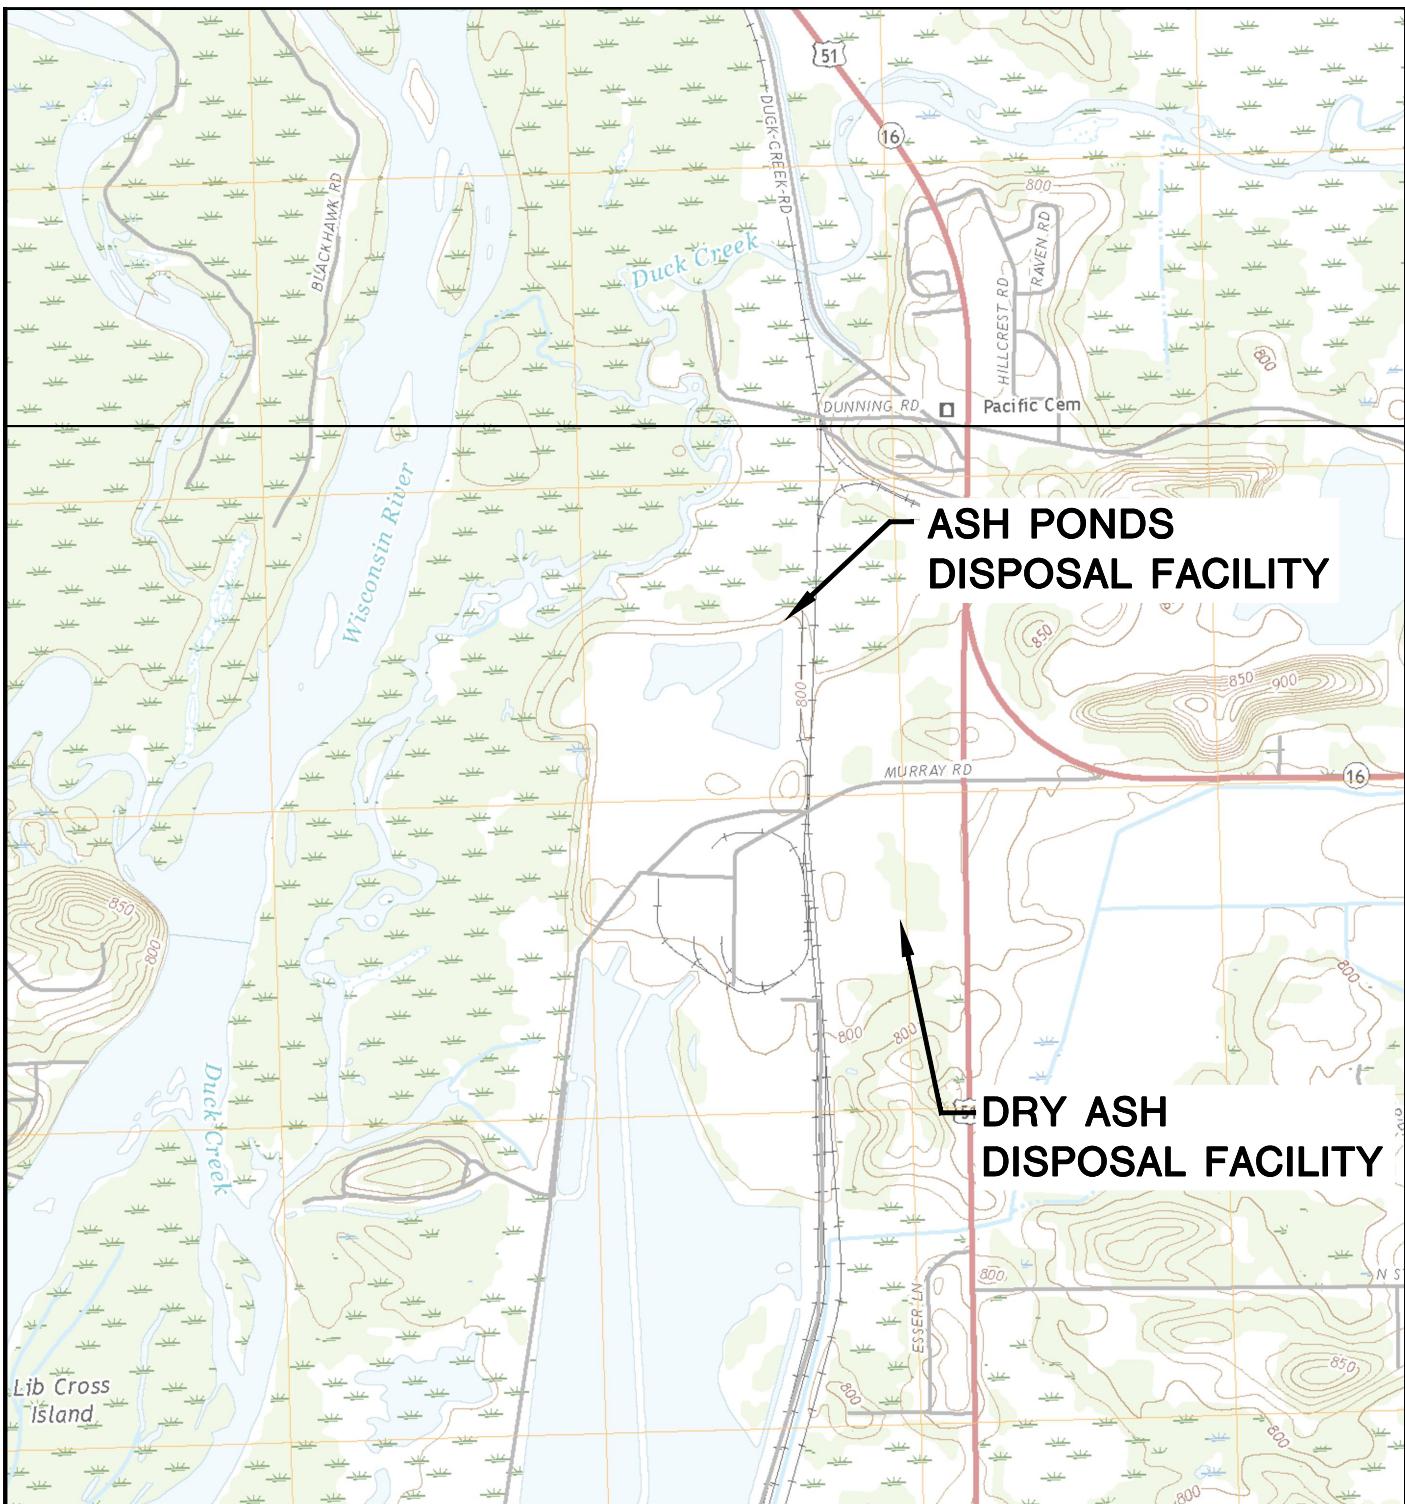

POYNETTE QUADRANGLE
WISCONSIN-COLUMBIA CO.
7.5 MINUTE SERIES (TOPOGRAPHIC)
2018
SCALE: 1" = 2,000'



CLIENT	ALLIANT ENERGY COLUMBIA ENERGY CENTER W8375 MURRAY ROAD PARDEEVILLE, WI 53954	SITE	ALLIANT ENERGY COLUMBIA ENERGY CENTER PARDEEVILLE, WI	SITE LOCATION MAP	
PROJECT NO.	25219067.00	DRAWN BY:	BSS	ENGINEER	FIGURE
DRAWN:	12/02/2019	CHECKED BY:	MDB	SCS ENGINEERS	
REVISED:	01/10/2020	APPROVED BY:	TK 01/30/2020	2830 DAIRY DRIVE MADISON, WI 53718-6751 PHONE: (608) 224-2830	1

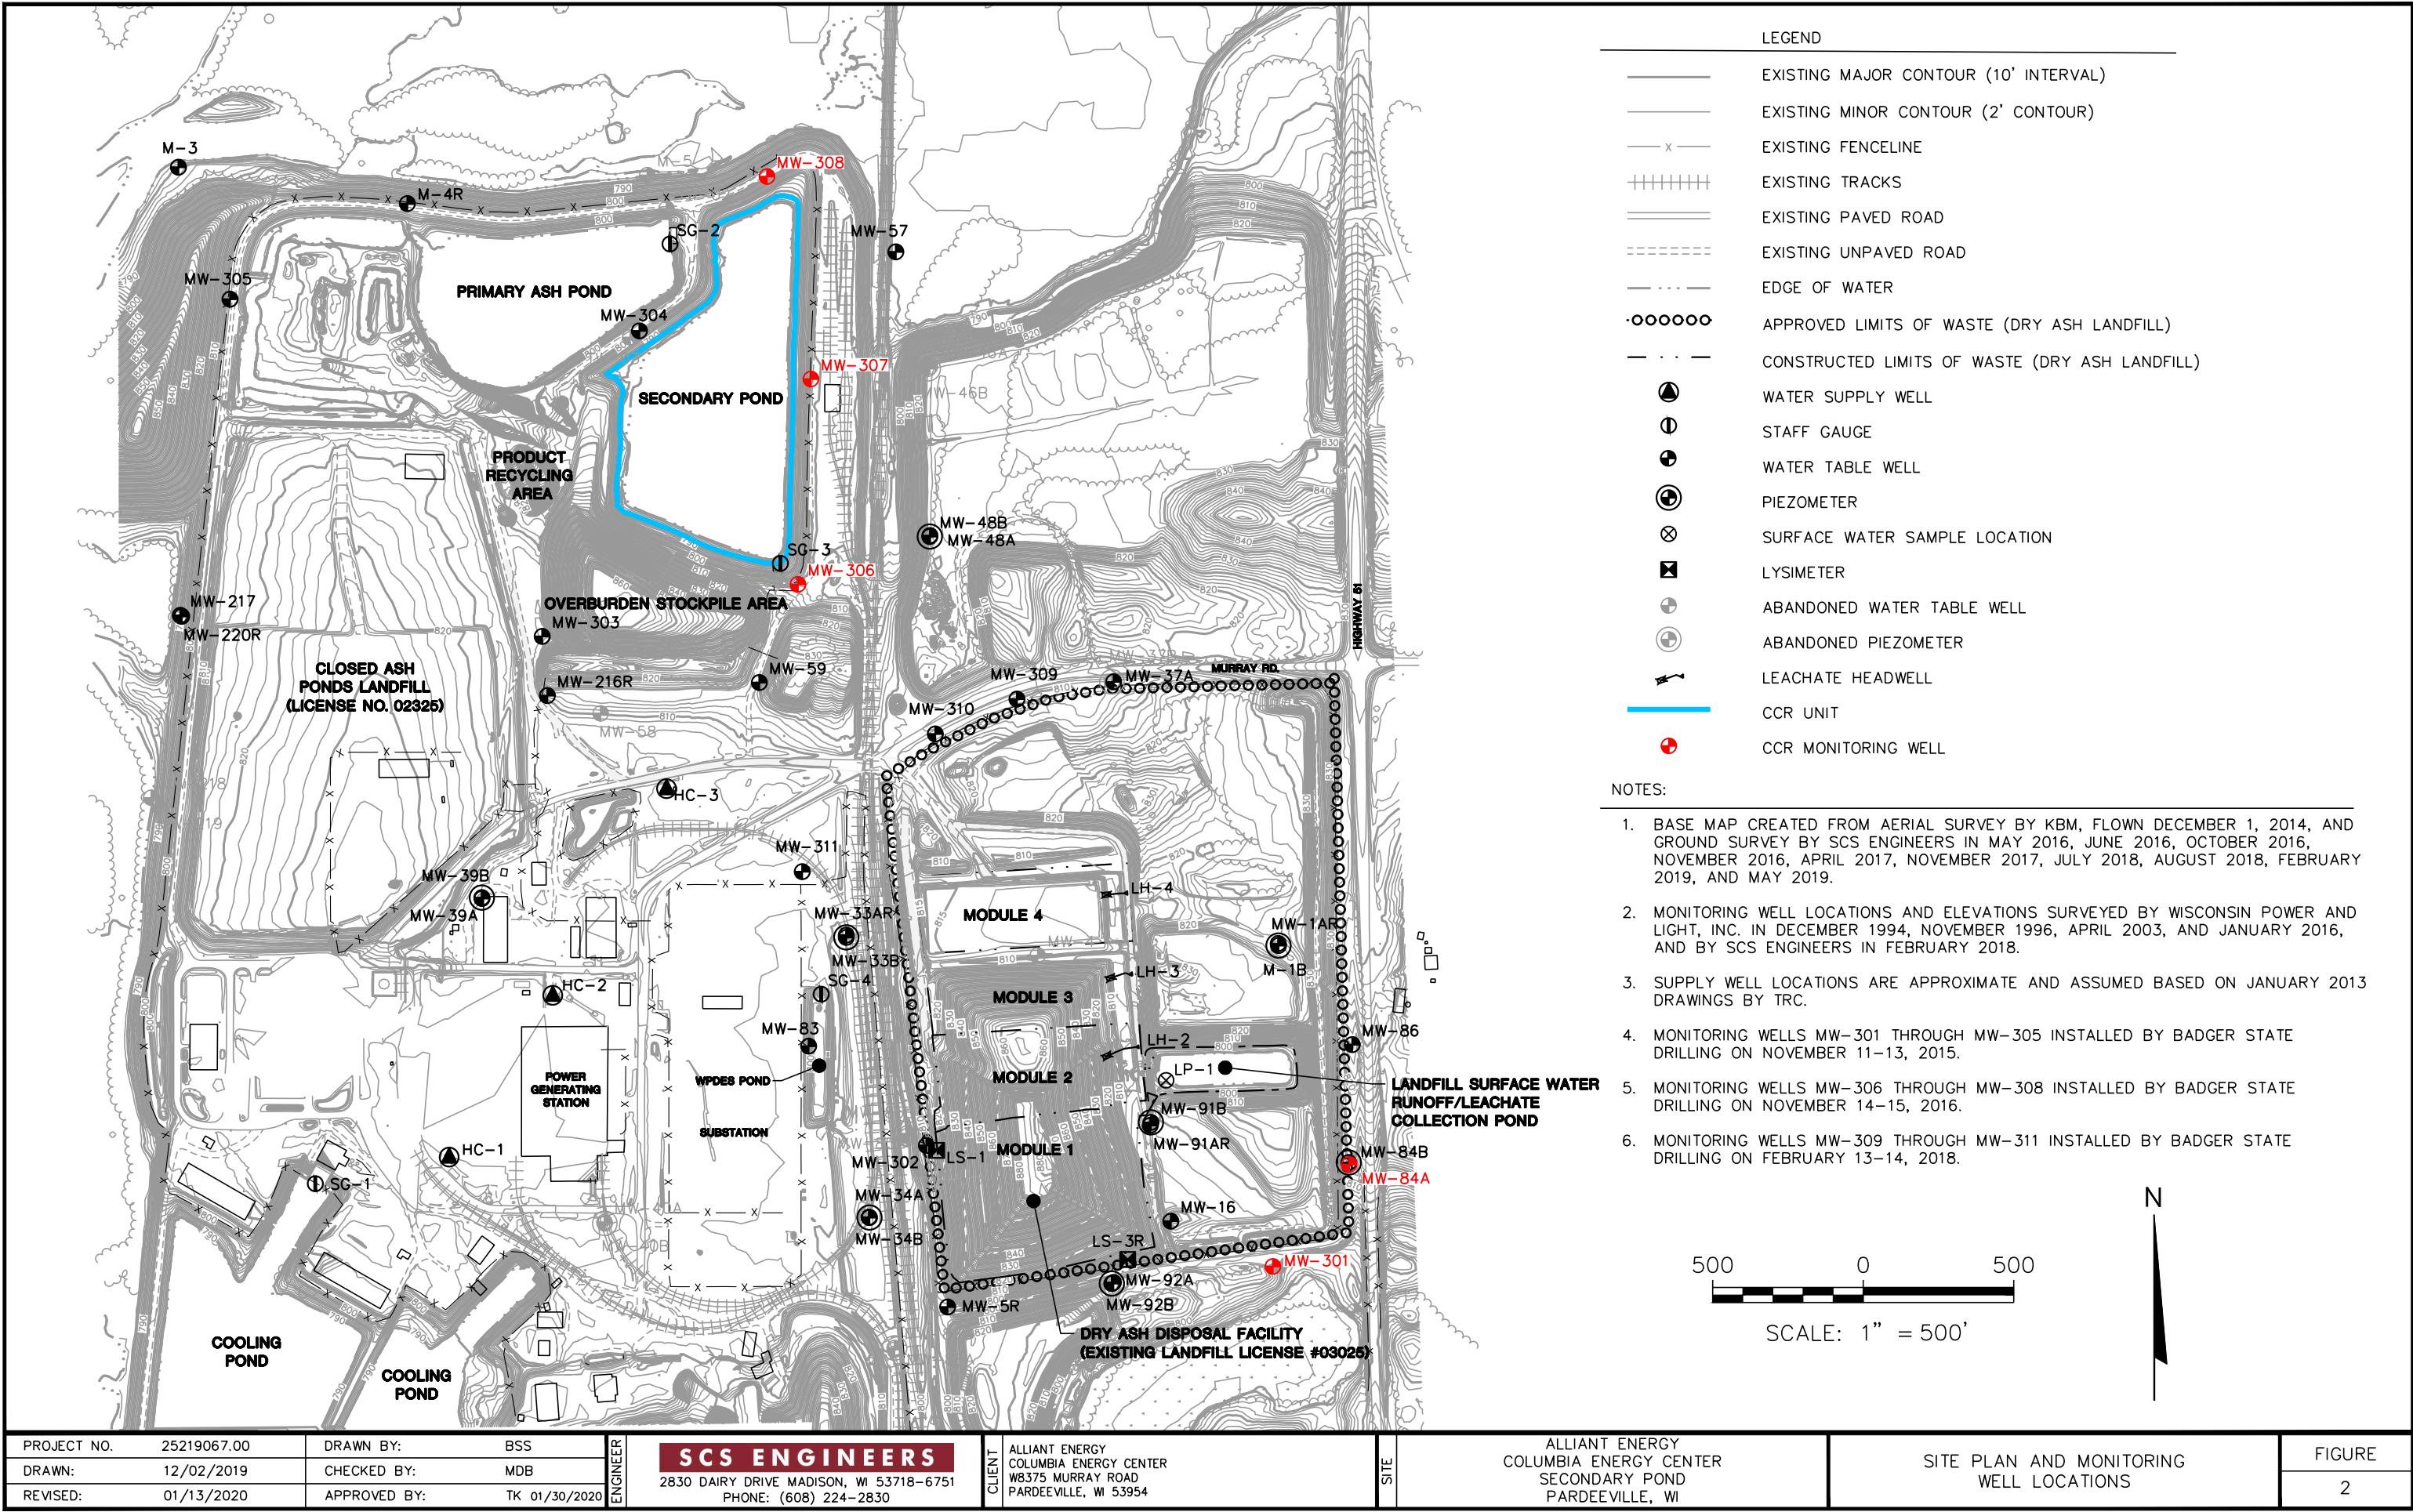

PROJECT NO.	25219067.00
DRAWN:	12/02/2019
REVISED:	01/13/2020

DRAWN BY:	BSS
CHECKED BY:	MDB
APPROVED BY:	TK 01/30

SCS ENGINEERS
2830 DAIRY DRIVE MADISON, WI 53718-6751
PHONE: (608) 224-2830

CLIENT ALLIANT ENERGY
COLUMBIA ENERGY CENTER
W8375 MURRAY ROAD
PARDEEVILLE, WI 53954

ALLIANT ENERGY
COLUMBIA ENERGY CENTER
SECONDARY POND
PARDEEVILLE, WI

SITE PLAN AND MONITORING WELL LOCATIONS

FIGURE

2

Appendix A

Laboratory Reports

A1 April 2019 Detection Monitoring

July 09, 2019

Meghan Blodgett
SCS ENGINEERS
2830 Dairy Drive
Madison, WI 53718

RE: Project: 25219067 ALLIANT-COLUMBIA CCR
Pace Project No.: 40185522


Dear Meghan Blodgett:

Enclosed are the analytical results for sample(s) received by the laboratory on April 04, 2019. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

Revised Report: Additional metals are included on this report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Dan Milewsky
dan.milewsky@pacelabs.com
(920)469-2436
Project Manager

Enclosures

cc: Tom Karwoski, SCS ENGINEERS
Nicole Kron, SCS ENGINEERS
Jeff Maxted, ALLIANT ENERGY
Marc Morandi, ALLIANT ENERGY



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: 25219067 ALLIANT-COLUMBIA CCR
Pace Project No.: 40185522

Green Bay Certification IDs

1241 Bellevue Street, Green Bay, WI 54302
Florida/NELAP Certification #: E87948
Illinois Certification #: 200050
Kentucky UST Certification #: 82
Louisiana Certification #: 04168
Minnesota Certification #: 055-999-334
New York Certification #: 12064
North Dakota Certification #: R-150

Virginia VELAP ID: 460263
South Carolina Certification #: 83006001
Texas Certification #: T104704529-14-1
Wisconsin Certification #: 405132750
Wisconsin DATCP Certification #: 105-444
USDA Soil Permit #: P330-16-00157
Federal Fish & Wildlife Permit #: LE51774A-0

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: 25219067 ALLIANT-COLUMBIA CCR

Pace Project No.: 40185522

Lab ID	Sample ID	Matrix	Date Collected	Date Received
40185260009	MW-306	Water	04/01/19 18:15	04/04/19 09:30
40185260010	MW-307	Water	04/01/19 17:25	04/04/19 09:30
40185260011	MW-308	Water	04/01/19 16:50	04/04/19 09:30
40185260012	FIELD BLANK SC POND	Water	04/01/19 16:50	04/04/19 09:30

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: 25219067 ALLIANT-COLUMBIA CCR

Pace Project No.: 40185522

Lab ID	Sample ID	Method	Analysts	Analytes Reported
40185260009	MW-306	EPA 6020	KXS	14
			AXL	7
		SM 2540C	TMK	1
		EPA 9040	ALY	1
		EPA 300.0	HMB	3
40185260010	MW-307	EPA 6020	KXS	14
			AXL	7
		SM 2540C	TMK	1
		EPA 9040	ALY	1
		EPA 300.0	HMB	3
40185260011	MW-308	EPA 6020	KXS	14
			AXL	7
		SM 2540C	TMK	1
		EPA 9040	ALY	1
		EPA 300.0	HMB	3
40185260012	FIELD BLANK SC POND	EPA 6020	KXS	14
		SM 2540C	TMK	1
		EPA 9040	ALY	1
		EPA 300.0	HMB	3

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: 25219067 ALLIANT-COLUMBIA CCR

Pace Project No.: 40185522

Sample: MW-306	Lab ID: 40185260009	Collected: 04/01/19 18:15	Received: 04/04/19 09:30	Matrix: Water					
Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
6020 MET ICPMS	Analytical Method: EPA 6020 Preparation Method: EPA 3010								
Antimony	<0.15	ug/L	1.0	0.15	1	04/05/19 08:40	04/09/19 08:31	7440-36-0	
Arsenic	<0.28	ug/L	1.0	0.28	1	04/05/19 08:40	04/09/19 08:31	7440-38-2	
Barium	10	ug/L	4.9	1.5	1	04/05/19 08:40	04/09/19 08:31	7440-39-3	
Beryllium	<0.18	ug/L	1.0	0.18	1	04/05/19 08:40	04/09/19 08:31	7440-41-7	
Boron	119	ug/L	11.0	3.3	1	04/05/19 08:40	04/09/19 08:31	7440-42-8	
Cadmium	<0.15	ug/L	1.0	0.15	1	04/05/19 08:40	04/09/19 08:31	7440-43-9	
Calcium	87300	ug/L	250	69.8	1	04/05/19 08:40	04/09/19 08:31	7440-70-2	
Chromium	2.2J	ug/L	3.4	1.0	1	04/05/19 08:40	04/09/19 08:31	7440-47-3	
Cobalt	<0.12	ug/L	1.0	0.12	1	04/05/19 08:40	04/09/19 08:31	7440-48-4	
Lead	<0.24	ug/L	1.0	0.24	1	04/05/19 08:40	04/09/19 08:31	7439-92-1	
Lithium	3.1	ug/L	1.0	0.19	1	04/05/19 08:40	04/09/19 08:31	7439-93-2	
Molybdenum	6.3	ug/L	1.5	0.44	1	04/05/19 08:40	04/09/19 08:31	7439-98-7	
Selenium	0.55J	ug/L	1.1	0.32	1	04/05/19 08:40	04/09/19 08:31	7782-49-2	
Thallium	<0.14	ug/L	1.0	0.14	1	04/05/19 08:40	04/09/19 08:31	7440-28-0	
Field Data	Analytical Method:								
Field pH	7.31	Std. Units			1		04/01/19 18:15		
Field Specific Conductance	592.3	umhos/cm			1		04/01/19 18:15		
Oxygen, Dissolved	8.46	mg/L			1		04/01/19 18:15	7782-44-7	
REDOX	150.0	mV			1		04/01/19 18:15		
Turbidity	1.61	NTU			1		04/01/19 18:15		
Static Water Level	786.72	feet			1		04/01/19 18:15		
Temperature, Water (C)	9.1	deg C			1		04/01/19 18:15		
2540C Total Dissolved Solids	Analytical Method: SM 2540C								
Total Dissolved Solids	310	mg/L	20.0	8.7	1		04/08/19 15:38		
9040 pH	Analytical Method: EPA 9040								
pH at 25 Degrees C	7.4	Std. Units	0.10	0.010	1		04/09/19 11:18		H6
300.0 IC Anions 28 Days	Analytical Method: EPA 300.0								
Chloride	1.7J	mg/L	2.0	0.50	1		04/15/19 14:02	16887-00-6	
Fluoride	<0.10	mg/L	0.30	0.10	1		04/15/19 14:02	16984-48-8	
Sulfate	9.2	mg/L	3.0	1.0	1		04/15/19 14:02	14808-79-8	

Sample: MW-307	Lab ID: 40185260010	Collected: 04/01/19 17:25	Received: 04/04/19 09:30	Matrix: Water					
Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
6020 MET ICPMS	Analytical Method: EPA 6020 Preparation Method: EPA 3010								
Antimony	<0.15	ug/L	1.0	0.15	1	04/05/19 08:40	04/09/19 08:38	7440-36-0	
Arsenic	<0.28	ug/L	1.0	0.28	1	04/05/19 08:40	04/09/19 08:38	7440-38-2	
Barium	12.3	ug/L	4.9	1.5	1	04/05/19 08:40	04/09/19 08:38	7440-39-3	
Beryllium	<0.18	ug/L	1.0	0.18	1	04/05/19 08:40	04/09/19 08:38	7440-41-7	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: 25219067 ALLIANT-COLUMBIA CCR

Pace Project No.: 40185522

Sample: MW-307	Lab ID: 40185260010	Collected: 04/01/19 17:25	Received: 04/04/19 09:30	Matrix: Water					
Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
6020 MET ICPMS	Analytical Method: EPA 6020 Preparation Method: EPA 3010								
Boron	154	ug/L	11.0	3.3	1	04/05/19 08:40	04/09/19 08:38	7440-42-8	
Cadmium	<0.15	ug/L	1.0	0.15	1	04/05/19 08:40	04/09/19 08:38	7440-43-9	
Calcium	76500	ug/L	250	69.8	1	04/05/19 08:40	04/09/19 08:38	7440-70-2	
Chromium	<1.0	ug/L	3.4	1.0	1	04/05/19 08:40	04/09/19 08:38	7440-47-3	
Cobalt	0.42J	ug/L	1.0	0.12	1	04/05/19 08:40	04/09/19 08:38	7440-48-4	
Lead	<0.24	ug/L	1.0	0.24	1	04/05/19 08:40	04/09/19 08:38	7439-92-1	
Lithium	<0.19	ug/L	1.0	0.19	1	04/05/19 08:40	04/09/19 08:38	7439-93-2	
Molybdenum	<0.44	ug/L	1.5	0.44	1	04/05/19 08:40	04/09/19 08:38	7439-98-7	
Selenium	<0.32	ug/L	1.1	0.32	1	04/05/19 08:40	04/09/19 08:38	7782-49-2	
Thallium	<0.14	ug/L	1.0	0.14	1	04/05/19 08:40	04/09/19 08:38	7440-28-0	
Field Data	Analytical Method:								
Field pH	7.14	Std. Units			1		04/01/19 17:25		
Field Specific Conductance	662.5	umhos/cm			1		04/01/19 17:25		
Oxygen, Dissolved	0.12	mg/L			1		04/01/19 17:25	7782-44-7	
REDOX	-0.8	mV			1		04/01/19 17:25		
Turbidity	2.27	NTU			1		04/01/19 17:25		
Static Water Level	786.71	feet			1		04/01/19 17:25		
Temperature, Water (C)	8.2	deg C			1		04/01/19 17:25		
2540C Total Dissolved Solids	Analytical Method: SM 2540C								
Total Dissolved Solids	350	mg/L	20.0	8.7	1		04/08/19 15:38		
9040 pH	Analytical Method: EPA 9040								
pH at 25 Degrees C	7.3	Std. Units	0.10	0.010	1		04/09/19 11:19		H6
300.0 IC Anions 28 Days	Analytical Method: EPA 300.0								
Chloride	13.8	mg/L	2.0	0.50	1		04/15/19 14:14	16887-00-6	
Fluoride	<0.10	mg/L	0.30	0.10	1		04/15/19 14:14	16984-48-8	
Sulfate	38.2	mg/L	3.0	1.0	1		04/15/19 14:14	14808-79-8	

Sample: MW-308	Lab ID: 40185260011	Collected: 04/01/19 16:50	Received: 04/04/19 09:30	Matrix: Water					
Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
6020 MET ICPMS	Analytical Method: EPA 6020 Preparation Method: EPA 3010								
Antimony	<0.15	ug/L	1.0	0.15	1	04/05/19 08:40	04/09/19 08:45	7440-36-0	
Arsenic	3.3	ug/L	1.0	0.28	1	04/05/19 08:40	04/09/19 08:45	7440-38-2	
Barium	54.8	ug/L	4.9	1.5	1	04/05/19 08:40	04/09/19 08:45	7440-39-3	
Beryllium	<0.18	ug/L	1.0	0.18	1	04/05/19 08:40	04/09/19 08:45	7440-41-7	
Boron	587	ug/L	11.0	3.3	1	04/05/19 08:40	04/09/19 08:45	7440-42-8	
Cadmium	<0.15	ug/L	1.0	0.15	1	04/05/19 08:40	04/09/19 08:45	7440-43-9	
Calcium	132000	ug/L	250	69.8	1	04/05/19 08:40	04/09/19 08:45	7440-70-2	
Chromium	<1.0	ug/L	3.4	1.0	1	04/05/19 08:40	04/09/19 08:45	7440-47-3	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: 25219067 ALLIANT-COLUMBIA CCR

Pace Project No.: 40185522

Sample: MW-308	Lab ID: 40185260011	Collected: 04/01/19 16:50	Received: 04/04/19 09:30	Matrix: Water					
Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
6020 MET ICPMS	Analytical Method: EPA 6020 Preparation Method: EPA 3010								
Cobalt	<0.12	ug/L	1.0	0.12	1	04/05/19 08:40	04/09/19 08:45	7440-48-4	
Lead	<0.24	ug/L	1.0	0.24	1	04/05/19 08:40	04/09/19 08:45	7439-92-1	
Lithium	<0.19	ug/L	1.0	0.19	1	04/05/19 08:40	04/09/19 08:45	7439-93-2	
Molybdenum	1.0J	ug/L	1.5	0.44	1	04/05/19 08:40	04/09/19 08:45	7439-98-7	
Selenium	<0.32	ug/L	1.1	0.32	1	04/05/19 08:40	04/09/19 08:45	7782-49-2	
Thallium	<0.14	ug/L	1.0	0.14	1	04/05/19 08:40	04/09/19 08:45	7440-28-0	
Field Data	Analytical Method:								
Field pH	7.39	Std. Units			1		04/01/19 16:50		
Field Specific Conductance	924	umhos/cm			1		04/01/19 16:50		
Oxygen, Dissolved	0.15	mg/L			1		04/01/19 16:50	7782-44-7	
REDOX	-137.7	mV			1		04/01/19 16:50		
Turbidity	3.44	NTU			1		04/01/19 16:50		
Static Water Level	787.53	feet			1		04/01/19 16:50		
Temperature, Water (C)	8.9	deg C			1		04/01/19 16:50		
2540C Total Dissolved Solids	Analytical Method: SM 2540C								
Total Dissolved Solids	484	mg/L	20.0	8.7	1		04/08/19 15:38		
9040 pH	Analytical Method: EPA 9040								
pH at 25 Degrees C	7.4	Std. Units	0.10	0.010	1		04/09/19 11:21		H6
300.0 IC Anions 28 Days	Analytical Method: EPA 300.0								
Chloride	1.8J	mg/L	2.0	0.50	1		04/15/19 14:26	16887-00-6	
Fluoride	<0.10	mg/L	0.30	0.10	1		04/15/19 14:26	16984-48-8	
Sulfate	1.1J	mg/L	3.0	1.0	1		04/15/19 14:26	14808-79-8	

Sample: FIELD BLANK SC POND	Lab ID: 40185260012	Collected: 04/01/19 16:50	Received: 04/04/19 09:30	Matrix: Water					
Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
6020 MET ICPMS	Analytical Method: EPA 6020 Preparation Method: EPA 3010								
Antimony	<0.15	ug/L	1.0	0.15	1	04/05/19 08:40	04/09/19 05:14	7440-36-0	
Arsenic	<0.28	ug/L	1.0	0.28	1	04/05/19 08:40	04/09/19 05:14	7440-38-2	
Barium	<1.5	ug/L	4.9	1.5	1	04/05/19 08:40	04/09/19 05:14	7440-39-3	
Beryllium	<0.18	ug/L	1.0	0.18	1	04/05/19 08:40	04/09/19 05:14	7440-41-7	
Boron	<3.3	ug/L	11.0	3.3	1	04/05/19 08:40	04/09/19 05:14	7440-42-8	
Cadmium	<0.15	ug/L	1.0	0.15	1	04/05/19 08:40	04/09/19 05:14	7440-43-9	
Calcium	<69.8	ug/L	250	69.8	1	04/05/19 08:40	04/09/19 05:14	7440-70-2	
Chromium	<1.0	ug/L	3.4	1.0	1	04/05/19 08:40	04/09/19 05:14	7440-47-3	
Cobalt	<0.12	ug/L	1.0	0.12	1	04/05/19 08:40	04/09/19 05:14	7440-48-4	
Lead	<0.24	ug/L	1.0	0.24	1	04/05/19 08:40	04/09/19 05:14	7439-92-1	
Lithium	<0.19	ug/L	1.0	0.19	1	04/05/19 08:40	04/09/19 05:14	7439-93-2	
Molybdenum	<0.44	ug/L	1.5	0.44	1	04/05/19 08:40	04/09/19 05:14	7439-98-7	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: 25219067 ALLIANT-COLUMBIA CCR

Pace Project No.: 40185522

Sample: FIELD BLANK SC POND Lab ID: 40185260012 Collected: 04/01/19 16:50 Received: 04/04/19 09:30 Matrix: Water

Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
6020 MET ICPMS	Analytical Method: EPA 6020 Preparation Method: EPA 3010								
Selenium	<0.32	ug/L	1.1	0.32	1	04/05/19 08:40	04/09/19 05:14	7782-49-2	
Thallium	<0.14	ug/L	1.0	0.14	1	04/05/19 08:40	04/09/19 05:14	7440-28-0	
2540C Total Dissolved Solids	Analytical Method: SM 2540C								
Total Dissolved Solids	<8.7	mg/L	20.0	8.7	1		04/08/19 15:39		
9040 pH	Analytical Method: EPA 9040								
pH at 25 Degrees C	7.2	Std. Units	0.10	0.010	1		04/09/19 11:26		H6
300.0 IC Anions 28 Days	Analytical Method: EPA 300.0								
Chloride	<0.50	mg/L	2.0	0.50	1		04/15/19 14:38	16887-00-6	
Fluoride	<0.10	mg/L	0.30	0.10	1		04/15/19 14:38	16984-48-8	
Sulfate	<1.0	mg/L	3.0	1.0	1		04/15/19 14:38	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: 25219067 ALLIANT-COLUMBIA CCR

Pace Project No.: 40185522

QC Batch: 317485 Analysis Method: EPA 6020
QC Batch Method: EPA 3010 Analysis Description: 6020 MET

Associated Lab Samples: 40185260009, 40185260010, 40185260011, 40185260012

METHOD BLANK: 1846066 Matrix: Water

Associated Lab Samples: 40185260009, 40185260010, 40185260011, 40185260012

Parameter	Units	Blank Result	Reporting Limit	Analyzed	Qualifiers
Antimony	ug/L	<0.15	1.0	04/09/19 04:47	
Arsenic	ug/L	<0.28	1.0	04/09/19 04:47	
Barium	ug/L	<1.5	4.9	04/09/19 04:47	
Beryllium	ug/L	<0.18	1.0	04/09/19 04:47	
Boron	ug/L	<3.3	11.0	04/09/19 04:47	
Cadmium	ug/L	<0.15	1.0	04/09/19 04:47	
Calcium	ug/L	<69.8	250	04/09/19 04:47	
Chromium	ug/L	<1.0	3.4	04/09/19 04:47	
Cobalt	ug/L	<0.12	1.0	04/09/19 04:47	
Lead	ug/L	<0.24	1.0	04/09/19 04:47	
Lithium	ug/L	<0.19	1.0	04/09/19 04:47	
Molybdenum	ug/L	<0.44	1.5	04/09/19 04:47	
Selenium	ug/L	<0.32	1.1	04/09/19 04:47	
Thallium	ug/L	<0.14	1.0	04/09/19 04:47	

LABORATORY CONTROL SAMPLE: 1846067

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Antimony	ug/L	500	500	100	80-120	
Arsenic	ug/L	500	474	95	80-120	
Barium	ug/L	500	487	97	80-120	
Beryllium	ug/L	500	492	98	80-120	
Boron	ug/L	500	486	97	80-120	
Cadmium	ug/L	500	500	100	80-120	
Calcium	ug/L	5000	4990	100	80-120	
Chromium	ug/L	500	492	98	80-120	
Cobalt	ug/L	500	485	97	80-120	
Lead	ug/L	500	463	93	80-120	
Lithium	ug/L	500	467	93	80-120	
Molybdenum	ug/L	500	465	93	80-120	
Selenium	ug/L	500	508	102	80-120	
Thallium	ug/L	500	464	93	80-120	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 1846068 1846069

Parameter	Units	MS		MSD		MS Result	MS % Rec	MSD Result	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
		40185256001	Spike Conc.	Spike Conc.	MS Result								
Antimony	ug/L	0.32J	500	500	496	496	99	99	99	75-125	0	20	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,

without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: 25219067 ALLIANT-COLUMBIA CCR

Pace Project No.: 40185522

Parameter	Units	40185256001		MSD		1846068		1846069				
		Result	Spike Conc.	Spike	MS Conc.	MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec	RPD	Max RPD
				Conc.	Result	% Rec	Limits	RPD	Qual			
Arsenic	ug/L	0.40J	500	500	480	478	96	95	75-125	0	20	
Barium	ug/L	11.8	500	500	496	498	97	97	75-125	0	20	
Beryllium	ug/L	0.28J	500	500	481	480	96	96	75-125	0	20	
Boron	ug/L	26.9	500	500	492	498	93	94	75-125	1	20	
Cadmium	ug/L	0.21J	500	500	491	490	98	98	75-125	0	20	
Calcium	ug/L	126000	5000	5000	126000	123000	12	-46	75-125	2	20	P6
Chromium	ug/L	<1.0	500	500	484	483	97	96	75-125	0	20	
Cobalt	ug/L	0.35J	500	500	476	473	95	95	75-125	1	20	
Lead	ug/L	0.30J	500	500	467	468	93	94	75-125	0	20	
Lithium	ug/L	0.90J	500	500	463	463	92	92	75-125	0	20	
Molybdenum	ug/L	<0.44	500	500	465	464	93	93	75-125	0	20	
Selenium	ug/L	0.49J	500	500	512	513	102	103	75-125	0	20	
Thallium	ug/L	0.48J	500	500	474	476	95	95	75-125	0	20	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: 25219067 ALLIANT-COLUMBIA CCR

Pace Project No.: 40185522

QC Batch:	317697	Analysis Method:	SM 2540C
QC Batch Method:	SM 2540C	Analysis Description:	2540C Total Dissolved Solids
Associated Lab Samples:	40185260009, 40185260010, 40185260011, 40185260012		

METHOD BLANK: 1847172 Matrix: Water

Associated Lab Samples: 40185260009, 40185260010, 40185260011, 40185260012

Parameter	Units	Blank Result	Reporting Limit	Analyzed	Qualifiers
Total Dissolved Solids	mg/L	<8.7	20.0	04/08/19 15:37	

LABORATORY CONTROL SAMPLE: 1847173

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Total Dissolved Solids	mg/L	577	550	95	80-120	

SAMPLE DUPLICATE: 1847174

Parameter	Units	40185256003 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	726	726	0	5	

SAMPLE DUPLICATE: 1847175

Parameter	Units	40185155001 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	576	580	1	5	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,

without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: 25219067 ALLIANT-COLUMBIA CCR

Pace Project No.: 40185522

QC Batch: 317736 Analysis Method: EPA 9040

QC Batch Method: EPA 9040 Analysis Description: 9040 pH

Associated Lab Samples: 40185260009, 40185260010, 40185260011, 40185260012

SAMPLE DUPLICATE: 1847351

Parameter	Units	40185260001 Result	Dup Result	RPD	Max RPD	Qualifiers
pH at 25 Degrees C	Std. Units	7.4	7.4	0	20	H6

SAMPLE DUPLICATE: 1847381

Parameter	Units	40185339014 Result	Dup Result	RPD	Max RPD	Qualifiers
pH at 25 Degrees C	Std. Units	7.7	7.7	0	20	H6

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,

without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: 25219067 ALLIANT-COLUMBIA CCR

Pace Project No.: 40185522

QC Batch:	318035	Analysis Method:	EPA 300.0
QC Batch Method:	EPA 300.0	Analysis Description:	300.0 IC Anions
Associated Lab Samples:	40185260009, 40185260010, 40185260011, 40185260012		

METHOD BLANK: 1848956 Matrix: Water

Associated Lab Samples: 40185260009, 40185260010, 40185260011, 40185260012

Parameter	Units	Blank	Reporting	Analyzed	Qualifiers
		Result	Limit		
Chloride	mg/L	<0.50	2.0	04/15/19 11:11	
Fluoride	mg/L	<0.10	0.30	04/15/19 11:11	
Sulfate	mg/L	<1.0	3.0	04/15/19 11:11	

LABORATORY CONTROL SAMPLE: 1848957

Parameter	Units	Spike	LCS	LCS	% Rec	Qualifiers
		Conc.	Result	% Rec	Limits	
Chloride	mg/L	20	21.2	106	90-110	
Fluoride	mg/L	2	2.1	104	90-110	
Sulfate	mg/L	20	21.4	107	90-110	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 1848958 1848959

Parameter	Units	MS	MSD	MS	MSD	MS	MSD	% Rec	% Rec	Limits	RPD	RPD	Max	
		40185548003	Spike	Spike	Result	% Rec	RPD	Qual						
Chloride	mg/L	261	200	200	438	463	88	101	90-110	6	15	M0		
Fluoride	mg/L	<1.0	20	20	18.0	19.8	90	99	90-110	9	15			
Sulfate	mg/L	54.2	200	200	232	252	89	99	90-110	8	15	M0		

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 1848960 1848961

Parameter	Units	MS	MSD	MS	MSD	MS	MSD	% Rec	% Rec	Limits	RPD	RPD	Max	
		40185308003	Spike	Spike	Result	% Rec	RPD	Qual						
Chloride	mg/L	106	200	200	313	318	104	106	90-110	1	15			
Fluoride	mg/L	<1.0	20	20	20.6	21.5	103	108	90-110	4	15			
Sulfate	mg/L	94.8	200	200	298	309	102	107	90-110	3	15			

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,

without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: 25219067 ALLIANT-COLUMBIA CCR
Pace Project No.: 40185522

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above LOD.

J - Estimated concentration at or above the LOD and below the LOQ.

LOD - Limit of Detection adjusted for dilution factor, percent moisture, initial weight and final volume.

LOQ - Limit of Quantitation adjusted for dilution factor, percent moisture, initial weight and final volume.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected at or above the adjusted LOD.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

ANALYTE QUALIFIERS

H6 Analysis initiated outside of the 15 minute EPA required holding time.

M0 Matrix spike recovery and/or matrix spike duplicate recovery was outside laboratory control limits.

P6 Matrix spike recovery was outside laboratory control limits due to a parent sample concentration notably higher than the spike level.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: 25219067 ALLIANT-COLUMBIA CCR
 Pace Project No.: 40185522

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
40185260009	MW-306	EPA 3010	317485	EPA 6020	317570
40185260010	MW-307	EPA 3010	317485	EPA 6020	317570
40185260011	MW-308	EPA 3010	317485	EPA 6020	317570
40185260012	FIELD BLANK SC POND	EPA 3010	317485	EPA 6020	317570
40185260009	MW-306	SM 2540C	317697		
40185260010	MW-307	SM 2540C	317697		
40185260011	MW-308	SM 2540C	317697		
40185260012	FIELD BLANK SC POND	SM 2540C	317697		
40185260009	MW-306	EPA 9040	317736		
40185260010	MW-307	EPA 9040	317736		
40185260011	MW-308	EPA 9040	317736		
40185260012	FIELD BLANK SC POND	EPA 9040	317736		
40185260009	MW-306	EPA 300.0	318035		
40185260010	MW-307	EPA 300.0	318035		
40185260011	MW-308	EPA 300.0	318035		
40185260012	FIELD BLANK SC POND	EPA 300.0	318035		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
 without the written consent of Pace Analytical Services, LLC.

(Please Print Clearly)

Company Name: **SCS**
Branch/Location: **Madison WI**

Project Contact: **Meg Blodgett**
Phone: **608-216-77362**

Project Number: **25219D67**
Project Name: **Alliant - Columbia**

Project State: **WI**
Sampled By (Print): **Adam Watson**

Sampled By (Sign): **Paula Green for Adam Watson**

PO#:

Data Package Options
 EPA Level III
 EPA Level IV

MS/MSD
 On your sample
 NOT needed on
 your sample

Matrix Codes
 Air
 B = Biota
 C = Charcoal
 O = Oil
 S = Soil
 Sl = Sludge
 W = Water
 DW = Drinking Water
 GW = Ground Water
 SW = Surface Water
 WW = Waste Water
 WP = Wipe

Analyses Requested
 TDS, SO₄, PH
 fluoride, Cl
 Ca, B

PICK LETTER

Y/N

NO

NO

NO

A

A

D

Y/N

NO

NO</p

Sample Preservation Receipt Form

Client Name: S C S

Project # 40185-240

All containers needing preservation have been checked and noted below: Yes No N/A

Lab Lot# of pH paper:

10453581 Lab Std #ID of preservation (if pH adjusted):

Initial when skipped completed: Date: _____ Time: _____

Pace Lab #	Glass		Plastic		Vials		Jars		General		VOA Vials (>6mm) *	H2SO4 pH ≤2	NaOH+Zn Act pH ≥9	NaOH pH ≥12	HNO3 pH ≤2	pH after adjusted	Volume (mL)			
	001	002	003	004	005	006	007	008	009	010	011	012	013	014	015	016	017	018	019	020
AG1U	1 liter amber glass	BP1U	1 liter plastic unpres	DG9A	40 mL amber ascorbic	JGFU	4 oz amber jar unpres	WGFU	4 oz clear jar unpres	WPFU	4 oz plastic jar unpres									
AG1H	1 liter amber glass HCl	BP2N	500 mL plastic HNO3	DG9T	40 mL amber Na Thio															
AG4S	125 mL amber glass H2SO4	BP2Z	500 mL plastic NaOH, Znact	VG9U	40 mL clear vial unpres															
AG4U	120 mL amber glass unpres	BP3U	250 mL plastic unpres	VG9H	40 mL clear vial HCl															
AG5U	100 mL amber glass unpres	BP3C	250 mL plastic NaOH	VG9M	40 mL clear vial MeOH			SP5T	120 mL plastic Na Thiosulfate	ZPLC	ziptloc bag									
AG2S	500 mL amber glass H2SO4	BP3N	250 mL plastic HNO3	VG9D	40 mL clear vial DI			GN:												
BG3U	250 mL clear glass unpres	BP3S	250 mL plastic H2SO4																	

Exceptions to preservation check: VOA, Coliform, TOC, TOX, TOH, O&G, WI DRO, Phenolics, Other:

Headspace in VOA Vials (>6mm): Yes No N/A *If yes look in headspace column

AG1U	1 liter amber glass	BP1U	1 liter plastic unpres	DG9A	40 mL amber ascorbic	JGFU	4 oz amber jar unpres	WGFU	4 oz clear jar unpres	WPFU	4 oz plastic jar unpres
AG1H	1 liter amber glass HCl	BP2N	500 mL plastic HNO3	DG9T	40 mL amber Na Thio						
AG4S	125 mL amber glass H2SO4	BP2Z	500 mL plastic NaOH, Znact	VG9U	40 mL clear vial unpres						
AG4U	120 mL amber glass unpres	BP3U	250 mL plastic unpres	VG9H	40 mL clear vial HCl						
AG5U	100 mL amber glass unpres	BP3C	250 mL plastic NaOH	VG9M	40 mL clear vial MeOH			SP5T	120 mL plastic Na Thiosulfate	ZPLC	ziptloc bag
AG2S	500 mL amber glass H2SO4	BP3N	250 mL plastic HNO3	VG9D	40 mL clear vial DI			GN:			
BG3U	250 mL clear glass unpres	BP3S	250 mL plastic H2SO4								

Document Name:
Sample Condition Upon Receipt (SCUR)

Document Revised: 25Apr2018

Document No.:
F-GB-C-031-Rev.07Issuing Authority:
Pace Green Bay Quality Office

Sample Condition Upon Receipt Form (SCUR)

Project #:

Client Name: SCSCourier: CS Logistics Fed Ex Speedee UPS Waltco Client Pace Other:Tracking #: 786437200524WO# : **40185260**

40185260

Custody Seal on Cooler/Box Present: yes no Seals intact: yes noCustody Seal on Samples Present: yes no Seals intact: yes noPacking Material: Bubble Wrap Bubble Bags None OtherThermometer Used SR - N/A Type of Ice: Wet Blue Dry None Samples on ice, cooling process has begunCooler Temperature Uncorr: 40.1 /Corr:Temp Blank Present: yes noBiological Tissue is Frozen: yes no

Person examining contents:

Date: 4-4-19
Initials: SKL

Temp should be above freezing to 6°C.

Biota Samples may be received at ≤ 0°C.

Chain of Custody Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1.
Chain of Custody Filled Out:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	<u>No pg#, Mail, Invoice</u> 4418
Chain of Custody Relinquished:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	3.
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	4.
Samples Arrived within Hold Time: - VOA Samples frozen upon receipt	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	5. Date/Time:
Short Hold Time Analysis (<72hr):	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	6.
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	7.
Sufficient Volume: For Analysis: <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No MS/MSD: <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	8.	
Correct Containers Used: -Pace Containers Used: -Pace IR Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	9.
Containers Intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	10.
Filtered volume received for Dissolved tests	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	11.
Sample Labels match COC: -Includes date/time/ID/Analysis Matrix:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	12. <u>004-ID is Field Blank MOD 34</u> <u>009-No date + time on 250mlp 4-4-19</u>
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	13.
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
Pace Trip Blank Lot # (if purchased):		

Client Notification/ Resolution:

If checked, see attached form for additional comments

Person Contacted: _____ Date/Time: _____

Comments/ Resolution: _____

Project Manager Review:

A2 for DMDate: 4/4/19

April 25, 2019

Meghan Blodgett
SCS ENGINEERS
2830 Dairy Drive
Madison, WI 53718

RE: Project: 25219067 ALLIANT-COLUMBIA CCR
Pace Project No.: 40185256

Dear Meghan Blodgett:

Enclosed are the analytical results for sample(s) received by the laboratory on April 04, 2019. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Dan Milewsky
dan.milewsky@pacelabs.com
(920)469-2436
Project Manager

Enclosures

cc: Tom Karwoski, SCS ENGINEERS
Nicole Kron, SCS ENGINEERS
Jeff Maxted, ALLIANT ENERGY
Marc Morandi, ALLIANT ENERGY



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: 25219067 ALLIANT-COLUMBIA CCR
 Pace Project No.: 40185256

Pennsylvania Certification IDs

1638 Roseytown Rd Suites 2,3&4, Greensburg, PA 15601	Missouri Certification #: 235
ANAB DOD-ELAP Rad Accreditation #: L2417	Montana Certification #: Cert0082
Alabama Certification #: 41590	Nebraska Certification #: NE-OS-29-14
Arizona Certification #: AZ0734	Nevada Certification #: PA014572018-1
Arkansas Certification	New Hampshire/TNI Certification #: 297617
California Certification #: 04222CA	New Jersey/TNI Certification #: PA051
Colorado Certification #: PA01547	New Mexico Certification #: PA01457
Connecticut Certification #: PH-0694	New York/TNI Certification #: 10888
Delaware Certification	North Carolina Certification #: 42706
EPA Region 4 DW Rad	North Dakota Certification #: R-190
Florida/TNI Certification #: E87683	Ohio EPA Rad Approval: #41249
Georgia Certification #: C040	Oregon/TNI Certification #: PA200002-010
Florida: Cert E871149 SEKS WET	Pennsylvania/TNI Certification #: 65-00282
Guam Certification	Puerto Rico Certification #: PA01457
Hawaii Certification	Rhode Island Certification #: 65-00282
Idaho Certification	South Dakota Certification
Illinois Certification	Tennessee Certification #: 02867
Indiana Certification	Texas/TNI Certification #: T104704188-17-3
Iowa Certification #: 391	Utah/TNI Certification #: PA014572017-9
Kansas/TNI Certification #: E-10358	USDA Soil Permit #: P330-17-00091
Kentucky Certification #: KY90133	Vermont Dept. of Health: ID# VT-0282
KY WW Permit #: KY0098221	Virgin Island/PADEP Certification
KY WW Permit #: KY0000221	Virginia/VELAP Certification #: 9526
Louisiana DHH/TNI Certification #: LA180012	Washington Certification #: C868
Louisiana DEQ/TNI Certification #: 4086	West Virginia DEP Certification #: 143
Maine Certification #: 2017020	West Virginia DHHR Certification #: 9964C
Maryland Certification #: 308	Wisconsin Approve List for Rad
Massachusetts Certification #: M-PA1457	Wyoming Certification #: 8TMS-L
Michigan/PADEP Certification #: 9991	

Green Bay Certification IDs

1241 Bellevue Street, Green Bay, WI 54302	Virginia VELAP ID: 460263
Florida/NELAP Certification #: E87948	South Carolina Certification #: 83006001
Illinois Certification #: 200050	Texas Certification #: T104704529-14-1
Kentucky UST Certification #: 82	Wisconsin Certification #: 405132750
Louisiana Certification #: 04168	Wisconsin DATCP Certification #: 105-444
Minnesota Certification #: 055-999-334	USDA Soil Permit #: P330-16-00157
New York Certification #: 12064	Federal Fish & Wildlife Permit #: LE51774A-0
North Dakota Certification #: R-150	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
 without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: 25219067 ALLIANT-COLUMBIA CCR

Pace Project No.: 40185256

Lab ID	Sample ID	Matrix	Date Collected	Date Received
40185256001	MW-301	Water	04/02/19 17:20	04/04/19 09:30
40185256002	MW-84A	Water	04/03/19 09:40	04/04/19 09:30

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: 25219067 ALLIANT-COLUMBIA CCR
Pace Project No.: 40185256

Lab ID	Sample ID	Method	Analysts	Analytes Reported	Laboratory
40185256001	MW-301	EPA 6020	KXS	14	PASI-G
		EPA 7470	AJT	1	PASI-G
			AXL	7	PASI-G
		EPA 903.1	MK1	1	PASI-PA
		EPA 904.0	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
		SM 2540C	TMK	1	PASI-G
		EPA 9040	ALY	1	PASI-G
		EPA 300.0	HMB	3	PASI-G
40185256002	MW-84A	EPA 6020	KXS	14	PASI-G
		EPA 7470	AJT	1	PASI-G
			AXL	7	PASI-G
		EPA 903.1	MK1	1	PASI-PA
		EPA 904.0	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
		SM 2540C	TMK	1	PASI-G
		EPA 9040	ALY	1	PASI-G
		EPA 300.0	HMB	3	PASI-G

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: 25219067 ALLIANT-COLUMBIA CCR

Pace Project No.: 40185256

Sample: MW-301	Lab ID: 40185256001	Collected: 04/02/19 17:20	Received: 04/04/19 09:30	Matrix: Water					
Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
6020 MET ICPMS	Analytical Method: EPA 6020 Preparation Method: EPA 3010								
Antimony	0.32J	ug/L	1.0	0.15	1	04/05/19 08:40	04/09/19 06:15	7440-36-0	
Arsenic	0.40J	ug/L	1.0	0.28	1	04/05/19 08:40	04/09/19 06:15	7440-38-2	
Barium	11.8	ug/L	4.9	1.5	1	04/05/19 08:40	04/09/19 06:15	7440-39-3	
Beryllium	0.28J	ug/L	1.0	0.18	1	04/05/19 08:40	04/09/19 06:15	7440-41-7	
Boron	26.9	ug/L	11.0	3.3	1	04/05/19 08:40	04/09/19 06:15	7440-42-8	
Cadmium	0.21J	ug/L	1.0	0.15	1	04/05/19 08:40	04/09/19 06:15	7440-43-9	
Calcium	126000	ug/L	2500	698	10	04/05/19 08:40	04/09/19 05:48	7440-70-2	P6
Chromium	<1.0	ug/L	3.4	1.0	1	04/05/19 08:40	04/09/19 06:15	7440-47-3	
Cobalt	0.35J	ug/L	1.0	0.12	1	04/05/19 08:40	04/09/19 06:15	7440-48-4	
Lead	0.30J	ug/L	1.0	0.24	1	04/05/19 08:40	04/09/19 06:15	7439-92-1	
Lithium	0.90J	ug/L	1.0	0.19	1	04/05/19 08:40	04/09/19 06:15	7439-93-2	
Molybdenum	<0.44	ug/L	1.5	0.44	1	04/05/19 08:40	04/09/19 06:15	7439-98-7	
Selenium	0.49J	ug/L	1.1	0.32	1	04/05/19 08:40	04/09/19 06:15	7782-49-2	
Thallium	0.48J	ug/L	1.0	0.14	1	04/05/19 08:40	04/09/19 06:15	7440-28-0	
7470 Mercury	Analytical Method: EPA 7470 Preparation Method: EPA 7470								
Mercury	<0.084	ug/L	0.28	0.084	1	04/12/19 09:55	04/15/19 10:05	7439-97-6	
Field Data	Analytical Method:								
Field pH	6.62	Std. Units			1		04/02/19 17:20		
Field Specific Conductance	883	umhos/cm			1		04/02/19 17:20		
Oxygen, Dissolved	2.20	mg/L			1		04/02/19 17:20	7782-44-7	
REDOX	152.1	mV			1		04/02/19 17:20		
Turbidity	2.02	NTU			1		04/02/19 17:20		
Static Water Level	787.04	feet			1		04/02/19 17:20		
Temperature, Water (C)	7.5	deg C			1		04/02/19 17:20		
2540C Total Dissolved Solids	Analytical Method: SM 2540C								
Total Dissolved Solids	462	mg/L	20.0	8.7	1		04/09/19 12:34		
9040 pH	Analytical Method: EPA 9040								
pH at 25 Degrees C	6.8	Std. Units	0.10	0.010	1		04/08/19 11:21		H6
300.0 IC Anions 28 Days	Analytical Method: EPA 300.0								
Chloride	2.9J	mg/L	10.0	2.5	5		04/16/19 19:51	16887-00-6	B,D3
Fluoride	<0.50	mg/L	1.5	0.50	5		04/16/19 19:51	16984-48-8	D3
Sulfate	5.3J	mg/L	15.0	5.0	5		04/16/19 19:51	14808-79-8	D3

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: 25219067 ALLIANT-COLUMBIA CCR

Pace Project No.: 40185256

Sample: MW-84A	Lab ID: 40185256002	Collected: 04/03/19 09:40	Received: 04/04/19 09:30	Matrix: Water					
Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
6020 MET ICPMS	Analytical Method: EPA 6020 Preparation Method: EPA 3010								
Antimony	<0.15	ug/L	1.0	0.15	1	04/05/19 08:40	04/09/19 06:42	7440-36-0	
Arsenic	<0.28	ug/L	1.0	0.28	1	04/05/19 08:40	04/09/19 06:42	7440-38-2	
Barium	14.7	ug/L	4.9	1.5	1	04/05/19 08:40	04/09/19 06:42	7440-39-3	
Beryllium	<0.18	ug/L	1.0	0.18	1	04/05/19 08:40	04/09/19 06:42	7440-41-7	
Boron	13.6	ug/L	11.0	3.3	1	04/05/19 08:40	04/09/19 06:42	7440-42-8	
Cadmium	<0.15	ug/L	1.0	0.15	1	04/05/19 08:40	04/09/19 06:42	7440-43-9	
Calcium	80100	ug/L	250	69.8	1	04/05/19 08:40	04/09/19 06:42	7440-70-2	
Chromium	1.8J	ug/L	3.4	1.0	1	04/05/19 08:40	04/09/19 06:42	7440-47-3	
Cobalt	<0.12	ug/L	1.0	0.12	1	04/05/19 08:40	04/09/19 06:42	7440-48-4	
Lead	<0.24	ug/L	1.0	0.24	1	04/05/19 08:40	04/09/19 06:42	7439-92-1	
Lithium	0.56J	ug/L	1.0	0.19	1	04/05/19 08:40	04/09/19 06:42	7439-93-2	
Molybdenum	<0.44	ug/L	1.5	0.44	1	04/05/19 08:40	04/09/19 06:42	7439-98-7	
Selenium	<0.32	ug/L	1.1	0.32	1	04/05/19 08:40	04/09/19 06:42	7782-49-2	
Thallium	<0.14	ug/L	1.0	0.14	1	04/05/19 08:40	04/09/19 06:42	7440-28-0	
7470 Mercury	Analytical Method: EPA 7470 Preparation Method: EPA 7470								
Mercury	<0.084	ug/L	0.28	0.084	1	04/12/19 09:55	04/15/19 10:07	7439-97-6	
Field Data	Analytical Method:								
Field pH	7.03	Std. Units			1		04/03/19 09:40		
Field Specific Conductance	637.2	umhos/cm			1		04/03/19 09:40		
Oxygen, Dissolved	9.49	mg/L			1		04/03/19 09:40	7782-44-7	
REDOX	103.4	mV			1		04/03/19 09:40		
Turbidity	1.90	NTU			1		04/03/19 09:40		
Static Water Level	787.35	feet			1		04/03/19 09:40		
Temperature, Water (C)	10.2	deg C			1		04/03/19 09:40		
2540C Total Dissolved Solids	Analytical Method: SM 2540C								
Total Dissolved Solids	318	mg/L	20.0	8.7	1		04/09/19 12:34		
9040 pH	Analytical Method: EPA 9040								
pH at 25 Degrees C	7.4	Std. Units	0.10	0.010	1		04/08/19 11:24		H6
300.0 IC Anions 28 Days	Analytical Method: EPA 300.0								
Chloride	3.6	mg/L	2.0	0.50	1		04/16/19 20:03	16887-00-6	B
Fluoride	<0.10	mg/L	0.30	0.10	1		04/16/19 20:03	16984-48-8	
Sulfate	1.4J	mg/L	3.0	1.0	1		04/16/19 20:03	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: 25219067 ALLIANT-COLUMBIA CCR
Pace Project No.: 40185256

QC Batch:	318138	Analysis Method:	EPA 7470
QC Batch Method:	EPA 7470	Analysis Description:	7470 Mercury
Associated Lab Samples:	40185256001, 40185256002		

METHOD BLANK: 1849587 Matrix: Water

Associated Lab Samples: 40185256001, 40185256002

Parameter	Units	Blank	Reporting	Analyzed	Qualifiers
		Result	Limit		
Mercury	ug/L	<0.084	0.28	04/15/19 09:25	

LABORATORY CONTROL SAMPLE: 1849588

Parameter	Units	Spike	LCS	LCS	% Rec	Qualifiers
		Conc.	Result	% Rec	Limits	
Mercury	ug/L	5	5.3	105	85-115	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 1849589 1849590

Parameter	Units	40185483005	MS	MSD	MS	MSD	MS	MSD	% Rec	% Rec	Max	RPD	RPD	Qual
		Result	Spike	Spike										
Mercury	ug/L	0.00016J	5	5	5.4	5.2	105	101	85-115	85-115	4	20		

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,

without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: 25219067 ALLIANT-COLUMBIA CCR

Pace Project No.: 40185256

QC Batch:	317485	Analysis Method:	EPA 6020
QC Batch Method:	EPA 3010	Analysis Description:	6020 MET
Associated Lab Samples:	40185256001, 40185256002		

METHOD BLANK: 1846066 Matrix: Water

Associated Lab Samples: 40185256001, 40185256002

Parameter	Units	Blank Result	Reporting Limit	Analyzed	Qualifiers
Antimony	ug/L	<0.15	1.0	04/09/19 04:47	
Arsenic	ug/L	<0.28	1.0	04/09/19 04:47	
Barium	ug/L	<1.5	4.9	04/09/19 04:47	
Beryllium	ug/L	<0.18	1.0	04/09/19 04:47	
Boron	ug/L	<3.3	11.0	04/09/19 04:47	
Cadmium	ug/L	<0.15	1.0	04/09/19 04:47	
Calcium	ug/L	<69.8	250	04/09/19 04:47	
Chromium	ug/L	<1.0	3.4	04/09/19 04:47	
Cobalt	ug/L	<0.12	1.0	04/09/19 04:47	
Lead	ug/L	<0.24	1.0	04/09/19 04:47	
Lithium	ug/L	<0.19	1.0	04/09/19 04:47	
Molybdenum	ug/L	<0.44	1.5	04/09/19 04:47	
Selenium	ug/L	<0.32	1.1	04/09/19 04:47	
Thallium	ug/L	<0.14	1.0	04/09/19 04:47	

LABORATORY CONTROL SAMPLE: 1846067

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Antimony	ug/L	500	500	100	80-120	
Arsenic	ug/L	500	474	95	80-120	
Barium	ug/L	500	487	97	80-120	
Beryllium	ug/L	500	492	98	80-120	
Boron	ug/L	500	486	97	80-120	
Cadmium	ug/L	500	500	100	80-120	
Calcium	ug/L	5000	4990	100	80-120	
Chromium	ug/L	500	492	98	80-120	
Cobalt	ug/L	500	485	97	80-120	
Lead	ug/L	500	463	93	80-120	
Lithium	ug/L	500	467	93	80-120	
Molybdenum	ug/L	500	465	93	80-120	
Selenium	ug/L	500	508	102	80-120	
Thallium	ug/L	500	464	93	80-120	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 1846068 1846069

Parameter	Units	MS Result	MS Spike Conc.	MS Result	MSD Result	MS % Rec	MSD Result	MS % Rec	% Rec Limits	RPD RPD	Max Qual
Antimony	ug/L	0.32J	500	500	496	496	99	99	75-125	0 20	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: 25219067 ALLIANT-COLUMBIA CCR

Pace Project No.: 40185256

Parameter	Units	40185256001		MSD		1846069		% Rec	MSD % Rec	% Rec Limits	Max	
		Result	Spike Conc.	Spike Conc.	MS Result	MSD Result	MS % Rec				RPD RPD	RPD RPD
Arsenic	ug/L	0.40J	500	500	480	478	96	95	75-125	0	20	
Barium	ug/L	11.8	500	500	496	498	97	97	75-125	0	20	
Beryllium	ug/L	0.28J	500	500	481	480	96	96	75-125	0	20	
Boron	ug/L	26.9	500	500	492	498	93	94	75-125	1	20	
Cadmium	ug/L	0.21J	500	500	491	490	98	98	75-125	0	20	
Calcium	ug/L	126000	5000	5000	126000	123000	12	-46	75-125	2	20	P6
Chromium	ug/L	<1.0	500	500	484	483	97	96	75-125	0	20	
Cobalt	ug/L	0.35J	500	500	476	473	95	95	75-125	1	20	
Lead	ug/L	0.30J	500	500	467	468	93	94	75-125	0	20	
Lithium	ug/L	0.90J	500	500	463	463	92	92	75-125	0	20	
Molybdenum	ug/L	<0.44	500	500	465	464	93	93	75-125	0	20	
Selenium	ug/L	0.49J	500	500	512	513	102	103	75-125	0	20	
Thallium	ug/L	0.48J	500	500	474	476	95	95	75-125	0	20	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: 25219067 ALLIANT-COLUMBIA CCR

Pace Project No.: 40185256

QC Batch:	317813	Analysis Method:	SM 2540C
QC Batch Method:	SM 2540C	Analysis Description:	2540C Total Dissolved Solids
Associated Lab Samples:	40185256001, 40185256002		

METHOD BLANK: 1847582 Matrix: Water

Associated Lab Samples: 40185256001, 40185256002

Parameter	Units	Blank Result	Reporting Limit	Analyzed	Qualifiers
Total Dissolved Solids	mg/L	<8.7	20.0	04/09/19 12:32	

LABORATORY CONTROL SAMPLE: 1847583

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Total Dissolved Solids	mg/L	577	552	96	80-120	

SAMPLE DUPLICATE: 1847584

Parameter	Units	40185256001 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	462	462	0	5	

SAMPLE DUPLICATE: 1847585

Parameter	Units	40185260001 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	290	284	2	5	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,

without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: 25219067 ALLIANT-COLUMBIA CCR
 Pace Project No.: 40185256

QC Batch:	317619	Analysis Method:	EPA 9040
QC Batch Method:	EPA 9040	Analysis Description:	9040 pH
Associated Lab Samples:	40185256001, 40185256002		

SAMPLE DUPLICATE: 1846956

Parameter	Units	40185113001 Result	Dup Result	RPD	Max RPD	Qualifiers
pH at 25 Degrees C	Std. Units	1.1	1.1	7	20	H6

SAMPLE DUPLICATE: 1846957

Parameter	Units	40185204001 Result	Dup Result	RPD	Max RPD	Qualifiers
pH at 25 Degrees C	Std. Units	7.2	7.2	0	20	H6

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,

without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: 25219067 ALLIANT-COLUMBIA CCR

Pace Project No.: 40185256

QC Batch:	317955	Analysis Method:	EPA 300.0
QC Batch Method:	EPA 300.0	Analysis Description:	300.0 IC Anions
Associated Lab Samples:	40185256001, 40185256002		

METHOD BLANK: 1848305 Matrix: Water

Associated Lab Samples: 40185256001, 40185256002

Parameter	Units	Blank	Reporting	Analyzed	Qualifiers
		Result	Limit		
Chloride	mg/L	0.52J	2.0	04/16/19 10:22	
Fluoride	mg/L	<0.10	0.30	04/16/19 10:22	
Sulfate	mg/L	<1.0	3.0	04/16/19 10:22	

LABORATORY CONTROL SAMPLE: 1848306

Parameter	Units	Spike	LCS	LCS	% Rec	Qualifiers
		Conc.	Result	% Rec	Limits	
Chloride	mg/L	20	21.6	108	90-110	
Fluoride	mg/L	2	2.0	98	90-110	
Sulfate	mg/L	20	21.7	109	90-110	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 1848307 1848308

Parameter	Units	40185204004		MSD		MS	MSD	MS	MSD	% Rec	% Rec	Limits	RPD	RPD	Max
		Result	Spike Conc.	Spike Conc.	Result										
Chloride	mg/L	43.0	100	100	149	148	106	105	90-110	90-110	1	15			
Fluoride	mg/L	<0.50	10	10	10.3	10.4	103	104	90-110	90-110	1	15			
Sulfate	mg/L	<5.0	100	100	109	109	105	105	90-110	90-110	0	15			

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 1848309 1848310

Parameter	Units	40185260002		MSD		MS	MSD	MS	MSD	% Rec	% Rec	Limits	RPD	RPD	Max
		Result	Spike Conc.	Spike Conc.	Result										
Chloride	mg/L	229	200	200	439	425	105	98	90-110	90-110	3	15			
Fluoride	mg/L	<0.10	2	2	1.9	2.0	97	99	90-110	90-110	2	15			
Sulfate	mg/L	201	200	200	411	397	105	98	90-110	90-110	3	15			

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,

without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: 25219067 ALLIANT-COLUMBIA CCR

Pace Project No.: 40185256

Sample: MW-301 Lab ID: **40185256001** Collected: 04/02/19 17:20 Received: 04/04/19 09:30 Matrix: Water

PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 903.1	0.000 ± 0.278 (0.565) C:NA T:94%	pCi/L	04/22/19 23:16	13982-63-3	
Radium-228	EPA 904.0	0.552 ± 0.391 (0.759) C:75% T:91%	pCi/L	04/19/19 12:45	15262-20-1	
Total Radium	Total Radium Calculation	0.552 ± 0.669 (1.32)	pCi/L	04/25/19 11:01	7440-14-4	

Sample: MW-84A Lab ID: **40185256002** Collected: 04/03/19 09:40 Received: 04/04/19 09:30 Matrix: Water

PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 903.1	0.199 ± 0.391 (0.715) C:NA T:93%	pCi/L	04/22/19 23:16	13982-63-3	
Radium-228	EPA 904.0	0.482 ± 0.511 (1.07) C:72% T:80%	pCi/L	04/19/19 12:45	15262-20-1	
Total Radium	Total Radium Calculation	0.681 ± 0.902 (1.79)	pCi/L	04/25/19 11:01	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: 25219067 ALLIANT-COLUMBIA CCR

Pace Project No.: 40185256

QC Batch: 338211 Analysis Method: EPA 904.0
QC Batch Method: EPA 904.0 Analysis Description: 904.0 Radium 228
Associated Lab Samples: 40185256001, 40185256002

METHOD BLANK: 1646527 Matrix: Water

Associated Lab Samples: 40185256001, 40185256002

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-228	-0.0681 ± 0.343 (0.816) C:74% T:84%	pCi/L	04/19/19 12:45	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: 25219067 ALLIANT-COLUMBIA CCR

Pace Project No.: 40185256

QC Batch: 338210 Analysis Method: EPA 903.1
QC Batch Method: EPA 903.1 Analysis Description: 903.1 Radium-226
Associated Lab Samples: 40185256001, 40185256002

METHOD BLANK: 1646526 Matrix: Water

Associated Lab Samples: 40185256001, 40185256002

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-226	0.212 ± 0.323 (0.520) C:NA T:90%	pCi/L	04/22/19 22:44	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: 25219067 ALLIANT-COLUMBIA CCR
Pace Project No.: 40185256

DEFINITIONS

Act - Activity

Unc - Uncertainty: SDWA = 1.96 sigma count uncertainty, all other matrices = Expanded Uncertainty (95% confidence interval).

Gamma Spec = Expanded Uncertainty (95.4% Confidence Interval)

(MDC) - Minimum Detectable Concentration

Trac - Tracer Recovery (%)

Carr - Carrier Recovery (%)

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above LOD.

J - Estimated concentration at or above the LOD and below the LOQ.

LOD - Limit of Detection adjusted for dilution factor, percent moisture, initial weight and final volume.

LOQ - Limit of Quantitation adjusted for dilution factor, percent moisture, initial weight and final volume.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected at or above the adjusted LOD.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

LABORATORIES

PASI-G Pace Analytical Services - Green Bay

PASI-PA Pace Analytical Services - Greensburg

ANALYTE QUALIFIERS

B Analyte was detected in the associated method blank.

D3 Sample was diluted due to the presence of high levels of non-target analytes or other matrix interference.

H6 Analysis initiated outside of the 15 minute EPA required holding time.

P6 Matrix spike recovery was outside laboratory control limits due to a parent sample concentration notably higher than the spike level.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: 25219067 ALLIANT-COLUMBIA CCR

Pace Project No.: 40185256

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
40185256001	MW-301	EPA 3010	317485	EPA 6020	317570
40185256002	MW-84A	EPA 3010	317485	EPA 6020	317570
40185256001	MW-301	EPA 7470	318138	EPA 7470	318191
40185256002	MW-84A	EPA 7470	318138	EPA 7470	318191
40185256001	MW-301				
40185256002	MW-84A				
40185256001	MW-301	EPA 903.1	338210		
40185256002	MW-84A	EPA 903.1	338210		
40185256001	MW-301	EPA 904.0	338211		
40185256002	MW-84A	EPA 904.0	338211		
40185256001	MW-301	Total Radium Calculation	339896		
40185256002	MW-84A	Total Radium Calculation	339897		
40185256001	MW-301	SM 2540C	317813		
40185256002	MW-84A	SM 2540C	317813		
40185256001	MW-301	EPA 9040	317619		
40185256002	MW-84A	EPA 9040	317619		
40185256001	MW-301	EPA 300.0	317955		
40185256002	MW-84A	EPA 300.0	317955		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

(Please Print Clearly)

(Please Print Clearly)

Analytical

CHAIN OF CUSTODY

40185256

UPPER MIDWEST REGION
MN: 612-607-1700 WI:

Page 1 of

*Preservation Codes							
A=None	B=HCl	C=H ₂ SO ₄	D=HNO ₃	E=DI Water	F=Methanol	G=NaOH	H=Sodium Bisulfate Solution
I=	Sodium Thiosulfate	J=Other					

		TIME	DATE
001	MW 301	4/3/19 1720	W
002	MW 844	4/3/19 0940	
003	MW 303	4/1/19 1800	
004	MW 304	4/2/19 1230	
005	MW 305	4/1/19 1410	
006	M-4R	4/1/19 1515	
007	Field Blank Pond	4/2/19 1230	↓

① Filled in by lab from labels (Julia S)

Rush Turnaround Time Requested - Prelims
 (Rush TAT subject to approvals(surcharge))

Re-publisher By:	McGraw-Hill	Date/Time:	4-3-14 19:00
			Received By:

Transmit Prelim Rush Results by (complete what you want):
mail #1: Date Needed: **Revised By:**
Teddy 4/4/19 0930 **Date/Time:** **Revised By:**
John

Email #2:		Relinquished by:	Date/Time:	Received By:
Telephone:		Reinstituted By:	Date/Time:	Received By:

Fax:	
Samples on HOLD are subject to special pricing and release of liability	
Relinquished By:	Date/Time:
	Received By:

(Please Print Clearly)

Company Name: SCS
Branch/Location: Madison, WI
Project Contact: Meg Blodgett
Phone: 608 216 7362

UPPER MIDWEST REGION
MN: 612-607-1700 **WI:** 920-489-2436

40185256

Page 1 of

Page 19 of 21

Pace Analytical®
www.pacealabs.com

CHAIN OF CUSTODY

		Preservation Codes		
		A=None (VESNO) I=	B=HCl H=Sodium Bisulfate Solution	C=H2SO4 D=HNO3 E=DI Water F=Methanol G=NaOH H=Sodium Thiosulfate J=Other
V/I	Ns	No	No	No
Preservation Letter	A	C	C	C

Mail To Contact:	Quote #:

Invoice To Company:
 Invoice To Address:

CLIENT FIELD ID	COLLECTION DATE	TIME	MATRIX	COMMENTS	LAB COMMENTS (Lab Use Only)	Profile #
MW 301	4-2-19	17:20	GW			
MW 84A	4-2-19	9:40	GW			
MW 303	4-1-19	18:00	GW	X X X X	CL, fluoride, Ph, SO4, TDS	
MW 304	4-2-19	12:30	GW	X X X X	Metals	
MW 305	4-1-19	14:10	GW	X X X X	Radium 226	
M-4R	4-1-19	15:15	GW	X X X X	Radium 228	
Field Blank Pond	4-2-19	12:30	DT	↓ ↓ ↓ ↓		

Received By:	Date/Time:	Received Temp =
40185256		°C

Received By:	Date/Time:	Sample Receipt pH
		OK / Adjusted

Received By:	Date/Time:	Cooler Custody Seal
		Present / Not Present
		Intact / Not Intact

Rush Turnaround Time Requested - Prelims (Rush TAT subject to approval/surcharge)		Date Needed:	Requisitioned By:	Received By:	Date/Time:	PAGE Project No.
						40185256
Transmit Prelim Rush Results by (complete what you want):						
Email #1:		Requisitioned By:		Received By:	Date/Time:	Recept Temp =
Email #2:						°C
Telephone:		Requisitioned By:		Received By:	Date/Time:	Sample Receipt pH
Fax:						OK / Adjusted
Samples on HOLD are subject to special pricing and release of liability						
Requisitioned By:	Date/Time:	Received By:	Date/Time:	Received By:	Date/Time:	Received By:

Sample Preservation Receipt Form

Client Name: SCS

Project # G0189256

All containers needing preservation have been checked and noted below: Yes No N/A

Lab Lot# of pH paper: 1045358 / Lab Std #ID of preservation (if pH adjusted):

Initial whey skim
completed: _____ Date: _____ Time: _____

Pace Lab #	Glass		Plastic		Vials		Jars		General		VOA Vials (>6mm) *	H2SO4 pH ≤2	NaOH+Zn Act pH ≥9	NaOH pH ≥12	HNO3 pH ≤2	pH after adjusted	Volume (mL)								
	AG1U	AG1H	AG4S	AG4U	AG5U	AG2S	BG3U	BP1U	BP2N	BP2Z	BP3U	BP3C	BP3N	BP3S	DG9A	DG9T	VG9U	VG9H	VG9M	VG9D	JGFU	WGFU	WPFU	SP5T	ZPLC
001																									
002																									
003																									
004																									
005																									
006																									
007																									
008																									
009																									
010																									
011																									
012																									
013																									
014																									
015																									
016																									
017																									
018																									
019																									
020																									

Exceptions to preservation check: VOA, Coliform, TOC, TOH, O&G, WI DRO, Phenolics, Other: _____ Headspace in VOA Vials (>6mm): Yes No N/A *If yes look in headspace column

AG1U	1 liter amber glass	BP1U	1 liter plastic unpres	DG9A	40 mL amber ascorbic	JGFU	4 oz amber jar unpres
AG1H	1 liter amber glass HCl	BP2N	500 mL plastic HNO3	DG9T	40 mL amber Na Thio	WGFU	4 oz clear jar unpres
AG4S	125 mL amber glass H2SO4	BP2Z	500 mL plastic NaOH, Znact	VGGJ	40 mL clear vial unpres	WPFU	4 oz plastic jar unpres
AG4U	120 mL amber glass unpres	BP3U	250 mL plastic unpres	VGGH	40 mL clear vial HCl		
AG5U	100 mL amber glass unpres	BP3C	250 mL plastic NaOH	VGGM	40 mL clear vial MeOH	SP5T	120 mL plastic Na Thiosulfate
AG5S	500 mL amber glass H2SO4	BP3N	250 mL plastic HNO3	VGGD	40 mL clear vial DI	ZPLC	zipploc bag
BG3U	250 mL clear glass unpres	BP3S	250 mL plastic H2SO4	GN:			

Sample Condition Upon Receipt Form (SCUR)

Project #:

WO# : 40185256

Client Name: SCS

Courier: CS Logistics Fed Ex Speedee UPS Waltco

Client Pace Other:

Tracking #: 786437200524



40185256

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Custody Seal on Samples Present: yes no Seals intact: yes no

Packing Material: Bubble Wrap Bubble Bags None Other

Thermometer Used SR - N/A Type of Ice: Wet Blue Dry None

Cooler Temperature Uncorr: ROI /Corr:

Samples on ice, cooling process has begun

Temp Blank Present: yes no

Biological Tissue is Frozen: yes no

Temp should be above freezing to 6°C.

Biota Samples may be received at ≤ 0°C.

Person examining contents:

Date: 4-4-19
Initials: SLD

Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1.
Chain of Custody Filled Out:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	2. <u>No pg # Mail, Invone, Collect 4-4-19</u>
Chain of Custody Relinquished:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	3. <u>dated time lab added forced</u>
Sampler Name & Signature on COC:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	4. <u>Received updated LOC via email from client 4-4-19</u>
Samples Arrived within Hold Time:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	5.
- VOA Samples frozen upon receipt	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Date/Time:
Short Hold Time Analysis (<72hr):	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	6.
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	7.
Sufficient Volume:	8.	
For Analysis: <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No MS/MSD: <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A		
Correct Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	9.
-Pace Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
-Pace IR Containers Used:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	
Containers Intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	10.
Filtered volume received for Dissolved tests	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	11.
Sample Labels match COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	12.
-Includes date/time/ID/Analysis Matrix:	<u>W</u>	
Trip Blank Present:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	13.
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	
Pace Trip Blank Lot # (if purchased):		

Client Notification/ Resolution:

Person Contacted: _____

Date/Time: _____

If checked, see attached form for additional comments

Comments/ Resolution: _____

Project Manager Review:

An Fr DM

Date:

4/4/19

A2 October 2019 Detection Monitoring

October 28, 2019

Meghan Blodgett
SCS ENGINEERS
2830 Dairy Drive
Madison, WI 53718

RE: Project: 25219067.00 COLUMBIA CCR
Pace Project No.: 40196897

Dear Meghan Blodgett:

Enclosed are the analytical results for sample(s) received by the laboratory on October 10, 2019. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Dan Milewsky
dan.milewsky@pacelabs.com
(920)469-2436
Project Manager

Enclosures

cc: Tom Karwoski, SCS ENGINEERS
Nicole Kron, SCS ENGINEERS
Jeff Maxted, ALLIANT ENERGY
Marc Morandi, ALLIANT ENERGY



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: 25219067.00 COLUMBIA CCR
Pace Project No.: 40196897

Green Bay Certification IDs

1241 Bellevue Street, Green Bay, WI 54302
Florida/NELAP Certification #: E87948
Illinois Certification #: 200050
Kentucky UST Certification #: 82
Louisiana Certification #: 04168
Minnesota Certification #: 055-999-334
New York Certification #: 12064
North Dakota Certification #: R-150

Virginia VELAP ID: 460263
South Carolina Certification #: 83006001
Texas Certification #: T104704529-14-1
Wisconsin Certification #: 405132750
Wisconsin DATCP Certification #: 105-444
USDA Soil Permit #: P330-16-00157
Federal Fish & Wildlife Permit #: LE51774A-0

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: 25219067.00 COLUMBIA CCR

Pace Project No.: 40196897

Lab ID	Sample ID	Matrix	Date Collected	Date Received
40196971009	MW-306	Water	10/08/19 10:55	10/10/19 09:15
40196971010	MW-307	Water	10/07/19 10:05	10/10/19 09:15
40196971011	MW-308	Water	10/07/19 13:55	10/10/19 09:15
40196971012	FIELD BLANK SCPOND	Water	10/08/19 10:55	10/10/19 09:15

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: 25219067.00 COLUMBIA CCR
Pace Project No.: 40196897

Lab ID	Sample ID	Method	Analysts	Analytes Reported
40196971009	MW-306	EPA 6020	DS1	2
			HMG	7
		SM 2540C	TMK	1
		EPA 9040	ALY	1
		EPA 300.0	HMB	3
40196971010	MW-307	EPA 6020	DS1	2
			HMG	7
		SM 2540C	TMK	1
		EPA 9040	ALY	1
		EPA 300.0	HMB	3
40196971011	MW-308	EPA 6020	DS1	2
			HMG	7
		SM 2540C	TMK	1
		EPA 9040	ALY	1
		EPA 300.0	HMB	3
40196971012	FIELD BLANK SCPOND	EPA 6020	DS1	2
		SM 2540C	TMK	1
		EPA 9040	ALY	1
		EPA 300.0	HMB	3

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: 25219067.00 COLUMBIA CCR

Pace Project No.: 40196897

Sample: MW-306	Lab ID: 40196971009	Collected: 10/08/19 10:55	Received: 10/10/19 09:15	Matrix: Water					
Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
6020 MET ICPMS	Analytical Method: EPA 6020 Preparation Method: EPA 3010								
Boron	134	ug/L	10.0	3.0	1	10/11/19 07:55	10/15/19 11:20	7440-42-8	
Calcium	92800	ug/L	254	76.2	1	10/11/19 07:55	10/15/19 11:20	7440-70-2	
Field Data	Analytical Method:								
Field pH	7.28	Std. Units			1		10/08/19 10:55		
Field Specific Conductance	583.0	umhos/cm			1		10/08/19 10:55		
Oxygen, Dissolved	9.80	mg/L			1		10/08/19 10:55	7782-44-7	
REDOX	109.1	mV			1		10/08/19 10:55		
Turbidity	1.27	NTU			1		10/08/19 10:55		
Static Water Level	787.47	feet			1		10/08/19 10:55		
Temperature, Water (C)	13.1	deg C			1		10/08/19 10:55		
2540C Total Dissolved Solids	Analytical Method: SM 2540C								
Total Dissolved Solids	328	mg/L	20.0	8.7	1		10/11/19 18:22		
9040 pH	Analytical Method: EPA 9040								
pH at 25 Degrees C	7.3	Std. Units	0.10	0.010	1		10/22/19 10:26		H6
300.0 IC Anions	Analytical Method: EPA 300.0								
Chloride	0.64J	mg/L	2.0	0.50	1		10/21/19 21:17	16887-00-6	
Fluoride	<0.10	mg/L	0.30	0.10	1		10/21/19 21:17	16984-48-8	
Sulfate	7.8	mg/L	3.0	1.0	1		10/21/19 21:17	14808-79-8	

Sample: MW-307	Lab ID: 40196971010	Collected: 10/07/19 10:05	Received: 10/10/19 09:15	Matrix: Water					
Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
6020 MET ICPMS	Analytical Method: EPA 6020 Preparation Method: EPA 3010								
Boron	242	ug/L	10.0	3.0	1	10/11/19 07:55	10/15/19 11:27	7440-42-8	
Calcium	75800	ug/L	254	76.2	1	10/11/19 07:55	10/15/19 11:27	7440-70-2	
Field Data	Analytical Method:								
Field pH	7.24	Std. Units			1		10/07/19 10:05		
Field Specific Conductance	618.2	umhos/cm			1		10/07/19 10:05		
Oxygen, Dissolved	0.11	mg/L			1		10/07/19 10:05	7782-44-7	
REDOX	-98.7	mV			1		10/07/19 10:05		
Turbidity	1.83	NTU			1		10/07/19 10:05		
Static Water Level	786.99	feet			1		10/07/19 10:05		
Temperature, Water (C)	14.3	deg C			1		10/07/19 10:05		
2540C Total Dissolved Solids	Analytical Method: SM 2540C								
Total Dissolved Solids	336	mg/L	20.0	8.7	1		10/11/19 18:22		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: 25219067.00 COLUMBIA CCR

Pace Project No.: 40196897

Sample: MW-307	Lab ID: 40196971010	Collected: 10/07/19 10:05	Received: 10/10/19 09:15	Matrix: Water					
Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
9040 pH	Analytical Method: EPA 9040								
pH at 25 Degrees C	7.5	Std. Units	0.10	0.010	1		10/22/19 10:48		H6
300.0 IC Anions	Analytical Method: EPA 300.0								
Chloride	9.3	mg/L	2.0	0.50	1		10/21/19 22:10	16887-00-6	
Fluoride	<0.10	mg/L	0.30	0.10	1		10/21/19 22:10	16984-48-8	
Sulfate	27.8	mg/L	3.0	1.0	1		10/21/19 22:10	14808-79-8	
Sample: MW-308	Lab ID: 40196971011	Collected: 10/07/19 13:55	Received: 10/10/19 09:15	Matrix: Water					
Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
6020 MET ICPMS	Analytical Method: EPA 6020 Preparation Method: EPA 3010								
Boron	694	ug/L	10.0	3.0	1	10/11/19 07:55	10/15/19 11:34	7440-42-8	
Calcium	131000	ug/L	254	76.2	1	10/11/19 07:55	10/15/19 11:34	7440-70-2	
Field Data	Analytical Method:								
Field pH	7.48	Std. Units			1		10/07/19 13:55		
Field Specific Conductance	896	umhos/cm			1		10/07/19 13:55		
Oxygen, Dissolved	0.07	mg/L			1		10/07/19 13:55	7782-44-7	
REDOX	-170.0	mV			1		10/07/19 13:55		
Turbidity	6.75	NTU			1		10/07/19 13:55		
Static Water Level	787.18	feet			1		10/07/19 13:55		
Temperature, Water (C)	15.0	deg C			1		10/07/19 13:55		
2540C Total Dissolved Solids	Analytical Method: SM 2540C								
Total Dissolved Solids	470	mg/L	20.0	8.7	1		10/11/19 18:22		
9040 pH	Analytical Method: EPA 9040								
pH at 25 Degrees C	7.4	Std. Units	0.10	0.010	1		10/22/19 10:50		H6
300.0 IC Anions	Analytical Method: EPA 300.0								
Chloride	1.6J	mg/L	2.0	0.50	1		10/21/19 22:23	16887-00-6	
Fluoride	<0.10	mg/L	0.30	0.10	1		10/21/19 22:23	16984-48-8	
Sulfate	<1.0	mg/L	3.0	1.0	1		10/21/19 22:23	14808-79-8	

Sample: FIELD BLANK SCPOND	Lab ID: 40196971012	Collected: 10/08/19 10:55	Received: 10/10/19 09:15	Matrix: Water					
Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
6020 MET ICPMS	Analytical Method: EPA 6020 Preparation Method: EPA 3010								
Boron	<3.0	ug/L	10.0	3.0	1	10/11/19 07:55	10/15/19 08:20	7440-42-8	
Calcium	<76.2	ug/L	254	76.2	1	10/11/19 07:55	10/15/19 08:20	7440-70-2	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: 25219067.00 COLUMBIA CCR
Pace Project No.: 40196897

Sample: FIELD BLANK SCPOND Lab ID: 40196971012 Collected: 10/08/19 10:55 Received: 10/10/19 09:15 Matrix: Water

Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
2540C Total Dissolved Solids	Analytical Method: SM 2540C								
Total Dissolved Solids	<8.7	mg/L	20.0	8.7	1		10/11/19 18:22		
9040 pH	Analytical Method: EPA 9040								
pH at 25 Degrees C	6.5	Std. Units	0.10	0.010	1		10/22/19 10:53		H6
300.0 IC Anions	Analytical Method: EPA 300.0								
Chloride	<0.50	mg/L	2.0	0.50	1		10/22/19 17:30	16887-00-6	
Fluoride	<0.10	mg/L	0.30	0.10	1		10/22/19 17:30	16984-48-8	
Sulfate	<1.0	mg/L	3.0	1.0	1		10/22/19 17:30	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: 25219067.00 COLUMBIA CCR

Pace Project No.: 40196897

QC Batch: 337095 Analysis Method: EPA 6020

QC Batch Method: EPA 3010 Analysis Description: 6020 MET

Associated Lab Samples: 40196971009, 40196971010, 40196971011, 40196971012

METHOD BLANK: 1957892 Matrix: Water

Associated Lab Samples: 40196971009, 40196971010, 40196971011, 40196971012

Parameter	Units	Blank	Reporting	Analyzed	Qualifiers
		Result	Limit		
Boron	ug/L	<3.0	10.0	10/15/19 07:53	
Calcium	ug/L	<76.2	254	10/15/19 07:53	

LABORATORY CONTROL SAMPLE: 1957893

Parameter	Units	Spike	LCS	LCS	% Rec	Qualifiers
		Conc.	Result	% Rec	Limits	
Boron	ug/L	500	474	95	80-120	
Calcium	ug/L	5000	5060	101	80-120	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 1957894 1957895

Parameter	Units	MS	MSD	MS	MSD	MS	MSD	% Rec	% Rec	RPD	RPD	Max
		40196734001	Spike									
Boron	ug/L	7220	500	500	7950	8800	146	316	75-125	10	20	P6
Calcium	ug/L	87600	5000	5000	95700	98200	161	210	75-125	3	20	P6

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,

without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: 25219067.00 COLUMBIA CCR

Pace Project No.: 40196897

QC Batch:	337218	Analysis Method:	SM 2540C
QC Batch Method:	SM 2540C	Analysis Description:	2540C Total Dissolved Solids
Associated Lab Samples:	40196971009, 40196971010, 40196971011, 40196971012		

METHOD BLANK: 1959158 Matrix: Water

Associated Lab Samples: 40196971009, 40196971010, 40196971011, 40196971012

Parameter	Units	Blank Result	Reporting Limit	Analyzed	Qualifiers
Total Dissolved Solids	mg/L	<8.7	20.0	10/11/19 18:18	

LABORATORY CONTROL SAMPLE: 1959159

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Total Dissolved Solids	mg/L	547	560	102	80-120	

SAMPLE DUPLICATE: 1959160

Parameter	Units	40196967001 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	574	564	2	10	

SAMPLE DUPLICATE: 1959161

Parameter	Units	40196971001 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	274	278	1	10	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,

without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: 25219067.00 COLUMBIA CCR

Pace Project No.: 40196897

QC Batch: 338272 Analysis Method: EPA 9040

QC Batch Method: EPA 9040 Analysis Description: 9040 pH

Associated Lab Samples: 40196971009, 40196971010, 40196971011, 40196971012

SAMPLE DUPLICATE: 1964592

Parameter	Units	Result	Dup Result	RPD	Max RPD	Qualifiers
pH at 25 Degrees C	Std. Units	7.6	7.7	1	20	H6

SAMPLE DUPLICATE: 1964593

Parameter	Units	Result	Dup Result	RPD	Max RPD	Qualifiers
pH at 25 Degrees C	Std. Units	7.3	7.3	0	20	H6

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,

without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: 25219067.00 COLUMBIA CCR

Pace Project No.: 40196897

QC Batch:	337822	Analysis Method:	EPA 300.0
QC Batch Method:	EPA 300.0	Analysis Description:	300.0 IC Anions
Associated Lab Samples:	40196971009, 40196971010, 40196971011		

METHOD BLANK: 1962191 Matrix: Water

Associated Lab Samples: 40196971009, 40196971010, 40196971011

Parameter	Units	Blank	Reporting	Analyzed	Qualifiers
		Result	Limit		
Chloride	mg/L	<0.50	2.0	10/21/19 11:34	
Fluoride	mg/L	<0.10	0.30	10/21/19 11:34	
Sulfate	mg/L	<1.0	3.0	10/21/19 11:34	

LABORATORY CONTROL SAMPLE: 1962192

Parameter	Units	Spike	LCS	LCS	% Rec	Qualifiers
		Conc.	Result	% Rec	Limits	
Chloride	mg/L	20	20.1	101	90-110	
Fluoride	mg/L	2	2.0	102	90-110	
Sulfate	mg/L	20	20.1	100	90-110	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 1962193 1962194

Parameter	Units	40196954007	MS	MSD	MS	MSD	MS	MSD	% Rec	% Rec	Limits	RPD	RPD	Max	
		Result	Spike	Spike											
Chloride	mg/L	14.1	20	20	33.8	33.6	99	98	90-110	90-110	90-110	1	15		
Fluoride	mg/L	<0.10	2	2	2.1	2.1	102	102	90-110	90-110	90-110	0	15		
Sulfate	mg/L	7.2	20	20	27.0	26.9	99	98	90-110	90-110	90-110	0	15		

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 1962195 1962196

Parameter	Units	40196971011	MS	MSD	MS	MSD	MS	MSD	% Rec	% Rec	Limits	RPD	RPD	Max	
		Result	Spike	Spike											
Chloride	mg/L	1.6J	20	20	20.9	21.3	97	99	90-110	90-110	90-110	2	15		
Fluoride	mg/L	<0.10	2	2	2.1	2.1	102	102	90-110	90-110	90-110	0	15		
Sulfate	mg/L	<1.0	20	20	20.6	20.4	102	101	90-110	90-110	90-110	1	15		

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,

without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: 25219067.00 COLUMBIA CCR
Pace Project No.: 40196897

QC Batch:	337894	Analysis Method:	EPA 300.0
QC Batch Method:	EPA 300.0	Analysis Description:	300.0 IC Anions
Associated Lab Samples:	40196971012		

METHOD BLANK: 1962626 Matrix: Water

Associated Lab Samples: 40196971012

Parameter	Units	Blank Result	Reporting Limit	Analyzed	Qualifiers
Chloride	mg/L	<0.50	2.0	10/22/19 12:43	
Fluoride	mg/L	<0.10	0.30	10/22/19 12:43	
Sulfate	mg/L	<1.0	3.0	10/22/19 12:43	

LABORATORY CONTROL SAMPLE: 1962627

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Chloride	mg/L	20	19.5	98	90-110	
Fluoride	mg/L	2	2.0	100	90-110	
Sulfate	mg/L	20	19.5	97	90-110	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 1962628 1962629

Parameter	Units	MS		MSD								Max Qual
		40196978001	Result	Spike Conc.	MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	RPD	RPD	
Chloride	mg/L	12.8	100	100	115	117	102	104	90-110	2	15	
Fluoride	mg/L	<0.50	10	10	10.7	10.9	106	108	90-110	2	15	
Sulfate	mg/L	63.0	100	100	161	163	98	100	90-110	2	15	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 1962630 1962631

Parameter	Units	MS		MSD								Max Qual
		40197074003	Result	Spike Conc.	MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	RPD	RPD	
Chloride	mg/L	6.1	20	20	26.1	26.3	100	101	90-110	1	15	
Fluoride	mg/L	<0.10	2	2	2.1	2.1	101	102	90-110	1	15	
Sulfate	mg/L	6.2	20	20	25.9	26.1	98	99	90-110	1	15	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: 25219067.00 COLUMBIA CCR
Pace Project No.: 40196897

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above LOD.

J - Estimated concentration at or above the LOD and below the LOQ.

LOD - Limit of Detection adjusted for dilution factor, percent moisture, initial weight and final volume.

LOQ - Limit of Quantitation adjusted for dilution factor, percent moisture, initial weight and final volume.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected at or above the adjusted LOD.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

ANALYTE QUALIFIERS

H6 Analysis initiated outside of the 15 minute EPA required holding time.

P6 Matrix spike recovery was outside laboratory control limits due to a parent sample concentration notably higher than the spike level.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: 25219067.00 COLUMBIA CCR
Pace Project No.: 40196897

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
40196971009	MW-306	EPA 3010	337095	EPA 6020	337193
40196971010	MW-307	EPA 3010	337095	EPA 6020	337193
40196971011	MW-308	EPA 3010	337095	EPA 6020	337193
40196971012	FIELD BLANK SCPOND	EPA 3010	337095	EPA 6020	337193
40196971009	MW-306	SM 2540C	337218		
40196971010	MW-307	SM 2540C	337218		
40196971011	MW-308	SM 2540C	337218		
40196971012	FIELD BLANK SCPOND	SM 2540C	337218		
40196971009	MW-306	EPA 9040	338272		
40196971010	MW-307	EPA 9040	338272		
40196971011	MW-308	EPA 9040	338272		
40196971012	FIELD BLANK SCPOND	EPA 9040	338272		
40196971009	MW-306	EPA 300.0	337822		
40196971010	MW-307	EPA 300.0	337822		
40196971011	MW-308	EPA 300.0	337822		
40196971012	FIELD BLANK SCPOND	EPA 300.0	337894		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

(Please Print Clearly)

UPPER MIDWEST REGION

MN: 612-607-1700 WI: 920-469-2436

Page 1 of

Company Name: SCS Engineers
Branch/Location: Madison WI
Project Contact: Tom Kowoski
Phone: 608-224-2830
Project Number: 25219067.00

Pace Analytical®
www.pacealts.com


CHAIN OF CUSTODY

FILTERED? (YES/NO)		PRESERVATION (CODE)*	
A=None H=Sodium Bisulfite Solution	B=ICL C=H2SO4	D=HNO3 E=DI Water I=Sodium Thiosulfate	F=Methanol G=NaOH J=Other

Quote #:	Tom Kowoski	
Mail To Contact:	SCS Engineers	
Mail To Address:	2830 Dairy Dr Madison WI 53719	
Invoice To Contact:	John	
Invoice To Company:	John	
Invoice To Address:		
CLIENT COMMENTS	LAB COMMENTS (Lab Use Only)	Profile #

Data Package Options (Billable)		MSI/MSD		Matrix Codes		Analyses Requested	
<input type="checkbox"/> EPA Level III	<input type="checkbox"/> On your sample (billable)	A = Air B = Biota C = Charcoal O = Oil S = Soil SI = Sludge	V = Water DW = Drinking Water GW = Ground Water SW = Surface Water WW = Waste Water WP = Wipe	N	N	N	Boron / Calcium / pH / TDS, Cl, F, SO4
<input type="checkbox"/> EPA Level IV	<input type="checkbox"/> NOT needed on your sample			A	A		

PACE LAB #	CLIENT FIELD ID	DATE	TIME	MATRIX	COLLECTION	CLIENT COMMENTS	LAB COMMENTS (Lab Use Only)	Profile #
MW-302	10/19/19 1100	10/19/19	1100	WP	X	X		601
MW-33AR	10/8/19 1540	10/8/19	1540	WP	X	X		002
MW-34A	10/8/19 1435	10/8/19	1435	WP	X	X		003
Field Blank Mod 1-3LF	10/8/19 1435	10/8/19	1435	WP	X	X		004
MW-309	10/8/19 1150	10/8/19	1150	WP	X	X		005
MW-310	10/8/19 1250	10/8/19	1250	WP	X	X		006
MW-311	10/8/19 1340	10/8/19	1340	WP	X	X		007
Field blank Mod 1	10/8/19 1450	10/8/19	1450	WP	X	X		008
MW-306	10/8/19 1055	10/8/19	1055	WP	X	X		009
MW-307	10/7/19 1005	10/7/19	1005	WP	X	X		010
MW-308	10/7/19 1355	10/7/19	1355	WP	X	X		011
Field blank SC POND	10/8/19 1055	10/8/19	1055	WP	X	X		012

Rush Turnaround Time Requested - Prelims (Rush TRT subject to approval/surcharge)	Relinquished By:  Date/Time: 10/9/19 1600	Received By: Date/Time: 10/9/19 1700	PAGE Project No. 4096971
Date Needed:	Relinquished By:  Date/Time: 10/10/19 0915	Received By: Date/Time: 10/10/19 0915	Receipt Temp - 20.1 °C
Transmit Prelim Rush Results by (complete what you want):	Relinquished By:  Date/Time:	Received By: Date/Time:	Sample Receipt pH OK Adjusted
Email #1:	Relinquished By: Date/Time:	Received By: Date/Time:	Cooler Custody Seal
Email #2:	Relinquished By: Date/Time:	Received By: Date/Time:	Present / Not Present
Telephone:	Relinquished By: Date/Time:	Received By: Date/Time:	Intact / Not Intact
Fax:	Relinquished By: Date/Time:	Received By: Date/Time:	
Samples on HOLD are subject to special pricing and release of liability	Relinquished By: Date/Time:	Received By: Date/Time:	

Sample Preservation Receipt Form

Client Name: S C S Snaidero

Project # 40196971

Pace Analytical Services, LLC
1241 Bellevue Street, Suite 9
Green Bay, WI 54302

All containers needing preservation have been checked and noted below: Yes No N/A

Lab Lot# of pH paper: 10050891

Lab Std #ID of preservation (if pH adjusted):

Initial when completed: 8 Date/
Time:

Pace Lab #	Glass		Plastic		Vials		Jars		General		VOA Vials (>6mm)*	H2SO4 pH ≤ 2	NaOH+Zn Act pH ≥ 9	NaOH pH ≥ 12	HNO3 pH ≤ 2	pH after adjusted	Volume (mL)								
	AG1U	AG1H	AG4S	AG4U	AG5U	AG2S	BG3U	BP1U	BP2N	BP2Z	BP3U	BP3B	BP3N	BP3S	DG9A	DG9T	VG9U	VG9H	VG9M	VG9D	JGFU	WGFU	WPFU	SP5T	ZPLC
001								2	1																
002								2	1																
003								2	1																
004								2	1																
005								2	1																
006								2	1																
007								2	1																
008								2	1																
009								2	1																
010								2	1																
011								2	1																
012								2	1																
013								2	1																
014								2	1																
015								2	1																
016								2	1																
017								2	1																
018								2	1																
019								2	1																
020								2	1																

Exceptions to preservation check: VOA, Coliform, TOC, TOX, TOH, O&G, WIDRO, Phenolics, Other:

Headspace in VOA Vials (>6mm) : Yes No N/A *If yes look in Headspace column

AG1U	1 liter amber glass	BP1U	1 liter plastic unpres	DC9A	40 mL amber ascorbic	JGFU	4 oz amber jar unpres
AG1H	1 liter HCl	BP2N	500 mL plastic HNO3	DG9T	40 mL amber Na Thio	WGFU	4 oz clear jar unpres
AG4S	125 mL amber glass H2SO4	BP2Z	500 mL plastic NaOH, Znact	VG9U	40 mL clear vial HCl	WPFU	4 oz plastic jar unpres
AG4U	120 mL amber glass unpres	BP3U	250 mL plastic unpres	VG9H	40 mL clear vial MeOH	SP5T	120 mL plastic Na Thiosulfate
AG5U	100 mL amber glass unpres	BP3B	250 mL plastic NaOH	VG9M	40 mL clear vial DI	ZPLC	ziploc bag
AG2S	500 mL amber glass H2SO4	BP3N	250 mL plastic HNO3	VG9D	250 mL plastic H2SO4	GN:	
BG3U	250 mL clear glass unpres	BP3S					



Document Name: Sample Condition Upon Receipt (SCUR)	Document Revised: 25Apr2018
Document No.: F-GB-C-031-Rev.07	Issuing Authority: Pace Green Bay Quality Office

Sample Condition Upon Receipt Form (SCUR)

Project #:

WO# : 40196971

Client Name: SCS Engineers

Courier: CS Logistics Fed Ex Speedee UPS Waltco Client Pace Other: _____

Tracking #: Z120_100919

Custody Seal on Cooler/Box Present: yes no Seals intact: yes noCustody Seal on Samples Present: yes no Seals intact: yes noPacking Material: Bubble Wrap Bubble Bags None Other plastic bagThermometer Used SR - NA Type of Ice: Wet Blue Dry None Samples on ice, cooling process has begun

Cooler Temperature Uncorr: 20°C /Corr: _____

Temp Blank Present: yes noBiological Tissue is Frozen: yes no

Temp should be above freezing to 6°C.

Biota Samples may be received at ≤ 0°C.

Person examining contents:

Date: 10/10/19

Initials: J.W.

Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1.
Chain of Custody Filled Out:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	2.
Chain of Custody Relinquished:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	3.
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	4.
Samples Arrived within Hold Time: - VOA Samples frozen upon receipt	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> Yes <input type="checkbox"/> No	5. Date/Time:
Short Hold Time Analysis (<72hr):	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	6.
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	7.
Sufficient Volume: For Analysis: <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No MS/MSD: <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	8.	
Correct Containers Used: -Pace Containers Used: -Pace IR Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A <input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	9.
Containers Intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	10.
Filtered volume received for Dissolved tests	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	11.
Sample Labels match COC: -Includes date/time/ID/Analysis Matrix: W	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	12.
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	13.
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	
Pace Trip Blank Lot # (if purchased):		

Client Notification/ Resolution:

If checked, see attached form for additional comments

Person Contacted: _____

Date/Time: _____

Comments/ Resolution: _____

_____Project Manager Review: J.W. for DM

Date:

10-10-19

November 01, 2019

Meghan Blodgett
SCS ENGINEERS
2830 Dairy Drive
Madison, WI 53718

RE: Project: 25219067.00 COLUMBIA CCR
Pace Project No.: 40196970

Dear Meghan Blodgett:

Enclosed are the analytical results for sample(s) received by the laboratory on October 10, 2019. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Dan Milewsky
dan.milewsky@pacelabs.com
(920)469-2436
Project Manager

Enclosures

cc: Tom Karwoski, SCS ENGINEERS
Nicole Kron, SCS ENGINEERS
Jeff Maxted, ALLIANT ENERGY
Marc Morandi, ALLIANT ENERGY



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: 25219067.00 COLUMBIA CCR
 Pace Project No.: 40196970

Pennsylvania Certification IDs

1638 Roseytown Rd Suites 2,3&4, Greensburg, PA 15601	Missouri Certification #: 235
ANAB DOD-ELAP Rad Accreditation #: L2417	Montana Certification #: Cert0082
Alabama Certification #: 41590	Nebraska Certification #: NE-OS-29-14
Arizona Certification #: AZ0734	Nevada Certification #: PA014572018-1
Arkansas Certification	New Hampshire/TNI Certification #: 297617
California Certification #: 04222CA	New Jersey/TNI Certification #: PA051
Colorado Certification #: PA01547	New Mexico Certification #: PA01457
Connecticut Certification #: PH-0694	New York/TNI Certification #: 10888
Delaware Certification	North Carolina Certification #: 42706
EPA Region 4 DW Rad	North Dakota Certification #: R-190
Florida/TNI Certification #: E87683	Ohio EPA Rad Approval: #41249
Georgia Certification #: C040	Oregon/TNI Certification #: PA200002-010
Florida: Cert E871149 SEKS WET	Pennsylvania/TNI Certification #: 65-00282
Guam Certification	Puerto Rico Certification #: PA01457
Hawaii Certification	Rhode Island Certification #: 65-00282
Idaho Certification	South Dakota Certification
Illinois Certification	Tennessee Certification #: 02867
Indiana Certification	Texas/TNI Certification #: T104704188-17-3
Iowa Certification #: 391	Utah/TNI Certification #: PA014572017-9
Kansas/TNI Certification #: E-10358	USDA Soil Permit #: P330-17-00091
Kentucky Certification #: KY90133	Vermont Dept. of Health: ID# VT-0282
KY WW Permit #: KY0098221	Virgin Island/PADEP Certification
KY WW Permit #: KY0000221	Virginia/VELAP Certification #: 9526
Louisiana DHH/TNI Certification #: LA180012	Washington Certification #: C868
Louisiana DEQ/TNI Certification #: 4086	West Virginia DEP Certification #: 143
Maine Certification #: 2017020	West Virginia DHHR Certification #: 9964C
Maryland Certification #: 308	Wisconsin Approve List for Rad
Massachusetts Certification #: M-PA1457	Wyoming Certification #: 8TMS-L
Michigan/PADEP Certification #: 9991	

Green Bay Certification IDs

1241 Bellevue Street, Green Bay, WI 54302	Virginia VELAP ID: 460263
Florida/NELAP Certification #: E87948	South Carolina Certification #: 83006001
Illinois Certification #: 200050	Texas Certification #: T104704529-14-1
Kentucky UST Certification #: 82	Wisconsin Certification #: 405132750
Louisiana Certification #: 04168	Wisconsin DATCP Certification #: 105-444
Minnesota Certification #: 055-999-334	USDA Soil Permit #: P330-16-00157
New York Certification #: 12064	Federal Fish & Wildlife Permit #: LE51774A-0
North Dakota Certification #: R-150	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
 without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: 25219067.00 COLUMBIA CCR

Pace Project No.: 40196970

Lab ID	Sample ID	Matrix	Date Collected	Date Received
40196970001	MW-301	Water	10/09/19 12:00	10/10/19 09:15
40196970002	MW-84A	Water	10/09/19 13:10	10/10/19 09:15

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: 25219067.00 COLUMBIA CCR
Pace Project No.: 40196970

Lab ID	Sample ID	Method	Analysts	Analytes Reported	Laboratory
40196970001	MW-301	EPA 6020	DS1	14	PASI-G
		EPA 7470	AJT	1	PASI-G
			HMG	7	PASI-G
		EPA 903.1	MK1	1	PASI-PA
		EPA 904.0	VAL	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
		SM 2540C	TMK	1	PASI-G
		EPA 9040	ALY	1	PASI-G
		EPA 300.0	HMB	3	PASI-G
40196970002	MW-84A	EPA 6020	DS1	14	PASI-G
		EPA 7470	AJT	1	PASI-G
			HMG	7	PASI-G
		EPA 903.1	MK1	1	PASI-PA
		EPA 904.0	VAL	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
		SM 2540C	TMK	1	PASI-G
		EPA 9040	ALY	1	PASI-G
		EPA 300.0	HMB	3	PASI-G

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: 25219067.00 COLUMBIA CCR

Pace Project No.: 40196970

Sample: MW-301	Lab ID: 40196970001	Collected: 10/09/19 12:00	Received: 10/10/19 09:15	Matrix: Water					
Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
6020 MET ICPMS	Analytical Method: EPA 6020 Preparation Method: EPA 3010								
Antimony	<0.15	ug/L	1.0	0.15	1	10/14/19 07:07	10/14/19 23:25	7440-36-0	
Arsenic	0.42J	ug/L	1.0	0.28	1	10/14/19 07:07	10/15/19 12:57	7440-38-2	
Barium	10	ug/L	2.3	0.70	1	10/14/19 07:07	10/14/19 23:25	7440-39-3	
Beryllium	<0.25	ug/L	1.0	0.25	1	10/14/19 07:07	10/15/19 12:57	7440-41-7	
Boron	35.9	ug/L	10.0	3.0	1	10/14/19 07:07	10/15/19 12:57	7440-42-8	
Cadmium	<0.15	ug/L	1.0	0.15	1	10/14/19 07:07	10/14/19 23:25	7440-43-9	
Calcium	114000	ug/L	254	76.2	1	10/14/19 07:07	10/15/19 12:57	7440-70-2	
Chromium	<1.0	ug/L	3.4	1.0	1	10/14/19 07:07	10/15/19 12:57	7440-47-3	
Cobalt	<0.12	ug/L	1.0	0.12	1	10/14/19 07:07	10/15/19 12:57	7440-48-4	
Lead	<0.24	ug/L	1.0	0.24	1	10/14/19 07:07	10/14/19 23:25	7439-92-1	
Lithium	0.61J	ug/L	1.0	0.22	1	10/14/19 07:07	10/15/19 12:57	7439-93-2	
Molybdenum	<0.44	ug/L	1.5	0.44	1	10/14/19 07:07	10/14/19 23:25	7439-98-7	
Selenium	<0.32	ug/L	1.1	0.32	1	10/14/19 07:07	10/15/19 12:57	7782-49-2	
Thallium	<0.14	ug/L	1.0	0.14	1	10/14/19 07:07	10/14/19 23:25	7440-28-0	
7470 Mercury	Analytical Method: EPA 7470 Preparation Method: EPA 7470								
Mercury	<0.084	ug/L	0.28	0.084	1	10/22/19 14:50	10/23/19 09:18	7439-97-6	
Field Data	Analytical Method:								
Field pH	6.67	Std. Units			1		10/09/19 12:00		
Field Specific Conductance	801	umhos/cm			1		10/09/19 12:00		
Oxygen, Dissolved	1.67	mg/L			1		10/09/19 12:00	7782-44-7	
REDOX	173.0	mV			1		10/09/19 12:00		
Turbidity	2.12	NTU			1		10/09/19 12:00		
Static Water Level	788.47	feet			1		10/09/19 12:00		
Temperature, Water (C)	11.3	deg C			1		10/09/19 12:00		
2540C Total Dissolved Solids	Analytical Method: SM 2540C								
Total Dissolved Solids	418	mg/L	20.0	8.7	1		10/15/19 16:41		
9040 pH	Analytical Method: EPA 9040								
pH at 25 Degrees C	7.0	Std. Units	0.10	0.010	1		10/18/19 09:42		H6
300.0 IC Anions	Analytical Method: EPA 300.0								
Chloride	1.7J	mg/L	2.0	0.50	1		10/21/19 18:26	16887-00-6	
Fluoride	<0.10	mg/L	0.30	0.10	1		10/21/19 18:26	16984-48-8	
Sulfate	8.4	mg/L	3.0	1.0	1		10/21/19 18:26	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: 25219067.00 COLUMBIA CCR

Pace Project No.: 40196970

Sample: MW-84A	Lab ID: 40196970002	Collected: 10/09/19 13:10	Received: 10/10/19 09:15	Matrix: Water					
Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
6020 MET ICPMS	Analytical Method: EPA 6020 Preparation Method: EPA 3010								
Antimony	<0.15	ug/L	1.0	0.15	1	10/14/19 07:07	10/14/19 23:46	7440-36-0	
Arsenic	0.46J	ug/L	1.0	0.28	1	10/14/19 07:07	10/15/19 13:34	7440-38-2	
Barium	13.2	ug/L	2.3	0.70	1	10/14/19 07:07	10/14/19 23:46	7440-39-3	
Beryllium	<0.25	ug/L	1.0	0.25	1	10/14/19 07:07	10/15/19 13:34	7440-41-7	
Boron	12.0	ug/L	10.0	3.0	1	10/14/19 07:07	10/15/19 13:34	7440-42-8	
Cadmium	<0.15	ug/L	1.0	0.15	1	10/14/19 07:07	10/15/19 13:34	7440-43-9	
Calcium	73500	ug/L	254	76.2	1	10/14/19 07:07	10/15/19 13:34	7440-70-2	
Chromium	1.6J	ug/L	3.4	1.0	1	10/14/19 07:07	10/15/19 13:34	7440-47-3	
Cobalt	<0.12	ug/L	1.0	0.12	1	10/14/19 07:07	10/15/19 13:34	7440-48-4	
Lead	<0.24	ug/L	1.0	0.24	1	10/14/19 07:07	10/14/19 23:46	7439-92-1	
Lithium	0.52J	ug/L	1.0	0.22	1	10/14/19 07:07	10/15/19 13:34	7439-93-2	
Molybdenum	<0.44	ug/L	1.5	0.44	1	10/14/19 07:07	10/15/19 13:34	7439-98-7	
Selenium	<0.32	ug/L	1.1	0.32	1	10/14/19 07:07	10/15/19 13:34	7782-49-2	
Thallium	<0.14	ug/L	1.0	0.14	1	10/14/19 07:07	10/14/19 23:46	7440-28-0	
7470 Mercury	Analytical Method: EPA 7470 Preparation Method: EPA 7470								
Mercury	<0.084	ug/L	0.28	0.084	1	10/22/19 14:50	10/23/19 09:25	7439-97-6	
Field Data	Analytical Method:								
Field pH	7.23	Std. Units			1		10/09/19 13:10		
Field Specific Conductance	614.1	umhos/cm			1		10/09/19 13:10		
Oxygen, Dissolved	11.36	mg/L			1		10/09/19 13:10	7782-44-7	
REDOX	181.7	mV			1		10/09/19 13:10		
Turbidity	2.41	NTU			1		10/09/19 13:10		
Static Water Level	787.79	feet			1		10/09/19 13:10		
Temperature, Water (C)	11.8	deg C			1		10/09/19 13:10		
2540C Total Dissolved Solids	Analytical Method: SM 2540C								
Total Dissolved Solids	310	mg/L	20.0	8.7	1		10/15/19 16:41		
9040 pH	Analytical Method: EPA 9040								
pH at 25 Degrees C	7.5	Std. Units	0.10	0.010	1		10/18/19 09:44		H6
300.0 IC Anions	Analytical Method: EPA 300.0								
Chloride	3.9	mg/L	2.0	0.50	1		10/21/19 19:19	16887-00-6	
Fluoride	<0.10	mg/L	0.30	0.10	1		10/21/19 19:19	16984-48-8	
Sulfate	1.3J	mg/L	3.0	1.0	1		10/21/19 19:19	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: 25219067.00 COLUMBIA CCR

Pace Project No.: 40196970

QC Batch:	338359	Analysis Method:	EPA 7470
QC Batch Method:	EPA 7470	Analysis Description:	7470 Mercury
Associated Lab Samples:	40196970001, 40196970002		

METHOD BLANK:	1964880	Matrix:	Water
---------------	---------	---------	-------

Associated Lab Samples: 40196970001, 40196970002

Parameter	Units	Blank Result	Reporting Limit	Analyzed	Qualifiers
Mercury	ug/L	<0.084	0.28	10/23/19 09:14	

LABORATORY CONTROL SAMPLE: 1964881

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Mercury	ug/L	5	5.3	105	85-115	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 1964882 1964883

Parameter	Units	40196970001	MS Result	MSD Spike Conc.	MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
Mercury	ug/L	<0.084	5	5	5.1	5.0	101	100	85-115	1	20	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,

without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: 25219067.00 COLUMBIA CCR

Pace Project No.: 40196970

QC Batch: 337277 Analysis Method: EPA 6020
QC Batch Method: EPA 3010 Analysis Description: 6020 MET

Associated Lab Samples: 40196970001, 40196970002

METHOD BLANK: 1959950 Matrix: Water

Associated Lab Samples: 40196970001, 40196970002

Parameter	Units	Blank Result	Reporting Limit	Analyzed	Qualifiers
Antimony	ug/L	<0.15	1.0	10/14/19 18:40	
Arsenic	ug/L	<0.28	1.0	10/14/19 18:40	
Barium	ug/L	<0.70	2.3	10/14/19 18:40	
Beryllium	ug/L	<0.25	1.0	10/14/19 18:40	
Boron	ug/L	<3.0	10.0	10/14/19 18:40	
Cadmium	ug/L	<0.15	1.0	10/14/19 18:40	
Calcium	ug/L	<76.2	254	10/14/19 18:40	
Chromium	ug/L	<1.0	3.4	10/14/19 18:40	
Cobalt	ug/L	<0.12	1.0	10/14/19 18:40	
Lead	ug/L	<0.24	1.0	10/14/19 18:40	
Lithium	ug/L	<0.22	1.0	10/14/19 18:40	
Molybdenum	ug/L	<0.44	1.5	10/14/19 18:40	
Selenium	ug/L	<0.32	1.1	10/14/19 18:40	
Thallium	ug/L	<0.14	1.0	10/14/19 18:40	

LABORATORY CONTROL SAMPLE: 1959951

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Antimony	ug/L	500	497	99	80-120	
Arsenic	ug/L	500	478	96	80-120	
Barium	ug/L	500	477	95	80-120	
Beryllium	ug/L	500	488	98	80-120	
Boron	ug/L	500	464	93	80-120	
Cadmium	ug/L	500	501	100	80-120	
Calcium	ug/L	5000	5080	102	80-120	
Chromium	ug/L	500	478	96	80-120	
Cobalt	ug/L	500	467	93	80-120	
Lead	ug/L	500	470	94	80-120	
Lithium	ug/L	500	477	95	80-120	
Molybdenum	ug/L	500	452	90	80-120	
Selenium	ug/L	500	494	99	80-120	
Thallium	ug/L	500	476	95	80-120	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 1959952 1959953

Parameter	Units	MS Result	MSD Spike Conc.	MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
		40196861005	Spike Conc.	500	500	513	510	103	102	75-125	1
Antimony	ug/L	<0.15	500	500	513	510	103	102	75-125	1	20

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,

without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: 25219067.00 COLUMBIA CCR

Pace Project No.: 40196970

Parameter	Units	40196861005		MS		MSD		1959952		1959953			
		Result	Spike Conc.	Spike	Conc.	MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec	RPD	RPD	Max
								Limits					Qual
Arsenic	ug/L	2.4	500	500	512	504	102	100	75-125	2	20		
Barium	ug/L	169	500	500	671	672	100	101	75-125	0	20		
Beryllium	ug/L	<0.25	500	500	513	469	103	94	75-125	9	20		
Boron	ug/L	73.0	500	500	582	529	102	91	75-125	10	20		
Cadmium	ug/L	<0.15	500	500	514	512	103	102	75-125	0	20		
Calcium	ug/L	90300	5000	5000	96800	99900	130	192	75-125	3	20	P6	
Chromium	ug/L	<1.0	500	500	492	486	98	97	75-125	1	20		
Cobalt	ug/L	<0.12	500	500	488	484	98	97	75-125	1	20		
Lead	ug/L	<0.24	500	500	489	489	98	98	75-125	0	20		
Lithium	ug/L	12.4	500	500	518	476	101	93	75-125	8	20		
Molybdenum	ug/L	2.6	500	500	477	476	95	95	75-125	0	20		
Selenium	ug/L	<0.32	500	500	524	521	105	104	75-125	1	20		
Thallium	ug/L	<0.14	500	500	502	502	100	100	75-125	0	20		

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: 25219067.00 COLUMBIA CCR

Pace Project No.: 40196970

QC Batch:	337571	Analysis Method:	SM 2540C
QC Batch Method:	SM 2540C	Analysis Description:	2540C Total Dissolved Solids
Associated Lab Samples:	40196970001, 40196970002		

METHOD BLANK: 1960873 Matrix: Water

Associated Lab Samples: 40196970001, 40196970002

Parameter	Units	Blank Result	Reporting Limit	Analyzed	Qualifiers
Total Dissolved Solids	mg/L	<8.7	20.0	10/15/19 16:39	

LABORATORY CONTROL SAMPLE: 1960874

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Total Dissolved Solids	mg/L	547	558	102	80-120	

SAMPLE DUPLICATE: 1960875

Parameter	Units	40196939001 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	354	368	4	10	

SAMPLE DUPLICATE: 1960876

Parameter	Units	40196970001 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	418	406	3	10	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: 25219067.00 COLUMBIA CCR

Pace Project No.: 40196970

QC Batch: 337952 Analysis Method: EPA 9040

QC Batch Method: EPA 9040 Analysis Description: 9040 pH

Associated Lab Samples: 40196970001, 40196970002

SAMPLE DUPLICATE: 1962801

Parameter	Units	Result	Dup Result	RPD	Max RPD	Qualifiers
pH at 25 Degrees C	Std. Units	7.3	7.3	0	20	H6

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: 25219067.00 COLUMBIA CCR

Pace Project No.: 40196970

QC Batch:	337822	Analysis Method:	EPA 300.0
QC Batch Method:	EPA 300.0	Analysis Description:	300.0 IC Anions
Associated Lab Samples:	40196970001, 40196970002		

METHOD BLANK: 1962191 Matrix: Water

Associated Lab Samples: 40196970001, 40196970002

Parameter	Units	Blank	Reporting	Analyzed	Qualifiers
		Result	Limit		
Chloride	mg/L	<0.50	2.0	10/21/19 11:34	
Fluoride	mg/L	<0.10	0.30	10/21/19 11:34	
Sulfate	mg/L	<1.0	3.0	10/21/19 11:34	

LABORATORY CONTROL SAMPLE: 1962192

Parameter	Units	Spike	LCS	LCS	% Rec	Qualifiers
		Conc.	Result	% Rec	Limits	
Chloride	mg/L	20	20.1	101	90-110	
Fluoride	mg/L	2	2.0	102	90-110	
Sulfate	mg/L	20	20.1	100	90-110	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 1962193 1962194

Parameter	Units	40196954007	MS	MSD	MS	MSD	MS	MSD	% Rec	% Rec	Limits	RPD	RPD	Max
		Result	Spike	Spike										
Chloride	mg/L	14.1	20	20	33.8	33.6	99	98	90-110	90-110	1	15		
Fluoride	mg/L	<0.10	2	2	2.1	2.1	102	102	90-110	90-110	0	15		
Sulfate	mg/L	7.2	20	20	27.0	26.9	99	98	90-110	90-110	0	15		

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 1962195 1962196

Parameter	Units	40196971011	MS	MSD	MS	MSD	MS	MSD	% Rec	% Rec	Limits	RPD	RPD	Max
		Result	Spike	Spike										
Chloride	mg/L	1.6J	20	20	20.9	21.3	97	99	90-110	90-110	2	15		
Fluoride	mg/L	<0.10	2	2	2.1	2.1	102	102	90-110	90-110	0	15		
Sulfate	mg/L	<1.0	20	20	20.6	20.4	102	101	90-110	90-110	1	15		

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,

without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: 25219067.00 COLUMBIA CCR

Pace Project No.: 40196970

Sample: MW-301	Lab ID: 40196970001	Collected: 10/09/19 12:00	Received: 10/10/19 09:15	Matrix: Water
PWS:	Site ID:	Sample Type:		
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed
Radium-226	EPA 903.1	0.252 ± 0.351 (0.585) C:NA T:83%	pCi/L	10/31/19 12:20
Radium-228	EPA 904.0	0.449 ± 0.363 (0.723) C:77% T:95%	pCi/L	10/30/19 14:23
Total Radium	Total Radium Calculation	0.701 ± 0.714 (1.31)	pCi/L	11/01/19 15:00
<hr/>				
Sample: MW-84A	Lab ID: 40196970002	Collected: 10/09/19 13:10	Received: 10/10/19 09:15	Matrix: Water
PWS:	Site ID:	Sample Type:		
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed
Radium-226	EPA 903.1	0.247 ± 0.292 (0.459) C:NA T:101%	pCi/L	10/31/19 12:20
Radium-228	EPA 904.0	-0.0240 ± 0.355 (0.827) C:78% T:89%	pCi/L	10/30/19 14:24
Total Radium	Total Radium Calculation	0.247 ± 0.647 (1.29)	pCi/L	11/01/19 15:00

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: 25219067.00 COLUMBIA CCR

Pace Project No.: 40196970

QC Batch: 366494 Analysis Method: EPA 903.1
QC Batch Method: EPA 903.1 Analysis Description: 903.1 Radium-226
Associated Lab Samples: 40196970001, 40196970002

METHOD BLANK: 1777728 Matrix: Water

Associated Lab Samples: 40196970001, 40196970002

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-226	0.0468 ± 0.331 (0.660) C:NA T:87%	pCi/L	10/31/19 12:20	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: 25219067.00 COLUMBIA CCR

Pace Project No.: 40196970

QC Batch: 366493 Analysis Method: EPA 904.0
QC Batch Method: EPA 904.0 Analysis Description: 904.0 Radium 228
Associated Lab Samples: 40196970001, 40196970002

METHOD BLANK: 1777725 Matrix: Water

Associated Lab Samples: 40196970001, 40196970002

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-228	-0.00340 ± 0.362 (0.843) C:80% T:79%	pCi/L	10/30/19 14:21	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: 25219067.00 COLUMBIA CCR
Pace Project No.: 40196970

DEFINITIONS

Act - Activity

Unc - Uncertainty: SDWA = 1.96 sigma count uncertainty, all other matrices = Expanded Uncertainty (95% confidence interval).

Gamma Spec = Expanded Uncertainty (95.4% Confidence Interval)

(MDC) - Minimum Detectable Concentration

Trac - Tracer Recovery (%)

Carr - Carrier Recovery (%)

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above LOD.

J - Estimated concentration at or above the LOD and below the LOQ.

LOD - Limit of Detection adjusted for dilution factor, percent moisture, initial weight and final volume.

LOQ - Limit of Quantitation adjusted for dilution factor, percent moisture, initial weight and final volume.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected at or above the adjusted LOD.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

LABORATORIES

PASI-G Pace Analytical Services - Green Bay

PASI-PA Pace Analytical Services - Greensburg

ANALYTE QUALIFIERS

H6 Analysis initiated outside of the 15 minute EPA required holding time.

P6 Matrix spike recovery was outside laboratory control limits due to a parent sample concentration notably higher than the spike level.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: 25219067.00 COLUMBIA CCR

Pace Project No.: 40196970

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
40196970001	MW-301	EPA 3010	337277	EPA 6020	337400
40196970002	MW-84A	EPA 3010	337277	EPA 6020	337400
40196970001	MW-301	EPA 7470	338359	EPA 7470	338406
40196970002	MW-84A	EPA 7470	338359	EPA 7470	338406
40196970001	MW-301				
40196970002	MW-84A				
40196970001	MW-301	EPA 903.1	366494		
40196970002	MW-84A	EPA 903.1	366494		
40196970001	MW-301	EPA 904.0	366493		
40196970002	MW-84A	EPA 904.0	366493		
40196970001	MW-301	Total Radium Calculation	369027		
40196970002	MW-84A	Total Radium Calculation	369027		
40196970001	MW-301	SM 2540C	337571		
40196970002	MW-84A	SM 2540C	337571		
40196970001	MW-301	EPA 9040	337952		
40196970002	MW-84A	EPA 9040	337952		
40196970001	MW-301	EPA 300.0	337822		
40196970002	MW-84A	EPA 300.0	337822		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

(Please Print Clearly)

Company Name: SCS Engineers

Branch/Location: Madison, WI

Project Contact: Tom Kowalewski

Phone: 608-224-2830

Project Number: 25219067.00

Project Name: Columbia

Project State: WI, Scovina

Sampled By (Print): Adam Jackson

Sampled By (Sign): 

PO #:

Program:

Data Package Options (Billable)

EPA Level III

EPA Level IV

On your sample (Billable)

NOT needed on your sample

A = Air
B = Biota
C = Charcoal
O = Oil
S = Soil
SI = Sludge

W = Water
DW = Drinking Water
GW = Ground Water
SW = Surface Water
WW = Waste Water
WP = Wipe

MSMSD Matrix Codes

PICK LETTER

D

A

A

N

N

N

N

N

N

N

N

N

N

N

N

N

N

N

N

N

CHAIN OF CUSTODY

www.paceanalytical.com

UPPER MIDWEST REGION

MN: 612-607-1700 WI: 920-469-2436

Page 1 of

PRESERVATION CODES	
A=None	B=HCl
H=Sodium Bisulfite Solution	C=H2SO4
I=Sodium Thiosulfate	D=HNO3
J=Other	E=DI Water
F=Methanol	G=NaOH

FILTERED? (YES/NO)	PICK LETTER	Y/N	V	N	N	N	N	N	N
	D	D	D	A	A				

Analyses Requested

Radium 226, 228
Metals See attached table
TDS, Cl, F, SO4

CLIENT FIELD ID	COLLECTION DATE	TIME	MATRIX	CLIENT COMMENTS		LAB COMMENTS (Lab Use Only)	Profile #
				Received By:	Date/Time:		
001 MW - 301	10/9/19	1200	C	X	X	001	
002 MW - 84A	10/9/19	1316	C	X	X	002	

Received By:	Date/Time:	Received By:	Date/Time:	PACE Project No.
	10/9/19 1600		10/10/19 0915	40196970
CS LOGISTICS	10/10/19 0915		10/10/19 0915	40196970

Received By:	Date/Time:	Received By:	Date/Time:	Received Temp = 20.5 °C
	Date/Time:		Date/Time:	Sample Receipt pH OK Adjusted
Samples on HOLD are subject to special pricing and release of liability	Date/Time:	Received By:	Date/Time:	Cooler Custody Seal Present (Not Present) Intact / Not Intact

4096970

Table 2. Sampling Points and Parameters - CCR Rule Sampling Program
Groundwater Monitoring - Columbia Energy Center / SCS Engineers Project #23219067

Parameter	COC #1 - Background Wells		COC #2 - Landfill Modules 1-3				COC #3 - Landfill Module 4				COC #4 - Primary Pond				COC #5 - Secondary Pond			
	MW-301	MW-84A	MW-302	MW-33A	FIELD BLANK - MW-34A MW-35F	MW-309	MW-310	MW-311	FIELD BLANK - MOD4	MW-303	MW-304	MW-305	MW-306	MW-307	MW-308	FIELD BLANK - SECOND		
Boron	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
Calcium	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
Chloride	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
Fluoride	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
pH	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
Sulfate	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
TDS	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
Antimony	X	X								X	X	X	X	X	X			
Arsenic										X	X	X	X	X	X			
Boron	X	X								X	X	X	X	X	X			
Beryllium	X	X								X	X	X	X	X	X			
Cadmium	X	X								X	X	X	X	X	X			
Chromium	X	X								X	X	X	X	X	X			
Cobalt	X	X								X	X	X	X	X	X			
Fluoride										X	X	X	X	X	X			
Lead	X	X								X	X	X	X	X	X			
Lithium	X	X								X	X	X	X	X	X			
Mercury	X	X								X	X	X	X	X	X			
Molybdenum	X	X								X	X	X	X	X	X			
Selenium	X	X								X	X	X	X	X	X			
Thallium	X	X								X	X	X	X	X	X			
Radium 226+228	X	X								X	X	X	X	X	X			
Groundwater Elevation	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
CCR Rule Field Parameters																		
Specific Conductance	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
Dissolved Oxygen	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
ORP	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
Temperature	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
Turbidity	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
Color	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
Odor	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	

Notes:

All samples are unfiltered (total).

Sample Preservation Receipt Form

Project #

401K970

Pace Analytical Services, LLC
1241 Bellevue Street, Suite 9
Green Bay, WI 54302

Page 20 of 21

Client Name: Sc Engineers

All containers needing preservation have been checked and noted below: Yes No N/A

Lab Lot# of pH paper: 16050891 Lab Std #ID of preservation (if pH adjusted):

Initial when completed: 2/2 Date/
Time:

2/2


Time:

Pace Lab #	Glass		Plastic		Vials		Jars		General		VOA Vials (>6mm) *	H2SO4 pH ≤	NaOH Act pH ≥9	NaOH pH ≥12	HNO3 pH ≤2	pH after adjusted	Volume (mL)								
	AG1U	AG1H	AG4S	AG4U	AG5U	AG2S	BG3U	BP1U	BP2N	BP2Z	BP3U	BP3B	BP3N	BP3S	DG9A	DG9T	VG9U	VG9H	VG9M	VG9D	JGFU	WGFU	WPFU	SP5T	ZPLC
001																									
002																									
003																									
004																									
005																									
006																									
007																									
008																									
009																									
010																									
011																									
012																									
013																									
014																									
015																									
016																									
017																									
018																									
019																									
020																									

Exceptions to preservation check: VOA, Coliform, TOC, TOX, TOH, O&G, WIDRO, Phenolics, Other:

Headspace in VOA Vials (>6mm) Yes No N/A * If yes look in headspace column

AG1U	1 liter amber glass	BPIU	1 liter plastic unpres	DG9A	40 mL amber ascorbic	JGFU	4 oz amber jar unpres
AG1H	1 liter HCl	BP2N	500 mL plastic HNO3	DG9T	40 mL amber Na Thio	WGFU	4 oz clear jar unpres
AG4S	125 mL amber glass H2SO4	BP2Z	500 mL plastic NaOH, Znact	VG9U	40 mL clear vial HCl	WPFU	4 oz plastic jar unpres
AG4U	120 mL amber glass unpres	BP3U	250 mL plastic unpres	VG9H	40 mL clear vial MeOH		
AG5U	100 mL amber glass unpres	BP3B	250 mL plastic NaOH	VG9M	120 mL plastic Na Thiosulfate	SP5T	
AG2S	500 mL amber glass H2SO4	BP3N	250 mL plastic HNO3,	VG9D	ziploc bag	ZPLC	
BG3U	250 mL clear glass unpres	BP3S	250 mL plastic H2SO4	GN:	1 liter plastic HNO3 pres	GN:	

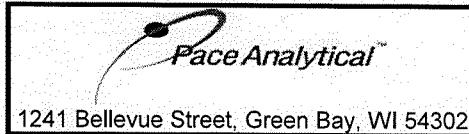

Document Name:
Sample Condition Upon Receipt (SCUR)

Document Revised: 25Apr2018

Document No.:
F-GB-C-031-Rev.07

Issuing Authority:
Pace Green Bay Quality Office

Sample Condition Upon Receipt Form (SCUR)

Project #:

WO# : 40196970



40196970

Client Name: SCS Engineers

Courier: CS Logistics Fed Ex Speedee UPS Waltco
 Client Pace Other: _____

Tracking #: Z1Z0.100919

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Custody Seal on Samples Present: yes no Seals intact: yes no

Packing Material: Bubble Wrap Bubble Bags None Other zip lock/plastic bag

Thermometer Used SR - NA Type of Ice: Blue Dry None Samples on ice, cooling process has begun

Cooler Temperature Uncorr: 20.1 /Corr: -

Temp Blank Present: yes no

Biological Tissue is Frozen: yes no

Temp should be above freezing to 6°C.

Biota Samples may be received at ≤ 0°C.

Person examining contents:

Date: 10/10/19

Initials: JW

Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1.
Chain of Custody Filled Out:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	2. <u>Invoice details not documented</u> <small>10/10/19</small>
Chain of Custody Relinquished:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	3.
Sampler Name & Signature on COC:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	4.
Samples Arrived within Hold Time: - VOA Samples frozen upon receipt	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	5. Date/Time: _____
Short Hold Time Analysis (<72hr):	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	6.
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	7.
Sufficient Volume: For Analysis: <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No MS/MSD: <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	8.	
Correct Containers Used: -Pace Containers Used: -Pace IR Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	9.
Containers Intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	10.
Filtered volume received for Dissolved tests	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	11.
Sample Labels match COC: -Includes date/time/ID/Analysis Matrix: <u>N</u>	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	12.
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	13.
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	
Pace Trip Blank Lot # (if purchased):		

Client Notification/ Resolution:

If checked, see attached form for additional comments

Person Contacted: _____

Date/Time: _____

Comments/ Resolution:

Project Manager Review:

BB for DM

Date: 10-10-19

A3 December 2019 Assessment Monitoring

December 26, 2019

Meghan Blodgett
SCS ENGINEERS
2830 Dairy Drive
Madison, WI 53718

RE: Project: 25219067 ALLIANT-COLUMBIA
Pace Project No.: 40200888

Dear Meghan Blodgett:

Enclosed are the analytical results for sample(s) received by the laboratory on December 17, 2019. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Dan Milewsky
dan.milewsky@pacelabs.com
(920)469-2436
Project Manager

Enclosures

cc: Tom Karwoski, SCS ENGINEERS
Nicole Kron, SCS ENGINEERS
Jeff Maxted, ALLIANT ENERGY
Marc Morandi, ALLIANT ENERGY



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: 25219067 ALLIANT-COLUMBIA
Pace Project No.: 40200888

Pace Analytical Services Green Bay

1241 Bellevue Street, Green Bay, WI 54302
Florida/NELAP Certification #: E87948
Illinois Certification #: 200050
Kentucky UST Certification #: 82
Louisiana Certification #: 04168
Minnesota Certification #: 055-999-334
New York Certification #: 12064
North Dakota Certification #: R-150

Virginia VELAP ID: 460263
South Carolina Certification #: 83006001
Texas Certification #: T104704529-14-1
Wisconsin Certification #: 405132750
Wisconsin DATCP Certification #: 105-444
USDA Soil Permit #: P330-16-00157
Federal Fish & Wildlife Permit #: LE51774A-0

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: 25219067 ALLIANT-COLUMBIA

Pace Project No.: 40200888

Lab ID	Sample ID	Matrix	Date Collected	Date Received
40200888001	MW 306	Water	12/13/19 14:05	12/17/19 09:20
40200888002	MW 307	Water	12/13/19 15:25	12/17/19 09:20
40200888003	MW 308	Water	12/13/19 11:40	12/17/19 09:20
40200888004	FIELD BLANK	Water	12/13/19 15:30	12/17/19 09:20

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: 25219067 ALLIANT-COLUMBIA

Pace Project No.: 40200888

Lab ID	Sample ID	Method	Analysts	Analytes Reported
40200888001	MW 306	EPA 6020	KXS	14
		EPA 7470	AJT	1
			HMG	7
		SM 2540C	TMK	1
		EPA 9040	ALY	1
		EPA 300.0	HMB	3
40200888002	MW 307	EPA 6020	KXS	14
		EPA 7470	AJT	1
			HMG	7
		SM 2540C	TMK	1
		EPA 9040	ALY	1
		EPA 300.0	HMB	3
40200888003	MW 308	EPA 6020	KXS	14
		EPA 7470	AJT	1
			HMG	7
		SM 2540C	TMK	1
		EPA 9040	ALY	1
		EPA 300.0	HMB	3
40200888004	FIELD BLANK	EPA 6020	KXS	14
		EPA 7470	AJT	1
		SM 2540C	TMK	1
		EPA 9040	ALY	1
		EPA 300.0	HMB	3

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: 25219067 ALLIANT-COLUMBIA

Pace Project No.: 40200888

Sample: MW 306	Lab ID: 40200888001	Collected: 12/13/19 14:05	Received: 12/17/19 09:20	Matrix: Water					
Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
6020 MET ICPMS	Analytical Method: EPA 6020 Preparation Method: EPA 3010								
Antimony	<0.15	ug/L	1.0	0.15	1	12/19/19 07:21	12/21/19 17:32	7440-36-0	
Arsenic	<0.28	ug/L	1.0	0.28	1	12/19/19 07:21	12/21/19 17:32	7440-38-2	
Barium	9.0	ug/L	2.3	0.70	1	12/19/19 07:21	12/21/19 17:32	7440-39-3	
Beryllium	<0.25	ug/L	1.0	0.25	1	12/19/19 07:21	12/21/19 17:32	7440-41-7	
Boron	121	ug/L	10.0	3.0	1	12/19/19 07:21	12/21/19 17:32	7440-42-8	
Cadmium	<0.15	ug/L	1.0	0.15	1	12/19/19 07:21	12/21/19 17:32	7440-43-9	
Calcium	83800	ug/L	2540	762	10	12/19/19 07:21	12/21/19 17:05	7440-70-2	P6
Chromium	4.1	ug/L	3.4	1.0	1	12/19/19 07:21	12/21/19 17:32	7440-47-3	
Cobalt	<0.12	ug/L	1.0	0.12	1	12/19/19 07:21	12/21/19 17:32	7440-48-4	
Lead	<0.24	ug/L	1.0	0.24	1	12/19/19 07:21	12/21/19 02:50	7439-92-1	
Lithium	2.2	ug/L	1.0	0.22	1	12/19/19 07:21	12/21/19 17:32	7439-93-2	
Molybdenum	5.8	ug/L	1.5	0.44	1	12/19/19 07:21	12/21/19 17:32	7439-98-7	
Selenium	0.54J	ug/L	1.1	0.32	1	12/19/19 07:21	12/21/19 17:32	7782-49-2	1q
Thallium	0.17J	ug/L	1.0	0.14	1	12/19/19 07:21	12/21/19 17:32	7440-28-0	
7470 Mercury	Analytical Method: EPA 7470 Preparation Method: EPA 7470								
Mercury	<0.084	ug/L	0.28	0.084	1	12/20/19 10:00	12/23/19 08:09	7439-97-6	
Field Data	Analytical Method:								
Field pH	7.29	Std. Units			1		12/13/19 14:05		
Field Specific Conductance	662	umhos/cm			1		12/13/19 14:05		
Oxygen, Dissolved	8.34	mg/L			1		12/13/19 14:05	7782-44-7	
REDOX	56.0	mV			1		12/13/19 14:05		
Turbidity	0.00	NTU			1		12/13/19 14:05		
Static Water Level	787.03	feet			1		12/13/19 14:05		
Temperature, Water (C)	11.6	deg C			1		12/13/19 14:05		
2540C Total Dissolved Solids	Analytical Method: SM 2540C								
Total Dissolved Solids	326	mg/L	20.0	8.7	1		12/19/19 16:46		
9040 pH	Analytical Method: EPA 9040								
pH at 25 Degrees C	7.3	Std. Units	0.10	0.010	1		12/20/19 11:35		H6
300.0 IC Anions	Analytical Method: EPA 300.0								
Chloride	0.76J	mg/L	2.0	0.43	1		12/18/19 21:50	16887-00-6	
Fluoride	<0.095	mg/L	0.32	0.095	1		12/18/19 21:50	16984-48-8	
Sulfate	7.6	mg/L	2.0	0.44	1		12/18/19 21:50	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: 25219067 ALLIANT-COLUMBIA

Pace Project No.: 40200888

Sample: MW 307	Lab ID: 40200888002	Collected: 12/13/19 15:25	Received: 12/17/19 09:20	Matrix: Water					
Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
6020 MET ICPMS	Analytical Method: EPA 6020 Preparation Method: EPA 3010								
Antimony	<0.15	ug/L	1.0	0.15	1	12/19/19 07:21	12/21/19 18:13	7440-36-0	
Arsenic	1.1	ug/L	1.0	0.28	1	12/19/19 07:21	12/21/19 18:13	7440-38-2	
Barium	15.9	ug/L	2.3	0.70	1	12/19/19 07:21	12/21/19 18:13	7440-39-3	
Beryllium	<0.25	ug/L	1.0	0.25	1	12/19/19 07:21	12/21/19 18:13	7440-41-7	
Boron	281	ug/L	10.0	3.0	1	12/19/19 07:21	12/21/19 18:13	7440-42-8	
Cadmium	<0.15	ug/L	1.0	0.15	1	12/19/19 07:21	12/21/19 18:13	7440-43-9	
Calcium	78700	ug/L	254	76.2	1	12/19/19 07:21	12/21/19 18:13	7440-70-2	
Chromium	<1.0	ug/L	3.4	1.0	1	12/19/19 07:21	12/21/19 18:13	7440-47-3	
Cobalt	0.46J	ug/L	1.0	0.12	1	12/19/19 07:21	12/21/19 18:13	7440-48-4	
Lead	<0.24	ug/L	1.0	0.24	1	12/19/19 07:21	12/21/19 03:30	7439-92-1	
Lithium	0.24J	ug/L	1.0	0.22	1	12/19/19 07:21	12/21/19 18:13	7439-93-2	
Molybdenum	0.72J	ug/L	1.5	0.44	1	12/19/19 07:21	12/21/19 18:13	7439-98-7	
Selenium	<0.32	ug/L	1.1	0.32	1	12/19/19 07:21	12/21/19 18:13	7782-49-2	1q
Thallium	0.21J	ug/L	1.0	0.14	1	12/19/19 07:21	12/21/19 18:13	7440-28-0	
7470 Mercury	Analytical Method: EPA 7470 Preparation Method: EPA 7470								
Mercury	<0.084	ug/L	0.28	0.084	1	12/20/19 10:00	12/23/19 08:16	7439-97-6	
Field Data	Analytical Method:								
Field pH	7.18	Std. Units			1		12/13/19 15:25		
Field Specific Conductance	752	umhos/cm			1		12/13/19 15:25		
Oxygen, Dissolved	0.33	mg/L			1		12/13/19 15:25	7782-44-7	
REDOX	-102.7	mV			1		12/13/19 15:25		
Turbidity	0.00	NTU			1		12/13/19 15:25		
Static Water Level	785.68	feet			1		12/13/19 15:25		
Temperature, Water (C)	12.0	deg C			1		12/13/19 15:25		
2540C Total Dissolved Solids	Analytical Method: SM 2540C								
Total Dissolved Solids	354	mg/L	20.0	8.7	1		12/19/19 16:46		
9040 pH	Analytical Method: EPA 9040								
pH at 25 Degrees C	7.2	Std. Units	0.10	0.010	1		12/20/19 11:37		H6
300.0 IC Anions	Analytical Method: EPA 300.0								
Chloride	16.0	mg/L	10.0	2.2	5		12/18/19 22:03	16887-00-6	
Fluoride	<0.48	mg/L	1.6	0.48	5		12/18/19 22:03	16984-48-8	D3
Sulfate	15.5	mg/L	10.0	2.2	5		12/18/19 22:03	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: 25219067 ALLIANT-COLUMBIA

Pace Project No.: 40200888

Sample: MW 308	Lab ID: 40200888003	Collected: 12/13/19 11:40	Received: 12/17/19 09:20	Matrix: Water					
Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
6020 MET ICPMS	Analytical Method: EPA 6020 Preparation Method: EPA 3010								
Antimony	<0.15	ug/L	1.0	0.15	1	12/19/19 07:21	12/21/19 18:26	7440-36-0	
Arsenic	3.5	ug/L	1.0	0.28	1	12/19/19 07:21	12/21/19 18:26	7440-38-2	
Barium	62.4	ug/L	2.3	0.70	1	12/19/19 07:21	12/21/19 18:26	7440-39-3	
Beryllium	<0.25	ug/L	1.0	0.25	1	12/19/19 07:21	12/21/19 18:26	7440-41-7	
Boron	647	ug/L	10.0	3.0	1	12/19/19 07:21	12/21/19 18:26	7440-42-8	
Cadmium	<0.15	ug/L	1.0	0.15	1	12/19/19 07:21	12/21/19 18:26	7440-43-9	
Calcium	130000	ug/L	254	76.2	1	12/19/19 07:21	12/21/19 18:26	7440-70-2	
Chromium	<1.0	ug/L	3.4	1.0	1	12/19/19 07:21	12/21/19 18:26	7440-47-3	
Cobalt	<0.12	ug/L	1.0	0.12	1	12/19/19 07:21	12/21/19 18:26	7440-48-4	
Lead	<0.24	ug/L	1.0	0.24	1	12/19/19 07:21	12/21/19 03:44	7439-92-1	
Lithium	<0.22	ug/L	1.0	0.22	1	12/19/19 07:21	12/21/19 18:26	7439-93-2	
Molybdenum	3.0	ug/L	1.5	0.44	1	12/19/19 07:21	12/21/19 18:26	7439-98-7	
Selenium	<0.32	ug/L	1.1	0.32	1	12/19/19 07:21	12/21/19 18:26	7782-49-2	1q
Thallium	<0.14	ug/L	1.0	0.14	1	12/19/19 07:21	12/21/19 18:26	7440-28-0	
7470 Mercury	Analytical Method: EPA 7470 Preparation Method: EPA 7470								
Mercury	<0.084	ug/L	0.28	0.084	1	12/20/19 10:00	12/23/19 08:19	7439-97-6	
Field Data	Analytical Method:								
Field pH	7.25	Std. Units			1		12/13/19 11:40		
Field Specific Conductance	1051	umhos/cm			1		12/13/19 11:40		
Oxygen, Dissolved	0.40	mg/L			1		12/13/19 11:40	7782-44-7	
REDOX	-154.9	mV			1		12/13/19 11:40		
Turbidity	0.00	NTU			1		12/13/19 11:40		
Static Water Level	786.43	feet			1		12/13/19 11:40		
Temperature, Water (C)	12.0	deg C			1		12/13/19 11:40		
2540C Total Dissolved Solids	Analytical Method: SM 2540C								
Total Dissolved Solids	504	mg/L	20.0	8.7	1		12/19/19 16:47		
9040 pH	Analytical Method: EPA 9040								
pH at 25 Degrees C	7.2	Std. Units	0.10	0.010	1		12/20/19 11:39		H6
300.0 IC Anions	Analytical Method: EPA 300.0								
Chloride	2.3J	mg/L	10.0	2.2	5		12/18/19 22:56	16887-00-6	D3
Fluoride	<0.48	mg/L	1.6	0.48	5		12/18/19 22:56	16984-48-8	D3
Sulfate	<2.2	mg/L	10.0	2.2	5		12/18/19 22:56	14808-79-8	D3

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: 25219067 ALLIANT-COLUMBIA

Pace Project No.: 40200888

Sample: FIELD BLANK	Lab ID: 40200888004	Collected: 12/13/19 15:30	Received: 12/17/19 09:20	Matrix: Water					
Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
6020 MET ICPMS	Analytical Method: EPA 6020 Preparation Method: EPA 3010								
Antimony	<0.15	ug/L	1.0	0.15	1	12/19/19 07:21	12/21/19 16:51	7440-36-0	
Arsenic	<0.28	ug/L	1.0	0.28	1	12/19/19 07:21	12/21/19 16:51	7440-38-2	
Barium	<0.70	ug/L	2.3	0.70	1	12/19/19 07:21	12/21/19 16:51	7440-39-3	
Beryllium	<0.25	ug/L	1.0	0.25	1	12/19/19 07:21	12/21/19 16:51	7440-41-7	
Boron	<3.0	ug/L	10.0	3.0	1	12/19/19 07:21	12/21/19 16:51	7440-42-8	
Cadmium	<0.15	ug/L	1.0	0.15	1	12/19/19 07:21	12/21/19 16:51	7440-43-9	
Calcium	<76.2	ug/L	254	76.2	1	12/19/19 07:21	12/21/19 16:51	7440-70-2	
Chromium	2.1J	ug/L	3.4	1.0	1	12/19/19 07:21	12/21/19 16:51	7440-47-3	
Cobalt	<0.12	ug/L	1.0	0.12	1	12/19/19 07:21	12/21/19 16:51	7440-48-4	
Lead	<0.24	ug/L	1.0	0.24	1	12/19/19 07:21	12/21/19 02:09	7439-92-1	
Lithium	<0.22	ug/L	1.0	0.22	1	12/19/19 07:21	12/21/19 16:51	7439-93-2	
Molybdenum	<0.44	ug/L	1.5	0.44	1	12/19/19 07:21	12/21/19 16:51	7439-98-7	
Selenium	<0.32	ug/L	1.1	0.32	1	12/19/19 07:21	12/21/19 16:51	7782-49-2	1q
Thallium	<0.14	ug/L	1.0	0.14	1	12/19/19 07:21	12/21/19 16:51	7440-28-0	
7470 Mercury	Analytical Method: EPA 7470 Preparation Method: EPA 7470								
Mercury	<0.084	ug/L	0.28	0.084	1	12/20/19 10:00	12/23/19 08:21	7439-97-6	
2540C Total Dissolved Solids	Analytical Method: SM 2540C								
Total Dissolved Solids	<8.7	mg/L	20.0	8.7	1		12/19/19 16:47		
9040 pH	Analytical Method: EPA 9040								
pH at 25 Degrees C	6.3	Std. Units	0.10	0.010	1		12/20/19 11:42		H6
300.0 IC Anions	Analytical Method: EPA 300.0								
Chloride	<0.43	mg/L	2.0	0.43	1		12/18/19 23:09	16887-00-6	
Fluoride	<0.095	mg/L	0.32	0.095	1		12/18/19 23:09	16984-48-8	
Sulfate	<0.44	mg/L	2.0	0.44	1		12/18/19 23:09	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: 25219067 ALLIANT-COLUMBIA

Pace Project No.: 40200888

QC Batch:	343991	Analysis Method:	EPA 7470
QC Batch Method:	EPA 7470	Analysis Description:	7470 Mercury
Associated Lab Samples:	40200888001, 40200888002, 40200888003, 40200888004		

METHOD BLANK: 1996911 Matrix: Water

Associated Lab Samples: 40200888001, 40200888002, 40200888003, 40200888004

Parameter	Units	Blank Result	Reporting Limit	Analyzed	Qualifiers
Mercury	ug/L	<0.084	0.28	12/23/19 08:05	

LABORATORY CONTROL SAMPLE: 1996912

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Mercury	ug/L	5	5.2	105	85-115	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 1996913 1996914

Parameter	Units	MS Result	MSD Spike Conc.	MSD Spike Conc.	MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
Mercury	ug/L	<0.084	5	5	5.1	5.0	103	100	85-115	3	20	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,

without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: 25219067 ALLIANT-COLUMBIA

Pace Project No.: 40200888

QC Batch:	343849	Analysis Method:	EPA 6020
QC Batch Method:	EPA 3010	Analysis Description:	6020 MET
Associated Lab Samples:	40200888001, 40200888002, 40200888003, 40200888004		

METHOD BLANK: 1996122 Matrix: Water

Associated Lab Samples: 40200888001, 40200888002, 40200888003, 40200888004

Parameter	Units	Blank Result	Reporting Limit	Analyzed	Qualifiers
Antimony	ug/L	<0.15	1.0	12/21/19 16:44	
Arsenic	ug/L	<0.28	1.0	12/21/19 16:44	
Barium	ug/L	<0.70	2.3	12/21/19 16:44	
Beryllium	ug/L	<0.25	1.0	12/21/19 16:44	
Boron	ug/L	<3.0	10.0	12/21/19 16:44	
Cadmium	ug/L	<0.15	1.0	12/21/19 16:44	
Calcium	ug/L	<76.2	254	12/21/19 16:44	
Chromium	ug/L	<1.0	3.4	12/21/19 16:44	
Cobalt	ug/L	<0.12	1.0	12/21/19 16:44	
Lead	ug/L	<0.24	1.0	12/21/19 02:02	
Lithium	ug/L	<0.22	1.0	12/21/19 16:44	
Molybdenum	ug/L	<0.44	1.5	12/21/19 16:44	
Selenium	ug/L	<0.32	1.1	12/21/19 16:44	
Thallium	ug/L	<0.14	1.0	12/21/19 16:44	

LABORATORY CONTROL SAMPLE: 1996123

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Antimony	ug/L	500	511	102	80-120	
Arsenic	ug/L	500	488	98	80-120	
Barium	ug/L	500	482	96	80-120	
Beryllium	ug/L	500	471	94	80-120	
Boron	ug/L	500	468	94	80-120	
Cadmium	ug/L	500	505	101	80-120	
Calcium	ug/L	5000	4960	99	80-120	
Chromium	ug/L	500	483	97	80-120	
Cobalt	ug/L	500	459	92	80-120	
Lead	ug/L	500	470	94	80-120	
Lithium	ug/L	500	459	92	80-120	
Molybdenum	ug/L	500	498	100	80-120	
Selenium	ug/L	500	511	102	80-120	
Thallium	ug/L	500	448	90	80-120	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 1996124 1996125

Parameter	Units	MS		MSD		MS Result	MS % Rec	MSD Result	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
		40200888001	Spike Conc.	Spike Conc.	MS Result								
Antimony	ug/L	<0.15	500	500	517	520	103	104	75-125	1	20		

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,

without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: 25219067 ALLIANT-COLUMBIA

Pace Project No.: 40200888

Parameter	Units	40200888001		MSD		1996124		1996125		Max			
		Result	Spike Conc.	Spike	MS	MS Result	MSD	MS % Rec	MSD % Rec	% Rec	RPD	RPD	Qual
				Conc.	Result	Result	% Rec	Limits					
Arsenic	ug/L	<0.28	500	500	504	500	101	100	75-125	1	20		
Barium	ug/L	9.0	500	500	500	498	98	98	75-125	0	20		
Beryllium	ug/L	<0.25	500	500	486	489	97	98	75-125	1	20		
Boron	ug/L	121	500	500	619	610	100	98	75-125	1	20		
Cadmium	ug/L	<0.15	500	500	505	504	101	101	75-125	0	20		
Calcium	ug/L	83800	5000	5000	93100	92200	186	169	75-125	1	20	P6	
Chromium	ug/L	4.1	500	500	494	489	98	97	75-125	1	20		
Cobalt	ug/L	<0.12	500	500	467	462	93	92	75-125	1	20		
Lead	ug/L	<0.24	500	500	485	481	97	96	75-125	1	20		
Lithium	ug/L	2.2	500	500	484	481	96	96	75-125	1	20		
Molybdenum	ug/L	5.8	500	500	519	517	103	102	75-125	0	20		
Selenium	ug/L	0.54J	500	500	521	514	104	103	75-125	1	20		
Thallium	ug/L	0.17J	500	500	455	455	91	91	75-125	0	20		

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: 25219067 ALLIANT-COLUMBIA

Pace Project No.: 40200888

QC Batch: 343898 Analysis Method: SM 2540C

QC Batch Method: SM 2540C Analysis Description: 2540C Total Dissolved Solids

Associated Lab Samples: 40200888001, 40200888002, 40200888003, 40200888004

METHOD BLANK: 1996444 Matrix: Water

Associated Lab Samples: 40200888001, 40200888002, 40200888003, 40200888004

Parameter	Units	Blank Result	Reporting Limit	Analyzed	Qualifiers
Total Dissolved Solids	mg/L	<8.7	20.0	12/19/19 16:43	

LABORATORY CONTROL SAMPLE: 1996445

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Total Dissolved Solids	mg/L	547	586	107	80-120	

SAMPLE DUPLICATE: 1996446

Parameter	Units	40200775001 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	510	504	1	10	

SAMPLE DUPLICATE: 1996447

Parameter	Units	40200888001 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	326	318	2	10	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,

without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: 25219067 ALLIANT-COLUMBIA

Pace Project No.: 40200888

QC Batch: 343989 Analysis Method: EPA 9040

QC Batch Method: EPA 9040 Analysis Description: 9040 pH

Associated Lab Samples: 40200888001, 40200888002, 40200888003, 40200888004

SAMPLE DUPLICATE: 1996906

Parameter	Units	Result	Dup Result	RPD	Max RPD	Qualifiers
pH at 25 Degrees C	Std. Units	7.6	7.6	0	20	H6

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,

without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: 25219067 ALLIANT-COLUMBIA

Pace Project No.: 40200888

QC Batch:	343670	Analysis Method:	EPA 300.0
QC Batch Method:	EPA 300.0	Analysis Description:	300.0 IC Anions
Associated Lab Samples:	40200888001, 40200888002, 40200888003, 40200888004		

METHOD BLANK: 1995185 Matrix: Water

Associated Lab Samples: 40200888001, 40200888002, 40200888003, 40200888004

Parameter	Units	Blank	Reporting	Analyzed	Qualifiers
		Result	Limit		
Chloride	mg/L	<0.43	2.0	12/18/19 21:23	
Fluoride	mg/L	<0.095	0.32	12/18/19 21:23	
Sulfate	mg/L	<0.44	2.0	12/18/19 21:23	

LABORATORY CONTROL SAMPLE: 1995186

Parameter	Units	Spike	LCS	LCS	% Rec	Qualifiers
		Conc.	Result	% Rec	Limits	
Chloride	mg/L	20	20.0	100	90-110	
Fluoride	mg/L	2	1.9	96	90-110	
Sulfate	mg/L	20	19.9	99	90-110	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 1995187 1995188

Parameter	Units	MS		MSD		MS	MSD	MS	MSD	% Rec	Limits	RPD	RPD	Max
		40200794004	Result	Spike	Conc.									
Chloride	mg/L	40.9	100	100	145	145	145	104	104	90-110	0	15		
Fluoride	mg/L	ND	10	10	10.2	10.2	10.2	102	102	90-110	1	15		
Sulfate	mg/L	17.4	100	100	121	121	121	103	104	90-110	0	15		

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,

without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: 25219067 ALLIANT-COLUMBIA
Pace Project No.: 40200888

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above LOD.

J - Estimated concentration at or above the LOD and below the LOQ.

LOD - Limit of Detection adjusted for dilution factor, percent moisture, initial weight and final volume.

LOQ - Limit of Quantitation adjusted for dilution factor, percent moisture, initial weight and final volume.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected at or above the adjusted LOD.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

ANALYTE QUALIFIERS

1q Analyte was measured in the associated method blank at -0.34 ug/L.

D3 Sample was diluted due to the presence of high levels of non-target analytes or other matrix interference.

H6 Analysis initiated outside of the 15 minute EPA required holding time.

P6 Matrix spike recovery was outside laboratory control limits due to a parent sample concentration notably higher than the spike level.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: 25219067 ALLIANT-COLUMBIA
Pace Project No.: 40200888

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
40200888001	MW 306	EPA 3010	343849	EPA 6020	343915
40200888002	MW 307	EPA 3010	343849	EPA 6020	343915
40200888003	MW 308	EPA 3010	343849	EPA 6020	343915
40200888004	FIELD BLANK	EPA 3010	343849	EPA 6020	343915
40200888001	MW 306	EPA 7470	343991	EPA 7470	344031
40200888002	MW 307	EPA 7470	343991	EPA 7470	344031
40200888003	MW 308	EPA 7470	343991	EPA 7470	344031
40200888004	FIELD BLANK	EPA 7470	343991	EPA 7470	344031
40200888001	MW 306				
40200888002	MW 307				
40200888003	MW 308				
40200888001	MW 306	SM 2540C	343898		
40200888002	MW 307	SM 2540C	343898		
40200888003	MW 308	SM 2540C	343898		
40200888004	FIELD BLANK	SM 2540C	343898		
40200888001	MW 306	EPA 9040	343989		
40200888002	MW 307	EPA 9040	343989		
40200888003	MW 308	EPA 9040	343989		
40200888004	FIELD BLANK	EPA 9040	343989		
40200888001	MW 306	EPA 300.0	343670		
40200888002	MW 307	EPA 300.0	343670		
40200888003	MW 308	EPA 300.0	343670		
40200888004	FIELD BLANK	EPA 300.0	343670		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

Pace Container Order #573266

40200888

Order By :

Company SCS ENGINEERS
 Contact Blodgett, Meghan
 Email mblodgett@scsengineers.com
 Address 2830 Dairy Drive
 Address 2
 City Madison
 State WI Zip 53718
 Phone 608-216-7362

Ship To :

Company SCS ENGINEERS (Pace Analytical)
 Contact Paul Grover
 Email pgrover@scsengineers.com
 Address 2830 Dairy Drive
 Address 2
 City Madison
 State WI Zip 53718
 Phone 608-216-7362

Return To:

Company Pace Analytical Green Bay
 Contact Milewsky, Dan
 Email dan.milewsky@pacelabs.com
 Address 1241 Bellevue Street
 Address 2 Suite 9
 City Green Bay
 State WI Zip 54302
 Phone (920)469-2436

Info

Project Name 25219067 Columbia CCR
 Project Milewsky, Dan

Due Date 12/09/2019

Profile x

Quote

Return

Carrier Most Economical

Locatio

Trip Blanks

Include Trip Blanks

Bottle Labels

Blank
 Pre-Printed No Sample IDs
 Pre-Printed With Sample IDs

Bottles

Boxed Cases
 Individually Wrapped
 Grouped By Sample

Return Shipping Labels

No Shipper
 With Shipper

Misc

Sampling Instructions
 Custody Seal
 Temp. Blanks
 Coolers
 Syringes

Extra Bubble Wrap
 Short Hold/Rush
 DI 3 Liter(s)
 USDA Regulated Soils

COC Options

Number of Blanks 2
 Pre-Printed

# of Samples	Matrix	Test	Container	Total	# of	Lot #	Notes
4	WT	Radium 226	1L Plastic HNO3 pres	5	1	090219-2EEY	
4	WT	Radium 228	1L Plastic HNO3 pres	4	0	090219-2EEY	
5	WT	Metals	250mL plastic w/HNO3	5	0	M-9-276-02BB	
5	WT	pH	250mL plastic unpres	5	0	M-9-221-04BB	
5	WT	TDS, Cl, F, SO4	250mL plastic unpres	5	0	M-9-221-04BB	

Hazard Shipping Placard In Place : NA

*Sample receiving hours are Monday through Friday 8:00 am to 6:00 pm and Saturday from 9:00 am to 12:00 pm unless special arrangements are made with your project manager.

*Pace Analytical reserves the right to return hazardous, toxic, or radioactive samples to you.

*Pace Analytical reserves the right to charge for unused bottles, as well as cost associated with sample

*Payment term are net 30 days.

*Please include the proposal number on the chain of custody to insure proper billing.

LAB USE:

Ship Date : 12/06/2019

Prepared By: Mai Yer Her

Verified By:

Sample

Full List Metals = B, Ca, Sb, As, Ba, Be, Cd, Cr, Co, Pb, Li Hg, Mo, Se, Ti
 ALL SAMPLES UNFILTERED

CLIENT USE (Optional):

Date Rec'd:

Received By:

Verified By:

4020088

Table 2. Sampling Points and Parameters - CCR Rule Sampling Program
Groundwater Monitoring - Columbia Energy Center / SCS Engineers Project #25219067

		Secondary Pond			
Parameter		MW-306	MW-307	MW-308	FIELD BLANK - SCPOND
Appendix III Parameters (Detection Monitoring)	Boron	X	X	X	X
	Calcium	X	X	X	X
	Chloride	X	X	X	X
	Fluoride	X	X	X	X
	pH	X	X	X	X
	Sulfate	X	X	X	X
	TDS	X	X	X	X
	Antimony	X	X	X	X
	Arsenic	X	X	X	X
	Barium	X	X	X	X
Appendix IV Parameters (Assessment Monitoring)	Beryllium	X	X	X	X
	Cadmium	X	X	X	X
	Chromium	X	X	X	X
	Cobalt	X	X	X	X
	Fluoride	X	X	X	X
	Lead	X	X	X	X
	Lithium	X	X	X	X
	Mercury	X	X	X	X
	Molybdenum	X	X	X	X
	Selenium	X	X	X	X
	Thallium	X	X	X	X
	Radium 226+228	X	X	X	X
	Groundwater Elevation	X	X	X	
	pH	X	X	X	
CCR Rule Field Parameters	Well Depth	X	X	X	
	Specific Conductance	X	X	X	
	Dissolved Oxygen	X	X	X	
	ORP	X	X	X	
	Temperature	X	X	X	
	Turbidity	X	X	X	
	Color	X	X	X	
	Odor	X	X	X	
Low-Flow Sampling Field Parameters					

Notes: All samples are unfiltered (total).

Sample Preservation Receipt Form

Client Name: SCS

Project # W020088

All containers needing preservation have been checked and noted below: Yes No DNA

Lab Lot# of pH paper:

0153581

Lab Std #ID of preservation (if pH adjusted):

Initial when completed: BR Date/
Time:

Pace Lab #	Glass		Plastic		Vials		Jars		General		VOA Vials (>6mm) *	H2SO4 pH ≤	NaOH+Zn Act pH ≥9	NaOH pH ≥12	HNO3 pH ≤	pH after adjusted	Volume (mL)								
	AG1U	AG1H	AG4S	AG4U	AG5U	AG2S	BG3U	BP1U	BP2N	BP2Z	BP3U	BP3B	BP3N	BP3S	DG9A	DG9T	VG9U	VG9H	VG9M	VG9D	JGFU	WGFU	WPFU	SP5T	ZPLC
001																									
002																									
003																									
004																									
005																									
006																									
007																									
008																									
009																									
010																									
011																									
012																									
013																									
014																									
015																									
016																									
017																									
018																									
019																									
020																									

Exceptions to preservation check: VOA, Coliform, TOC, TOX, TOH, O&G, WIDRO, Phenolics, Other: _____

Headspace in VOA Vials (>6mm): Yes No If yes look in headspace column

AG1U	1 liter amber glass	BP1U	1 liter plastic unpres	DG9A	40 mL amber ascorbic	JGFU	4 oz amber jar unpres
AG1H	1 liter amber glass HCL	BP2N	500 mL plastic HNO3	DG9T	40 mL amber Na Thio	WGFU	4 oz clear jar unpres
AG4S	125 mL amber glass H2SO4	BP2Z	500 mL plastic NaOH, Znact	VG9U	40 mL clear vial unpres	WPFU	4 oz plastic jar unpres
AG4U	120 mL amber glass unpres	BP3U	250 mL plastic unpres	VG9H	40 mL clear vial HCL		
AG5U	100 mL amber glass unpres	BP3B	250 mL plastic NaOH	VG9M	40 mL clear vial MeOH	SP5T	120 mL plastic Na Thiosulfate
AG2S	500 mL amber glass H2SO4	BP3N	250 mL plastic HNO3	VG9D	40 mL clear vial DI	ZPLC	Ziploc bag
BG3U	250 mL clear glass unpres	BP3S	250 mL plastic H2SO4	GN:	12-17-11-12		



Document Name:	Sample Condition Upon Receipt (SCUR)	Document Revised: 25Apr2018
Document No.:	F-GB-C-031-Rev.07	Issuing Authority: Pace Green Bay Quality Office

Sample Condition Upon Receipt Form (SCUR)

Client Name: SGS

Project #:

Courier: CS Logistics FedEx Speedee UPS Waltco
 Client Pace Other: _____

WO# : 40200888



40200888

Tracking #:

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Custody Seal on Samples Present: yes no Seals intact: yes no

Packing Material: Bubble Wrap Bubble Bags None Other

Thermometer Used SR - B Type of Ice: Wet Blue Dry None Samples on ice, cooling process has begun

Cooler Temperature Uncorr: 2.0 /Corr: 2.0

Temp Blank Present: yes no

Biological Tissue is Frozen: yes no

Temp should be above freezing to 6°C.

Biota Samples may be received at ≤ 0°C.

Person examining contents:

Date: 12-17-19

Initials: BP

Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1. <u>12-17-19 BP</u>
Chain of Custody Filled Out:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	2. <u>NO MAIL INFORMATION, MAIL INFORMATION, NO</u>
Chain of Custody Relinquished:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	3. <u>NUMBER 12-17-19 BP</u>
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	4.
Samples Arrived within Hold Time:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	5.
- VOA Samples frozen upon receipt	<input type="checkbox"/> Yes <input type="checkbox"/> No	Date/Time:
Short Hold Time Analysis (<72hr):	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	6.
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	7.
Sufficient Volume:		8.
For Analysis: <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	MS/MSD: <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	
Correct Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	9.
-Pace Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
-Pace IR Containers Used:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
Containers Intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	10.
Filtered volume received for Dissolved tests	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	11.
Sample Labels match COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	12.
-Includes date/time/ID/Analysis Matrix:	<u>W</u>	
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	13.
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
Pace Trip Blank Lot # (if purchased):		

Client Notification/ Resolution:

If checked, see attached form for additional comments

Person Contacted: _____ Date/Time: _____

Comments/ Resolution: _____

Project Manager Review: Ar for Drm

Date: 12/17/19

January 08, 2020

Meghan Blodgett
SCS ENGINEERS
2830 Dairy Drive
Madison, WI 53718

RE: Project: 25219067 ALLIANT-COLUMBIA
Pace Project No.: 40200891

Dear Meghan Blodgett:

Enclosed are the analytical results for sample(s) received by the laboratory on December 17, 2019. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Dan Milewsky
dan.milewsky@pacelabs.com
(920)469-2436
Project Manager

Enclosures

cc: Tom Karwoski, SCS ENGINEERS
Nicole Kron, SCS ENGINEERS
Jeff Maxted, ALLIANT ENERGY
Marc Morandi, ALLIANT ENERGY



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: 25219067 ALLIANT-COLUMBIA
 Pace Project No.: 40200891

Pace Analytical Services Pennsylvania

1638 Roseytown Rd Suites 2,3&4, Greensburg, PA 15601
 ANAB DOD-ELAP Rad Accreditation #: L2417
 Alabama Certification #: 41590
 Arizona Certification #: AZ0734
 Arkansas Certification
 California Certification #: 04222CA
 Colorado Certification #: PA01547
 Connecticut Certification #: PH-0694
 Delaware Certification
 EPA Region 4 DW Rad
 Florida/TNI Certification #: E87683
 Georgia Certification #: C040
 Florida: Cert E871149 SEKS WET
 Guam Certification
 Hawaii Certification
 Idaho Certification
 Illinois Certification
 Indiana Certification
 Iowa Certification #: 391
 Kansas/TNI Certification #: E-10358
 Kentucky Certification #: KY90133
 KY WW Permit #: KY0098221
 KY WW Permit #: KY0000221
 Louisiana DHH/TNI Certification #: LA180012
 Louisiana DEQ/TNI Certification #: 4086
 Maine Certification #: 2017020
 Maryland Certification #: 308
 Massachusetts Certification #: M-PA1457
 Michigan/PADEP Certification #: 9991
 Missouri Certification #: 235
 Montana Certification #: Cert0082
 Nebraska Certification #: NE-OS-29-14
 Nevada Certification #: PA014572018-1
 New Hampshire/TNI Certification #: 297617
 New Jersey/TNI Certification #: PA051
 New Mexico Certification #: PA01457
 New York/TNI Certification #: 10888
 North Carolina Certification #: 42706
 North Dakota Certification #: R-190
 Ohio EPA Rad Approval: #41249
 Oregon/TNI Certification #: PA200002-010
 Pennsylvania/TNI Certification #: 65-00282
 Puerto Rico Certification #: PA01457
 Rhode Island Certification #: 65-00282
 South Dakota Certification
 Tennessee Certification #: 02867
 Texas/TNI Certification #: T104704188-17-3
 Utah/TNI Certification #: PA014572017-9
 USDA Soil Permit #: P330-17-00091
 Vermont Dept. of Health: ID# VT-0282
 Virgin Island/PADEP Certification
 Virginia/VELAP Certification #: 9526
 Washington Certification #: C868
 West Virginia DEP Certification #: 143
 West Virginia DHHR Certification #: 9964C
 Wisconsin Approve List for Rad
 Wyoming Certification #: 8TMS-L

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
 without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: 25219067 ALLIANT-COLUMBIA

Pace Project No.: 40200891

Lab ID	Sample ID	Matrix	Date Collected	Date Received
40200891001	MW 306	Water	12/13/19 14:05	12/17/19 09:20
40200891002	MW 307	Water	12/13/19 15:25	12/17/19 09:20
40200891003	MW 308	Water	12/13/19 11:40	12/17/19 09:20
40200891004	FIELD BLANK	Water	12/13/19 15:30	12/17/19 09:20

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: 25219067 ALLIANT-COLUMBIA
Pace Project No.: 40200891

Lab ID	Sample ID	Method	Analysts	Analytes Reported	Laboratory
40200891001	MW 306	EPA 903.1	MK1	1	PASI-PA
		EPA 904.0	VAL	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
40200891002	MW 307	EPA 903.1	MK1	1	PASI-PA
		EPA 904.0	VAL	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
40200891003	MW 308	EPA 903.1	MK1	1	PASI-PA
		EPA 904.0	VAL	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
40200891004	FIELD BLANK	EPA 903.1	MK1	1	PASI-PA
		EPA 904.0	VAL	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: 25219067 ALLIANT-COLUMBIA

Pace Project No.: 40200891

Sample: MW 306	Lab ID: 40200891001	Collected: 12/13/19 14:05	Received: 12/17/19 09:20	Matrix: Water
PWS:	Site ID:	Sample Type:		
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed
Radium-226	EPA 903.1	0.000 ± 0.428 (0.875) C:NA T:90%	pCi/L	01/07/20 15:32
Radium-228	EPA 904.0	0.323 ± 0.412 (0.878) C:76% T:87%	pCi/L	01/07/20 14:04
Total Radium	Total Radium Calculation	0.323 ± 0.840 (1.75)	pCi/L	01/08/20 10:39
<hr/>				
Sample: MW 307	Lab ID: 40200891002	Collected: 12/13/19 15:25	Received: 12/17/19 09:20	Matrix: Water
PWS:	Site ID:	Sample Type:		
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed
Radium-226	EPA 903.1	-0.0613 ± 0.360 (0.803) C:NA T:91%	pCi/L	01/07/20 15:32
Radium-228	EPA 904.0	0.188 ± 0.367 (0.806) C:80% T:87%	pCi/L	01/07/20 14:12
Total Radium	Total Radium Calculation	0.188 ± 0.727 (1.61)	pCi/L	01/08/20 10:39
<hr/>				
Sample: MW 308	Lab ID: 40200891003	Collected: 12/13/19 11:40	Received: 12/17/19 09:20	Matrix: Water
PWS:	Site ID:	Sample Type:		
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed
Radium-226	EPA 903.1	0.0522 ± 0.271 (0.562) C:NA T:89%	pCi/L	01/07/20 15:32
Radium-228	EPA 904.0	0.681 ± 0.432 (0.828) C:80% T:87%	pCi/L	01/07/20 14:03
Total Radium	Total Radium Calculation	0.733 ± 0.703 (1.39)	pCi/L	01/08/20 10:39
<hr/>				
Sample: FIELD BLANK	Lab ID: 40200891004	Collected: 12/13/19 15:30	Received: 12/17/19 09:20	Matrix: Water
PWS:	Site ID:	Sample Type:		
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed
Radium-226	EPA 903.1	0.675 ± 0.567 (0.844) C:NA T:84%	pCi/L	01/07/20 15:43
Radium-228	EPA 904.0	0.575 ± 0.401 (0.782) C:83% T:86%	pCi/L	01/07/20 14:12
Total Radium	Total Radium Calculation	1.25 ± 0.968 (1.63)	pCi/L	01/08/20 10:39

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: 25219067 ALLIANT-COLUMBIA

Pace Project No.: 40200891

QC Batch: 377035 Analysis Method: EPA 904.0
QC Batch Method: EPA 904.0 Analysis Description: 904.0 Radium 228
Associated Lab Samples: 40200891001, 40200891002, 40200891003, 40200891004

METHOD BLANK: 1828979 Matrix: Water

Associated Lab Samples: 40200891001, 40200891002, 40200891003, 40200891004

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-228	0.221 ± 0.317 (0.681) C:86% T:84%	pCi/L	01/07/20 14:05	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: 25219067 ALLIANT-COLUMBIA

Pace Project No.: 40200891

QC Batch: 377033 Analysis Method: EPA 903.1
QC Batch Method: EPA 903.1 Analysis Description: 903.1 Radium-226
Associated Lab Samples: 40200891001, 40200891002, 40200891003, 40200891004

METHOD BLANK: 1828978 Matrix: Water

Associated Lab Samples: 40200891001, 40200891002, 40200891003, 40200891004

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-226	-0.0547 ± 0.284 (0.656) C:NA T:77%	pCi/L	01/07/20 15:07	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: 25219067 ALLIANT-COLUMBIA

Pace Project No.: 40200891

DEFINITIONS

Act - Activity

Unc - Uncertainty: SDWA = 1.96 sigma count uncertainty, all other matrices = Expanded Uncertainty (95% confidence interval).

Gamma Spec = Expanded Uncertainty (95.4% Confidence Interval)

(MDC) - Minimum Detectable Concentration

Trac - Tracer Recovery (%)

Carr - Carrier Recovery (%)

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above LOD.

J - Estimated concentration at or above the LOD and below the LOQ.

LOD - Limit of Detection adjusted for dilution factor, percent moisture, initial weight and final volume.

LOQ - Limit of Quantitation adjusted for dilution factor, percent moisture, initial weight and final volume.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected at or above the adjusted LOD.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

LABORATORIES

PASI-PA Pace Analytical Services - Greensburg

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: 25219067 ALLIANT-COLUMBIA
 Pace Project No.: 40200891

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
40200891001	MW 306	EPA 903.1	377033		
40200891002	MW 307	EPA 903.1	377033		
40200891003	MW 308	EPA 903.1	377033		
40200891004	FIELD BLANK	EPA 903.1	377033		
40200891001	MW 306	EPA 904.0	377035		
40200891002	MW 307	EPA 904.0	377035		
40200891003	MW 308	EPA 904.0	377035		
40200891004	FIELD BLANK	EPA 904.0	377035		
40200891001	MW 306	Total Radium Calculation	378421		
40200891002	MW 307	Total Radium Calculation	378421		
40200891003	MW 308	Total Radium Calculation	378421		
40200891004	FIELD BLANK	Total Radium Calculation	378421		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
 without the written consent of Pace Analytical Services, LLC.

Sample Preservation Receipt Form

Client Name: SCS

Project # 102084

All containers needing preservation have been checked and noted below: Yes No DNA

Lab Lot# of pH paper: 6/53581

Lab Std #ID of preservation (if pH adjusted):

Initial when completed: B/2 Date/ Time:

Pace Analytical Services, LLC
1241 Bellevue Street, Suite 9
Green Bay, WI 54302

Page 11 of 12

Pace Lab #	Glass		Plastic		Vials		Jars		General		VOA Vials (>6mm) *	H2SO4 pH ≤ 2	NaOH+Zn Act pH ≥ 9	NaOH pH ≥ 12	HNO3 pH ≤ 2	pH after adjusted	Volume (mL)								
	AG1U	AG1H	AG4S	AG4U	AG5U	AG2S	BG3U	BP1U	BP2N	BP2Z	BP3U	BP3B	BP3N	BP3S	DG9A	DG9T	VG9U	VG9H	VG9M	VG9D	JGFU	WGFU	WPFU	SP5T	ZPLC
001																									
002																									
003																									
004																									
005																									
006																									
007																									
008																									
009																									
010																									
011																									
012																									
013																									
014																									
015																									
016																									
017																									
018																									
019																									
020																									

Exceptions to preservation check: VOA, Coliform, TOC, TOX, TOH, O&G, WIDRO, Phenolics, Other:

Headspace in VOA Vials (>6mm): Yes No If yes look in headspace column

AG1U 1 liter amber glass	BPIU 1 liter plastic unpres	DG9A 40 mL amber ascorbic	JGFU 4 oz amber jar unpres	WGFU 4 oz clear jar unpres
AG1H 1 liter amber glass HCl	BP2N 500 mL plastic HNO3	DG9T 40 mL amber Na Thio	WPFU 4 oz plastic jar unpres	
AG4S 125 mL amber glass H2SO4	BP2Z 500 mL plastic NaOH, Znact	VG9U 40 mL clear vial HCl		
AG4U 120 mL amber glass unpres	BP3U 250 mL plastic unpres	VG9H 40 mL clear vial HCl		
AG5U 100 mL amber glass unpres	BP3B 250 mL plastic NaOH	VG9M 40 mL clear vial MeOH	SP5T 120 mL plastic Na Thiosulfate	
AG2S 500 mL amber glass H2SO4	BP3N 250 mL plastic HNO3	VG9D 40 mL clear vial DI	ZPLC ziploc bag	GN: 12-17-14
AG3U 250 mL clear glass unpres	BP3S 250 mL plastic H2SO4			



Document Name:
Sample Condition Upon Receipt (SCUR)
Document No.:
F-GB-C-031-Rev.07

Document Revised: 25Apr2018
Issuing Authority:
Pace Green Bay Quality Office

Sample Condition Upon Receipt Form (SCUR)

Project #:

Client Name: SJS

Courier: CS Logistics FedEx Speedee UPS Waltco
 Client Pace Other: _____

Tracking #: _____

WO# : 40200891



40200891

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Custody Seal on Samples Present: yes no Seals intact: yes no

Packing Material: Bubble Wrap Bubble Bags None Other

Thermometer Used SR - B Type of Ice: Wet Blue Dry None

Cooler Temperature Uncorr: 2.0 /Corr: 2.0 Samples on ice, cooling process has begun

Temp Blank Present: yes no

Temp should be above freezing to 6°C.

Biota Samples may be received at ≤ 0°C.

Biological Tissue is Frozen: yes no

Person examining contents:

Date: 12-17-19

Initials: BP

Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1. <u>12-17-19 BP</u>
Chain of Custody Filled Out:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	2. <u>NO MAIN INFORMATION, NO COOLING INFORMATION, PAGE</u>
Chain of Custody Relinquished:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	3. <u>NUMBER 12-17-19 BP</u>
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	4.
Samples Arrived within Hold Time:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	5.
- VOA Samples frozen upon receipt	<input type="checkbox"/> Yes <input type="checkbox"/> No	Date/Time:
Short Hold Time Analysis (<72hr):	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	6.
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	7.
Sufficient Volume:		8.
For Analysis: <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No MS/MSD: <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A		
Correct Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	9.
-Pace Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
-Pace IR Containers Used:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	
Containers Intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	10.
Filtered volume received for Dissolved tests	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	11.
Sample Labels match COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	12.
-Includes date/time/ID/Analysis Matrix:	<u>W</u>	
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	13.
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	
Pace Trip Blank Lot # (if purchased):		

Client Notification/ Resolution:

If checked, see attached form for additional comments

Person Contacted: _____ Date/Time: _____

Comments/ Resolution: _____

Project Manager Review: An 6v TN/Dm

Date: 12/17/19