

Run-On and Run-Off Control Plan Update – Coal Combustion Residual Landfill

Lansing Generating Station
2320 Power Plant Drive
Lansing, Iowa 52151

Prepared for:

Interstate Power and Light Company
2320 Power Plant Drive
Lansing, Iowa 52151

SCS ENGINEERS

25221070.00 | September 15, 2021

2830 Dairy Drive
Madison, WI 53718-6751
608-224-2830

Table of Contents

Section	Page
PE Certification	iii
1.0 Introduction and Project Summary	1
1.1 5-year Periodic Plan Updates.....	1
2.0 Run-on and Run-off Control Plan	1
2.1 Design Criteria	2
2.2 Design with Calculations.....	2
2.3 Construction.....	2
3.0 Certifications	2
4.0 Recordkeeping and Period Updates	3

Figures

- Figure 1. Site Location
Figure 2. Run-On and Run-Off Control Plan



Appendices

- Appendix A Drainage Design Calculations
 A1 2001 Design
 A2 Phase 1 Final Cover
 A3 Phase 2 Final Cover

I:\25221070.00\Deliverables\2021 Runon Runoff Plan Update\210915_Runon Runoff Plan Update.docx

[This page left blank intentionally]

PE CERTIFICATION

 <p>9/15/21</p>	<p>I, Eric J. Nelson, hereby certify that this Run-On and Run-Off Control Plan meets the requirements of 40 CFR 257.81(c), was prepared by me or under my direct supervision, and that I am a duly licensed Professional Engineer under the laws of the State of Iowa.</p>
	<div style="display: flex; justify-content: space-between;"> <div style="text-align: center;">  (signature) </div> <div style="text-align: center;"> 9/15/2021 (date) </div> </div>
	<p style="text-align: center;">Eric J. Nelson</p> <p>(printed or typed name)</p>
	<p>License number <u>23136</u></p>
	<p>My license renewal date is <u>December 31, 2022</u>.</p>
	<p>Pages or sheets covered by this seal:</p> <p style="margin-left: 20px;">All pages of September 2021</p>
<p style="text-align: center;">Run-on and Run-off Control Plan Update</p>	

[This page left blank intentionally]

1.0 INTRODUCTION AND PROJECT SUMMARY

On behalf of Interstate Power and Light Company (IPL), SCS Engineers (SCS) has prepared this Run-on and Run-off Control Plan Update for the Lansing Generating Station (LAN) coal combustion residual (CCR) Landfill in accordance with 40 CFR 257.81(c)(4) as follows.

40 CFR 257.81(c)(4). *“The owner or operator of the CCR unit must prepare periodic run-on and run-off control system plans required by paragraph (c)(1) of this section every five years. The date of completing the initial plan is the basis for establishing the deadline to complete the first subsequent plan. The owner or operator may complete any required plan prior to the required deadline provided the owner or operator places the completed plan into the facility’s operating record within a reasonable amount of time. In all cases, the deadline for completing a subsequent plan is based on the date of completing the previous plan. For purposes of this paragraph (c)(4), the owner or operator has completed a periodic run-on and run-off control system plan when the plan has been placed in the facility’s operating record as required by §257.105(g)(3).”*

The LAN Landfill includes a CCR landfill, which currently consists of a single existing CCR landfill unit. The LAN Landfill has received CCR both before and after the effective date of the CCR Rule. The initial Run-on and Run-off Control Plan was completed in 2016, and there have been no previous updates,

Refer to **Figure 1** for the site location. **Figure 2** shows the run-on and run-off drainage areas.

1.1 5-YEAR PERIODIC PLAN UPDATES

The following item has been updated in this periodic plan update:

- **Figure 2** – Figure 2 has been updated to show topographic data for active landfill areas obtained during the most recent survey of the landfill in May 2020.

No other changes impacting the run-on and run-off controls have been identified with this update.

2.0 RUN-ON AND RUN-OFF CONTROL PLAN

40 CFR 257.81(a). *“The owner or operator of an existing or new CCR landfill or any lateral expansion of a CCR landfill must design, construct, operate, and maintain:*

- (1) A run-on control system to prevent flow onto the active portion of the CCR unit during the peak discharge from a 24-hour, 25-year storm.”*

The entire site has run-on and run-off control in place, as approved by the Iowa Department of Natural Resources (IDNR). Run-on is controlled by berms and swales around the perimeter of the landfill that divert storm water away from the landfill to the Upper Ash Pond and the swale along the county highway.

- (2) “A run-off control system from the active portion of the CCR unit to collect and control at least the water volume resulting from a 24-hour, 25-year storm.”*

Run-off from the active portions of the CCR unit is handled as contact water and flows to the Upper Ash Pond. Discharge from the Upper Ash Pond is regulated by a National Pollutant Discharge

Elimination System (NPDES) permit. Per 257.81(b), this is consistent with the surface water requirements under 40 CFR 257.3-3.

Run-off from areas of the existing CCR unit where final cover is in place (which prevents contact with CCR) is diverted into the perimeter drainage swales, which drain to the Upper Ash Pond. Intermediate swales/berms and rock chutes on the final cover help minimize erosion of the final cover and divert water to the perimeter drainage system, and ultimately to the Upper Ash Pond. Per 257.81(b), this is consistent with the surface water requirements under 40 CFR 257.3-3.

2.1 DESIGN CRITERIA

The storm water features described above are designed to handle run-on and run-off from a 25-year, 24-hour storm event, as required by 40 CFR 257.81(a)(1) and (2). The run-on and run-off design calculations for the facility, except for the northern perimeter swale, were updated in 2015. The calculations were performed assuming a 25-year, 24-hour precipitation depth of 5.46 inches, based on National Oceanic and Atmospheric Administration (NOAA) Atlas 14 precipitation data published in April 2013. Design calculations for the northern perimeter swale were performed in 2001, and assumed a 25-year, 24-hour precipitation depth of 4.95 inches, based on Technical Paper-40 (TP-40) precipitation data published in May 1961.

2.2 DESIGN WITH CALCULATIONS

Storm water management design calculations (as described above) from the IDNR approved 2001 Permit Application and the 2015 Phase 2 Final Cover Construction Documentation Report are contained in **Appendix A**. As described in **Section 2.1**, the calculations from the 2001 Permit Application describe the storm water management design and provide calculations showing that the run-on control system will prevent flow onto the active portion of the CCR unit during the peak discharge from a 25-year, 24-hour storm. The calculations from the 2015 Final Cover Construction Documentation Report describe the storm water management design and provide calculations showing that the run-off control system for the active portions of the CCR unit will collect and control the water volume resulting from a 25-year, 24-hour storm. The calculations were performed or overseen by professional engineers licensed in the State of Iowa.

Currently available design storm event data from National Oceanic and Atmospheric Administration NOAA Atlas 14, Volume 8, Version 2 and the design calculations described above were reviewed at the time of this update. Current design storm event data does not substantially affect the results of design calculations provided in **Appendix A**.

2.3 CONSTRUCTION

Existing perimeter swales were constructed to site specifications with construction oversight directed by a professional engineer licensed in the State of Iowa. Construction documentation reports for the storm water management features were prepared, submitted to the IDNR, and approved by the IDNR.

3.0 CERTIFICATIONS

40 CFR 257.81(c)(5). *“The owner or operator must obtain a certification from a qualified professional engineer stating that the initial and periodic run-on and run-off control system plans meet the requirements of this section.”*

Eric Nelson, PE, a licensed professional engineer in the State of Iowa, has overseen the preparation of this Run-on and Run-off Control Plan Update. A certification statement is provided on **page iii** of this plan.

4.0 RECORDKEEPING AND PERIOD UPDATES

40 CFR 257.81(d). *“The owner or operator of the CCR unit must comply with the recordkeeping requirements specified in section 257.105(g), the notification requirements specified in section 257.106(g), and the internet requirements specified in section 257.107(g)”*


This Run-On and Run-Off Control Plan Update, and all additional periodic plans, will be placed in the facility’s operating record and on Alliant Energy’s CCR Rule Compliance Data and Information website, as will all amendments. Periodic plans will be completed every 5 years per 40 CFR 257.81(c)(4).

Notification will be provided to the State Director (Iowa Department of Natural Resources Land Quality Bureau Environmental Program Supervisor) when this Run-On and Run-Off Control Plan Update, and all subsequent updates, are available in the facility’s operating record and on the facility’s website per 40 CFR 257.105(g), 257.106(g), and 257.107(g).

[This page left blank intentionally]

Figures


- 1 Site Location Map
- 2 Run-On/Run-Off Control Plan

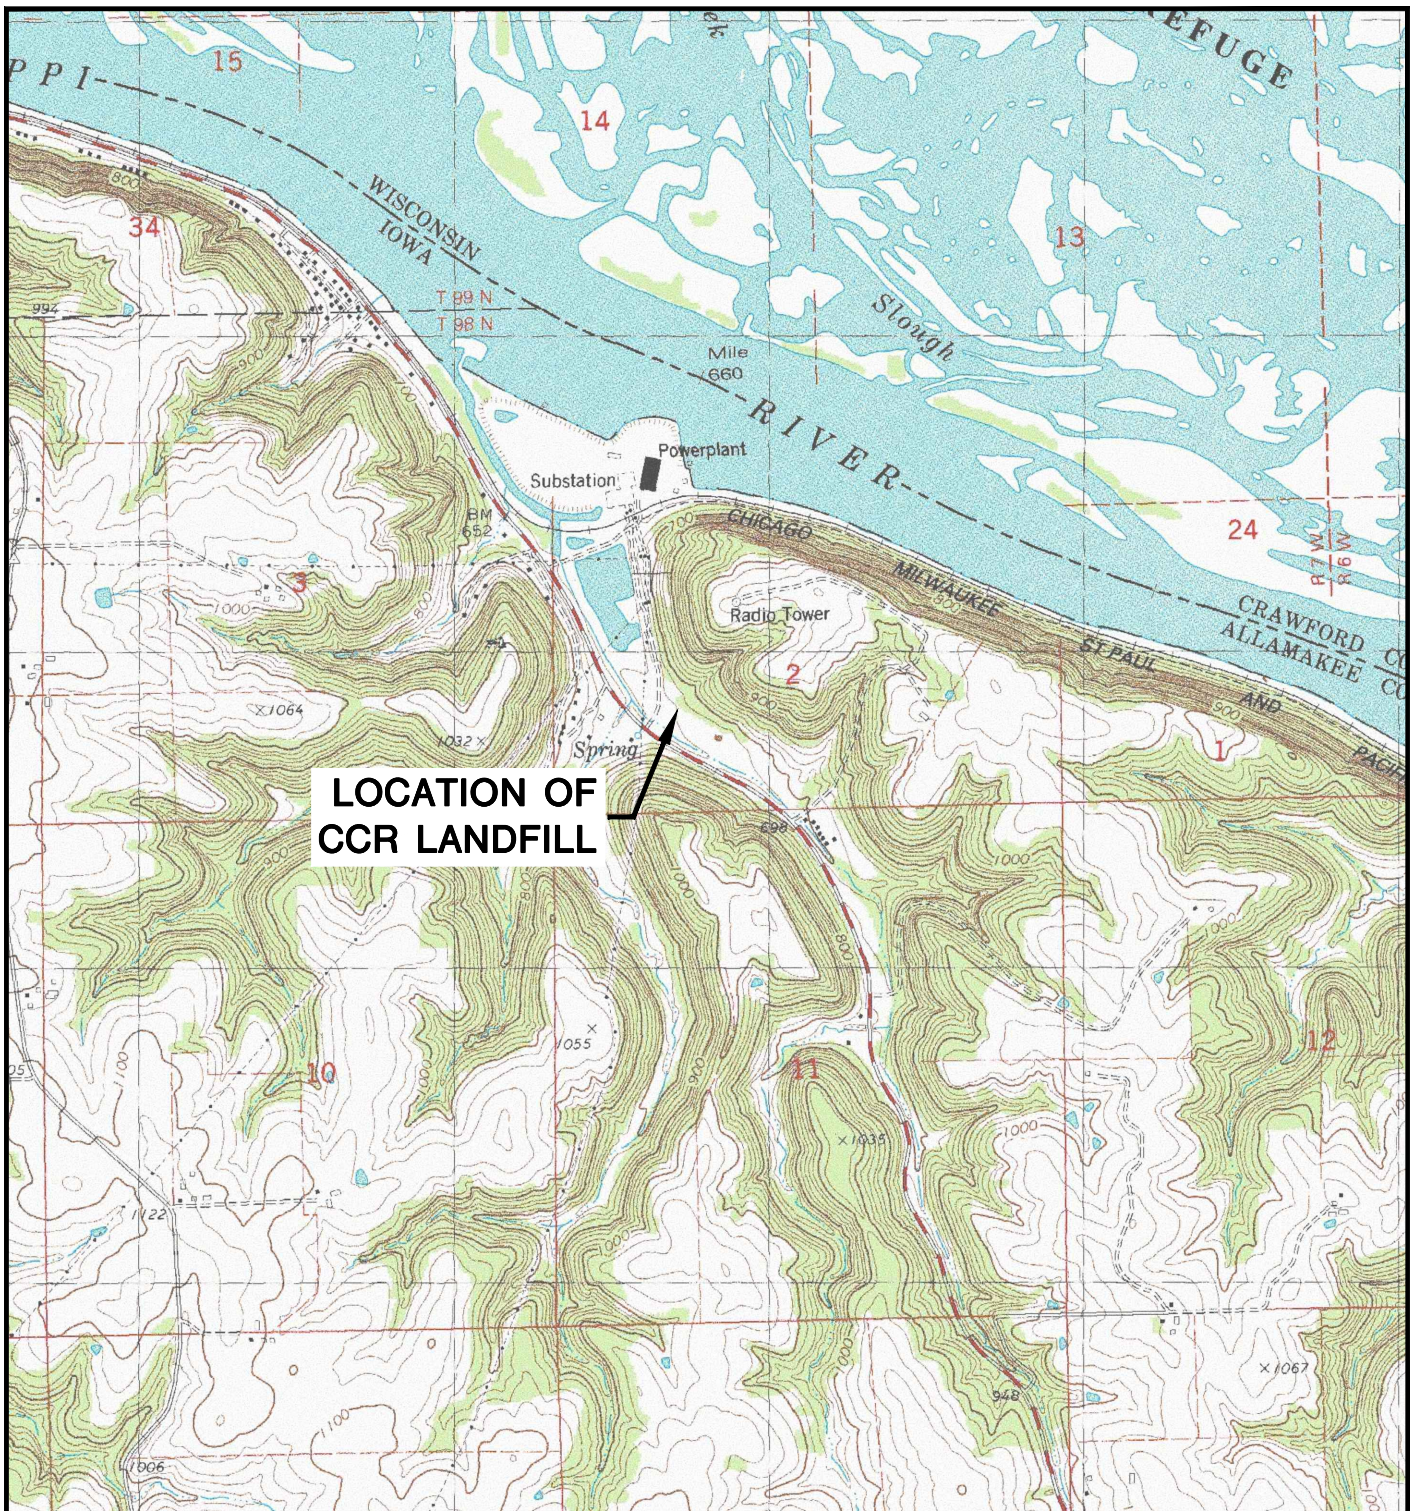

**LOCATION OF
CCR LANDFILL**




LANSING QUADRANGLE
 IOWA-ALLAMAKEE CO.
 7.5 MINUTE SERIES (TOPOGRAPHIC)
 SW/4 FERRYVILLE 15' QUADRANGLE
 1983
 SCALE: 1" = 2,000'



CLIENT	INTERSTATE POWER AND LIGHT CO. 2320 POWER PLANT DRIVE LANSING, IA 52151-9733		SITE	RUN-ON AND RUN-OFF CONTROL PLAN COAL COMBUSTION RESIDUE LANDFILL LANSING, IOWA		ENGINEER	SITE LOCATION MAP	
	PROJECT NO.	25221070.00		DRAWN BY:	AHB/RJG		SCS ENGINEERS 2830 DAIRY DRIVE MADISON, WI 53718-6751 PHONE: (608) 224-2830	FIGURE
DRAWN:	05/01/2013	CHECKED BY:	PG	APPROVED BY:	EJN 9/15/21			
REVISED:	07/30/2021							

I:\25221070.00\Drawings\Runon Runoff Plan\Figure1.dwg, 9/15/2021 8:44:56 AM

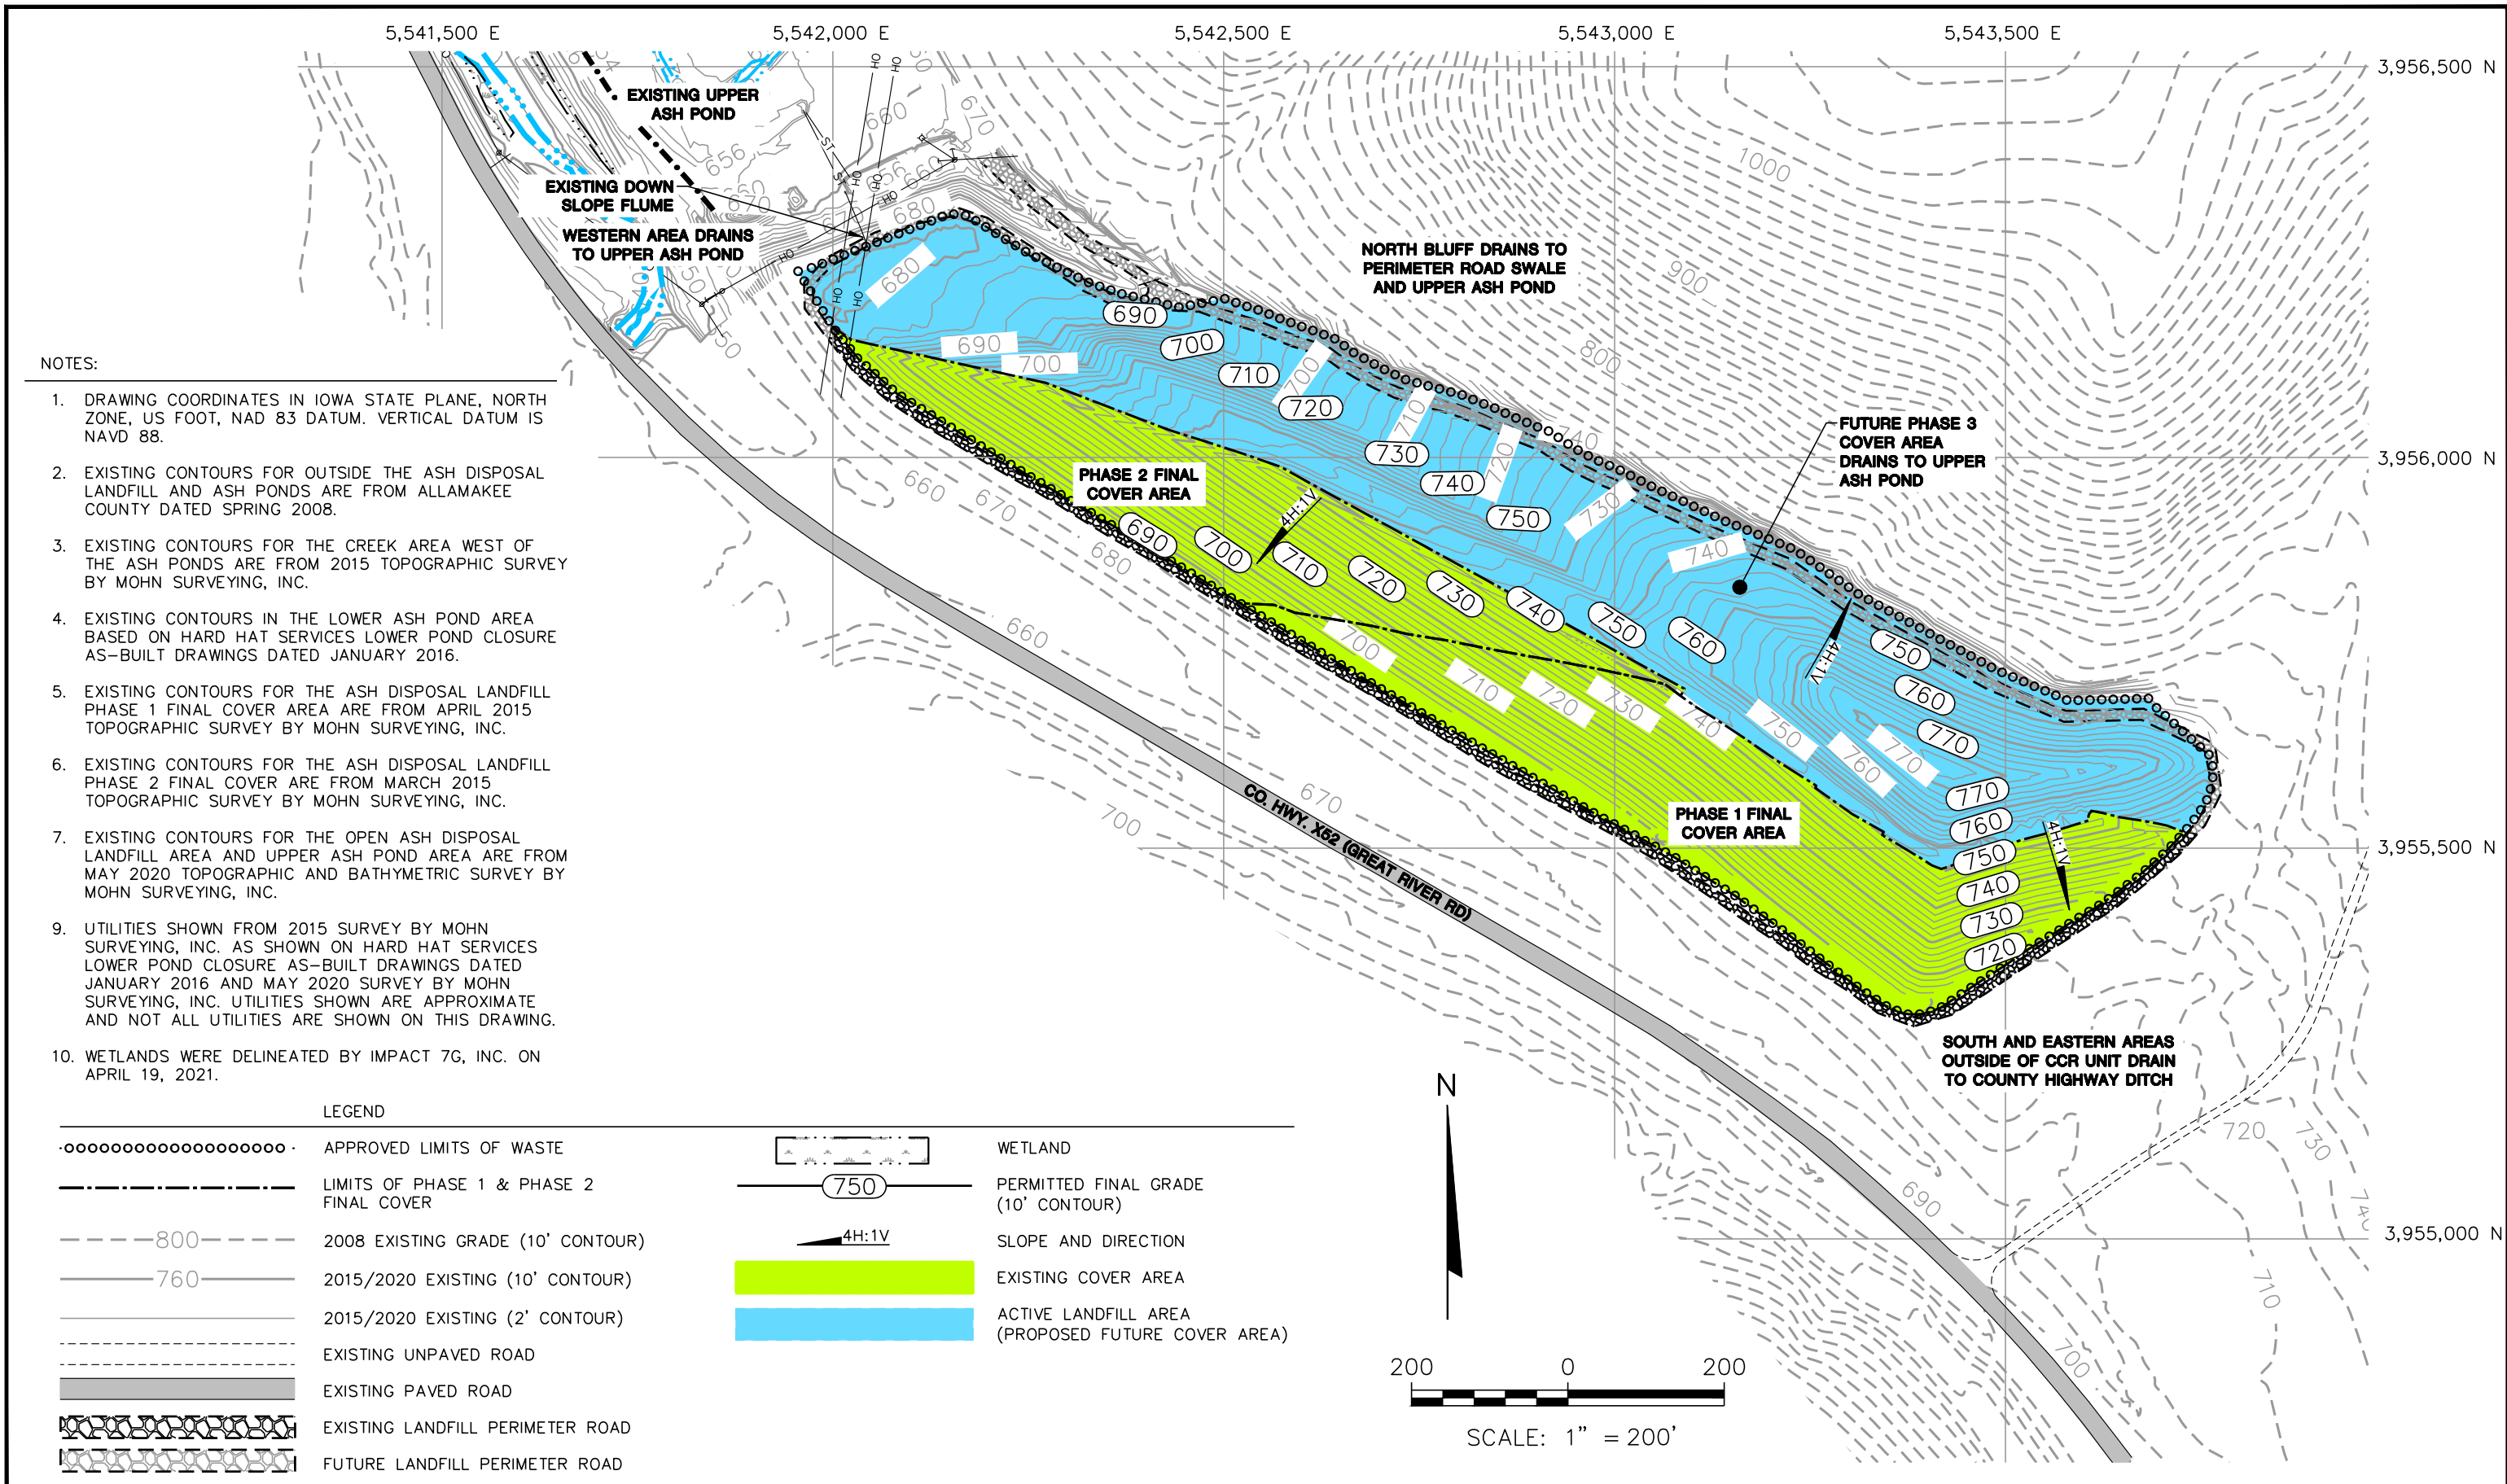


NOTES:

1. DRAWING COORDINATES IN IOWA STATE PLANE, NORTH ZONE, US FOOT, NAD 83 DATUM. VERTICAL DATUM IS NAVD 88.
2. EXISTING CONTOURS FOR OUTSIDE THE ASH DISPOSAL LANDFILL AND ASH PONDS ARE FROM ALLAMAKEE COUNTY DATED SPRING 2008.
3. EXISTING CONTOURS FOR THE CREEK AREA WEST OF THE ASH PONDS ARE FROM 2015 TOPOGRAPHIC SURVEY BY MOHN SURVEYING, INC.
4. EXISTING CONTOURS IN THE LOWER ASH POND AREA BASED ON HARD HAT SERVICES LOWER POND CLOSURE AS-BUILT DRAWINGS DATED JANUARY 2016.
5. EXISTING CONTOURS FOR THE ASH DISPOSAL LANDFILL PHASE 1 FINAL COVER AREA ARE FROM APRIL 2015 TOPOGRAPHIC SURVEY BY MOHN SURVEYING, INC.
6. EXISTING CONTOURS FOR THE ASH DISPOSAL LANDFILL PHASE 2 FINAL COVER ARE FROM MARCH 2015 TOPOGRAPHIC SURVEY BY MOHN SURVEYING, INC.
7. EXISTING CONTOURS FOR THE OPEN ASH DISPOSAL LANDFILL AREA AND UPPER ASH POND AREA ARE FROM MAY 2020 TOPOGRAPHIC AND BATHYMETRIC SURVEY BY MOHN SURVEYING, INC.
9. UTILITIES SHOWN FROM 2015 SURVEY BY MOHN SURVEYING, INC. AS SHOWN ON HARD HAT SERVICES LOWER POND CLOSURE AS-BUILT DRAWINGS DATED JANUARY 2016 AND MAY 2020 SURVEY BY MOHN SURVEYING, INC. UTILITIES SHOWN ARE APPROXIMATE AND NOT ALL UTILITIES ARE SHOWN ON THIS DRAWING.
10. WETLANDS WERE DELINEATED BY IMPACT 7G, INC. ON APRIL 19, 2021.

LEGEND

••••••••••••••••••••	APPROVED LIMITS OF WASTE		WETLAND
— — — — —	LIMITS OF PHASE 1 & PHASE 2 FINAL COVER		PERMITTED FINAL GRADE (10' CONTOUR)
- - - - -800-	2008 EXISTING GRADE (10' CONTOUR)		SLOPE AND DIRECTION
- - - - -760-	2015/2020 EXISTING (10' CONTOUR)		EXISTING COVER AREA
- - - - -	2015/2020 EXISTING (2' CONTOUR)		ACTIVE LANDFILL AREA (PROPOSED FUTURE COVER AREA)
- - - - -	EXISTING UNPAVED ROAD		
=====	EXISTING PAVED ROAD		
	EXISTING LANDFILL PERIMETER ROAD		
	FUTURE LANDFILL PERIMETER ROAD		

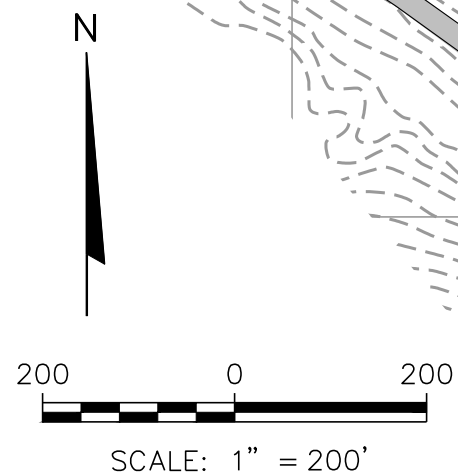

PROJECT NO. 25221070.00	DRAWN BY: BSS/RJG	SCS ENGINEERS 2830 DAIRY DRIVE MADISON, WI 53718-6751 PHONE: (608) 224-2830	CLIENT INTERSTATE POWER AND LIGHT CO. 2320 POWER PLANT DRIVE LANSING, IA 52151-9733	SITE RUN-ON AND RUN-OFF CONTROL PLAN COAL COMBUSTION RESIDUE LANDFILL LANSING, IOWA	FIGURE 2
DRAWN: 08/16/2021	CHECKED BY: RJG				
REVISED: 08/17/2021	APPROVED BY: EJN 9/15/21				

I:\25221070.00\Drawings\Runon Runoff Plan\2_Runon Runoff Plan.dwg, 9/15/2021 8:52:37 AM



Appendix A
Drainage Design Calculations

Appendix A1

2001 Design



Sheet No. 1 of 37

Calc. No. 1

Rev. No.

Job No. 1792

Job ALLIANT - LANSING ASH FILL

By TE Date 7/11/01

Client ALLIANT ENERGY

Subject SURFACE WATER DRAINAGE

Chk'd. MRH Date 7-19-01

PURPOSE: TO DETERMINE THE SIZE OF ALL PERIMETER DITCHES, DIVERSION BERMS AND CULVERTS USED TO MANAGE STORM WATER AT THE PROPOSED SITE.

APPROACH: DETERMINE WATERSHED AREAS CONTRIBUTING TO EACH DITCH, DIVERSION BERM, OR CULVERT. USING AUTOCAD AND PLANIMETER

USE PONDPAK SOFTWARE TO DETERMINE THE TIME OF CONCENTRATION FOR EACH WATERSHED AREA USING THE TR-55 METHOD.

USE PONDPAK SOFTWARE TO COMPUTE HYDROGRAPHS FOR EACH DITCH USING THE TR-55 TABULAR METHOD. OBTAIN MAXIMUM FLOWS FOR EACH DITCH, DIVERSION BERM, AND CULVERT USING THE COMPUTED HYDROGRAPHS.

USE FLOWMASTER VERSION 6.0 TO CALCULATE THE MAXIMUM DEPTH AND VELOCITY FOR MAXIMUM FLOWS FOR ALL DITCHES, DIVERSION BERMS AND CULVERTS

REFERENCES: URBAN HYDROLOGY FOR SMALL WATERSHEDS, SOIL CONSERVATION SERVICES, WASHINGTON DC JUNE 1986

INTERSTATE POWER COMPANY COAL COMBUSTION RESIDUE FILL SITE - LANSING IOWA 1997 SHEET NO. 2 PREPARED BY HOWARD E GREEN COMPANY

ALLIANT ENERGY - LANSING COAL COMBUSTION RESIDUE FILL SITE FINAL GRADES DRAWING. PREPARED BY BT² INC.



Sheet No. 2 of 37

Calc. No. 1

Rev. No.

Job No. 1797

Job ALLIANT LAWSVILLE ASH FILL

By TR Date 7/11/01

Client ALLIANT ENERGY Subject SURFACE WATER DRAINAGE

Chk'd. NRH Date 7-19-01

ASSUMPTIONS:

MANNINGS NO. FOR SHEET FLOW IS EQUAL TO 0.19 WHICH IS THE AVERAGE OF 0.16 FOR SHORT GRASS PRAIRIE AND 0.24 FOR DENSE GRASSES LISTED IN TABLE 3.1 OF URBAN HYDROLOGY FOR SMALL WATERSHEDS.

MANNINGS NO. FOR CHANNEL FLOW IS EQUAL TO 0.30 FOR ROUGH CHANNEL WITH GRASS AS LISTED AS AN OPTION IN FLOWMASTER VERSION 6.0

THE 2 YR 24 HR PRECIPITATION IS 2.95 INCHES AS SHOWN IN ATTACHED FIGURE 1

THE 25 YR 24 HR RAINFALL DEPTH IS 4.95 INCHES AS SHOWN ON FIGURE 2.



A CN NUMBER EQUAL TO 74 IS USED IN THE HYDROGRAPH COMPUTATION FOR LANDFILL AREAS AS AN AVERAGE BETWEEN C AND D SOIL GROUPS AND CONTINUOUS GRASS COVER.

A CN NUMBER EQUAL TO 74 IS USED FOR THE NORTH WOODED AREA AS AN AVERAGE BETWEEN C AND D SOIL GROUPS FOR WOODS IN GOOD CONDITION


CROSS SECTIONS OF DIVERSION BERMS AND DITCHES ARE AS FOLLOWS

SOUTH PERIMETER DITCH:

NORTH PERIMETER DITCH:



DIVERSION BERM:





Sheet No. 3 of 37

Calc. No. 1

Rev. No. _____

Job No. 1792 Job ALLIANT-LANSING 434 FILL

By TR Date 7/11/01

Client ALLIANT ENERGY Subject SURFACE WATER

Chk'd. MRF Date 7-19-01

ASSUMPTIONS: SLOPE OF CULVERT UNDER ROAD = 2.5%

SLOPE OF CULVERTS TO DRAIN DIVERSION BERM + SOUTH PERIMETER DITCH = 25%

CALCULATIONS: SOUTH PERIMETER DITCH AREA = $\frac{1}{2}(17+5) \times 2 = 22 \text{ FT}^2$
SOUTH PERIMETER DITCH WETTED PERIMETER = $\sqrt{4^2+2^2} + \sqrt{8^2+2^2} + 5 = 17.71 \text{ FT}$
NORTH PERIMETER DITCH AREA = $\frac{1}{2}(13+5) \times 2 = 18 \text{ FT}^2$
NORTH PERIMETER DITCH WETTED PERIMETER = $\sqrt{4^2+2^2} \times 2 + 5 = 13.94 \text{ FT}$
DIVERSION BERM AREA = $\frac{1}{2} \times 12 \times 2 = 12 \text{ FT}^2$
DIVERSION BERM WETTED PERIMETER = $\sqrt{4^2+2^2} + \sqrt{8^2+2^2} = 12.71 \text{ FT}$

OUTPUT SHEETS ARE ATTACHED

Worksheet Worksheet for Trapezoidal Channel

Project Description	
Worksheet	North Slope
Flow Element	Trapezoidal Channe
Method	Manning's Formula
Solve For	Channel Depth

Input Data	
Mannings Coefficient	0.030
Slope	0.080000 ft/ft
Left Side Slope	0.50 V : H
Right Side Slope	0.50 V : H
Bottom Width	5.00 ft
Discharge	95.00 cfs

Results	
Depth	1.10 ft
Flow Area	7.9 ft ²
Wetted Perimeter	9.91 ft
Top Width	9.39 ft
Critical Depth	1.76 ft
Critical Slope	0.013322 ft/ft
Velocity	12.04 ft/s
Velocity Head	2.25 ft
Specific Energy	3.35 ft
Froude Number	2.31
Flow Type	Supercritical

Worksheet Worksheet for Trapezoidal Channel

Project Description	
Worksheet	North Slope
Flow Element	Trapezoidal Channe
Method	Manning's Formula
Solve For	Channel Depth

Input Data	
Mannings Coefficient	0.030
Slope	0.020000 ft/ft
Left Side Slope	0.50 V : H
Right Side Slope	0.50 V : H
Bottom Width	5.00 ft
Discharge	95.00 cfs

Results	
Depth	1.59 ft
Flow Area	13.0 ft ²
Wetted Perimeter	12.09 ft
Top Width	11.34 ft
Critical Depth	1.76 ft
Critical Slope	0.013322 ft/ft
Velocity	7.33 ft/s
Velocity Head	0.84 ft
Specific Energy	2.42 ft
Froude Number	1.21
Flow Type	Supercritical

Type.... TR-55 Tabular Hyd. Peaks
Name.... NORTH SLOPE Tag: 25

File.... I:\1792\CALCS\PONDPACK\N_SLOPE.PPK
HYG Dir = I:\1792\CALCS\PONDPACK\
HYG file = NONE STORED NORTH SLOPE 25

TR-55 TABULAR HYDROGRAPH METHOD
TYPE II Distribution
25yr, 24hr Rainfall Depth = 4.95 in

>>>> Summary of Subarea Times to Peak <<<<

Subarea	Peak Discharge at Composite Outfall (cfs)	Time to Peak at Composite Outfall (hrs)
North Woods	36	12.3
Ravine	59	12.2
Composite Watershed	95	12.3

S/N: HOM0L0139361 BT 2, Inc
Pond Pack Ver: 5-05-97 :050 Compute Time: 16:04:58 Date: 07-19-2001

Type.... TR-55 Tabular Hyd.Input Data
Name.... NORTH SLOPE Tag: 25

File.... I:\1792\CALCS\PONDPACK\N_SLOPE.PPK
HYG Dir = I:\1792\CALCS\PONDPACK\
HYG file = NONE STORED NORTH SLOPE 25

TR-55 TABULAR HYDROGRAPH METHOD
TYPE II Distribution
25yr, 24hr Rainfall Depth = 4.95 in

Total Area = 40.000 acres or .062500 sq.mi.
Peak Discharge = 95 cfs

>>>> Input Parameters Used to Compute Hydrograph <<<<

Subarea Description	AREA (acres)	CN	Tc (hrs)	* Tt (hrs)	Precip. (in)	Runoff (in)	Ia/p input/used
North Woods	15.000	74.0	.3000	.0000	4.95	2.32	I.14 .14
Ravine	25.000	74.0	.3000	.0000	4.95	2.32	I.14 .14

* Travel time from subarea outfall to composite watershed outfall point.
I -- Subarea where user specified interpolation between Ia/p tables.

>>>> Computer Modifications of Input Parameters <<<<

Subarea Description	Input Values		Rounded Values		Ia/p Interpolated	Ia/p Messages
	Tc (hrs)	* Tt (hrs)	Tc (hrs)	* Tt (hrs)	(Yes/No)	
North Woods	.3294	.0000	.30	.00	Yes	--
Ravine	.2647	.0000	.30	.00	Yes	--

* Travel time from subarea outfall to composite watershed outfall point.

S/N: HOM0L0139361 BT 2, Inc
Pond Pack Ver: 5-05-97 :050 Compute Time: 16:04:58 Date: 07-19-2001

Type.... TcCalcs
Name.... NORTH WOODS

File.... I:\1792\CALCS\PONDPACK\N_SLOPE.PPK

.....
TIME OF CONCENTRATION CALCULATOR
.....

Segment #1: Tc: TR-55 Sheet
Description: North Woods Sheet Flow

Mannings n .1900
Hydraulic Length 300.00 ft
2yr, 24hr P 2.9500 in
Slope .100000 ft/ft

Avg.Velocity .32 ft/sec

Segment #1 Time: .2599 hrs

Segment #2: Tc: TR-55 Shallow
Description: North Woods Shallow Conc. 1

Hydraulic Length 100.00 ft
Slope .100000 ft/ft
Unpaved

Avg.Velocity 5.10 ft/sec

Segment #2 Time: .0054 hrs

Segment #3: Tc: TR-55 Shallow
Description: North Woods Shallow Conc. 2

Hydraulic Length 700.00 ft
Slope .370000 ft/ft
Unpaved

Avg.Velocity 9.81 ft/sec

Segment #3 Time: .0198 hrs

S/N: HOM0L0139361 BT 2, Inc
Pond Pack Ver: 5-05-97 :050 Compute Time: 16:02:29 Date: 07-19-2001

Type.... TcCalcs
 Name.... NORTH WOODS

Page 1.02

File.... I:\1792\CALCS\PONDPACK\N_SLOPE.PPK

Segment #4: Tc: TR-55 Channel
 Description: North Woods Channel 1

Flow Area 18.0000 sq.ft
 Wetted Perimeter 13.94 ft
 Hydraulic Radius 1.29 ft
 Slope .020000 ft/ft
 Mannings n .0300
 Hydraulic Length 700.00 ft

Avg.Velocity 8.33 ft/sec

Segment #4 Time: .0233 hrs

Segment #5: Tc: TR-55 Channel
 Description: North Woods Channel 2

Flow Area 18.0000 sq.ft
 Wetted Perimeter 13.94 ft
 Hydraulic Radius 1.29 ft
 Slope .080000 ft/ft
 Mannings n .0300
 Hydraulic Length 1250.00 ft

Avg.Velocity 16.66 ft/sec

Segment #5 Time: .0208 hrs

=====
 Total Tc: .3294 hrs
 =====

S/N: HOM0L0139361 BT 2, Inc
 Pond Pack Ver: 5-05-97 :050 Compute Time: 16:02:29 Date: 07-19-2001

Type.... TcCalcs
 Name.... NORTH WOODS

Page 1.03

File.... I:\1792\CALCS\PONDPACK\N_SLOPE.PPK

 Tc Equations used...

==== SCS TR-55 Sheet Flow =====

$$Tc = (.007 * ((n * Lf)**0.8)) / ((P**.5) * (Sf**.4))$$

Where: Tc = Time of concentration, hrs
 n = Mannings n
 Lf = Flow length, ft
 P = 2yr, 24hr Rain depth, inches
 Sf = Slope, ft/ft

==== SCS TR-55 Shallow Concentrated Flow =====

Unpaved surface:

$$V = 16.1345 * (Sf**0.5)$$

Paved surface:

$$V = 20.3282 * (Sf**0.5)$$

$$Tc = (Lf / V) / (3600sec/hr)$$

Where: V = Velocity, ft/sec
 Sf = Slope, ft/ft
 Tc = Time of concentration, hrs
 Lf = Flow length, ft

S/N: HOM0L0139361 BT 2, Inc

Pond Pack Ver: 5-05-97 :050 Compute Time: 16:02:29 Date: 07-19-2001

Type.... TcCalcs
 Name.... NORTH WOODS

Page 1.04

File.... I:\1792\CALCS\PONDPACK\N_SLOPE.PPK

==== SCS Channel Flow =====

$$R = Aq / Wp$$

$$V = (1.49 * (R^{2/3}) * (Sf^{*-0.5})) / n$$

$$Tc = (Lf / V) / (3600sec/hr)$$

Where: R = Hydraulic radius
 Aq = Flow area, sq.ft.
 Wp = Wetted perimeter, ft
 V = Velocity, ft/sec
 Sf = Slope, ft/ft
 n = Mannings n
 Tc = Time of concentration, hrs
 Lf = Flow length, ft

S/N: HOM0L0139361 BT 2, Inc
 Pond Pack Ver: 5-05-97 :050 Compute Time: 16:02:29 Date: 07-19-2001

Type.... TcCalcs
Name.... RAVINE

File.... I:\1792\CALCS\PONDPACK\N_SLOPE.PPK
Title... Ravine

.....
TIME OF CONCENTRATION CALCULATOR
.....

Ravine

Segment #1: Tc: TR-55 Sheet
Description: Ravine Sheet Flow

Mannings n .1900
Hydraulic Length 300.00 ft
2yr, 24hr P 2.9500 in
Slope .180000 ft/ft

Avg.Velocity .41 ft/sec

Segment #1 Time: .2055 hrs

Segment #2: Tc: TR-55 Shallow
Description: Ravine Shallow Conc. 1

Hydraulic Length 200.00 ft
Slope .180000 ft/ft
Unpaved

Avg.Velocity 6.85 ft/sec

Segment #2 Time: .0081 hrs

Segment #3: Tc: TR-55 Shallow
Description: Ravine Shallow Conc. 2

Hydraulic Length 400.00 ft
Slope .150000 ft/ft
Unpaved

Avg.Velocity 6.25 ft/sec

Segment #3 Time: .0178 hrs

S/N: HOMOL0139361 BT 2, Inc
Pond Pack Ver: 5-05-97 :050 Compute Time: 16:03:37 Date: 07-19-2001

Type.... TcCalcs
 Name.... RAVINE

File.... I:\1792\CALCS\PONDPACK\N_SLOPE.PPK
 Title... Ravine

Segment #4: Tc: TR-55 Shallow
 Description: Ravine Shallow Conc. 3

Hydraulic Length 900.00 ft
 Slope .280000 ft/ft
 Unpaved

Avg.Velocity 8.54 ft/sec

Segment #4 Time: .0293 hrs

Segment #5: Tc: TR-55 Channel
 Description: Ravine Channel 1

Flow Area 18.0000 sq.ft
 Wetted Perimeter 13.94 ft
 Hydraulic Radius 1.29 ft
 Slope .280000 ft/ft
 Mannings n .0300
 Hydraulic Length 450.00 ft

Avg.Velocity 31.16 ft/sec

Segment #5 Time: .0040 hrs

=====
 Total Tc: .2647 hrs
 =====

S/N: HOM0L0139361 BT 2, Inc
 Pond Pack Ver: 5-05-97 :050 Compute Time: 16:03:37 Date: 07-19-2001

Type.... TcCalcs
 Name.... RAVINE

Page 1.03

File.... I:\1792\CALCS\PONDPACK\N_SLOPE.PPK
 Title... Ravine

 Tc Equations used...

==== SCS TR-55 Sheet Flow =====

$$Tc = (.007 * ((n * Lf)**0.8)) / ((P**.5) * (Sf**.4))$$

Where: Tc = Time of concentration, hrs
 n = Mannings n
 Lf = Flow length, ft
 P = 2yr, 24hr Rain depth, inches
 Sf = Slope, ft/ft

==== SCS TR-55 Shallow Concentrated Flow =====

Unpaved surface:
 $V = 16.1345 * (Sf**0.5)$

Paved surface:
 $V = 20.3282 * (Sf**0.5)$

$$Tc = (Lf / V) / (3600sec/hr)$$

Where: V = Velocity, ft/sec
 Sf = Slope, ft/ft
 Tc = Time of concentration, hrs
 Lf = Flow length, ft

S/N: HOMOL0139361 BT 2, Inc
 Pond Pack Ver: 5-05-97 :050 Compute Time: 16:03:37 Date: 07-19-2001

Type.... TcCalcs
Name.... RAVINE

File.... I:\1792\CALCS\PONDPACK\N_SLOPE.PPK
Title... Ravine

==== SCS Channel Flow =====

$$R = Aq / Wp$$
$$V = (1.49 * (R**(2/3)) * (Sf**-0.5)) / n$$

$$Tc = (Lf / V) / (3600sec/hr)$$

- Where:
- R = Hydraulic radius
 - Aq = Flow area, sq.ft.
 - Wp = Wetted perimeter, ft
 - V = Velocity, ft/sec
 - Sf = Slope, ft/ft
 - n = Mannings n
 - Tc = Time of concentration, hrs
 - Lf = Flow length, ft

S/N: HOM0L0139361 BT 2, Inc
Pond Pack Ver: 5-05-97 :050 Compute Time: 16:03:37 Date: 07-19-2001

10/37

Worksheet Worksheet for Triangular Channel

Project Description

Worksheet	North Landfill Slope
Flow Element	Triangular Channel
Method	Manning's Formula
Solve For	Channel Depth

Input Data

Mannings Coefficient	0.030
Slope	0.014000 ft/ft
Left Side Slope	0.25 V : H
Right Side Slope	0.50 V : H
Discharge	16.00 cfs

Results

Depth	1.16 ft	<i>< 2ft ok</i>
Flow Area	4.1 ft ²	
Wetted Perimeter	7.41 ft	
Top Width	6.99 ft	
Critical Depth	1.12 ft	
Critical Slope	0.017190 ft/ft	
Velocity	3.93 ft/s	<i>ok</i>
Velocity Head	0.24 ft	
Specific Energy	1.40 ft	
Froude Number	0.91	
Flow Type	Subcritical	

Worksheet Worksheet for Triangular Channel

Project Description	
Worksheet	North Landfill Slope
Flow Element	Triangular Channel
Method	Manning's Formula
Solve For	Channel Depth

Input Data	
Mannings Coefficient	0.030
Slope	0.080000 ft/ft
Left Side Slope	0.25 V : H
Right Side Slope	0.50 V : H
Discharge	16.00 cfs

Results	
Depth	0.84 ft < 2'ok
Flow Area	2.1 ft ²
Wetted Perimeter	5.34 ft
Top Width	5.04 ft
Critical Depth	1.12 ft
Critical Slope	0.017190 ft/ft
Velocity	7.56 ft/s -
Velocity Head	0.89 ft
Specific Energy	1.73 ft
Froude Number	2.06
Flow Type	Supercritical

18137

Worksheet Worksheet for Trapezoidal Channel

Project Description	
Worksheet	South Ditch
Flow Element	Trapezoidal Channe
Method	Manning's Formula
Solve For	Channel Depth

Input Data	
Mannings Coefficient	0.030
Slope	0.078000 ft/ft
Left Side Slope	0.50 V : H
Right Side Slope	0.25 V : H
Bottom Width	5.00 ft
Discharge	17.00 cfs

Results	
Depth	0.41 ft < 2ft ok
Flow Area	2.5 ft ²
Wetted Perimeter	7.60 ft
Top Width	7.45 ft
Critical Depth	0.62 ft
Critical Slope	0.017206 ft/ft
Velocity	6.67 ft/s
Velocity Head	0.69 ft
Specific Energy	1.10 ft
Froude Number	2.01
Flow Type	Supercritical

Worksheet Worksheet for Trapezoidal Channel

Project Description	
Worksheet	South Ditch
Flow Element	Trapezoidal Channe
Method	Manning's Formula
Solve For	Channel Depth

Input Data	
Mannings Coefficient	0.030
Slope	0.012000 ft/ft
Left Side Slope	0.50 V : H
Right Side Slope	0.25 V : H
Bottom Width	5.00 ft
Discharge	17.00 cfs

Results	
Depth	0.69 ft < 2' ok
Flow Area	4.9 ft ²
Wetted Perimeter	9.37 ft
Top Width	9.13 ft
Critical Depth	0.62 ft
Critical Slope	0.017206 ft/ft
Velocity	3.50 ft/s
Velocity Head	0.19 ft
Specific Energy	0.88 ft
Froude Number	0.85
Flow Type	Subcritical

Worksheet Worksheet for Triangular Channel

Project Description	
Worksheet	South Berm
Flow Element	Triangular Channel
Method	Manning's Formula
Solve For	Channel Depth

Input Data	
Mannings Coefficient	0.030
Slope	0.020000 ft/ft
Left Side Slope	0.50 V : H
Right Side Slope	0.25 V : H
Discharge	9.00 cfs

Results	
Depth	0.88 ft < 2' ok
Flow Area	2.3 ft ²
Wetted Perimeter	5.58 ft
Top Width	5.27 ft
Critical Depth	0.89 ft
Critical Slope	0.018560 ft/ft
Velocity	3.89 ft/s
Velocity Head	0.24 ft
Specific Energy	1.11 ft
Froude Number	1.04
Flow Type	Supercritical

Type.... TR-55 Tabular Hyd.Input Data
Name.... LANDFILL Tag: 25

File.... I:\1792\CALCS\PONDPACK\Final_LF.ppk
HYG Dir = I:\1792\CALCS\PONDPACK\
HYG file = NONE STORED LANDFILL 25

TR-55 TABULAR HYDROGRAPH METHOD
TYPE II Distribution
25yr, 24hr Rainfall Depth = 4.95 in

Total Area = 13.500 acres or .021094 sq.mi.
Peak Discharge = 39 cfs

>>>> Input Parameters Used to Compute Hydrograph <<<<

Subarea Description	AREA (acres)	CN	Tc (hrs)	* Tt (hrs)	Precip. (in)	Runoff (in)	Ia/p input/used
North Landfill	4.300	74.0	.1000	.0000	4.95	2.32	I.14 .14
South Berm	3.300	74.0	.2000	.0000	4.95	2.32	I.14 .14
South Ditch	5.900	74.0	.2000	.0000	4.95	2.32	I.14 .14

* Travel time from subarea outfall to composite watershed outfall point.
I -- Subarea where user specified interpolation between Ia/p tables.

>>>> Computer Modifications of Input Parameters <<<<

Subarea Description	Input Values		Rounded Values		Ia/p Interpolated (Yes/No)	Ia/p Messages
	Tc (hrs)	* Tt (hrs)	Tc (hrs)	* Tt (hrs)		
North Landfill	.1338	.0000	.10	.00	Yes	--
South Berm	.1612	.0000	.20	.00	Yes	--
South Ditch	.1797	.0000	.20	.00	Yes	--

* Travel time from subarea outfall to composite watershed outfall point.

Type.... TR-55 Tabular Hyd.Peaks
Name.... LANDFILL Tag: 25

File.... I:\1792\CALCS\PONDPACK\Final_LF.ppk
HYG Dir = I:\1792\CALCS\PONDPACK\
HYG file = NONE STORED LANDFILL 25

TR-55 TABULAR HYDROGRAPH METHOD
TYPE II Distribution
25yr, 24hr Rainfall Depth = 4.95 in

>>>> Summary of Subarea Times to Peak <<<<

Subarea	Peak Discharge at Composite Outfall (cfs)	Time to Peak at Composite Outfall (hrs)
North Landfill	16	12.1
South Berm	9	12.2
South Ditch	17	12.2
Composite Watershed	39	12.1

2/2/21

Type.... Tc Calcs
Name.... NORTH LANDFILL

File.... I:\1792\CALCS\PONDPACK\Final_LF.ppk
Title... North Landfill

.....
TIME OF CONCENTRATION CALCULATOR
.....

North Landfill

Segment #1: Tc: TR-55 Sheet
Description: North Slope Sheet Flow

Mannings n .1900
Hydraulic Length 107.00 ft
2yr, 24hr P 2.9500 in
Slope .250000 ft/ft

Avg.Velocity .38 ft/sec

Segment #1 Time: .0790 hrs

Segment #2: Tc: TR-55 Channel
Description: North Side Channel 1

Flow Area 12.0000 sq.ft
Wetted Perimeter 12.70 ft
Hydraulic Radius .94 ft
Slope .020000 ft/ft
Mannings n .0300
Hydraulic Length 498.00 ft

Avg.Velocity 6.76 ft/sec

Segment #2 Time: .0205 hrs

Segment #3: Tc: TR-55 Channel
Description: North Side Channel 2

Flow Area 12.0000 sq.ft
Wetted Perimeter 12.70 ft
Hydraulic Radius .94 ft
Slope .080000 ft/ft
Mannings n .0300
Hydraulic Length 622.00 ft

Avg.Velocity 13.53 ft/sec

Segment #3 Time: .0128 hrs

Type.... Tc Calcs
Name.... NORTH LANDFILL

File.... I:\1792\CALCS\PONDPACK\Final_LF.ppk
Title... North Landfill

Segment #4: Tc: TR-55 Channel
Description: North Side Channel 3

Flow Area 12.0000 sq.ft
Wetted Perimeter 12.70 ft
Hydraulic Radius .94 ft
Slope .014000 ft/ft
Mannings n .0300
Hydraulic Length 439.00 ft

Avg.Velocity 5.66 ft/sec

Segment #4 Time: .0216 hrs

=====
Total Tc: .1338 hrs
=====

Type.... Tc Calcs
 Name.... NORTH LANDFILL

File.... I:\1792\CALCS\PONDPACK\Final_LF.ppk
 Title... North Landfill

 Tc Equations used...

==== SCS TR-55 Sheet Flow =====

$$Tc = (.007 * ((n * Lf)**0.8)) / ((P**.5) * (Sf**.4))$$

Where: Tc = Time of concentration, hrs
 n = Mannings n
 Lf = Flow length, ft
 P = 2yr, 24hr Rain depth, inches
 Sf = Slope, ft/ft

==== SCS Channel Flow =====

$$R = Aq / Wp$$

$$V = (1.49 * (R**(2/3)) * (Sf**-0.5)) / n$$

$$Tc = (Lf / V) / (3600sec/hr)$$

Where: R = Hydraulic radius
 Aq = Flow area, sq.ft.
 Wp = Wetted perimeter, ft
 V = Velocity, ft/sec
 Sf = Slope, ft/ft
 n = Mannings n
 Tc = Time of concentration, hrs
 Lf = Flow length, ft

Type.... Tc Calcs
Name.... SOUTH BERM

File.... I:\1792\CALCS\PONDPACK\Final_LF.ppk
Title... South Berm

.....
TIME OF CONCENTRATION CALCULATOR
.....

South Berm

Segment #1: Tc: TR-55 Sheet
Description: South Berm Sheet

Mannings n .1900
Hydraulic Length 140.00 ft
2yr, 24hr P 2.9500 in
Slope .250000 ft/ft

Avg.Velocity .40 ft/sec

Segment #1 Time: .0979 hrs

Segment #2: Tc: TR-55 Channel
Description: South Berm Channel 1

Flow Area 12.0000 sq.ft
Wetted Perimeter 12.70 ft
Hydraulic Radius .94 ft
Slope .020000 ft/ft
Mannings n .0300
Hydraulic Length 1540.00 ft

Avg.Velocity 6.76 ft/sec

Segment #2 Time: .0632 hrs

=====
Total Tc: .1612 hrs
=====

Type.... Tc Calcs
Name.... SOUTH BERM

File.... I:\1792\CALCS\PONDPACK\Final_LF.ppk
Title... South Berm

Tc Equations used...

==== SCS TR-55 Sheet Flow =====

$$Tc = (.007 * ((n * Lf)**0.8)) / ((P**.5) * (Sf**.4))$$

Where: Tc = Time of concentration, hrs
n = Mannings n
Lf = Flow length, ft
P = 2yr, 24hr Rain depth, inches
Sf = Slope, ft/ft

==== SCS Channel Flow =====

$$R = Aq / Wp$$
$$V = (1.49 * (R**(2/3)) * (Sf**-0.5)) / n$$

$$Tc = (Lf / V) / (3600sec/hr)$$

Where: R = Hydraulic radius
Aq = Flow area, sq.ft.
Wp = Wetted perimeter, ft
V = Velocity, ft/sec
Sf = Slope, ft/ft
n = Mannings n
Tc = Time of concentration, hrs
Lf = Flow length, ft

Type.... Tc Calcs
Name.... SOUTH LANDFILL

File.... I:\1792\CALCS\PONDPACK\Final_LF.ppk
Title... South Landfill

.....
TIME OF CONCENTRATION CALCULATOR
.....

South Landfill

Segment #1: Tc: TR-55 Sheet
Description: South Ditch Sheet

Mannings n .1900
Hydraulic Length 148.00 ft
2yr, 24hr P 2.9500 in
Slope .250000 ft/ft

Avg.Velocity .40 ft/sec

Segment #1 Time: .1024 hrs

Segment #2: Tc: TR-55 Channel
Description: South Ditch Channel 1

Flow Area 22.0000 sq.ft
Wetted Perimeter 17.71 ft
Hydraulic Radius 1.24 ft
Slope .078000 ft/ft
Mannings n .0300
Hydraulic Length 332.00 ft

Avg.Velocity 16.03 ft/sec

Segment #2 Time: .0058 hrs

Segment #3: Tc: TR-55 Channel
Description: South Ditch Channel 2

Flow Area 22.0000 sq.ft
Wetted Perimeter 17.71 ft
Hydraulic Radius 1.24 ft
Slope .030000 ft/ft
Mannings n .0300
Hydraulic Length 464.00 ft

Avg.Velocity 9.94 ft/sec

Segment #3 Time: .0130 hrs

Type.... Tc Calcs
Name.... SOUTH LANDFILL

File.... I:\1792\CALCS\PONDPACK\Final_LF.ppk
Title... South Landfill

Segment #4: Tc: TR-55 Channel
Description: South Ditch Channel 3

Flow Area 22.0000 sq.ft
Wetted Perimeter 17.71 ft
Hydraulic Radius 1.24 ft
Slope .012000 ft/ft
Mannings n .0300
Hydraulic Length 1326.00 ft

Avg.Velocity 6.29 ft/sec

Segment #4 Time: .0586 hrs

=====
Total Tc: .1797 hrs
=====

Type.... Tc Calcs
 Name.... SOUTH LANDFILL

Page 1.03

File.... I:\1792\CALCS\PONDPACK\Final_LF.ppk
 Title... South Landfill

 Tc Equations used...

==== SCS TR-55 Sheet Flow =====

$$Tc = (.007 * ((n * Lf)**0.8)) / ((P**.5) * (Sf**.4))$$

Where: Tc = Time of concentration, hrs
 n = Mannings n
 Lf = Flow length, ft
 P = 2yr, 24hr Rain depth, inches
 Sf = Slope, ft/ft

==== SCS Channel Flow =====

$$R = Aq / Wp$$

$$V = (1.49 * (R**(2/3)) * (Sf**-0.5)) / n$$

$$Tc = (Lf / V) / (3600sec/hr)$$


Where: R = Hydraulic radius
 Aq = Flow area, sq.ft.
 Wp = Wetted perimeter, ft
 V = Velocity, ft/sec
 Sf = Slope, ft/ft
 n = Mannings n
 Tc = Time of concentration, hrs
 Lf = Flow length, ft

S/N: HOM0L0862791 BT 2, Inc

Pond Pack Ver: 8-01-98 (61)

Compute Time: 15:56:08

Date: 07-11-2001

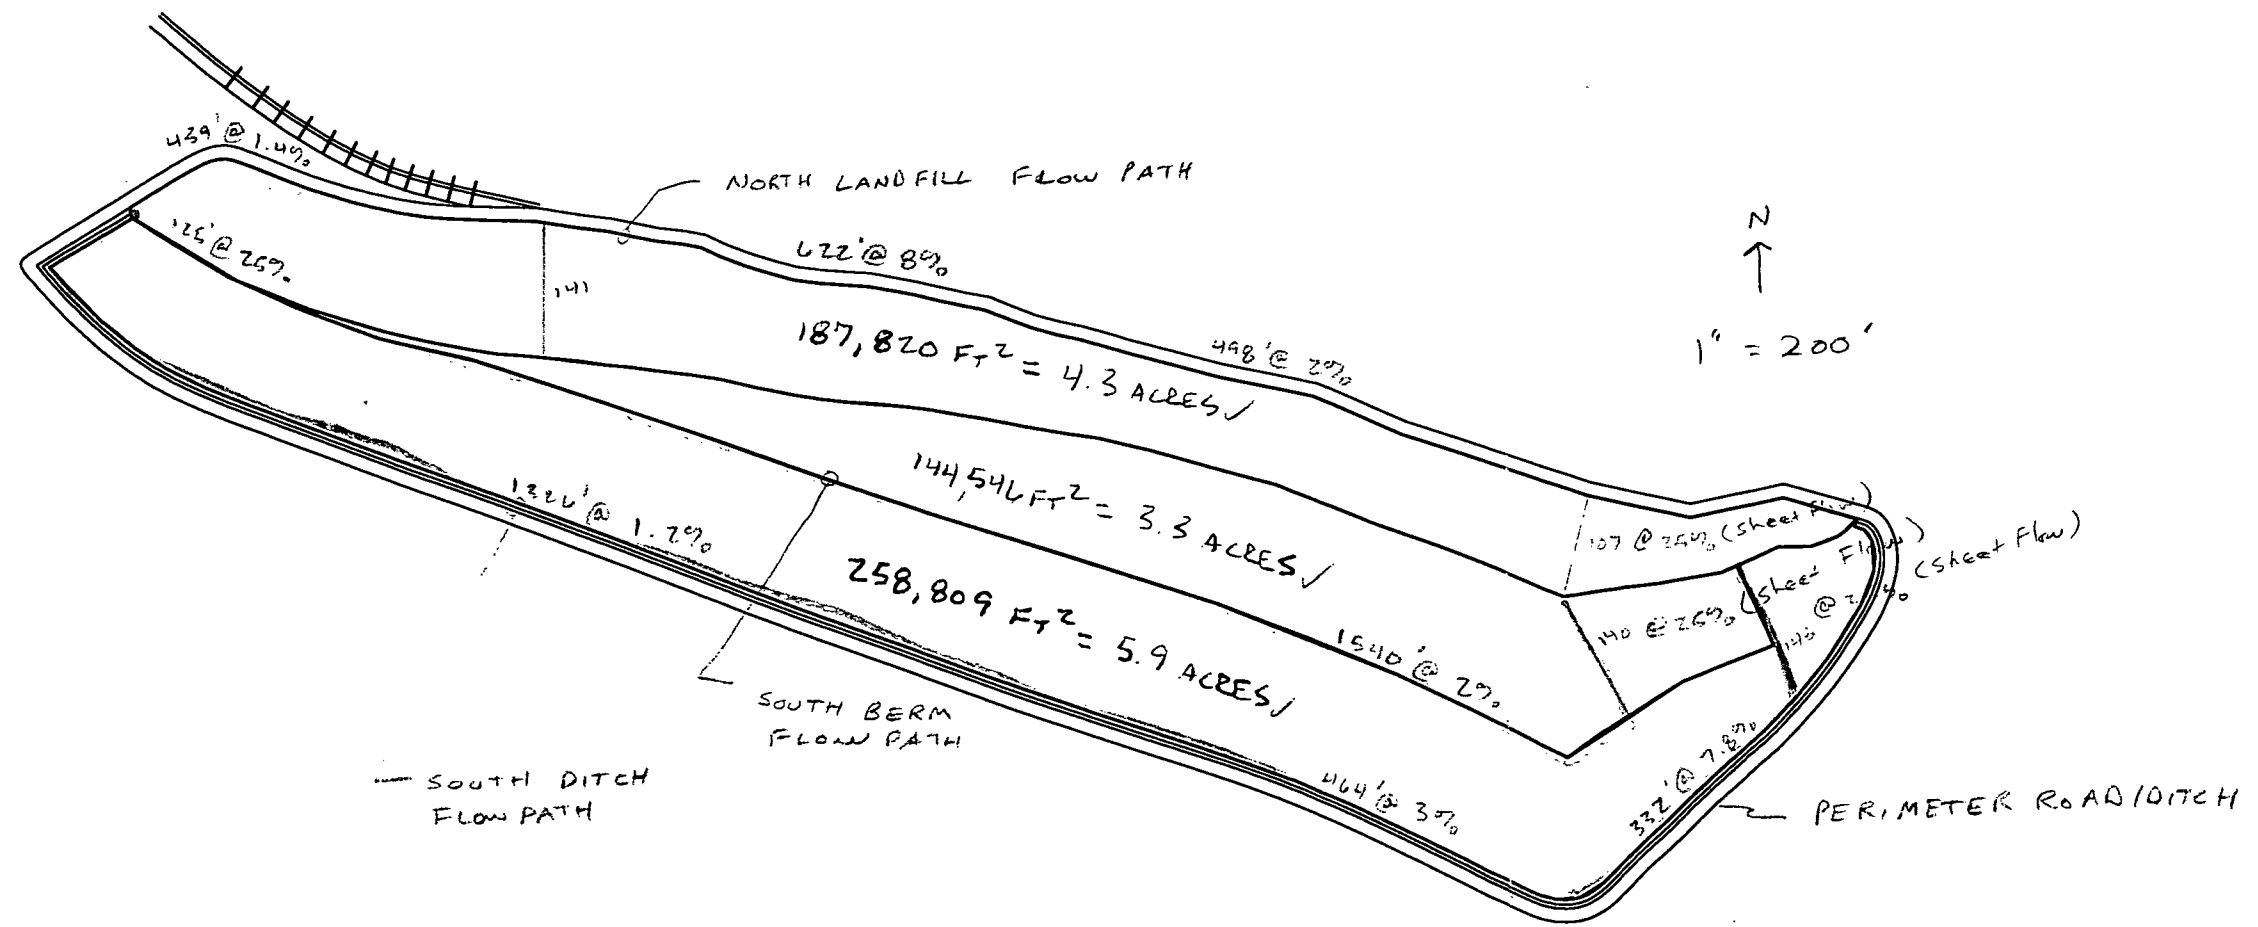

POWERPLANT

MISSISSIPPI

TOWER


COUNTY X42

NORTH WOODS AREA = 15 ACRES
RAVINE AREA = 25 ACRES

CONTOUR INTERVAL = 20 FEET

PROPOSED

10/07/2021 - Classification: Internal - ECRM12687163

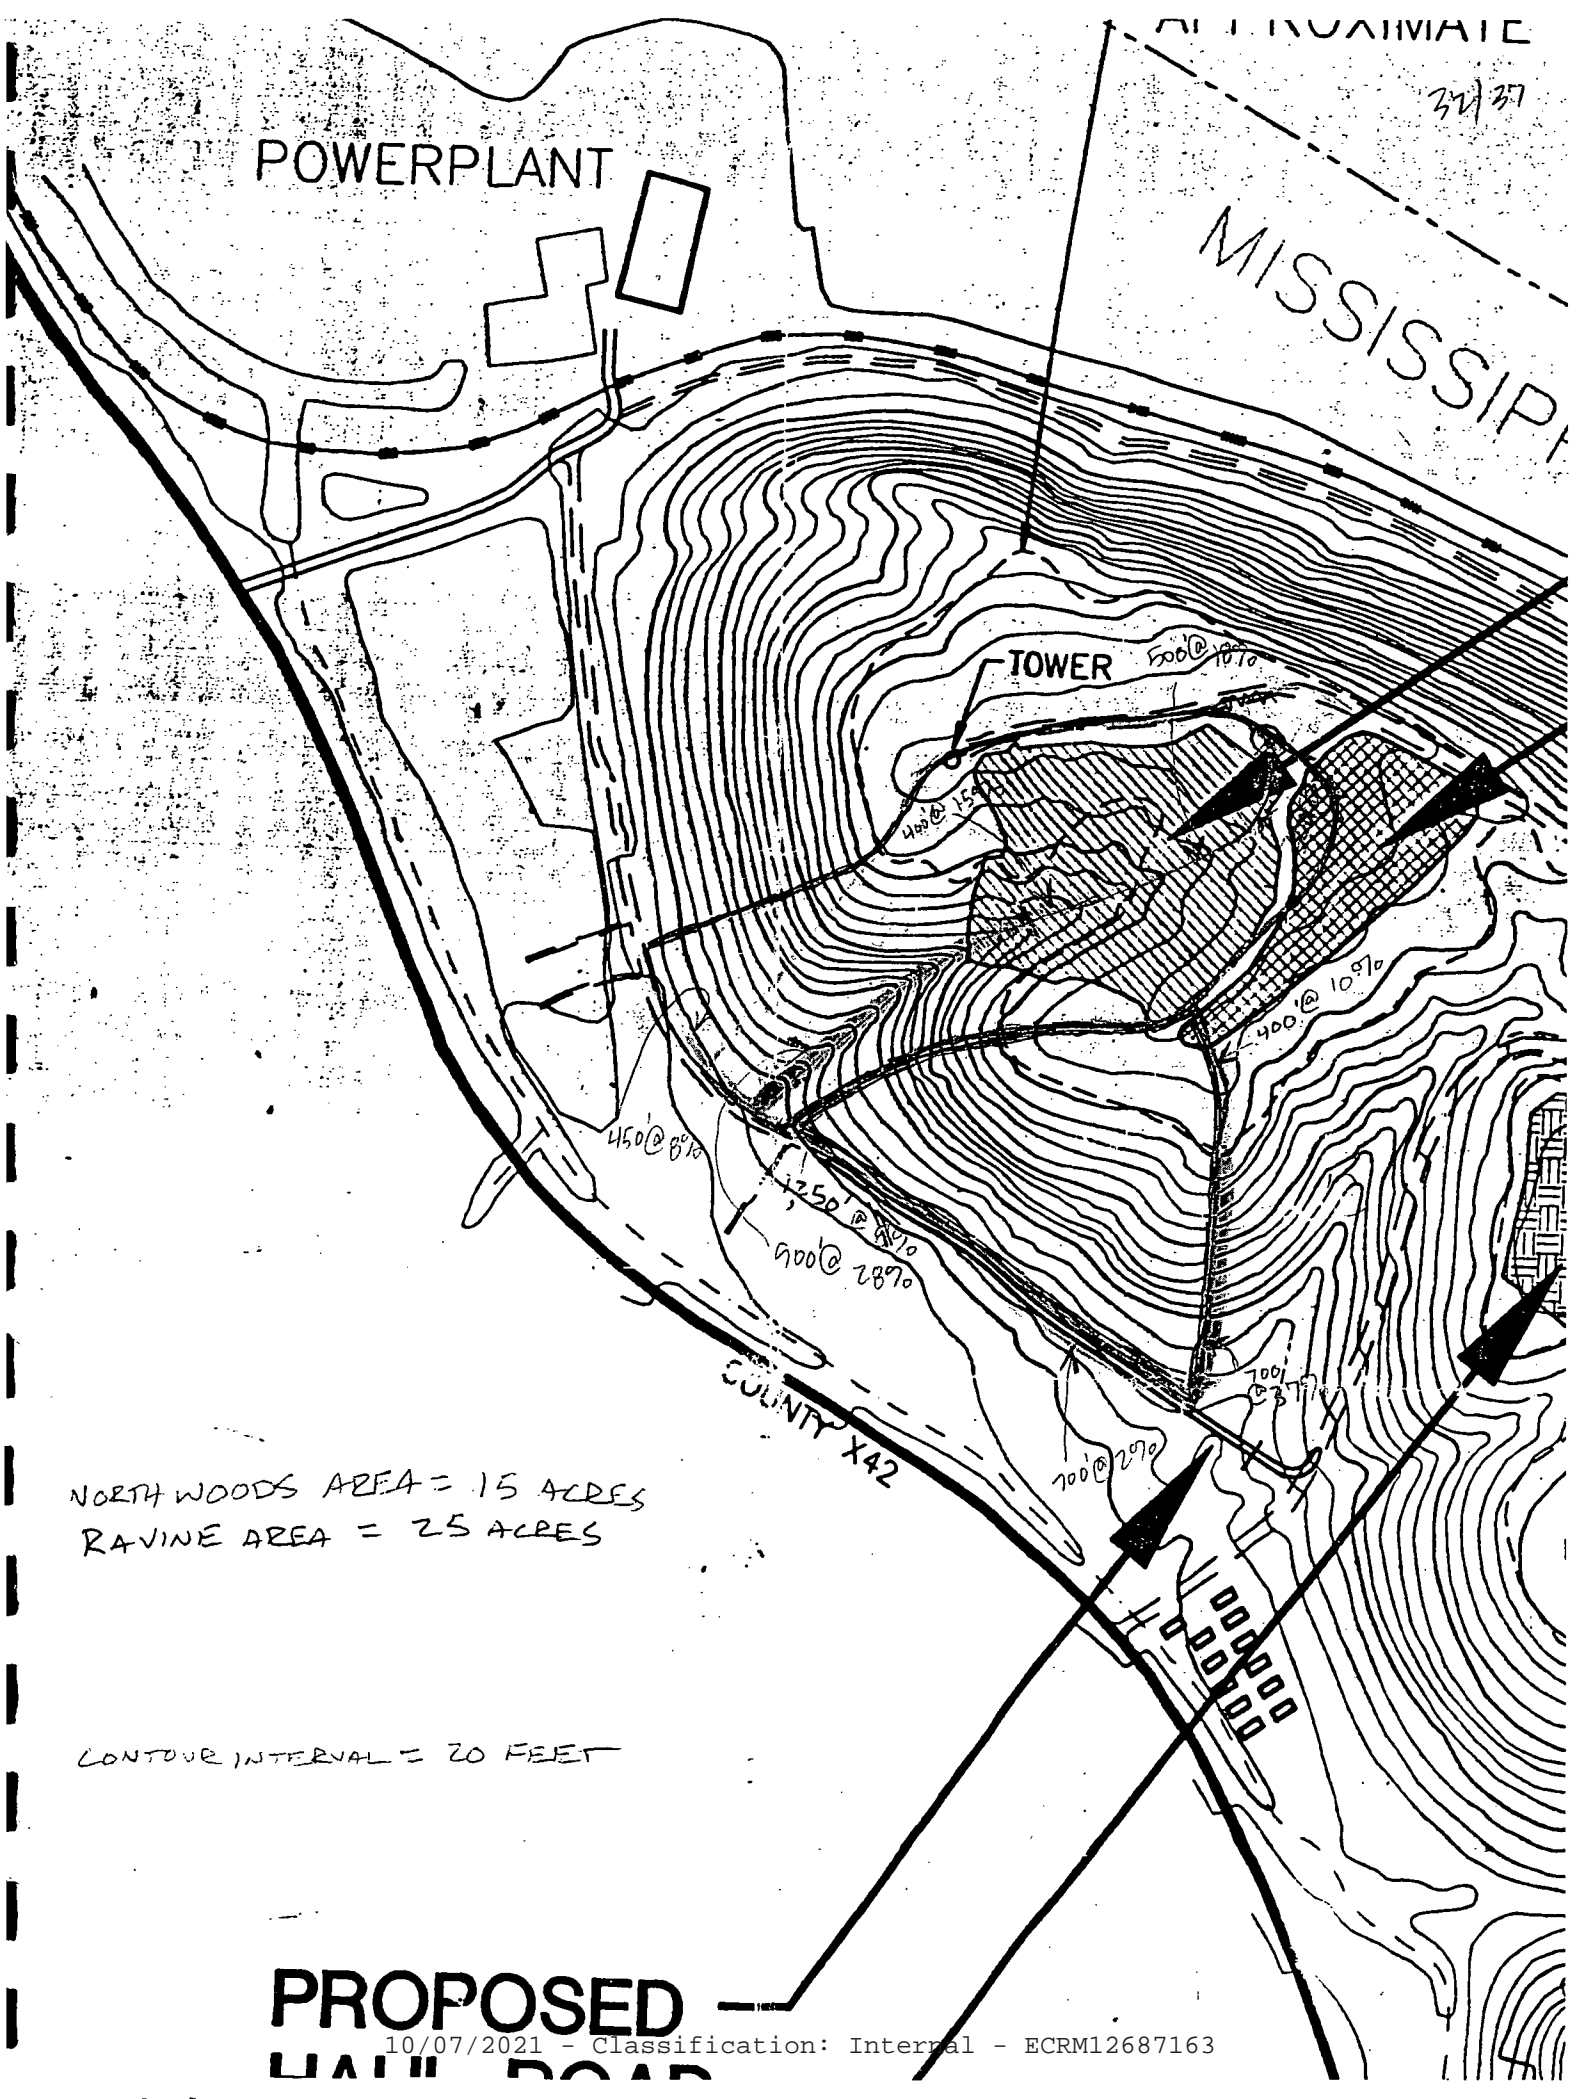

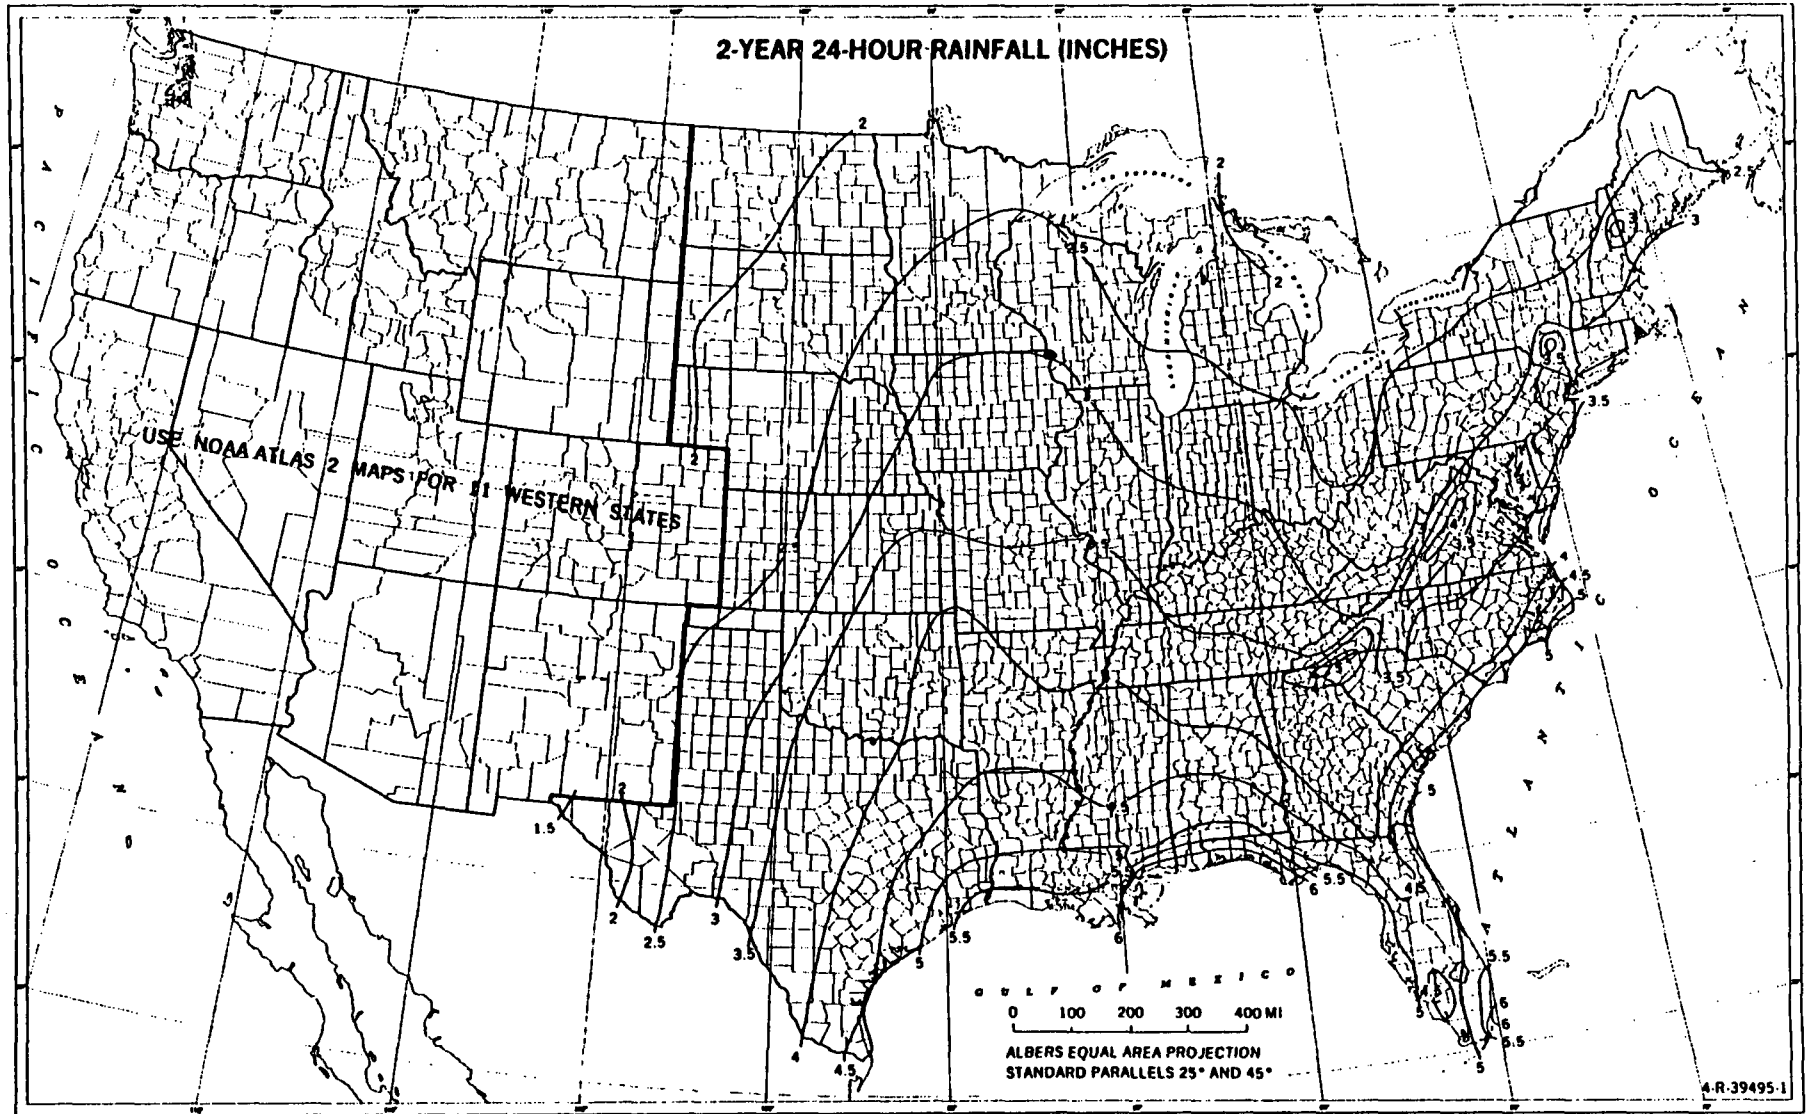


Figure B-3.—Two-year, 24-hour rainfall.

22/27

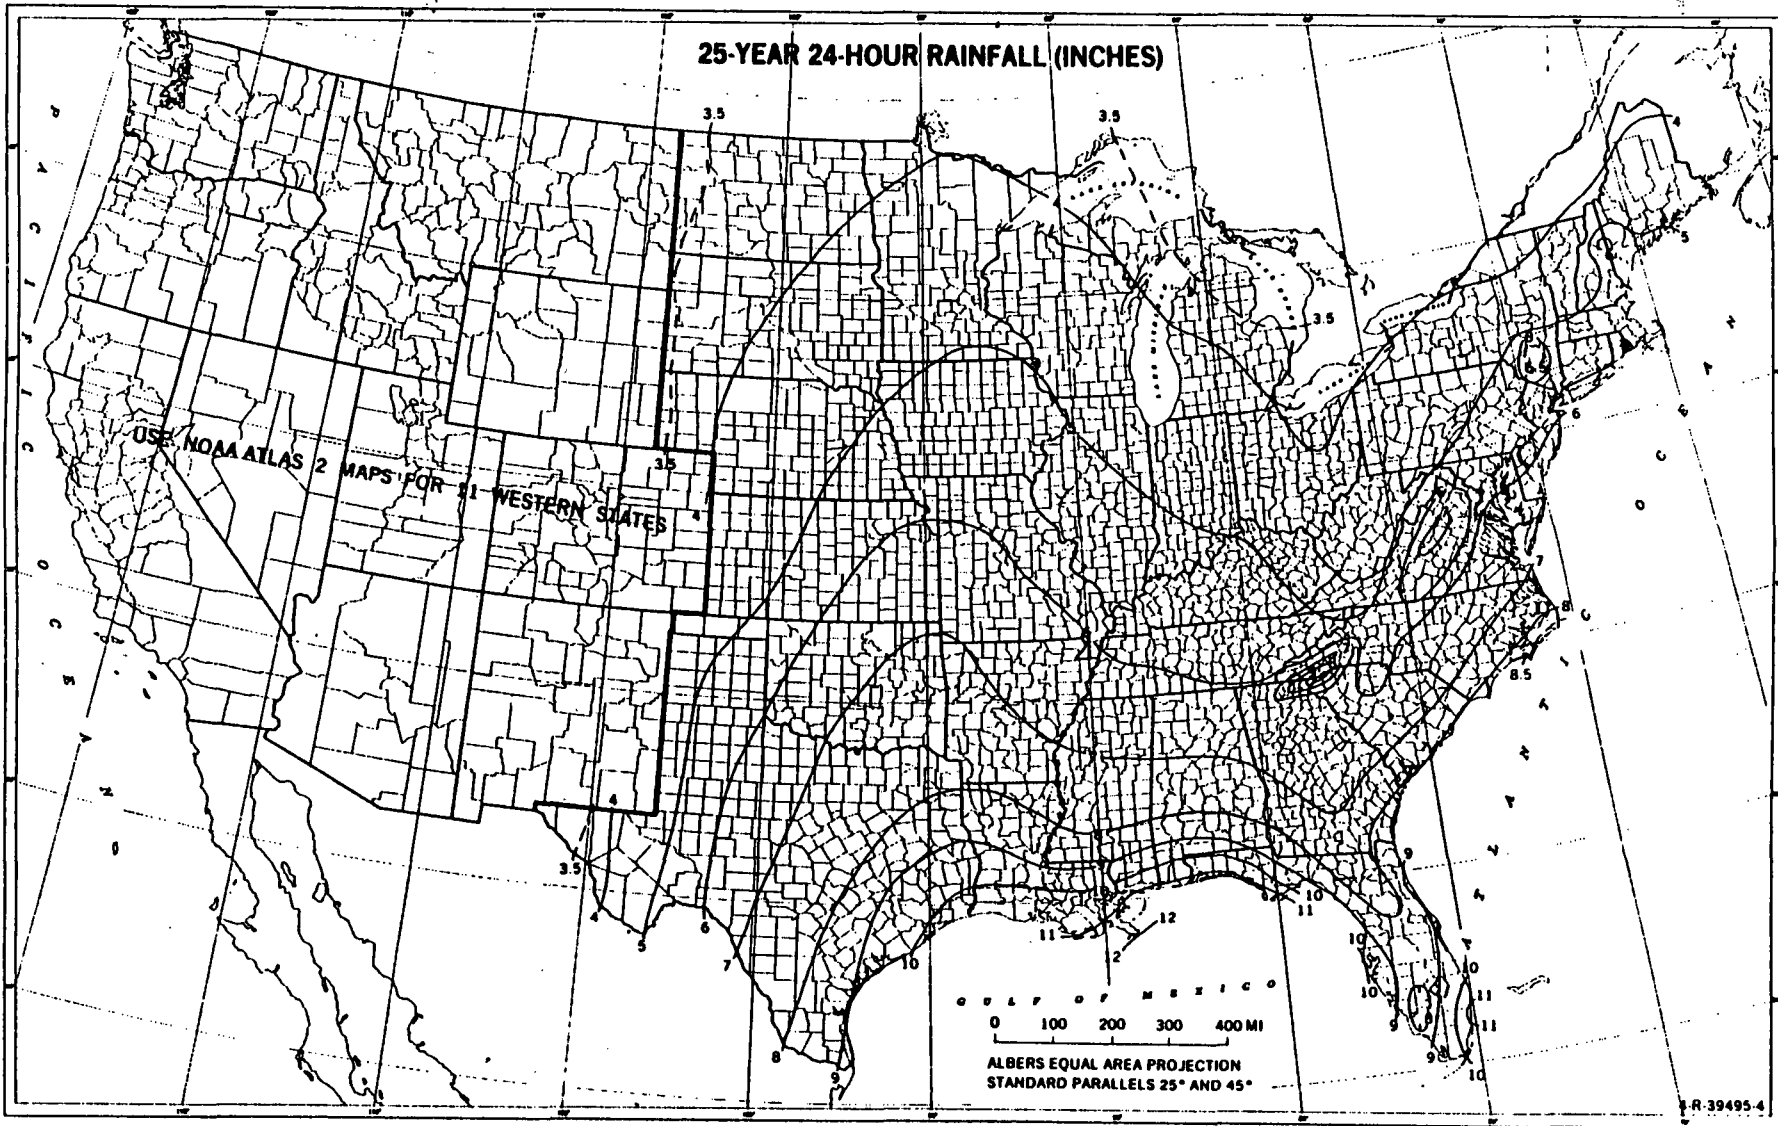


Figure B-6.—Twenty-five-year, 24-hour rainfall.

(210-VI-TR-55, Second Ed., June 1986)

B-7

34/37

35)37

Worksheet Worksheet for Circular Channel

Project Description	
Worksheet	Circular Channel - 1
Flow Element	Circular Channel
Method	Manning's Formula
Solve For	Channel Depth

Input Data	
Mannings Coefficient	0.024
Slope	0.025000 ft/ft
Diameter	48 in
Discharge	90.00 cfs

Results	
Depth	2.54 ft
Flow Area	8.4 ft ²
Wetted Perimeter	7.38 ft
Top Width	3.85 ft
Critical Depth	2.88 ft
Percent Full	63.5 %
Critical Slope	0.017817 ft/ft
Velocity	10.69 ft/s
Velocity Head	1.78 ft
Specific Energy	4.32 ft
Froude Number	1.27
Maximum Discharge	132.33 cfs
Discharge Full	123.02 cfs
Slope Full	0.013381 ft/ft
Flow Type	Supercritical

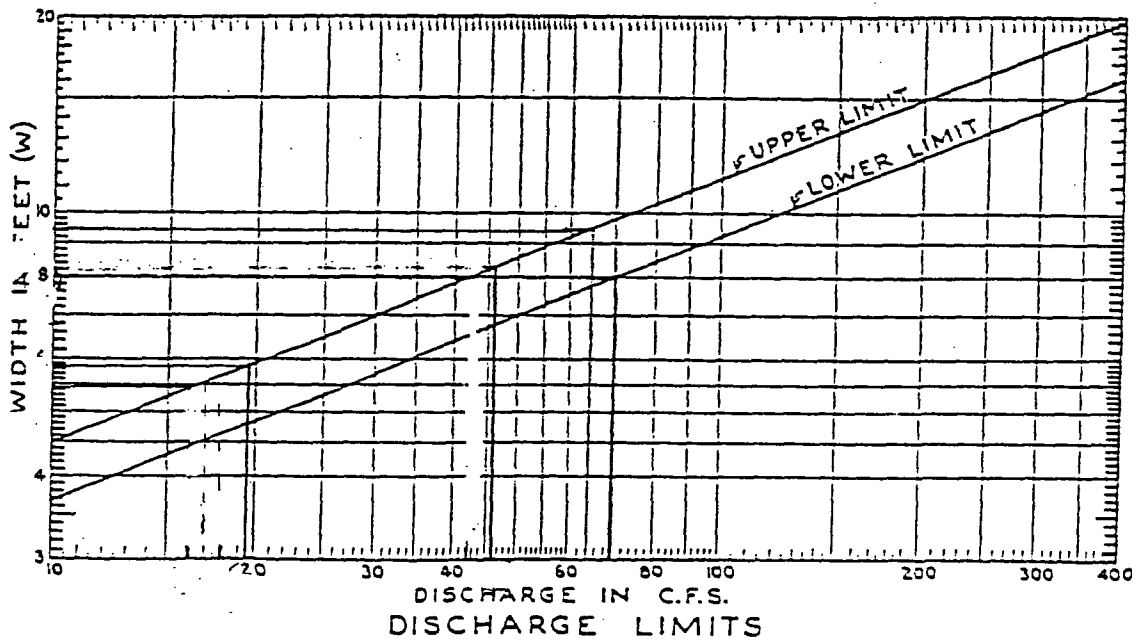
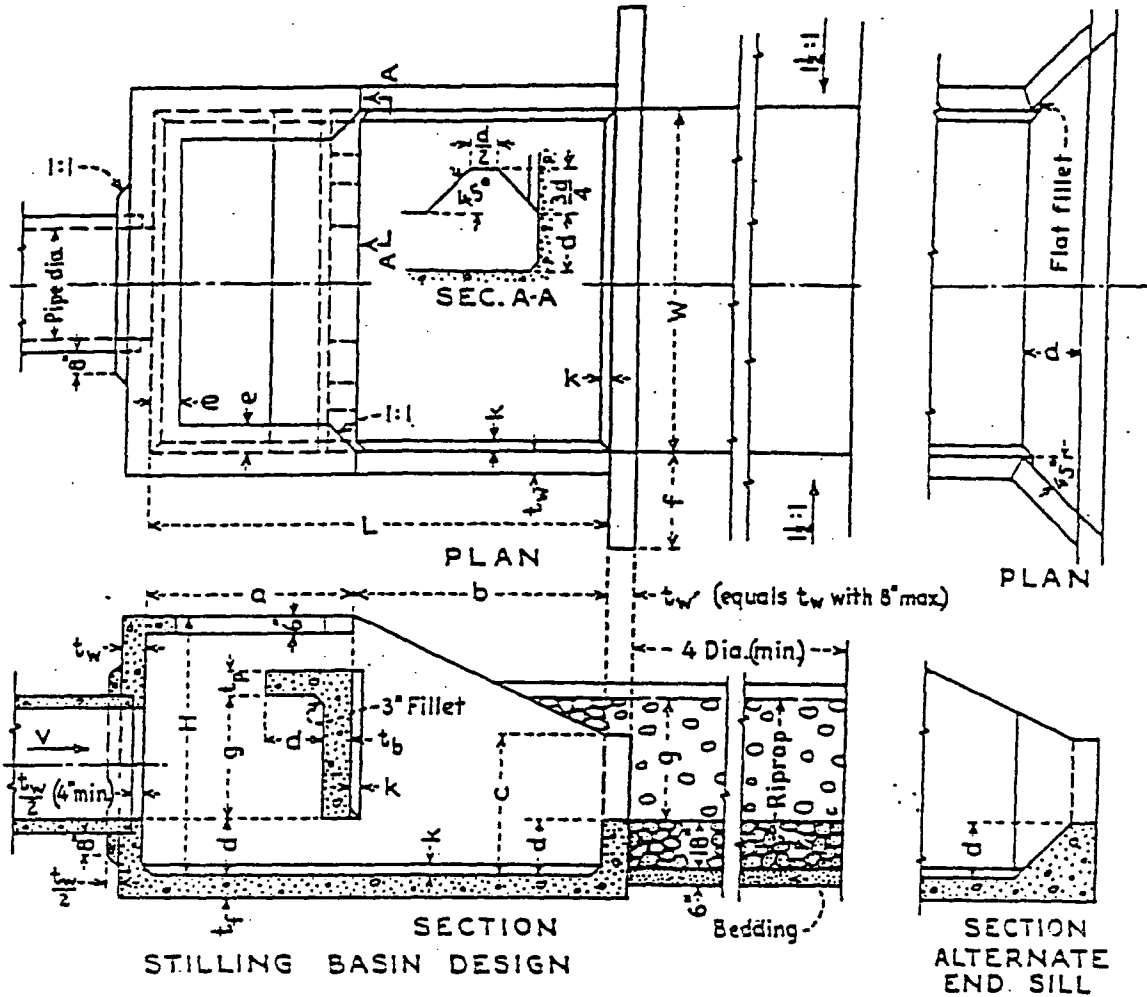


FIGURE 42.—Impact-type energy dissipator (Basin VI).

37/37

TABLE 11.—Stilling basin dimensions (Basin VI). Impact-type energy dissipator.

Suggested pipe size		Max. discharge Q (3)	Feet and inches											Inches				
Dia. in. (1)	Area (sq ft) (2)		W (4)	H (5)	L (6)	a (7)	b (8)	c (9)	d (10)	e (11)	f (12)	g (13)	h ₁ (14)	h ₂ (15)	h ₃ (16)	h ₄ (17)	K (18)	Suggested riprap dia. (19)
18	1.77	21	5-0	4-3	3-3	4-1	2-4	0-11	0-0	1-0	2-1	0	0 3/8	0	0	0	3	4.0
24	3.14	38	8-0	5-3	3-11	5-1	2-10	1-2	0-0	2-0	2-0	0	0 3/8	0	0	0	3	7.0
30	4.01	60	10-0	6-3	4-7	6-1	3-4	1-4	0-8	2-0	3-0	0	0 3/8	0	0 3/8	7	3	8.5
36	7.07	85	12-0	7-3	5-3	7-1	3-10	1-7	0-8	3-0	3-0	7	7 3/8	8	8	8	3	9.0
42	9.02	115	14-0	8-0	6-0	8-0	4-5	1-9	0-10	3-0	3-11	8	8 3/8	10	8	4	4	10.5
48	12.57	151	16-0	9-0	6-0	8-11	4-11	2-0	0-10	3-0	4-5	9	9 3/8	10	8	4	4	12.0
54	15.00	191	18-0	10-0	7-4	10-0	5-5	2-2	1-0	3-0	4-11	10	10 3/8	10	8	4	4	13.0
60	18.03	230	20-0	11-0	8-0	11-0	5-11	2-5	1-0	3-0	5-4	11	11 3/8	11	8	0	0	14.0
72	28.27	330	22-0	12-3	9-3	12-0	6-11	2-0	1-3	3-0	6-2	12	12 3/8	12	8	0	0	14.0

USE SMALLEST POSSIBLE FOR Q, CFS

¹ Suggested pipe will run full when velocity is 12 feet per second or half full when velocity is 21 feet per second. Size may be modified for other velocities by $Q = AV$, but relation between Q and basin dimensions shown must be maintained.

² For discharges less than 21 second-feet, obtain basin width from curve of Fig. 9. Other dimensions proportional to W; if $W = \frac{3W}{4}$, $L = \frac{4W}{3}$, $L = \frac{4W}{3}$, $d = \frac{W}{6}$, etc.


³ Determination of riprap size explained in Sec. 10.

Worksheet
Worksheet for Circular Channel

Project Description	
Worksheet	Road Culvert
Flow Element	Circular Channel
Method	Manning's Formula
Solve For	Channel Depth

Input Data	
Mannings Coefficient	0.024
Slope	0.025000 ft/ft
Diameter	48 in
Discharge	95.00 cfs

Results	
Depth	2.64 ft
Flow Area	8.8 ft ²
Wetted Perimeter	7.58 ft
Top Width	3.79 ft
Critical Depth	2.95 ft
Percent Full	66.0 %
Critical Slope	0.018582 ft/ft
Velocity	10.80 ft/s
Velocity Head	1.81 ft
Specific Energy	4.45 ft
Froude Number	1.25
Maximum Discharge	132.33 cfs
Discharge Full	123.02 cfs
Slope Full	0.014909 ft/ft
Flow Type	Supercritical



Sheet No. 1 OF 9

Calc. No. 2

Rev. No.

Job No. 1792

Job ALLIANT - LANSING ASH FILL

By TR Date 7/19/01

Client ALLIANT

Subject EROSION CONTROL

Chk'd. MRH Date 7-26-01

PURPOSE: TO DETERMINE WHAT KIND OF EROSION CONTROL PRODUCTS WILL BE REQUIRED IN THE PERIMETER DITCHES AND DIVERSION BERMS.

APPROACH: USE FLOW MASTER TO DETERMINE VELOCITIES FOR VARIOUS SCENARIOS USING MANNINGS NUMBERS FOR DIFFERENT EROSION CONTROL PRODUCTS.

REFERENCES: CALCULATION NO. 1
BON TERRA PRODUCT GUIDE.
PYRAMAT PRODUCT LITERATURE
PERMIT APPLICATION DRAWINGS

CALCULATIONS: REFER TO THE ATTACHED FLOWMASTER OUTPUT SHEETS

CONCLUSIONS: NORTH PERIMETER DITCH 2% SLOPE - BON TERRA S2
NORTH PERIMETER DITCH 8% SLOPE - BON TERRA CP2
OVER PYRAMAT
NORTH BERM - BON TERRA S2
SOUTH PERIMETER DITCH - BON TERRA S2
SOUTH BERM - BON TERRA S2

Worksheet Worksheet for Triangular Channel

Project Description	
Worksheet	North Berm
Flow Element	Triangular Channel
Method	Manning's Formula
Solve For	Channel Depth

Input Data	
Mannings Coefficient	0.021
Slope	0.020000 ft/ft
Left Side Slope	0.25 V : H
Right Side Slope	0.50 V : H
Discharge	16.00 cfs

Results	
Depth	0.96 ft
Flow Area	2.8 ft ²
Wetted Perimeter	6.09 ft
Top Width	5.75 ft
Critical Depth	1.12 ft
Critical Slope	0.008665 ft/ft
Velocity	5.81 ft/s
Velocity Head	0.52 ft
Specific Energy	1.48 ft
Froude Number	1.48
Flow Type	Supercritical

< 10 fps OK WITH BOW TERRA SZ

Worksheet Worksheet for Trapezoidal Channel

Project Description	
Worksheet	North Ditch
Flow Element	Trapezoidal Channe
Method	Manning's Formula
Solve For	Channel Depth

Input Data	
Mannings Coefficient	0.021
Slope	0.020000 ft/ft
Left Side Slope	0.50 V : H
Right Side Slope	0.50 V : H
Bottom Width	5.00 ft
Discharge	36.00 cfs

Results	
Depth	0.78 ft
Flow Area	5.1 ft ²
Wetted Perimeter	8.49 ft
Top Width	8.12 ft
Critical Depth	1.02 ft
Critical Slope	0.007666 ft/ft
Velocity	7.04 ft/s
Velocity Head	0.77 ft
Specific Energy	1.55 ft
Froude Number	1.56
Flow Type	Supercritical

< 10 fps OK WITH BON TERRA SL

Worksheet Worksheet for Trapezoidal Channel

Project Description	
Worksheet	North Ditch
Flow Element	Trapezoidal Channe
Method	Manning's Formula
Solve For	Channel Depth

Input Data	
Mannings Coefficient	0.020
Slope	0.080000 ft/ft
Left Side Slope	0.50 V : H
Right Side Slope	0.50 V : H
Bottom Width	5.00 ft
Discharge	95.00 cfs

Results	
Depth	0.88 ft
Flow Area	5.9 ft ²
Wetted Perimeter	8.93 ft
Top Width	8.51 ft
Critical Depth	1.76 ft
Critical Slope	0.005921 ft/ft
Velocity	16.01 ft/s
Velocity Head	3.98 ft
Specific Energy	4.86 ft
Froude Number	3.38
Flow Type	Supercritical

< 18 fps O.K WITH BON TERRA CP2 + PYRAMAT

Worksheet Worksheet for Triangular Channel

Project Description	
Worksheet	south berm
Flow Element	Triangular Channel
Method	Manning's Formula
Solve For	Channel Depth

Input Data	
Mannings Coefficient	0.021
Slope	0.020000 ft/ft
Left Side Slope	0.50 V : H
Right Side Slope	0.25 V : H
Discharge	9.00 cfs

Results	
Depth	0.77 ft
Flow Area	1.8 ft ²
Wetted Perimeter	4.91 ft
Top Width	4.63 ft
Critical Depth	0.89 ft
Critical Slope	0.009356 ft/ft
Velocity	5.03 ft/s
Velocity Head	0.39 ft
Specific Energy	1.17 ft
Froude Number	1.43
Flow Type	Supercritical

< 10 fps O.K. WITH BON TERRA SZ

6/9

Worksheet Worksheet for Trapezoidal Channel

Project Description

Worksheet	South Ditch
Flow Element	Trapezoidal Channe
Method	Manning's Formula
Solve For	Channel Depth

Input Data

Mannings Coefficient	0.021
Slope	0.075000 ft/ft
Left Side Slope	0.50 V : H
Right Side Slope	0.25 V : H
Bottom Width	5.00 ft
Discharge	17.00 cfs

Results

Depth	0.34 ft
Flow Area	2.0 ft ²
Wetted Perimeter	7.16 ft
Top Width	7.04 ft
Critical Depth	0.62 ft
Critical Slope	0.008674 ft/ft
Velocity	8.29 ft/s <i>< 10 fps OK. WITH BON TERRA SZ</i>
Velocity Head	1.07 ft
Specific Energy	1.41 ft
Froude Number	2.71
Flow Type	Supercritical

S2

Use on slopes with medium run off conditions. Made from 100% straw with lightweight photodegradable netting on both sides.

Mass/Unit Area: 8 oz./SY min
Thickness: .25 in.
Tensile Strength: 112x64 lb. ft.
Elongation: 42%x28%
Flexibility: 4780 x 7730 (mg-cm)
Flow Velocity: 10 fps
Permissible Shear Stress: 2.2 lbs/sq.ft.
Manning's N-Value: 0.0213
Size: 7.5 ft x 90 ft = 75 SY
"C" Factor: 0.002



S1

Use on slopes with moderate run off conditions. Made from 100% straw with lightweight photodegradable netting on top side.

Mass/Unit Area: 8 oz./SY min
Thickness: .25 in.
Tensile Strength: 90x60 lb.ft.
Elongation: 30%x30%
Flexibility: 3450 (mg-cm)
Flow Velocity: 6 fps
Permissible Shear Stress: 2 lbs/sq.ft.
Manning's N-Value: 0.0246
Size: 7.5 ft x 90 ft = 75 SY
"C" Factor: 0.002





HP90

Made from 100% natural coir (coconut) fiber, needlepunched with latex into a high tensile three dimensional matrix. HP90 serves as bioengineering media for live stake layering, controls erosion in high velocity intermittent flow channels or sediment trapping .

Mass/Unit Area: 18.84 oz./SY min
Thickness: .25 in.
Absorptive Capacity: 2.29
Resiliency: 33%
Tensile Strength: 13x8 lb.ft.
Elongation: 18%x16%
Flexibility: 4.67
Permeability: 5.02 cm/s
Tear Resistance: 19x16 lb.
Permittivity: 8.00
Flow Velocity: 598.80 gal/min/ft.²
Size: 36"/48"x60"
"C" Factor: 0.003



CFMats



Made from 100% coir fiber twine woven into high strength mats for extreme slope stabilization, protection of high velocity streambanks and high velocity intermittent flow channels; used for frost shear protection.

Distributed By:



CF4

Thickness: .30 in
Tensile Strength: 432x138 lb/ft.
Elongation: 26%x32
Flexibility (mg-cm): 19920x16790
Flow Velocity: Observed 9 ft./sec.
Weight: 11.8 oz/SY
Size: 6.6x164 ft (120 sy) or (100 sm)
"C" Factor: 0.002
Open Area (measured): 65%

CF7

Thickness: .30 in.
Tensile Strength: 1348x626 lb/ft.
Elongation: 34%x38%
Flexibility (mg-cm): 65030x29590
Flow Velocity: Observed 11ft./sec.
Weight: 20 oz/SY
Size: 6.6x164 ft (120 sy) or (100 sm)
"C" Factor: 0.002
Open Area (measured): 50%

CF9


Thickness: .30 in
Tensile Strength: 1648x670 lb/ft
Elongation: 42%x32%
Flexibility (mg-cm): 89270x39360
Flow Velocity: Observed 16 ft./sec.
Weight: 26 oz/SY
Size: 6.6x164 ft (120 sy) or (100 sm)
"C" Factor: 0.003
Open Area (measured): 39%



CS2

For slopes with heavy runoff conditions and where protection is needed for 2 to 4 years. Handles steep slide rehabilitation, high elevation reclamation, drought area revegetation, long slope cut and fill, mine land and landfill reclamation; also used on bridge abutments, ski runs, and channel shoulders. Made from a homogenous blend of 70% straw and 30% coir fiber. CS2 has a lightweight photodegradable netting on bottom side, and long lasting UV stabilized, photodegradable netting on the top side.


Mass/Unit Area: 8 oz./SYmin
Thickness: .25 in.
Tensile Strength: 126x94 lb. ft.
Elongation: 38%x30%
Flexibility: 810 (mg-cm)
Flow Velocity: 12 fps
Permissible Shear Stress: 2.5 lbs/sq.ft.
Manning's N-Value: 0.0213
Size: 7.5 ft x 90 ft = 75 SY
"C" Factor: 0.002

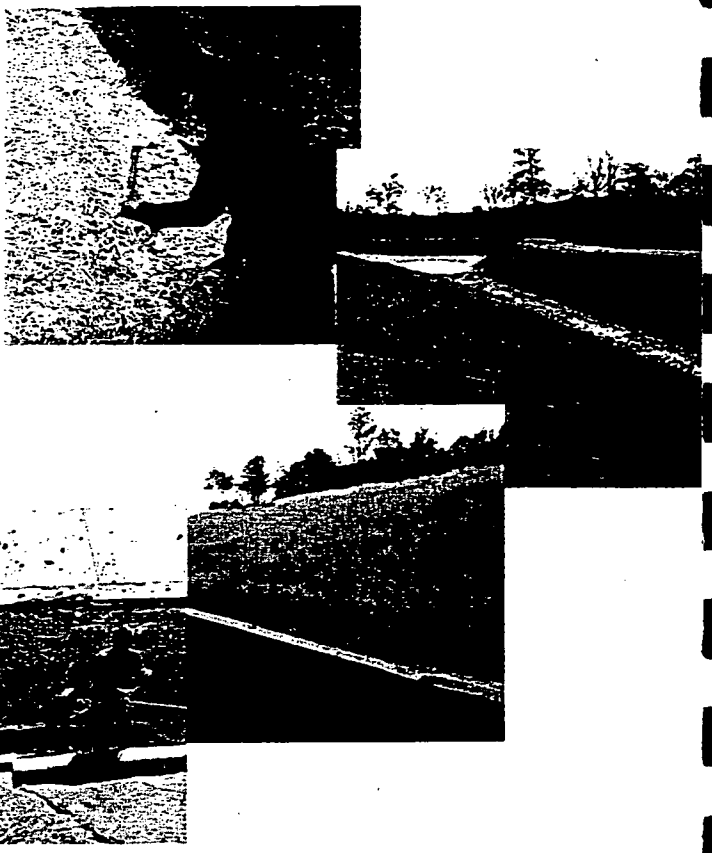

SFB12

Use in applications where flow exceeds 20 fps and where shear stress or tensile strength requirements exceed standard SFB. Made from 100% synthetic fibers with long lasting UV stabilized netting on bottom, heavy duty UV stabilized netting on top.

Mass/Unit Area: 12 oz./SYmin
Thickness: .50 in.
Tensile Strength: 280x200 lb.ft.
Elongation: 20%x20%
Flexibility: 12810-6070 (mg-cm)
Flow Velocity: 27fps
Permissible Shear Stress: 6 lbs/sq.ft.
Porosity: 95% (calculated)
Manning's N-Value: 0.0283
UVI Stability: 90%
Size: 7.5 ft x 90 ft = 75 SY
"C" Factor: 0.003

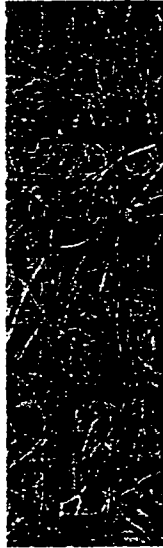

CP2

Made from a 50/50 homogeneous blend of natural coir (coconut) fiber and UV treated polypropylene fibers with photodegradable netting on both sides. For use as slope protection, channel liner, drainage ditch lining and bank stabilization. Developed for areas where long-term erosion control blankets are needed and where humus needs to be increased in the soil. Often used in arid areas to provide long-term soil protection during the 3-5 year revegetation process; also provides permanent support throughout the project's life.

Mass/Unit Area: 8 oz/SY min
Thickness: .25 in.
Tensile Strength: 250x150 lb. ft.
Elongation: 20%x20%
Flexibility: 700x1600 (mg-cm)
Flow Velocity: 18 fps
Permissible Shear Stress: 4 lbs/sq.ft.
Manning's N-Value: 0.02
Size: 7.5 ft x 90 ft = 75 SY
"C" Factor: 0.003

It's Performance That Counts!

BonTerra products are tested by laboratories such as the UWRL (Utah Water Research Laboratories) and other respected laboratories in the U.S. Extensive research is conducted to determine each product's effectiveness at reducing soil loss under various site conditions. The tests are conducted using flumes, soil-filled test beds, variable slopes, and rainfall simulation. Test results (shown as ASTM test measurements) are listed in our literature and on our sample labels, making product selection simple when designing to performance parameters.

If the jobsite is environmentally sensitive, EcoNet™ meets the specifications. Call 800-882-9489 for details.

Engineering Specifications

PIRAMAT - HIGH PERFORMANCE
TURF REINFORCEMENT MAT
PRODUCT LITERATURE PROVIDED
BY SYNTHETIC INDUSTRIES

The HIGH PERFORMANCE TURF REINFORCEMENT MAT shall be a three-dimensional, lofty, woven polypropylene geotextile specially designed for erosion control applications on steep slopes, water containment structures and vegetated waterways. The matrix shall be composed of polypropylene monofilament yarns woven into a uniform,

dimensionally stable configuration of resilient pyramid-like projections. The material shall exhibit very high interlock and reinforcement capacity with both soil and root systems and demonstrate high tensile modulus. The high performance TRM shall conform to the property values listed below under dry or saturated conditions.

		MINIMUM AVERAGE ROLL VALUES (MARV)			
PROPERTY	TEST METHOD	ENGLISH	METRIC		
MECHANICAL					
Tensile Strength ²	ASTM D-4595	3,200 X 2,200 lb/ft	46.7 X 32.1 kN/m		
	ASTM D-5035	3,100 X 2,000 lb/ft	45.2 X 29.2 kN/m		
Tensile Elongation ²	ASTM D-4595	80% (max)	80% (max)		
	ASTM D-5035	55% (max)	55% (max)		
Tensile Strength ² @ 10% Elongation	ASTM D-4595	1,850 X 1,600 lb/ft (typ)	27.0 X 23.4 kN/m (typ)		
ENDURANCE					
UV Resistance @ 1000 hours	ASTM D-4355	80%	80%		
PHYSICAL					
Thickness	ASTM D-1777	0.5 in	12.7 mm		
Resiliency ³	ASTM D-1777	80%	80%		
Mass Per Unit Area	ASTM D-5621	14 oz/yd ²	475 g/m ²		
Ground Cover Factor ⁴	Light Projection Analysis	75%	75%		
PERFORMANCE		MAXIMUM PERMISSIBLE VALUES			
Velocity	Short-Term (1/2 hr)		Long-Term (50 hrs)		
	Vegetated	25 ft/sec	7.6 m/sec	14 ft/sec	4.3 m/sec
Unvegetated	20 ft/sec	6.1 m/sec	10 ft/sec	3.0 m/sec	
Shear Stress	Vegetated	10 lb/ft ²	48.9 kg/m ²	6 lb/ft ²	29.3 kg/m ²
	Unvegetated	8 lb/ft ²	39.2 kg/m ²	3 lb/ft ²	14.7 kg/m ²

NOTES:

- All published values are Minimum Average Roll Values (MARV) unless otherwise indicated, yielding a 95% confidence level. Additional property values available upon request.
- Values for both machine and cross machine directions under dry or saturated conditions.
- Resiliency defined as percent of original thickness retained after 3 cycles of a 100 psi load (690 kPa) for 60 seconds without load... thickness measured 30 minutes after load removed in accordance with ASTM D-1777.
- Ground Cover Factor represents "% shade" from Lumite[®] Light Projection Test.
- Values obtained at an independent hydraulics testing laboratory.




STANDARD ROLL SIZE INFORMATION

2.59 m x 27.4 m = 71 m²
8.5 ft x 90 ft = 765 ft² = 85 yd²

Appendix A2
Phase 1 Final Cover

HydroCAD Output

25-yr, 24-hr Storm Event

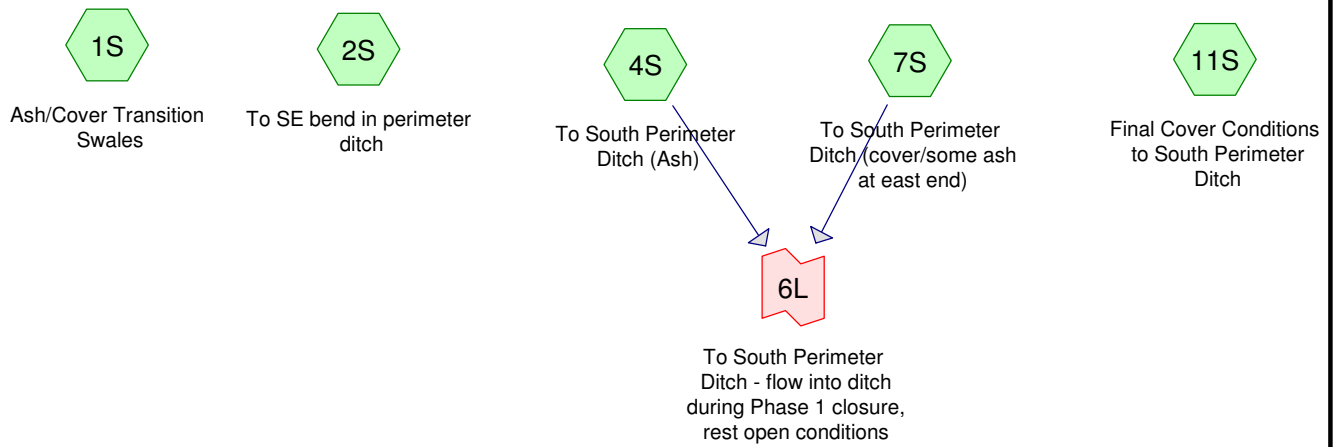

Routing Diagram for Hydrocad SW Model
Prepared by {enter your company name here}, Printed 6/10/2015
HydroCAD® 10.00-14 s/n 05804 © 2015 HydroCAD Software Solutions LLC

Hydrocad SW Model

Prepared by {enter your company name here}

Printed 6/10/2015

HydroCAD® 10.00-14 s/n 05804 © 2015 HydroCAD Software Solutions LLC

Page 2

Area Listing (selected nodes)

Area (acres)	CN	Description (subcatchment-numbers)
8.988	98	(1S, 4S, 7S)
15.636	74	(2S, 7S, 11S)
24.624	83	TOTAL AREA

Hydrocad SW Model

Prepared by {enter your company name here}

Printed 6/10/2015

HydroCAD® 10.00-14 s/n 05804 © 2015 HydroCAD Software Solutions LLC

Page 3

Soil Listing (selected nodes)

Area (acres)	Soil Group	Subcatchment Numbers
0.000	HSG A	
0.000	HSG B	
0.000	HSG C	
0.000	HSG D	
24.624	Other	1S, 2S, 4S, 7S, 11S
24.624		TOTAL AREA

Hydrocad SW Model

Prepared by {enter your company name here}

Printed 6/10/2015

HydroCAD® 10.00-14 s/n 05804 © 2015 HydroCAD Software Solutions LLC

Page 4

Ground Covers (selected nodes)

HSG-A (acres)	HSG-B (acres)	HSG-C (acres)	HSG-D (acres)	Other (acres)	Total (acres)	Ground Cover	Subcatchment Numbers
0.000	0.000	0.000	0.000	24.624	24.624		1S, 2S, 4S, 7S, 11S
0.000	0.000	0.000	0.000	24.624	24.624	TOTAL AREA	

Hydrocad SW Model*Type II 24-hr 25yr-24hr Rainfall=5.48"*

Prepared by {enter your company name here}

Printed 6/10/2015

HydroCAD® 10.00-14 s/n 05804 © 2015 HydroCAD Software Solutions LLC

Page 5

Time span=5.00-20.00 hrs, dt=0.05 hrs, 301 points
 Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
 Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 1S: Ash/Cover Transition Runoff Area=137,773 sf 100.00% Impervious Runoff Depth>4.80"
 Flow Length=1,215' Tc=3.6 min CN=98 Runoff=26.05 cfs 1.265 af

Subcatchment 2S: To SE bend in perimeter Runoff Area=55,425 sf 0.00% Impervious Runoff Depth>2.53"
 Flow Length=540' Tc=6.0 min CN=74 Runoff=6.03 cfs 0.269 af

Subcatchment 4S: To South Perimeter Runoff Area=5.550 ac 100.00% Impervious Runoff Depth>4.80"
 Flow Length=1,215' Tc=3.6 min CN=98 Runoff=45.72 cfs 2.221 af

Subcatchment 7S: To South Perimeter Runoff Area=197,719 sf 6.06% Impervious Runoff Depth>2.62"
 Flow Length=1,460' Tc=3.9 min CN=75 Runoff=24.26 cfs 0.993 af

Subcatchment 11S: Final Cover Conditions Runoff Area=10.100 ac 0.00% Impervious Runoff Depth>2.53"
 Flow Length=1,460' Tc=8.8 min CN=74 Runoff=44.16 cfs 2.131 af

Link 6L: To South Perimeter Ditch - flow into ditch during Phase 1 closure, Inflow=69.86 cfs 3.213 af
 Primary=69.86 cfs 3.213 af

Total Runoff Area = 24.624 ac Runoff Volume = 6.879 af Average Runoff Depth = 3.35"
63.50% Pervious = 15.636 ac 36.50% Impervious = 8.988 ac

HydroCAD SW Model

Type II 24-hr 25yr-24hr Rainfall=5.48"

Prepared by {enter your company name here}

Printed 6/10/2015

HydroCAD® 10.00-14 s/n 05804 © 2015 HydroCAD Software Solutions LLC

Page 6

Summary for Subcatchment 1S: Ash/Cover Transition Swales

[49] Hint: $T_c < 2dt$ may require smaller dt

Runoff = 26.05 cfs @ 11.94 hrs, Volume= 1.265 af, Depth> 4.80"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, $dt= 0.05$ hrs
 Type II 24-hr 25yr-24hr Rainfall=5.48"

Area (sf)	CN	Description
* 137,773	98	
137,773		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.5	100	0.2500	3.63		Sheet Flow, First 100 Feet Smooth surfaces n= 0.011 P2= 2.95"
2.1	580	0.0230	4.51	30.66	Channel Flow, Channel Flow Area= 6.8 sf Perim= 9.5' r= 0.72' n= 0.040
1.0	535	0.0970	9.37	80.58	Channel Flow, Second Channel Area= 8.6 sf Perim= 11.8' r= 0.73' n= 0.040
3.6	1,215	Total			

Subcatchment 1S: Ash/Cover Transition Swales

Hydrograph

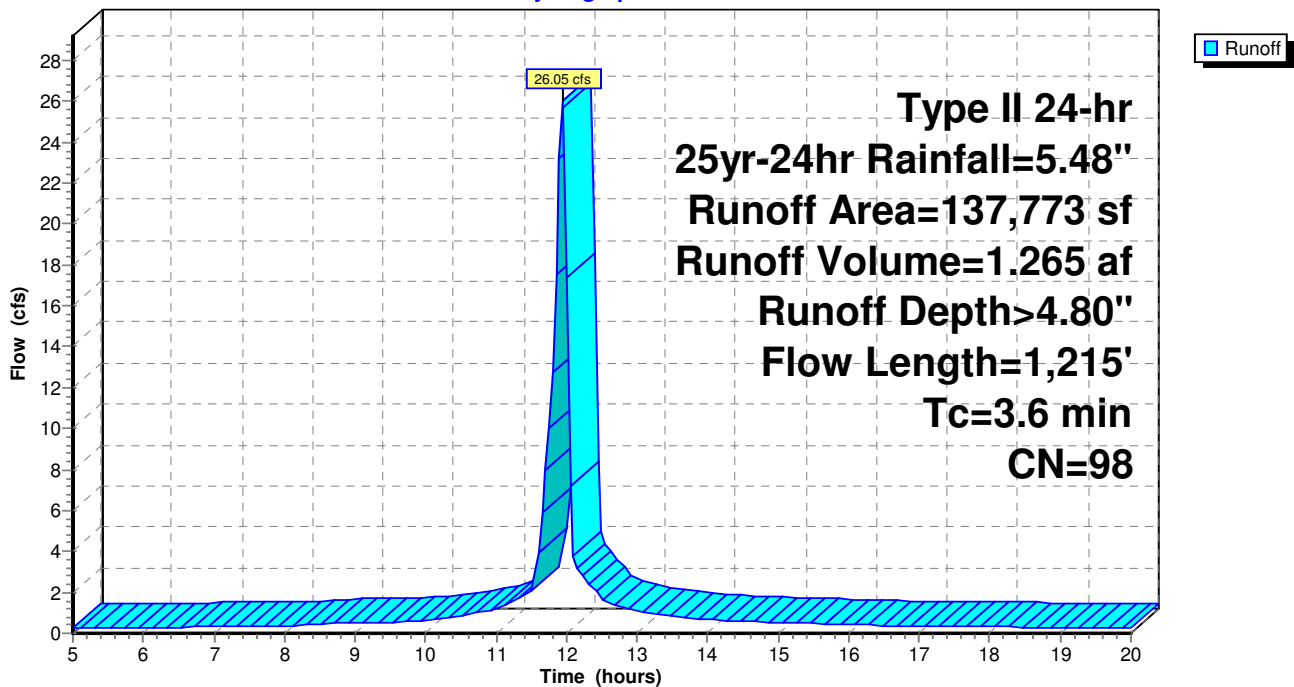

Hydrocad SW Model

Type II 24-hr 25yr-24hr Rainfall=5.48"

Prepared by {enter your company name here}

Printed 6/10/2015

HydroCAD® 10.00-14 s/n 05804 © 2015 HydroCAD Software Solutions LLC

Page 7

Summary for Subcatchment 2S: To SE bend in perimeter ditch

Runoff = 6.03 cfs @ 11.97 hrs, Volume= 0.269 af, Depth> 2.53"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs
 Type II 24-hr 25yr-24hr Rainfall=5.48"

Area (sf)	CN	Description
* 55,425	74	
55,425		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.4	100	0.2500	0.31		Sheet Flow, First 100 Feet Grass: Dense n= 0.240 P2= 2.95"
0.6	440	0.1000	12.07	265.58	Channel Flow, Channel Flow Area= 22.0 sf Perim= 17.7' r= 1.24' n= 0.045
6.0	540	Total			

Subcatchment 2S: To SE bend in perimeter ditch

Hydrograph

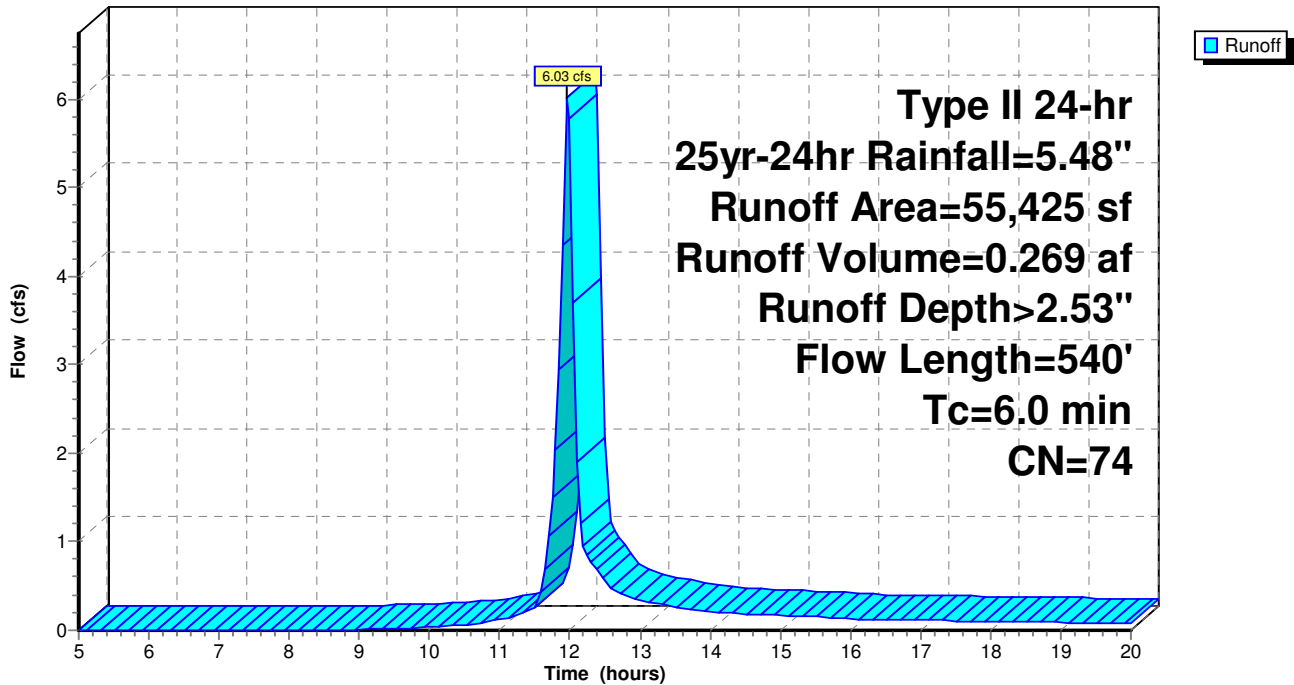

HydroCAD SW Model

Type II 24-hr 25yr-24hr Rainfall=5.48"

Prepared by {enter your company name here}

Printed 6/10/2015

HydroCAD® 10.00-14 s/n 05804 © 2015 HydroCAD Software Solutions LLC

Page 8

Summary for Subcatchment 4S: To South Perimeter Ditch (Ash)

[49] Hint: Tc<2dt may require smaller dt

Runoff = 45.72 cfs @ 11.94 hrs, Volume= 2.221 af, Depth> 4.80"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs
 Type II 24-hr 25yr-24hr Rainfall=5.48"

Area (ac)	CN	Description
* 5.550	98	
5.550		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.5	100	0.2500	3.63		Sheet Flow, First 100 Feet Smooth surfaces n= 0.011 P2= 2.95"
2.1	580	0.0230	4.51	30.66	Channel Flow, Channel Flow Area= 6.8 sf Perim= 9.5' r= 0.72' n= 0.040
1.0	535	0.0970	9.37	80.58	Channel Flow, Second Channel Area= 8.6 sf Perim= 11.8' r= 0.73' n= 0.040
3.6	1,215	Total			

Subcatchment 4S: To South Perimeter Ditch (Ash)

Hydrograph

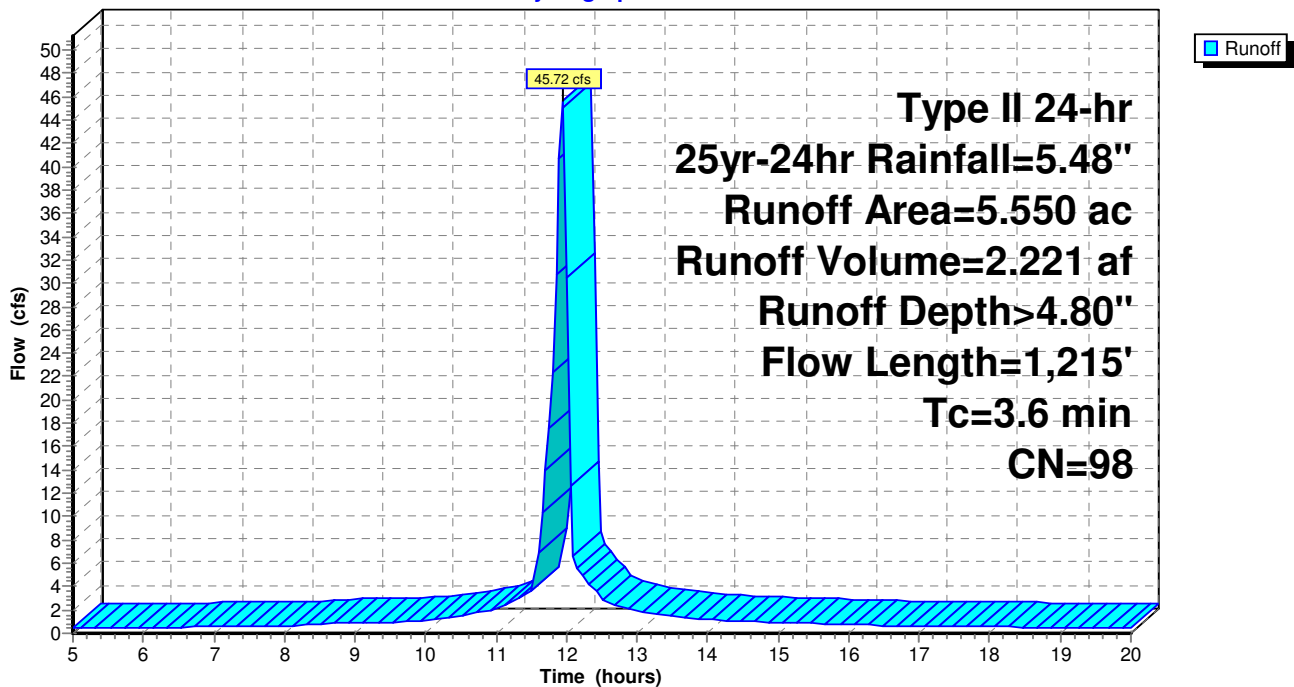

HydroCAD SW Model

Type II 24-hr 25yr-24hr Rainfall=5.48"

Prepared by {enter your company name here}

Printed 6/10/2015

HydroCAD® 10.00-14 s/n 05804 © 2015 HydroCAD Software Solutions LLC

Page 9

Summary for Subcatchment 7S: To South Perimeter Ditch (cover/some ash at east end)

[49] Hint: $T_c < 2dt$ may require smaller dt


Runoff = 24.26 cfs @ 11.95 hrs, Volume= 0.993 af, Depth> 2.62"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs
Type II 24-hr 25yr-24hr Rainfall=5.48"

	Area (sf)	CN	Description
*	185,740	74	
*	11,979	98	
	197,719	75	Weighted Average
	185,740		93.94% Pervious Area
	11,979		6.06% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.5	100	0.2500	3.63		Sheet Flow, First 100 Feet Smooth surfaces n= 0.011 P2= 2.95"
0.6	440	0.1000	12.07	265.58	Channel Flow, Channel Flow Area= 22.0 sf Perim= 17.7' r= 1.24' n= 0.045
2.8	920	0.0200	5.40	118.77	Channel Flow, Channel Flow Area= 22.0 sf Perim= 17.7' r= 1.24' n= 0.045
3.9	1,460	Total			

Subcatchment 7S: To South Perimeter Ditch (cover/some ash at east end)

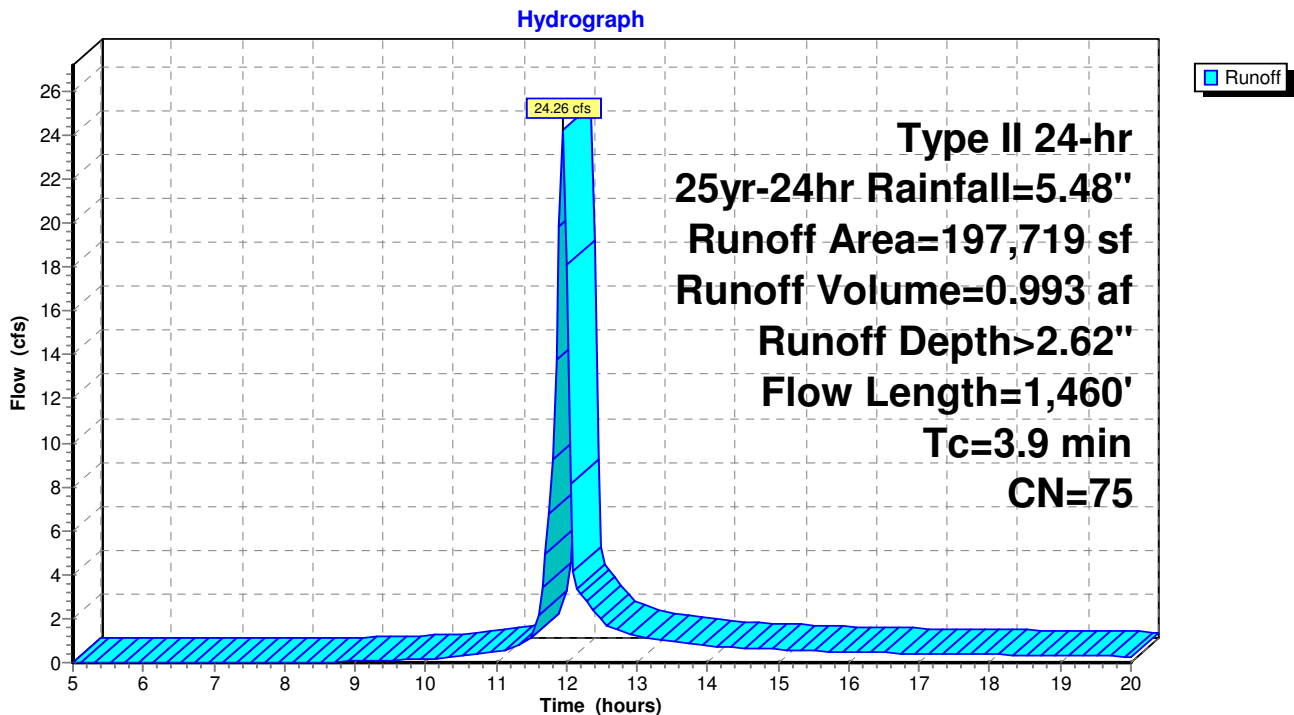

Hydrocad SW Model

Type II 24-hr 25yr-24hr Rainfall=5.48"

Prepared by {enter your company name here}

Printed 6/10/2015

HydroCAD® 10.00-14 s/n 05804 © 2015 HydroCAD Software Solutions LLC

Page 10

Summary for Subcatchment 11S: Final Cover Conditions to South Perimeter Ditch


Runoff = 44.16 cfs @ 12.00 hrs, Volume= 2.131 af, Depth> 2.53"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs
 Type II 24-hr 25yr-24hr Rainfall=5.48"

Area (ac)	CN	Description
* 10.100	74	
10.100		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.4	100	0.2500	0.31		Sheet Flow, First 100 Feet Grass: Dense n= 0.240 P2= 2.95"
0.6	440	0.1000	12.07	265.58	Channel Flow, Channel Flow Area= 22.0 sf Perim= 17.7' r= 1.24' n= 0.045
2.8	920	0.0200	5.40	118.77	Channel Flow, Channel Flow Area= 22.0 sf Perim= 17.7' r= 1.24' n= 0.045
8.8	1,460	Total			

Subcatchment 11S: Final Cover Conditions to South Perimeter Ditch

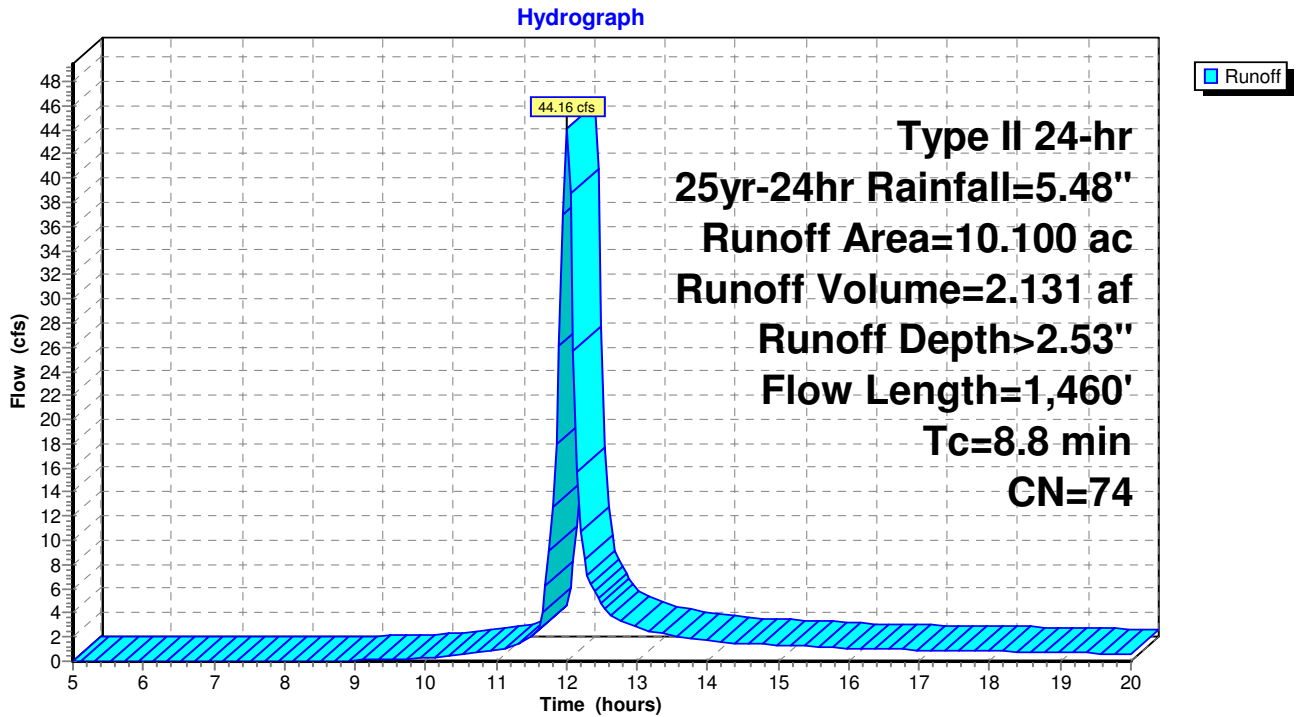

HydroCAD SW Model

Type II 24-hr 25yr-24hr Rainfall=5.48"

Prepared by {enter your company name here}

Printed 6/10/2015

HydroCAD® 10.00-14 s/n 05804 © 2015 HydroCAD Software Solutions LLC


Page 11

Summary for Link 6L: To South Perimeter Ditch - flow into ditch during Phase 1 closure, rest open conditions

Inflow Area = 10.089 ac, 57.74% Impervious, Inflow Depth > 3.82" for 25yr-24hr event
 Inflow = 69.86 cfs @ 11.94 hrs, Volume= 3.213 af
 Primary = 69.86 cfs @ 11.94 hrs, Volume= 3.213 af, Atten= 0%, Lag= 0.0 min




Primary outflow = Inflow, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Link 6L: To South Perimeter Ditch - flow into ditch during Phase 1 closure, rest open conditions

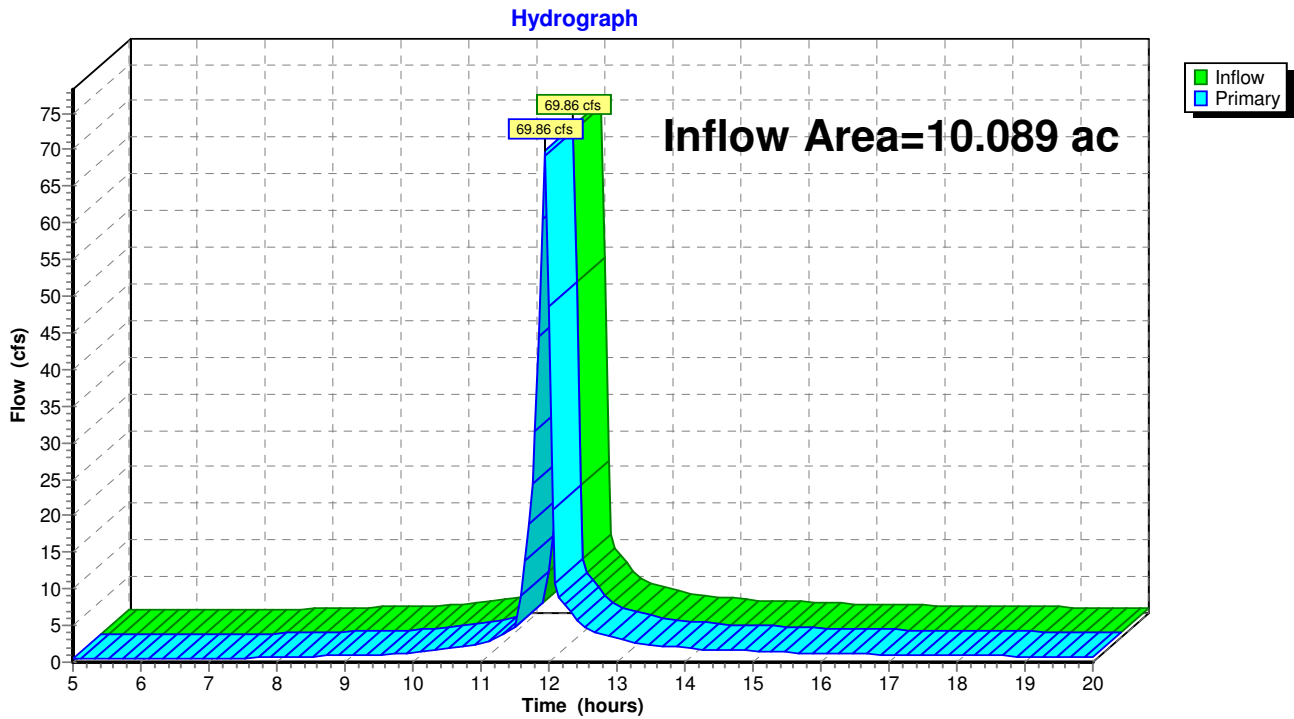

HydroCAD Output

100-yr, 24-hr Storm Event

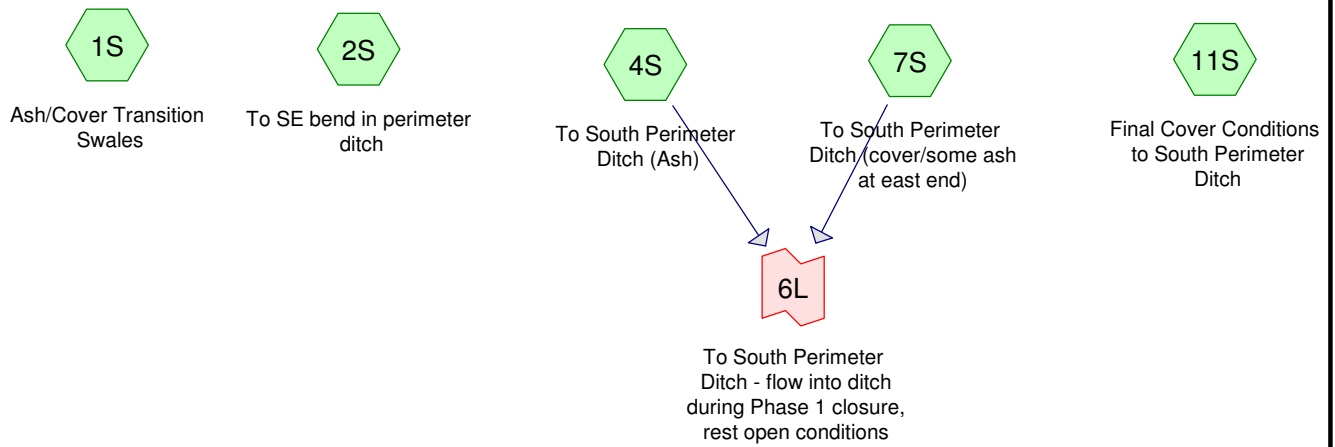

Routing Diagram for Hydrocad SW Model
 Prepared by {enter your company name here}, Printed 6/10/2015
 HydroCAD® 10.00-14 s/n 05804 © 2015 HydroCAD Software Solutions LLC

Hydrocad SW Model*Type II 24-hr 100yr-24hr Rainfall=7.58"*

Prepared by {enter your company name here}

Printed 6/10/2015

HydroCAD® 10.00-14 s/n 05804 © 2015 HydroCAD Software Solutions LLC

Page 12

Time span=5.00-20.00 hrs, dt=0.05 hrs, 301 points
 Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
 Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 1S: Ash/Cover Transition Runoff Area=137,773 sf 100.00% Impervious Runoff Depth>6.68"
 Flow Length=1,215' Tc=3.6 min CN=98 Runoff=36.11 cfs 1.762 af

Subcatchment 2S: To SE bend in perimeter Runoff Area=55,425 sf 0.00% Impervious Runoff Depth>4.23"
 Flow Length=540' Tc=6.0 min CN=74 Runoff=9.84 cfs 0.448 af

Subcatchment 4S: To South Perimeter Runoff Area=5.550 ac 100.00% Impervious Runoff Depth>6.68"
 Flow Length=1,215' Tc=3.6 min CN=98 Runoff=63.36 cfs 3.092 af

Subcatchment 7S: To South Perimeter Runoff Area=197,719 sf 6.06% Impervious Runoff Depth>4.34"
 Flow Length=1,460' Tc=3.9 min CN=75 Runoff=39.07 cfs 1.641 af

Subcatchment 11S: Final Cover Conditions Runoff Area=10.100 ac 0.00% Impervious Runoff Depth>4.22"
 Flow Length=1,460' Tc=8.8 min CN=74 Runoff=72.28 cfs 3.553 af

Link 6L: To South Perimeter Ditch - flow into ditch during Phase 1 closure, Inflow=102.32 cfs 4.732 af
 Primary=102.32 cfs 4.732 af

Total Runoff Area = 24.624 ac Runoff Volume = 10.495 af Average Runoff Depth = 5.11"
63.50% Pervious = 15.636 ac 36.50% Impervious = 8.988 ac

HydroCAD SW Model

Type II 24-hr 100yr-24hr Rainfall=7.58"

Prepared by {enter your company name here}

Printed 6/10/2015

HydroCAD® 10.00-14 s/n 05804 © 2015 HydroCAD Software Solutions LLC

Page 13

Summary for Subcatchment 1S: Ash/Cover Transition Swales

[49] Hint: $T_c < 2dt$ may require smaller dt

Runoff = 36.11 cfs @ 11.94 hrs, Volume= 1.762 af, Depth> 6.68"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, $dt= 0.05$ hrs
 Type II 24-hr 100yr-24hr Rainfall=7.58"

Area (sf)	CN	Description
* 137,773	98	
137,773		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.5	100	0.2500	3.63		Sheet Flow, First 100 Feet Smooth surfaces n= 0.011 P2= 2.95"
2.1	580	0.0230	4.51	30.66	Channel Flow, Channel Flow Area= 6.8 sf Perim= 9.5' r= 0.72' n= 0.040
1.0	535	0.0970	9.37	80.58	Channel Flow, Second Channel Area= 8.6 sf Perim= 11.8' r= 0.73' n= 0.040
3.6	1,215	Total			

Subcatchment 1S: Ash/Cover Transition Swales

Hydrograph

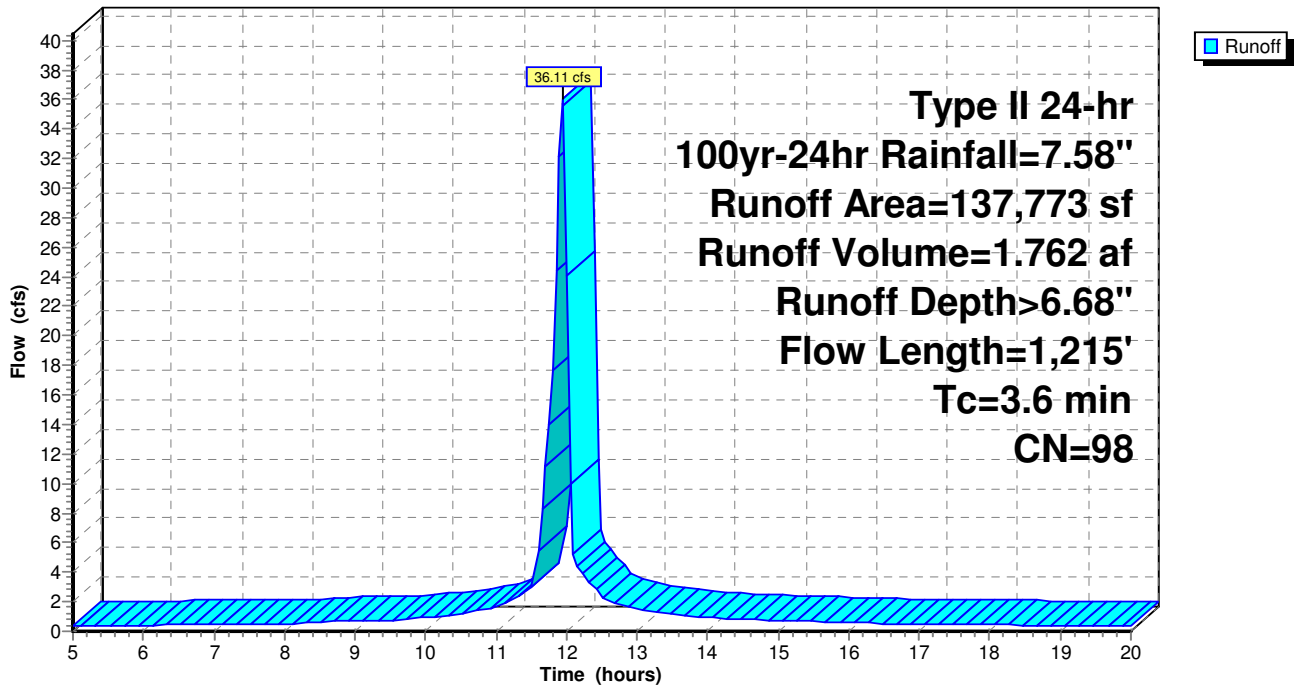

HydroCAD SW Model

Type II 24-hr 100yr-24hr Rainfall=7.58"

Prepared by {enter your company name here}

Printed 6/10/2015

HydroCAD® 10.00-14 s/n 05804 © 2015 HydroCAD Software Solutions LLC

Page 14

Summary for Subcatchment 2S: To SE bend in perimeter ditch

Runoff = 9.84 cfs @ 11.97 hrs, Volume= 0.448 af, Depth> 4.23"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs
 Type II 24-hr 100yr-24hr Rainfall=7.58"

Area (sf)	CN	Description
* 55,425	74	
55,425		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.4	100	0.2500	0.31		Sheet Flow, First 100 Feet Grass: Dense n= 0.240 P2= 2.95"
0.6	440	0.1000	12.07	265.58	Channel Flow, Channel Flow Area= 22.0 sf Perim= 17.7' r= 1.24' n= 0.045
6.0	540	Total			

Subcatchment 2S: To SE bend in perimeter ditch

Hydrograph

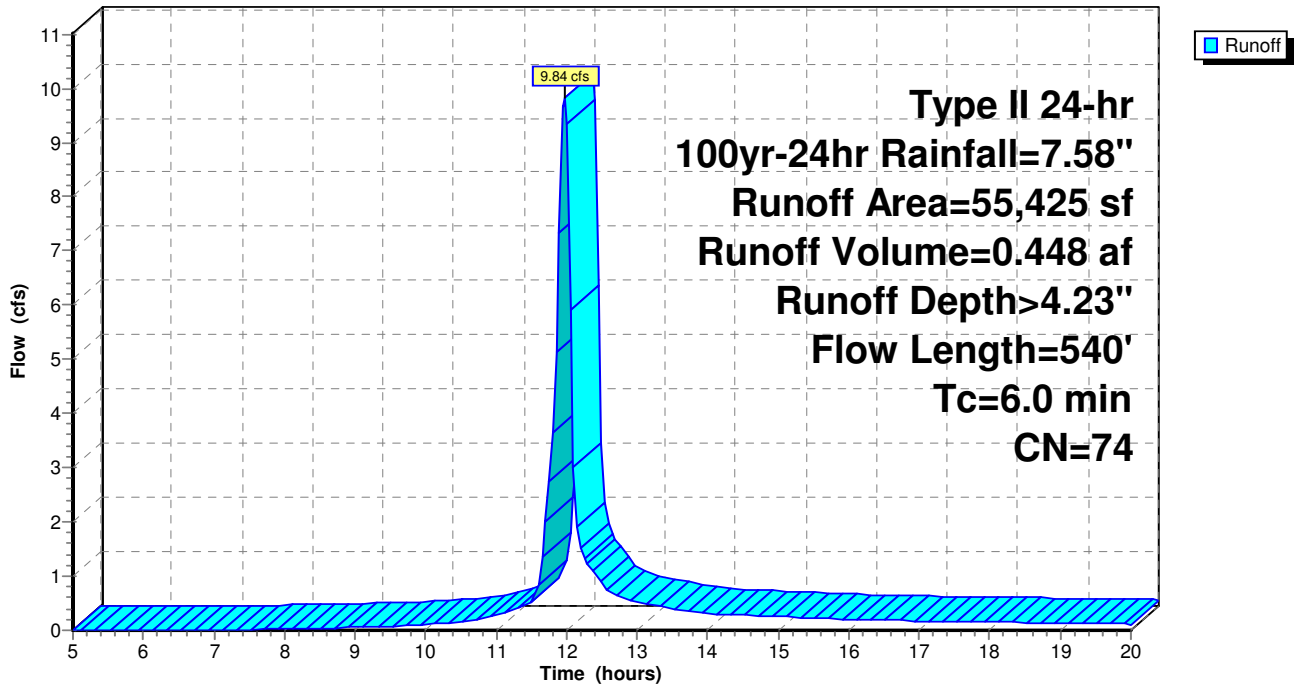

Hydrocad SW Model

Type II 24-hr 100yr-24hr Rainfall=7.58"

Prepared by {enter your company name here}

Printed 6/10/2015

HydroCAD® 10.00-14 s/n 05804 © 2015 HydroCAD Software Solutions LLC

Page 15

Summary for Subcatchment 4S: To South Perimeter Ditch (Ash)

[49] Hint: Tc<2dt may require smaller dt

Runoff = 63.36 cfs @ 11.94 hrs, Volume= 3.092 af, Depth> 6.68"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs
Type II 24-hr 100yr-24hr Rainfall=7.58"

Area (ac)	CN	Description
* 5.550	98	
5.550		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.5	100	0.2500	3.63		Sheet Flow, First 100 Feet Smooth surfaces n= 0.011 P2= 2.95"
2.1	580	0.0230	4.51	30.66	Channel Flow, Channel Flow Area= 6.8 sf Perim= 9.5' r= 0.72' n= 0.040
1.0	535	0.0970	9.37	80.58	Channel Flow, Second Channel Area= 8.6 sf Perim= 11.8' r= 0.73' n= 0.040
3.6	1,215	Total			

Subcatchment 4S: To South Perimeter Ditch (Ash)

Hydrograph

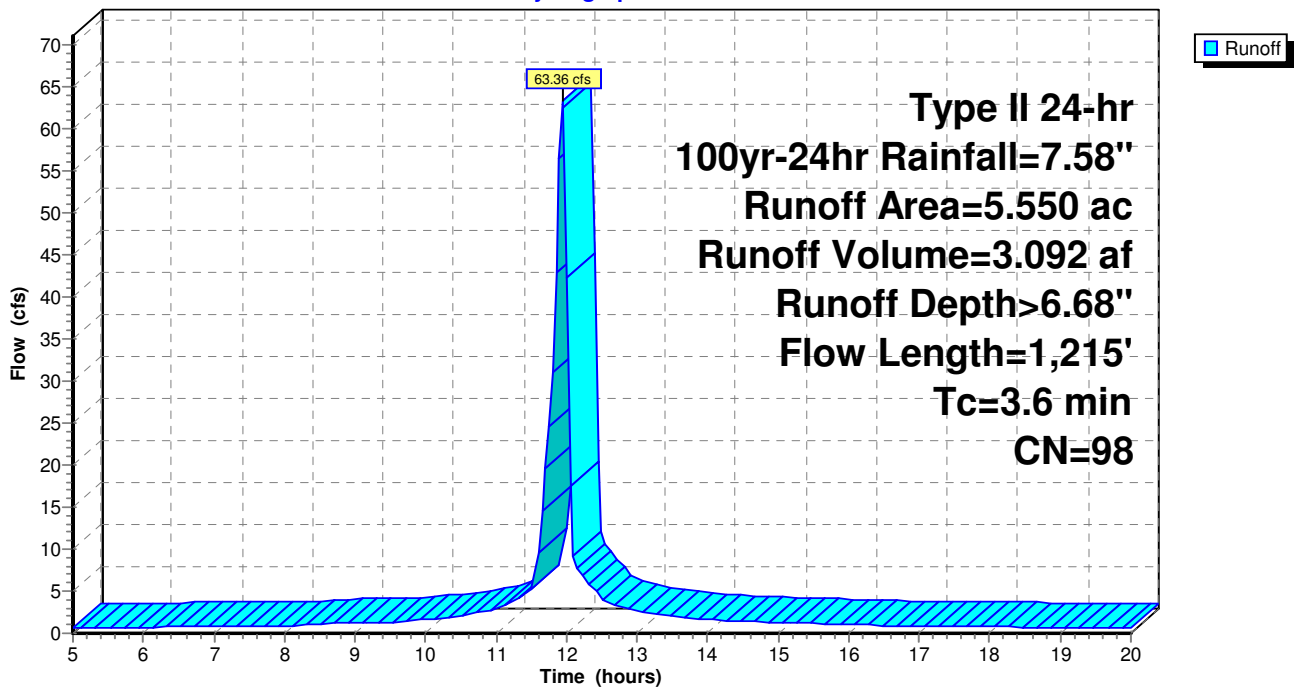

Hydrocad SW Model

Type II 24-hr 100yr-24hr Rainfall=7.58"

Prepared by {enter your company name here}

Printed 6/10/2015

HydroCAD® 10.00-14 s/n 05804 © 2015 HydroCAD Software Solutions LLC

Page 16

Summary for Subcatchment 7S: To South Perimeter Ditch (cover/some ash at east end)

[49] Hint: Tc<2dt may require smaller dt


Runoff = 39.07 cfs @ 11.94 hrs, Volume= 1.641 af, Depth> 4.34"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs
Type II 24-hr 100yr-24hr Rainfall=7.58"

	Area (sf)	CN	Description
*	185,740	74	
*	11,979	98	
	197,719	75	Weighted Average
	185,740		93.94% Pervious Area
	11,979		6.06% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.5	100	0.2500	3.63		Sheet Flow, First 100 Feet Smooth surfaces n= 0.011 P2= 2.95"
0.6	440	0.1000	12.07	265.58	Channel Flow, Channel Flow Area= 22.0 sf Perim= 17.7' r= 1.24' n= 0.045
2.8	920	0.0200	5.40	118.77	Channel Flow, Channel Flow Area= 22.0 sf Perim= 17.7' r= 1.24' n= 0.045
3.9	1,460	Total			

Subcatchment 7S: To South Perimeter Ditch (cover/some ash at east end)

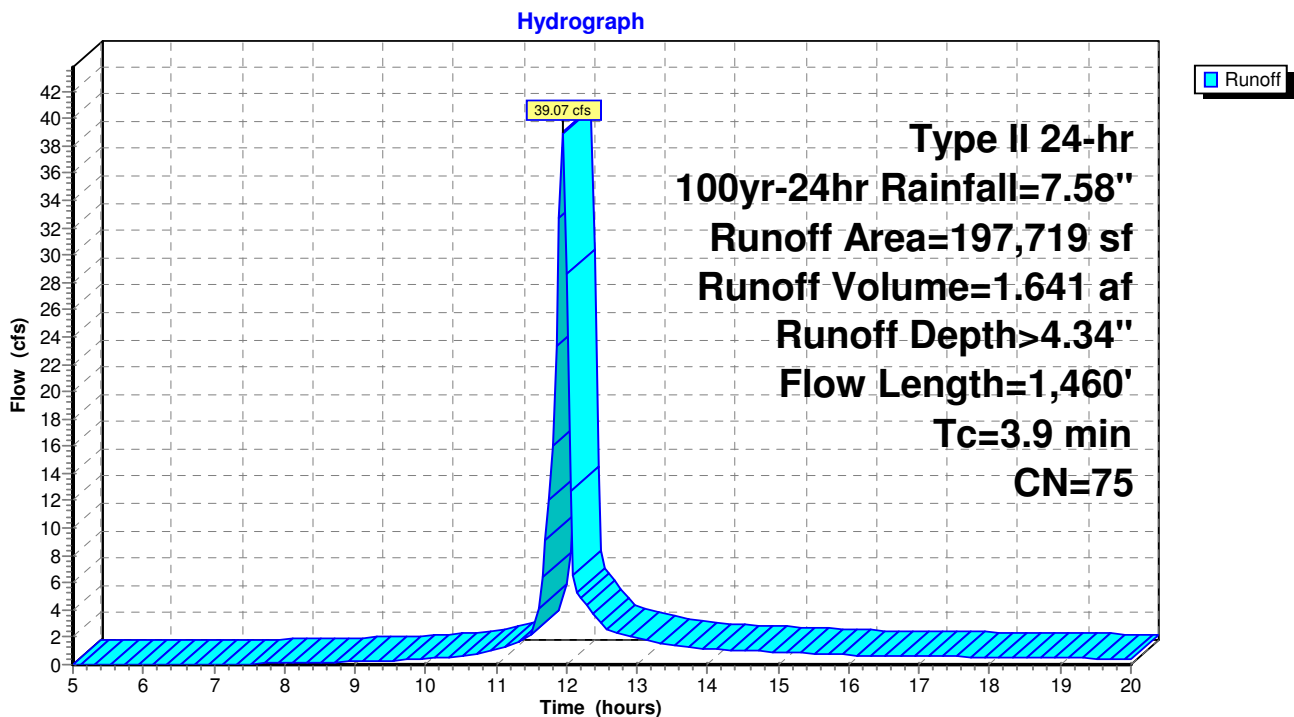

Hydrocad SW Model

Type II 24-hr 100yr-24hr Rainfall=7.58"

Prepared by {enter your company name here}

Printed 6/10/2015

HydroCAD® 10.00-14 s/n 05804 © 2015 HydroCAD Software Solutions LLC

Page 17

Summary for Subcatchment 11S: Final Cover Conditions to South Perimeter Ditch


Runoff = 72.28 cfs @ 12.00 hrs, Volume= 3.553 af, Depth> 4.22"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs
Type II 24-hr 100yr-24hr Rainfall=7.58"

Area (ac)	CN	Description
* 10.100	74	
10.100		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.4	100	0.2500	0.31		Sheet Flow, First 100 Feet Grass: Dense n= 0.240 P2= 2.95"
0.6	440	0.1000	12.07	265.58	Channel Flow, Channel Flow Area= 22.0 sf Perim= 17.7' r= 1.24' n= 0.045
2.8	920	0.0200	5.40	118.77	Channel Flow, Channel Flow Area= 22.0 sf Perim= 17.7' r= 1.24' n= 0.045
8.8	1,460	Total			

Subcatchment 11S: Final Cover Conditions to South Perimeter Ditch

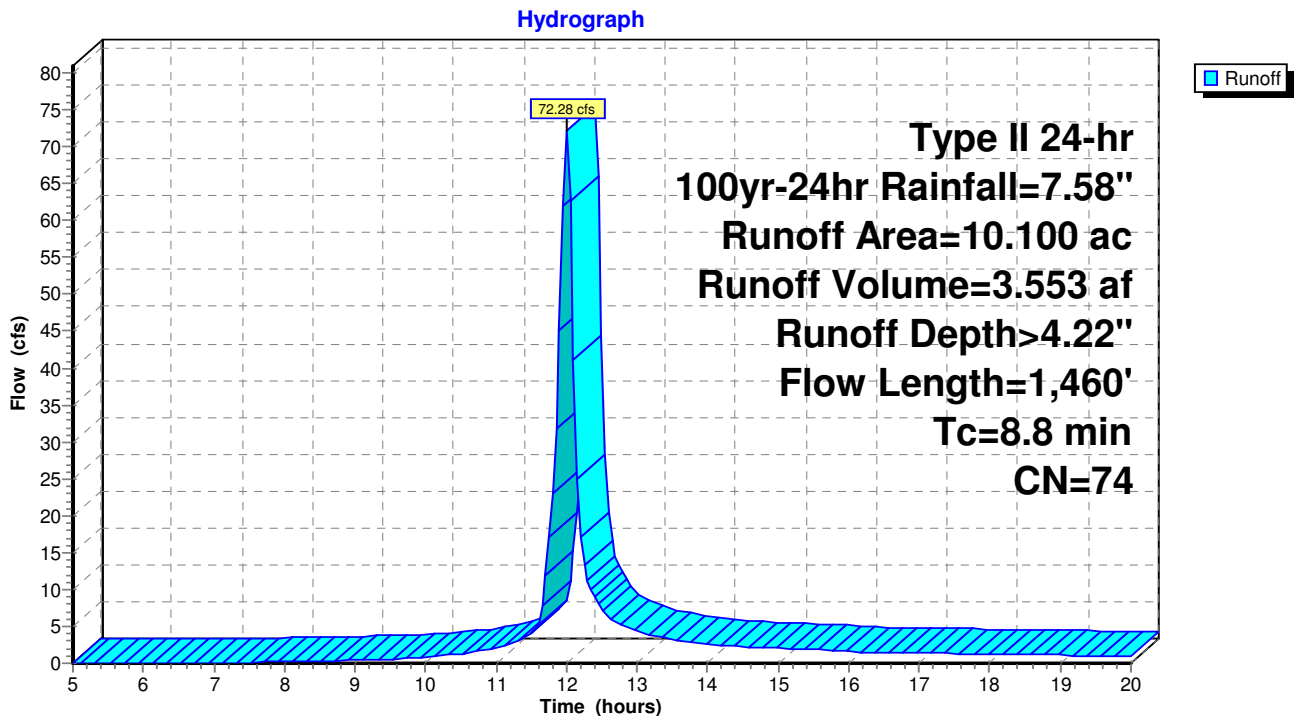

HydroCAD SW Model

Prepared by {enter your company name here}

HydroCAD® 10.00-14 s/n 05804 © 2015 HydroCAD Software Solutions LLC

Type II 24-hr 100yr-24hr Rainfall=7.58"

Printed 6/10/2015


Page 18

Summary for Link 6L: To South Perimeter Ditch - flow into ditch during Phase 1 closure, rest open conditions

Inflow Area = 10.089 ac, 57.74% Impervious, Inflow Depth > 5.63" for 100yr-24hr event
 Inflow = 102.32 cfs @ 11.94 hrs, Volume= 4.732 af
 Primary = 102.32 cfs @ 11.94 hrs, Volume= 4.732 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Link 6L: To South Perimeter Ditch - flow into ditch during Phase 1 closure, rest open conditions

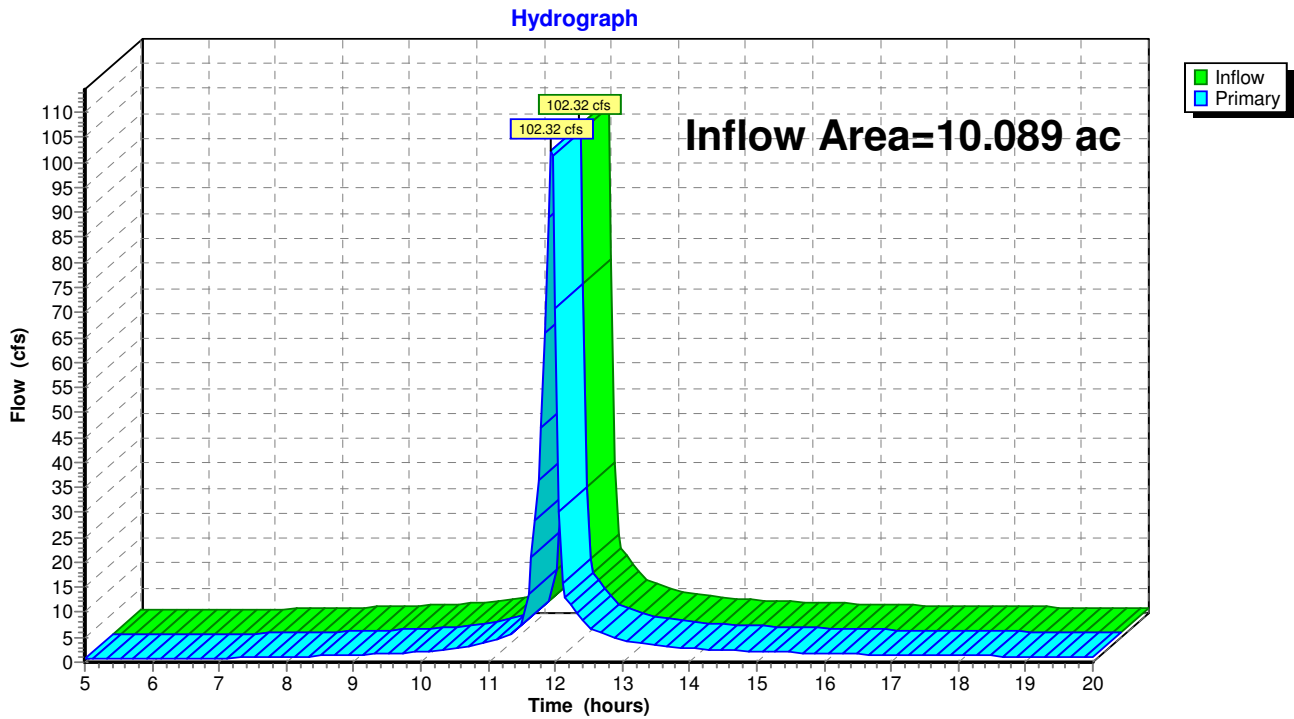

Grass-Lined Channel Sizing

Lining Type: Vegetation

Project ID: Alliant Lansing
Location:
Designer/Checker: BLP/JMO
Date: 9/4/14 / 6/10/15

	Ash/Cover Transition Swales		To SE bend in Perimeter ditch.		Ash and Ph 1 cover conditions To south perimeter ditch		Final cover conditions To south perimeter ditch	
	2% slope ok	2% slope ok	10% slope ok	10% slope ok	2.0% slope ok	2.0% slope ok	1.2% slope ok	1.2% slope ok
Channel/Ditch Geometry	25 yr	100 yr	25 yr	100 yr	25 yr	100 yr	25 yr	100 yr
Channel Slope, S_0 (ft/ft)	0.02	0.02	0.10	0.10	0.02	0.02	0.012	0.012
Channel Bottom Width, B (ft)	0	0	5	5	5	5	5	5
Channel Side Slope, z_1	4	4	4	4	4	4	4	4
Channel Side Slope, z_2	2	2	2	2	2	2	2	2
Flow Depth, d (ft) Solve iteratively	1.61	1.79	0.26	0.33	1.55	1.85	1.56	1.92
Safety Factor, SF	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Vegetation/Soil Parameters								
Vegetation Retardance Class	C	C	C	C	C	C	C	C
Vegetation Condition	good	good	good	good	good	good	good	good
Vegetation Growth Form	turf	turf	turf	turf	turf	turf	turf	turf
Soil Type	cohesive	cohesive	cohesive	cohesive	cohesive	cohesive	cohesive	cohesive
D_{75} (in) (Set at 0.00 for cohesive soils)								
ASTM Soil Class	SC	SC	SC	SC	SC	SC	SC	SC
Plasticity Index, PI	16	16	16	16	16	16	16	16
Results Summary								
Design Q (ft ³ /s)	26.0	36.0	6.0	10.0	69.0	102.0	44.0	72.0
Calculated Q (ft ³ /s)	26.2	36.2	6.0	10.2	68.8	103.4	43.6	71.9
Difference Between Design & Calc. Flow (%)	0.9%	0.5%	0.8%	1.8%	-0.3%	1.4%	-0.9%	-0.2%
Stable (Yes or No)	YES	YES	YES	YES	YES	YES	YES	YES
Channel Parameters								
Vegetation Height, h (ft)	0.67	0.67	0.67	0.67	0.67	0.67	0.67	0.67
Grass Roughness Coefficient, C_n	0.238	0.238	0.238	0.238	0.238	0.238	0.238	0.238
Cover Factor, C_f	0.90	0.90	0.90	0.90	0.90	0.90	0.90	0.90
Noncohesive Soil								
Soil Grain Roughness, n_s	0.016	0.016	0.016	0.016	0.016	0.016	0.016	0.016
Permissible Soil Shear Stress, τ_p (lb/ft ²)	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Cohesive Soil								
Porosity, e	0.35	0.35	0.35	0.35	0.35	0.35	0.35	0.35
Soil Coefficient 1, c_1	1.0700	1.0700	1.0700	1.0700	1.0700	1.0700	1.0700	1.0700
Soil Coefficient 2, c_2	14.30	14.30	14.30	14.30	14.30	14.30	14.30	14.30
Soil Coefficient 3, c_3	47.700	47.700	47.700	47.700	47.700	47.700	47.700	47.700
Soil Coefficient 4, c_4	1.42	1.42	1.42	1.42	1.42	1.42	1.42	1.42
Soil Coefficient 5, c_5	-0.61	-0.61	-0.61	-0.61	-0.61	-0.61	-0.61	-0.61
Soil Coefficient 6, c_6	0.00010	0.00010	0.00010	0.00010	0.00010	0.00010	0.00010	0.00010
Permissible Soil Shear Stress, τ_p (lb/ft ²)	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080
Total Permissible Shear Stress, τ_p (lb/ft ²)	0.080	0.080	0.080	0.080	0.080	0.080	0.080	0.080
Cross Sectional Area, A (ft ²)	7.776	9.612	1.516	2.010	14.958	19.518	15.101	20.659
Wetted Perimeter, P (ft)	10.24	11.38	6.67	7.13	14.86	16.76	14.92	17.21
Hydraulic Radius, R (ft)	0.760	0.844	0.227	0.282	1.007	1.164	1.012	1.200
Top Width, T (ft)	9.66	10.74	6.57	7.01	14.30	16.10	14.36	16.52
Hydraulic Depth, D (ft)	0.805	0.895	0.231	0.287	1.046	1.212	1.052	1.251
Froude Number (Q design)	0.663	0.701	1.464	1.667	0.793	0.848	0.496	0.548
Channel Shear Stress, τ_c (lb/ft ²)	0.95	1.05	1.42	1.76	1.26	1.45	0.76	0.90
Actual Shear Stress, τ_a (lb/ft ²)	2.01	2.23	1.63	2.09	1.93	2.31	1.17	1.44
Mannings n	0.052	0.050	0.044	0.040	0.046	0.044	0.057	0.053
Average Velocity, V (ft/s)	3.34	3.75	3.96	4.97	4.61	5.23	2.91	3.49
Calculated Flow, Q (ft ³ /s)	26.2	36.2	6.0	10.2	68.8	103.4	43.6	71.9
Difference Between Design & Calc. Flow (%)	0.9%	0.5%	0.8%	1.8%	-0.3%	1.4%	-0.9%	-0.2%
Effective Shear on Soil Surface, τ_e (lb/ft ²)	0.019	0.023	0.022	0.033	0.023	0.031	0.009	0.013
Total Permissible Shear on Veg., $\tau_{p,veg}$ (lb/ft ²)	8.46	7.82	6.06	5.01	6.62	6.06	10.17	8.79
Stable (Y or N)	YES	YES	YES	YES	YES	YES	YES	YES

Rock-Lined Channel Sizing

1 **Lining Type: Riprap**

2	Project ID: Alliant Lansing
3	Location:
4	Designer/Checker: BLP/JMO
5	Date: 9/4/14 / 6/10/15

7			
8		9.7% swale	9.7% swale
9	Channel Geometry	25 yr	100 yr
10	Channel Slope, S_o (ft/ft)	0.097	0.097
11	Channel Bottom Width, B (ft)	0	0
12	Channel Side Slope, z_1	4.3	4.3
13	Channel Side Slope, z_2	3.3	3.3
14	Curvature Radius, R_c (ft)	0	0
15	Depth of Flow, d (ft) Solve iteratively	1.28	1.41
16	Riprap Parameters		
17	Median Riprap Size, D_{50} (ft)	1.33	1.33
18	Riprap Specific Weight, γ_s (lb/ft ³)	165	165
19	Riprap Angle of Repose, ϕ , (degrees)	41.8	41.8
20	Safety Factor, SF	1.20	1.20
21	Safety Factor, SF (used in calculation)	1.50	1.50
22	Results Summary		
23	Design Flow, Q (ft ³ /s)	26	36
24	Calculated Flow, Q (cfs)	26.00	36.0
25	Difference Between Design & Calc. Flow (%)	0.0%	0.0%
26	Bottom Lining Stable (Yes or No)	Yes	Yes
27	Side Lining Stable (Yes or No)		
28	Bottom in Bend Stable (Yes or No)	N/A	N/A
29	Side in Bend Stable (Yes or No)	N/A	N/A
30	Downstream Length of Protection (ft)	N/A	N/A
31	Additional Freeboard Required, (ft)	N/A	N/A
32	Channel Parameters		
33	Cross Sectional Area, A (ft ²)	6.19	7.60
34	Top Width, T (ft)	9.7	10.7
35	Average Depth, d_a (ft)	0.638	0.707
36	Wetted Perimeter, P (ft)	10.03	11.12
37	Hydraulic Radius, R (ft)	0.617	0.683
38	Depth to D_{50} Ratio, d_a/D_{50}	0.5	0.5
39	Mannings n	0.080	0.076
40	Average Velocity, V (ft/s)	4.20	4.74
41	Calculated Flow, Q (ft ³ /s)	26.0	36.0
42	Difference Between Design & Calc. Flow (%)	0%	0%
43	Suggested Trial Depth, d_{i+1} (ft)	1.276	1.414
44	Manning's n		
45	Manning's n (Blodgett)	0.000	0.000
46	Manning's n (Bathurst)	0.080	0.076
47	Effective Roughness Concentration, b	0.255	0.265
48	Froude Number, Fr (design Q)	0.927	0.993
49	Froude Number function, f(Fr)	1.009	1.023
50	Roughness Element Geometry, f(REG)	6.1	6.6
51	Channel Geometry Function, f(CG)	0.500	0.487

52	Bottom Shear		
53	Shear Velocity, V_s (ft/s)	2.00	2.10
54	Reynolds Number, R_e	2.2E+05	2.3E+05
55	Shield's Parameter, F^*	0.150	0.150
56	Safety Factor, SF	1.50	1.50
57	Maximum Shear Stress, τ_d (lb/ft ²)	7.72	8.56
58	Permissible Shear Stress, $S_o \leq 10\%$, τ_p (lb/ft ²)	20.5	20.47
59	Stability Number, η	0.36	0.40
60	Steepest Channel Side Slope, z	3	3
61	Channel Side Slope Angle, θ (radians)	0.29	0.29
62	Channel Bottom Slope Angle, α (radians)	0.10	0.10
63	Riprap Angle of Repose, ϕ (radians)	0.730	0.730
64	Weight Vector Angle, B (radians)	0.48	0.52
65	Channel Geometry and Riprap Size Func, Δ	1.40	1.40
66	Permissible Shear Stress, $S_o > 5\%$, τ_p (lb/ft ²)	14.7	14.60
67	Permissible Shear based on Slope, τ_p (lb/ft ²)	14.7	14.6
68	Adjusted Permissible Shear, τ_p/SF (lb/ft ²)	9.8	9.7
69	Bottom Lining Stable (Yes or No)	Yes	Yes
70	Stable D_{50} (ft)	1.05	1.17
71	Side Shear		
72	Channel Side to Bottom Shear Stress Ratio, K_1	0.95	0.95
73	Channel Side Shear Stress, τ_s (lb/ft ²)	7.34	8.13
74	Side Slope Angle, θ (radians)	0.228	0.228
75	Side Slope Angle, θ (degrees)	13.1	13.1
76	Tractive Force Ratio, K_2	0.94	0.94
77	Permissible Side Tractive Force, τ_{ps} (lb/ft ²)		
78	Side Lining Stable (Yes or No)		
79	Stable D_{50} (ft)		
80	Bend Shear		
81	Curvature Radius, R_c (ft)	0	0
82	Ratio of Radius of Curvature to Top Width, R_c/T	N/A	N/A
83	f(Channel Bend and Bottom Shear Stress), K_b	N/A	N/A
84	Shear Stress on the Channel Bottom, τ_b (lb/ft ²)	N/A	N/A
85	Bottom in Bend Stable (Yes or No)	N/A	N/A
86	Shear Stress on the Channel Side, τ_{bs} (lb/ft ²)	N/A	N/A
87	Side in Bend Stable (Yes or No)	N/A	N/A
88	Downstream Length of Protection, L_p (ft)	N/A	N/A
89	Addition Freeboard Required, Δd (ft)	N/A	N/A

Ditch Transition Sizing

Rock Chute Design Data

(Version 4.03 - 11/29/11, Based on Design of Rock Chutes by Robinson, Rice, Kadavy, ASAE, 1998)

Project: WPL Lansing
Designer: BLP
Date: 09/08/14

County: _____
Checked by: JMO
Date: 06/10/15


Input Channel Geometry

Inlet Channel	Chute	Outlet Channel
Bw = 0.0 ft.	Bw = 5.0 ft.	Bw = 5.0 ft.
Side slopes = 4.3 (m:1)	Factor of safety = 1.20 (F _s)	Side slopes = 3.0 (m:1)
n-value = 0.040	Side slopes = 3.0 (m:1) → 2.0:1 max.	n-value = 0.030
Bed slope = 0.0200 ft./ft.	Bed slope (2.5:1) = 0.400 ft./ft. → 2.5:1 max.	Bed slope = 0.0150 ft./ft.
Minimum Fill = 0.0 ft.	Outlet apron depth, d = 1.0 ft.	Base flow = 0.0 cfs
Freeboard = 0.5 ft.		


Design Storm Data (Table 2, NHCP, NRCS Grade Stabilization Structure No. 410)

Drainage area = _____ acres	Rainfall = <input type="radio"/> 0 - 3 in. <input checked="" type="radio"/> 3 - 5 in. <input type="radio"/> 5+ in.	Note: The total required capacity is routed through the chute (principal spillway) or in combination with an auxiliary spillway.
Apron elev. --- Inlet = 690.0 ft. --- Outlet = 686.0 ft. --- (H _{drop} = 3 ft.)		
Chute capacity = Q5-year	Minimum capacity (based on a 5-year, 24-hour storm with a 3 - 5 inch rainfall)	Input tailwater (Tw): Tw (ft.) = Program 0.40
Total capacity = Q10-year		
Q _{high} = 75.0 cfs	High flow storm through chute	Tw (ft.) = Program 0.40
Q _{low} = 50.0 cfs	Low flow storm through chute	Tw (ft.) = Program

Profile and Cross Section (Output)

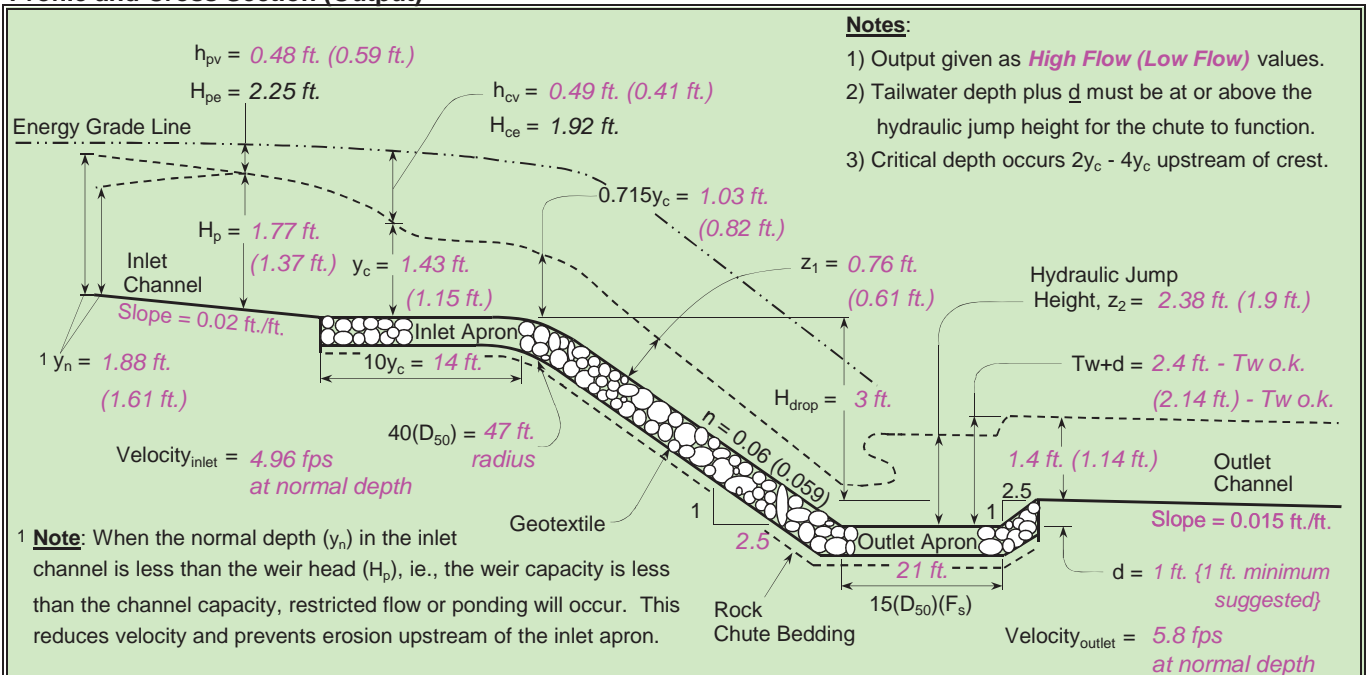

Profile Along Centerline of Chute

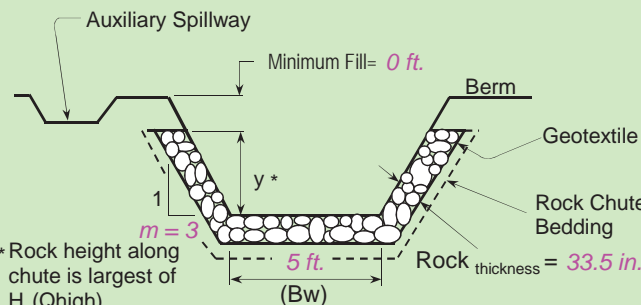

Typical Cross Section


q _t = 9.75 cfs/ft.	Equivalent unit discharge
F _s = 1.20	Factor of safety (multiplier)
z ₁ = 0.76 ft.	Normal depth in chute
n-value = 0.06	Manning's roughness coefficient
D ₅₀ (F _s) = 16.8 in. (343 lbs.)	- angular riprap
2(D ₅₀)(F _s) = 33.5 in.	Rock chute thickness
Tw + d = 2.4 ft.	Tailwater above outlet apron
z ₂ = 2.38 ft.	Hydraulic jump height
*** The outlet will function adequately	

High Flow Storm Information


Appendix A3
Phase 2 Final Cover

HydroCAD Output

25-yr, 24-hr Storm Event





Ph 2 - TO DIVERSION SWALE



Ph 2 - TO PERIMETER DITCH



TO PERIMETER DITCH (WEST OF ROCK CHANNEL)



Routing Diagram for Lansing_Ph 2 Final Cover_150616
Prepared by {enter your company name here}, Printed 6/19/2015
HydroCAD® 10.00-14 s/n 05804 © 2015 HydroCAD Software Solutions LLC

Lansing_Ph 2 Final Cover_150616

Prepared by {enter your company name here}

HydroCAD® 10.00-14 s/n 05804 © 2015 HydroCAD Software Solutions LLC

Printed 6/19/2015

Page 2

Area Listing (selected nodes)

Area (acres)	CN	Description (subcatchment-numbers)
2.390	98	Ash surface (17S)
7.070	74	Final Cover (19S)
9.460	80	TOTAL AREA

Lansing_Ph 2 Final Cover_150616

Prepared by {enter your company name here}

HydroCAD® 10.00-14 s/n 05804 © 2015 HydroCAD Software Solutions LLC

Printed 6/19/2015

Page 3

Soil Listing (selected nodes)

Area (acres)	Soil Group	Subcatchment Numbers
0.000	HSG A	
0.000	HSG B	
0.000	HSG C	
0.000	HSG D	
9.460	Other	17S, 19S
9.460		TOTAL AREA

Lansing_Ph 2 Final Cover_150616

Prepared by {enter your company name here}

HydroCAD® 10.00-14 s/n 05804 © 2015 HydroCAD Software Solutions LLC

Printed 6/19/2015

Page 4

Ground Covers (selected nodes)

HSG-A (acres)	HSG-B (acres)	HSG-C (acres)	HSG-D (acres)	Other (acres)	Total (acres)	Ground Cover	Subcatchment Numbers
0.000	0.000	0.000	0.000	2.390	2.390	Ash surface	17S
0.000	0.000	0.000	0.000	7.070	7.070	Final Cover	19S
0.000	0.000	0.000	0.000	9.460	9.460	TOTAL AREA	

Lansing_Ph 2 Final Cover_150616

Type II 24-hr 25yr-24hr Rainfall=5.48"

Prepared by {enter your company name here}

Printed 6/19/2015

HydroCAD® 10.00-14 s/n 05804 © 2015 HydroCAD Software Solutions LLC

Page 5

Time span=5.00-20.00 hrs, dt=0.05 hrs, 301 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 17S: Ph 2 - TO DIVERSION Runoff Area=2.390 ac 100.00% Impervious Runoff Depth>4.80"
Flow Length=1,766' Tc=5.0 min CN=98 Runoff=18.86 cfs 0.956 af

Subcatchment 19S: Ph 2 - TO PERIMETER Runoff Area=7.070 ac 0.00% Impervious Runoff Depth>2.53"
Flow Length=1,985' Tc=14.0 min CN=74 Runoff=25.85 cfs 1.489 af

Reach 20R: TO PERIMETER DITCH (WEST OF ROCK CHANNEL) Inflow=37.99 cfs 2.445 af
Outflow=37.99 cfs 2.445 af

Total Runoff Area = 9.460 ac Runoff Volume = 2.445 af Average Runoff Depth = 3.10"
74.74% Pervious = 7.070 ac 25.26% Impervious = 2.390 ac

Summary for Subcatchment 17S: Ph 2 - TO DIVERSION SWALE

[49] Hint: Tc<2dt may require smaller dt

Runoff = 18.86 cfs @ 11.95 hrs, Volume= 0.956 af, Depth> 4.80"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs
 Type II 24-hr 25yr-24hr Rainfall=5.48"

Area (ac)	CN	Description
* 2.390	98	Ash surface
2.390		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.5	100	0.2500	3.63		Sheet Flow, Smooth surfaces n= 0.011 P2= 2.95"
1.3	508	0.0200	6.68	45.06	Trap/Vee/Rect Channel Flow, Bot.W=0.00' D=1.50' Z= 4.0 & 2.0 '/' Top.W=9.00' n= 0.025
1.6	626	0.0180	6.33	42.75	Trap/Vee/Rect Channel Flow, Bot.W=0.00' D=1.50' Z= 4.0 & 2.0 '/' Top.W=9.00' n= 0.025
0.8	215	0.0760	4.65	31.37	Trap/Vee/Rect Channel Flow, Bot.W=0.00' D=1.50' Z= 4.0 & 2.0 '/' Top.W=9.00' n= 0.070
0.3	121	0.0170	6.15	41.54	Trap/Vee/Rect Channel Flow, Bot.W=0.00' D=1.50' Z= 4.0 & 2.0 '/' Top.W=9.00' n= 0.025
0.5	196	0.1500	6.53	44.07	Trap/Vee/Rect Channel Flow, Bot.W=0.00' D=1.50' Z= 4.0 & 2.0 '/' Top.W=9.00' n= 0.070
5.0	1,766	Total			

Subcatchment 17S: Ph 2 - TO DIVERSION SWALE

Hydrograph

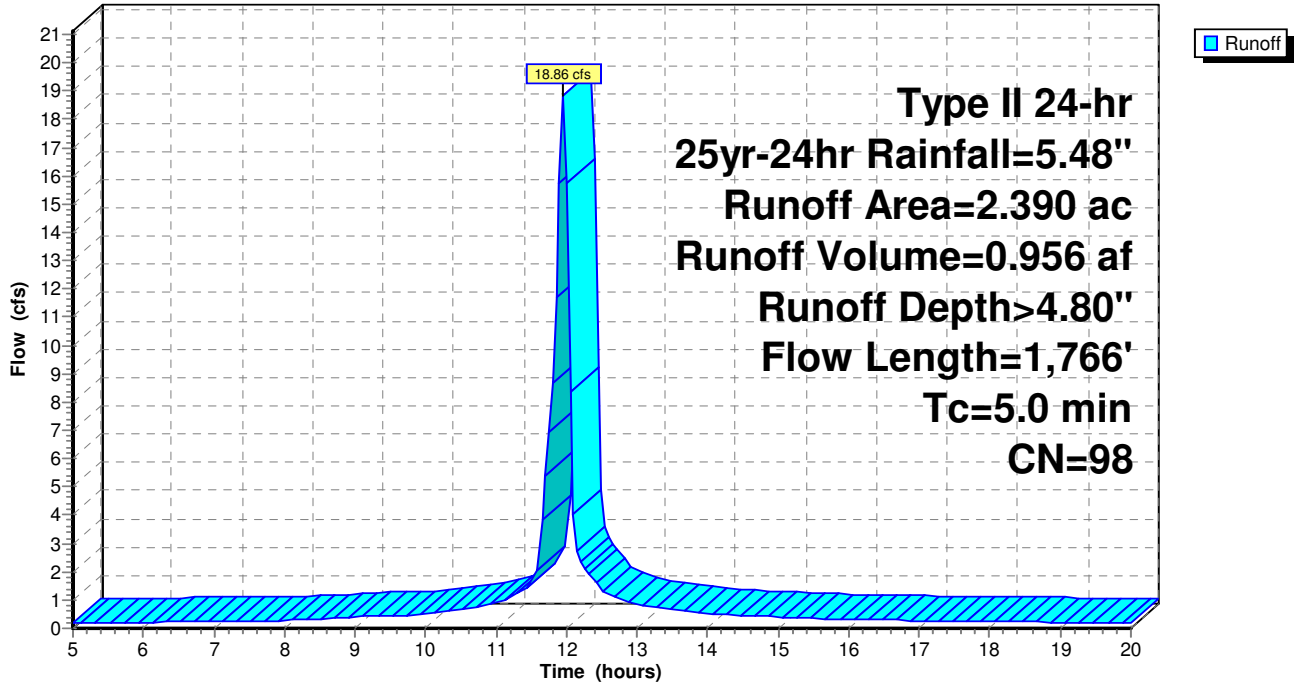

Summary for Subcatchment 19S: Ph 2 - TO PERIMETER DITCH

Runoff = 25.85 cfs @ 12.06 hrs, Volume= 1.489 af, Depth> 2.53"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs
 Type II 24-hr 25yr-24hr Rainfall=5.48"

Area (ac)	CN	Description
* 7.070	74	Final Cover
7.070		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.4	100	0.2500	0.31		Sheet Flow, First 100 Feet Grass: Dense n= 0.240 P2= 2.95"
0.6	270	0.0722	7.02	56.19	Trap/Vee/Rect Channel Flow, Bot.W=5.00' D=1.00' Z= 2.0 & 4.0 '/' Top.W=11.00' n= 0.045
4.8	1,030	0.0185	3.56	28.44	Trap/Vee/Rect Channel Flow, Bot.W=5.00' D=1.00' Z= 2.0 & 4.0 '/' Top.W=11.00' n= 0.045
3.2	585	0.0137	3.06	24.48	Trap/Vee/Rect Channel Flow, Bot.W=5.00' D=1.00' Z= 4.0 & 2.0 '/' Top.W=11.00' n= 0.045
14.0	1,985	Total			

Subcatchment 19S: Ph 2 - TO PERIMETER DITCH

Hydrograph

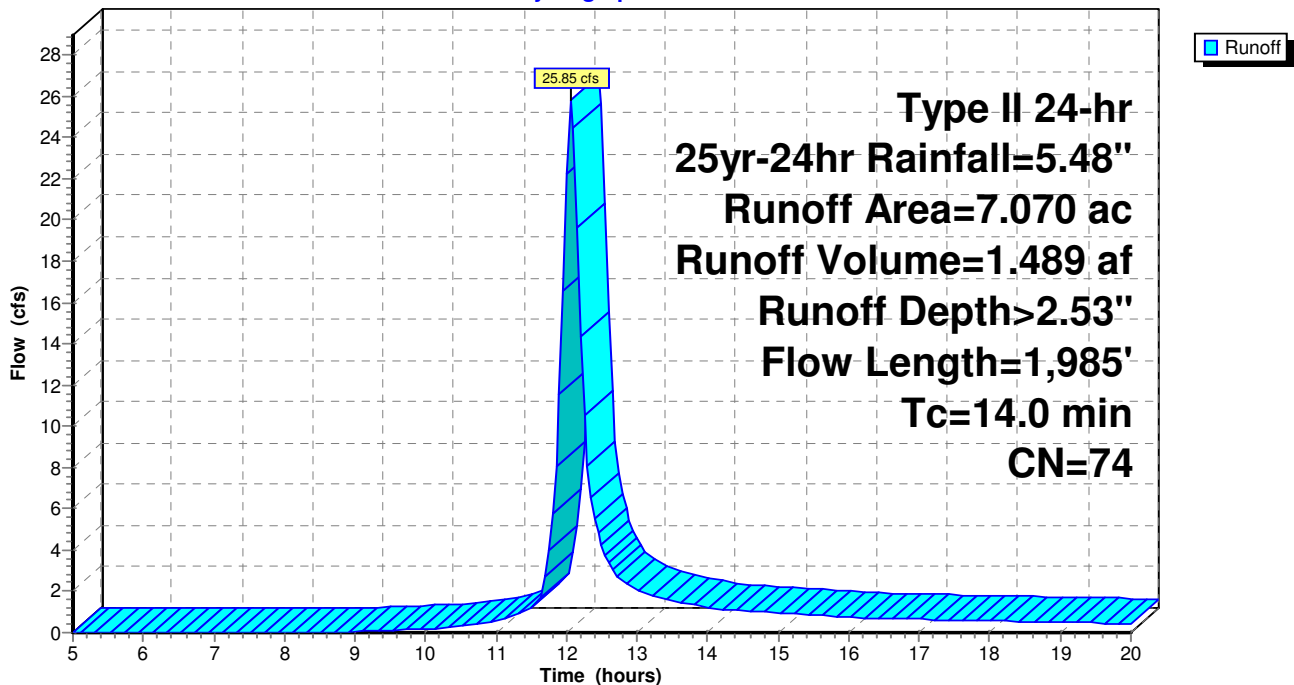


Summary for Reach 20R: TO PERIMETER DITCH (WEST OF ROCK CHANNEL)

[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 9.460 ac, 25.26% Impervious, Inflow Depth > 3.10" for 25yr-24hr event
Inflow = 37.99 cfs @ 11.99 hrs, Volume= 2.445 af
Outflow = 37.99 cfs @ 11.99 hrs, Volume= 2.445 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Reach 20R: TO PERIMETER DITCH (WEST OF ROCK CHANNEL)

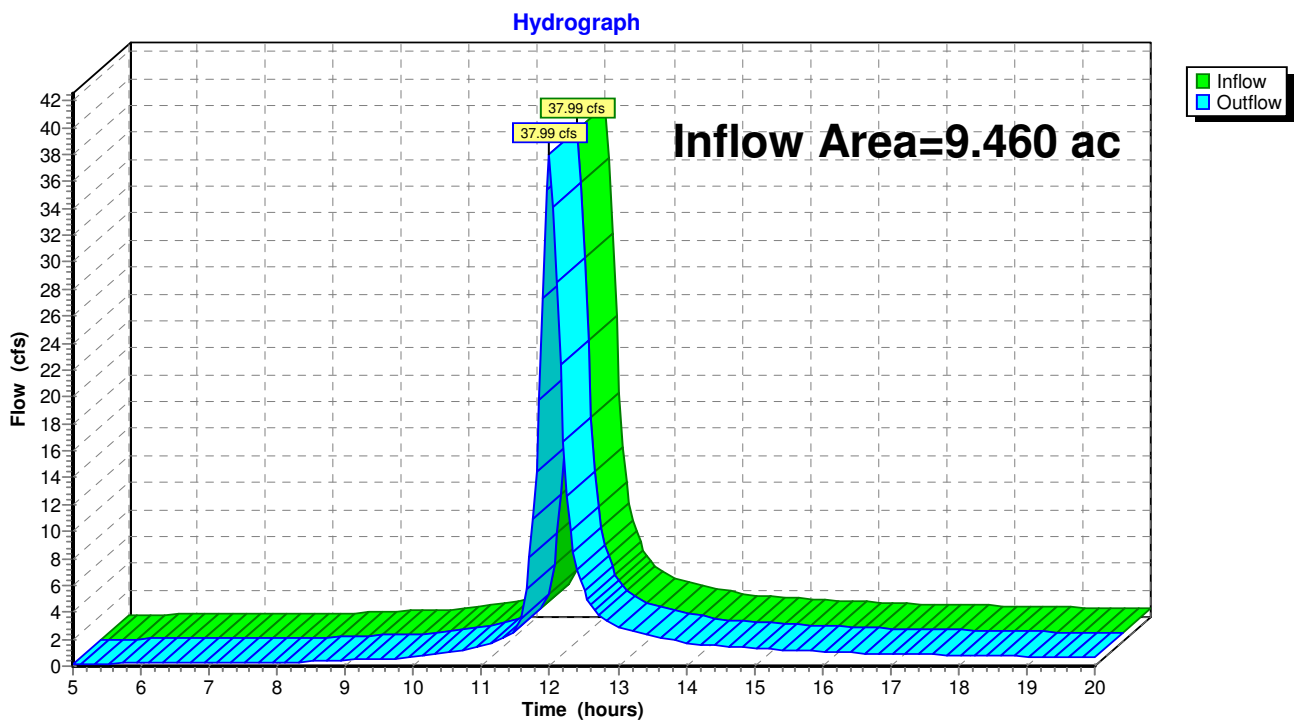

Lansing_Ph 2 Final Cover_150616

Type II 24-hr 100yr-24hr Rainfall=7.58"

Prepared by {enter your company name here}

Printed 6/19/2015

HydroCAD® 10.00-14 s/n 05804 © 2015 HydroCAD Software Solutions LLC

Page 10

Time span=5.00-20.00 hrs, dt=0.05 hrs, 301 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 17S: Ph 2 - TO DIVERSION Runoff Area=2.390 ac 100.00% Impervious Runoff Depth>6.69"
Flow Length=1,766' Tc=5.0 min CN=98 Runoff=26.14 cfs 1.331 af

Subcatchment 19S: Ph 2 - TO PERIMETER Runoff Area=7.070 ac 0.00% Impervious Runoff Depth>4.21"
Flow Length=1,985' Tc=14.0 min CN=74 Runoff=42.57 cfs 2.483 af

Reach 20R: TO PERIMETER DITCH (WEST OF ROCK CHANNEL) Inflow=59.15 cfs 3.814 af
Outflow=59.15 cfs 3.814 af

Total Runoff Area = 9.460 ac Runoff Volume = 3.814 af Average Runoff Depth = 4.84"
74.74% Pervious = 7.070 ac 25.26% Impervious = 2.390 ac

Summary for Subcatchment 17S: Ph 2 - TO DIVERSION SWALE

[49] Hint: Tc<2dt may require smaller dt

Runoff = 26.14 cfs @ 11.95 hrs, Volume= 1.331 af, Depth> 6.69"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs
 Type II 24-hr 100yr-24hr Rainfall=7.58"

Area (ac)	CN	Description
* 2.390	98	Ash surface
2.390		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.5	100	0.2500	3.63		Sheet Flow, Smooth surfaces n= 0.011 P2= 2.95"
1.3	508	0.0200	6.68	45.06	Trap/Vee/Rect Channel Flow, Bot.W=0.00' D=1.50' Z= 4.0 & 2.0 '/' Top.W=9.00' n= 0.025
1.6	626	0.0180	6.33	42.75	Trap/Vee/Rect Channel Flow, Bot.W=0.00' D=1.50' Z= 4.0 & 2.0 '/' Top.W=9.00' n= 0.025
0.8	215	0.0760	4.65	31.37	Trap/Vee/Rect Channel Flow, Bot.W=0.00' D=1.50' Z= 4.0 & 2.0 '/' Top.W=9.00' n= 0.070
0.3	121	0.0170	6.15	41.54	Trap/Vee/Rect Channel Flow, Bot.W=0.00' D=1.50' Z= 4.0 & 2.0 '/' Top.W=9.00' n= 0.025
0.5	196	0.1500	6.53	44.07	Trap/Vee/Rect Channel Flow, Bot.W=0.00' D=1.50' Z= 4.0 & 2.0 '/' Top.W=9.00' n= 0.070
5.0	1,766	Total			

Subcatchment 17S: Ph 2 - TO DIVERSION SWALE

Hydrograph

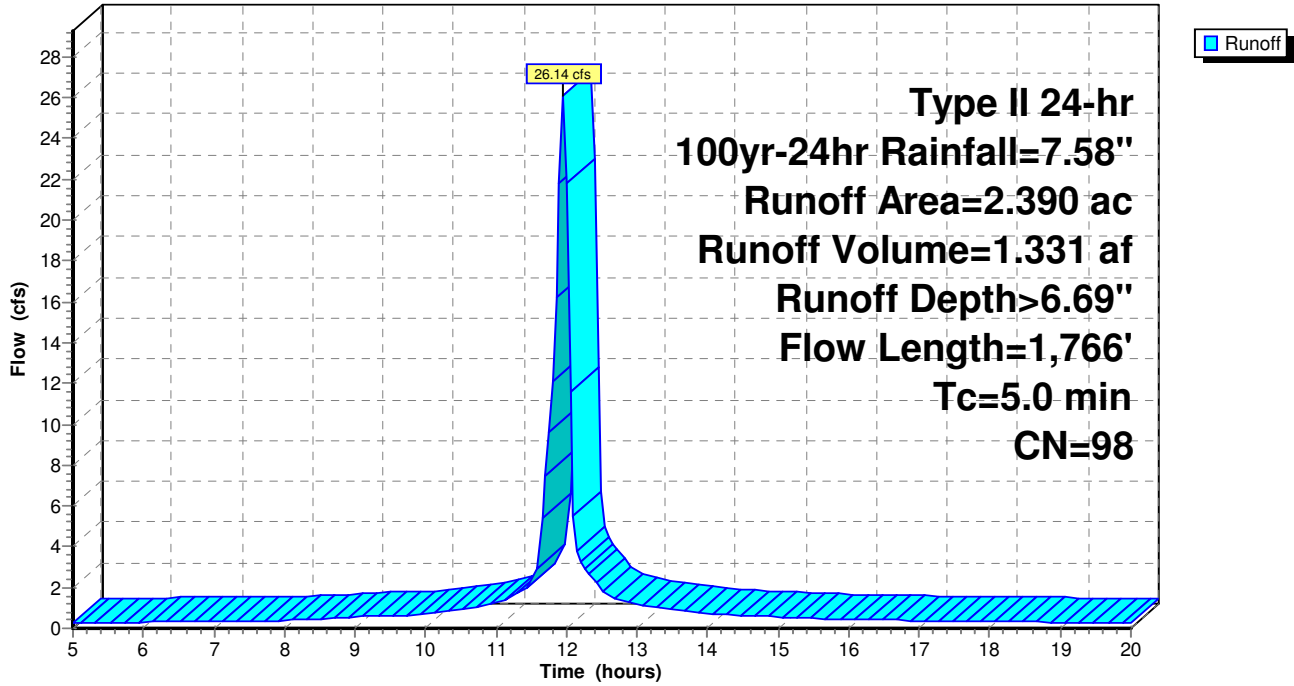

Summary for Subcatchment 19S: Ph 2 - TO PERIMETER DITCH

Runoff = 42.57 cfs @ 12.06 hrs, Volume= 2.483 af, Depth> 4.21"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs
 Type II 24-hr 100yr-24hr Rainfall=7.58"

Area (ac)	CN	Description
* 7.070	74	Final Cover
7.070		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.4	100	0.2500	0.31		Sheet Flow, First 100 Feet Grass: Dense n= 0.240 P2= 2.95"
0.6	270	0.0722	7.02	56.19	Trap/Vee/Rect Channel Flow, Bot.W=5.00' D=1.00' Z= 2.0 & 4.0 '/' Top.W=11.00' n= 0.045
4.8	1,030	0.0185	3.56	28.44	Trap/Vee/Rect Channel Flow, Bot.W=5.00' D=1.00' Z= 2.0 & 4.0 '/' Top.W=11.00' n= 0.045
3.2	585	0.0137	3.06	24.48	Trap/Vee/Rect Channel Flow, Bot.W=5.00' D=1.00' Z= 4.0 & 2.0 '/' Top.W=11.00' n= 0.045
14.0	1,985	Total			

Subcatchment 19S: Ph 2 - TO PERIMETER DITCH

Hydrograph

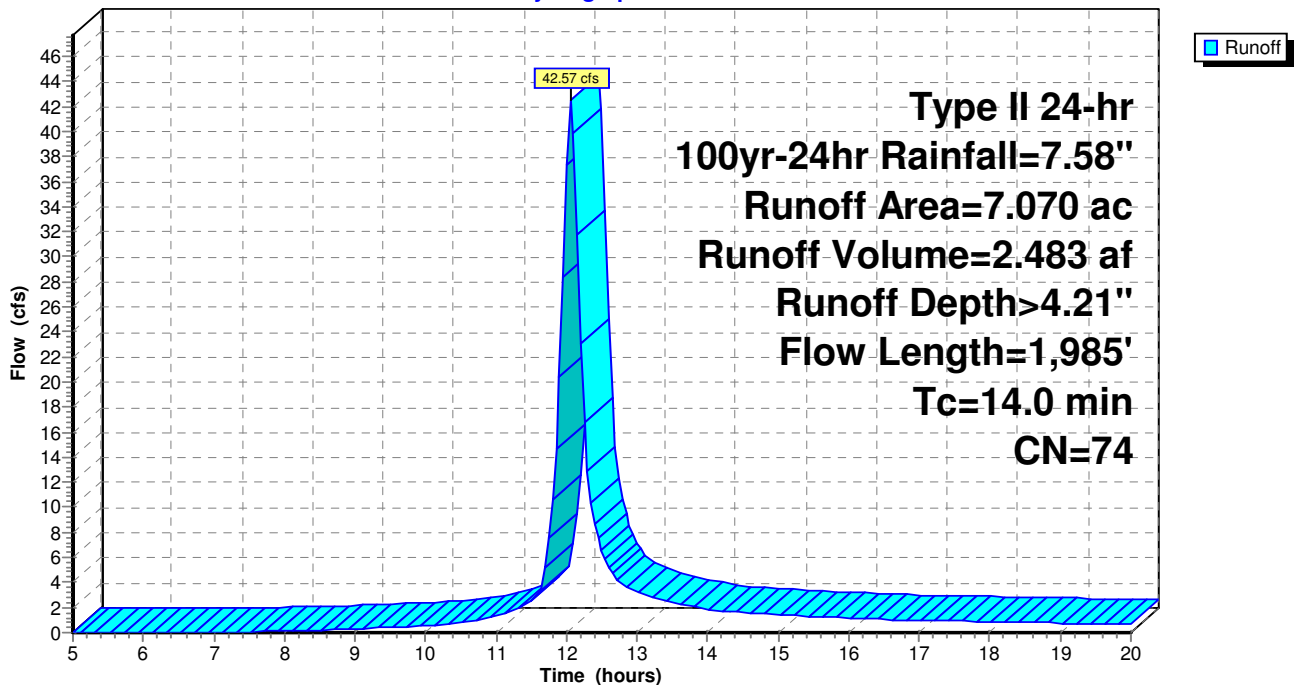


Summary for Reach 20R: TO PERIMETER DITCH (WEST OF ROCK CHANNEL)

[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 9.460 ac, 25.26% Impervious, Inflow Depth > 4.84" for 100yr-24hr event
Inflow = 59.15 cfs @ 12.00 hrs, Volume= 3.814 af
Outflow = 59.15 cfs @ 12.00 hrs, Volume= 3.814 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Reach 20R: TO PERIMETER DITCH (WEST OF ROCK CHANNEL)

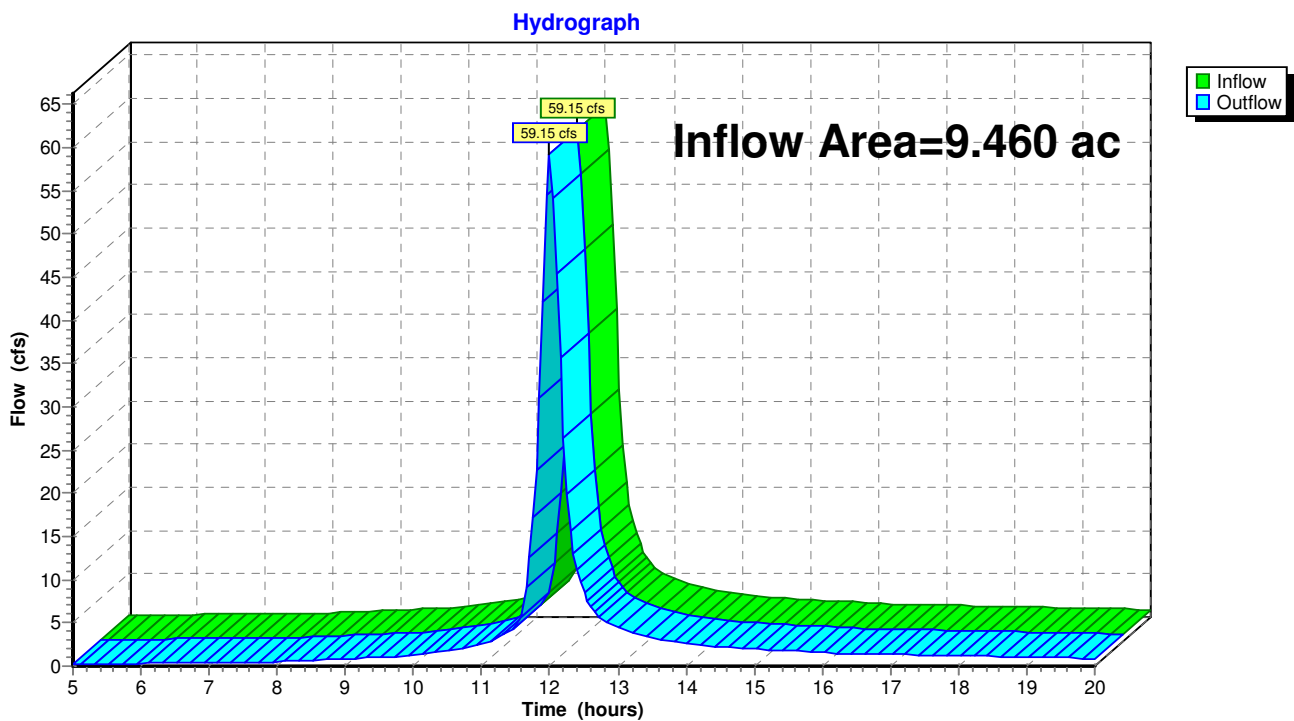

Grass-Lined Channel Sizing

Lining Type: Vegetation

Project ID: Alliant Lansing Ph 2 Final Cover
Location:
Designer/Checker: JMO/BJM
Date: 6/17/15, Revised: 7/7/15

	Ash/Cover Transition Swales						Ash, Ph 1 & Ph 2 cover conditions To south perimeter ditch	
	2.0% slope	2.0% slope	7.6% slope	7.6% slope	1.7% slope	1.7% slope	1.37% slope	1.37% slope
	Check Stability - OK		Check Stability - Not OK, Use Rock Lining		Check Capacity - OK		Check Capacity - OK	
Channel/Ditch Geometry	25 yr	100 yr	25 yr	100 yr	25 yr	100 yr	25 yr	100 yr
Channel Slope, S_b (ft/ft)	0.02	0.02	0.076	0.076	0.017	0.017	0.0137	0.0137
Channel Bottom Width, B (ft)	0	0	0	0	0	0	5	5
Channel Side Slope, z_1	4	4	4	4	4	4	4	4
Channel Side Slope, z_2	4	4	3	2	4	4	2	2
Flow Depth, d (ft) Solve iteratively	1.30	1.45	0.92	1.09	1.36	1.52	1.42	1.72
Safety Factor, SF	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Vegetation/Soil Parameters								
Vegetation Retardance Class	C	C	C	C	C	C	C	C
Vegetation Condition	good	good	good	good	good	good	good	good
Vegetation Growth Form	turf	turf	turf	turf	turf	turf	turf	turf
Soil Type	cohesive	cohesive	cohesive	cohesive	cohesive	cohesive	cohesive	cohesive
D_{75} (in) (Set at 0.00 for cohesive soils)								
ASTM Soil Class	SM	SM	SM	SM	SM	SM	SM	SM
Plasticity Index, PI	16	16	16	16	16	16	16	16
Results Summary								
Design Q (ft ³ /s)	18.86	26.14	18.33	26.14	18.33	26.14	39.87	61.98
Calculated Q (ft ³ /s)	18.7	26.4	18.6	26.2	18.5	26.2	39.9	62.3
Difference Between Design & Calc. Flow (%)	-0.8%	1.2%	1.363%	0.1%	0.7%	0.1%	0.2%	0.5%
Stable (Yes or No)	YES	YES	NO	NO	YES	YES	YES	YES
Channel Parameters								
Vegetation Height, h (ft)	0.67	0.67	0.67	0.67	0.67	0.67	0.67	0.67
Grass Roughness Coefficient, C_n	0.238	0.238	0.238	0.238	0.238	0.238	0.238	0.238
Cover Factor, C_r	0.90	0.90	0.90	0.90	0.90	0.90	0.90	0.90
Noncohesive Soil								
Soil Grain Roughness, n_s	0.016	0.016	0.016	0.016	0.016	0.016	0.016	0.016
Permissible Soil Shear Stress, τ_o (lb/ft ²)	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Cohesive Soil								
Porosity, e	0.29	0.29	0.29	0.29	0.29	0.29	0.29	0.29
Soil Coefficient 1, c_1	1.0700	1.0700	1.0700	1.0700	1.0700	1.0700	1.0700	1.0700
Soil Coefficient 2, c_2	7.15	7.15	7.15	7.15	7.15	7.15	7.15	7.15
Soil Coefficient 3, c_3	11.900	11.900	11.900	11.900	11.900	11.900	11.900	11.900
Soil Coefficient 4, c_4	1.42	1.42	1.42	1.42	1.42	1.42	1.42	1.42
Soil Coefficient 5, c_5	-0.61	-0.61	-0.61	-0.61	-0.61	-0.61	-0.61	-0.61
Soil Coefficient 6, c_6	0.00010	0.00010	0.00010	0.00010	0.00010	0.00010	0.00010	0.00010
Permissible Soil Shear Stress, τ_p (lb/ft ²)	0.062	0.062	0.062	0.062	0.062	0.062	0.062	0.062
Total Permissible Shear Stress, τ_a (lb/ft ²)	0.062	0.062	0.062	0.062	0.062	0.062	0.062	0.062
Cross Sectional Area, A (ft ²)	6.760	8.410	2.962	3.571	7.398	9.242	13.149	17.475
Wetted Perimeter, P (ft)	10.72	11.96	6.70	6.94	11.21	12.53	14.03	15.94
Hydraulic Radius, R (ft)	0.631	0.703	0.442	0.515	0.660	0.737	0.937	1.096
Top Width, T (ft)	10.40	11.60	6.44	6.55	10.88	12.16	13.52	15.32
Hydraulic Depth, D (ft)	0.650	0.725	0.460	0.546	0.680	0.760	0.973	1.141
Froude Number (Q design)	0.605	0.651	1.630	1.748	0.533	0.572	0.543	0.588
Channel Shear Stress, τ_o (lb/ft ²)	0.79	0.88	2.10	2.44	0.70	0.78	0.80	0.94
Actual Shear Stress, τ_d (lb/ft ²)	1.62	1.81	4.36	5.17	1.44	1.61	1.21	1.47
Mannings n	0.056	0.053	0.038	0.036	0.059	0.056	0.055	0.052
Average Velocity, V (ft/s)	2.79	3.11	6.19	7.32	2.48	2.83	3.03	3.55
Calculated Flow, Q (ft ³ /s)	18.7	26.4	18.6	26.2	18.5	26.2	39.9	62.3
Difference Between Design & Calc. Flow (%)	-0.8%	1.2%	1.4%	0.1%	0.7%	0.1%	0.2%	0.5%
Effective Shear on Soil Surface, τ_o (lb/ft ²)	0.013	0.016	0.077	0.102	0.011	0.013	0.010	0.014
Total Permissible Shear on Veg., $\tau_{o,veg}$ (lb/ft ²)	7.58	6.79	3.49	3.13	8.41	7.58	7.31	6.53
Stable (Y or N)	YES	YES	NO	NO	YES	YES	YES	YES

Rock-Lined Channel Sizing

Lining Type: Riprap

Project ID: Alliant Lansing Ph 2 Final Cover
Location:
Designer/Checker: JMO/BJM
Date: 06/17/2015, Revised: 07/06/15

	7.6% swale	7.6% swale	15% swale	15% swale
Channel Geometry	25 yr	100 yr	25 yr	100 yr
Channel Slope, S_o (ft/ft)	0.076	0.076	0.15	0.15
Channel Bottom Width, B (ft)	0	0	0	0
Channel Side Slope, z_1	4	4	4	4
Channel Side Slope, z_2	4	4	4	4
Curvature Radius, R_c (ft)	0	0	0	0
Depth of Flow, d (ft) Solve iteratively	1.22	1.35	0.98	1.09
Riprap Parameters				
Median Riprap Size, D_{50} (ft)	1.33	1.33	1.33	1.33
Riprap Specific Weight, γ_s (lb/ft ³)	165	165	165	165
Riprap Angle of Repose, ϕ , (degrees)	41.8	41.8	41.8	41.8
Safety Factor, SF	1.20	1.20	1.20	1.20
Safety Factor, SF (used in calculation)	1.47	1.50	1.50	1.50
Results Summary				
Design Flow, Q (ft ³ /s)	18.86	26.14	18.86	26.14
Calculated Flow, Q (cfs)	18.9	26.3	19.0	26.4
Difference Between Design & Calc. Flow (%)	0.4%	0.4%	0.8%	0.9%
Bottom Lining Stable (Yes or No)	Yes	Yes	Yes	Yes
Side Lining Stable (Yes or No)				
Bottom in Bend Stable (Yes or No)	N/A	N/A	N/A	N/A
Side in Bend Stable (Yes or No)	N/A	N/A	N/A	N/A
Downstream Length of Protection (ft)	N/A	N/A	N/A	N/A
Additional Freeboard Required, (ft)	N/A	N/A	N/A	N/A
Channel Parameters				
Cross Sectional Area, A (ft ²)	5.95	7.29	3.84	4.75
Top Width, T (ft)	9.8	10.8	7.8	8.7
Average Depth, d_a (ft)	0.610	0.675	0.490	0.545
Wetted Perimeter, P (ft)	10.06	11.13	8.08	8.99
Hydraulic Radius, R (ft)	0.592	0.655	0.475	0.529
Depth to D_{50} Ratio, d_a/D_{50}	0.5	0.5	0.4	0.4
Mannings n	0.091	0.086	0.071	0.068
Average Velocity, V (ft/s)	3.18	3.60	4.95	5.55
Calculated Flow, Q (ft ³ /s)	18.9	26.3	19.0	26.4
Difference Between Design & Calc. Flow (%)	0%	0%	1%	1%

Suggested Trial Depth, d_{i+1} (ft)	1.218	1.348	0.977	1.086
Manning's n				
Manning's n (Blodgett)	0.000	0.000	0.000	0.000
Manning's n (Bathurst)	0.091	0.086	0.071	0.068
Effective Roughness Concentration, b	0.245	0.254	0.226	0.235
Froude Number, Fr (design Q)	0.715	0.769	1.236	1.313
Froude Number function, f(Fr)	0.906	0.925	1.248	1.254
Roughness Element Geometry, f(REG)	5.8	6.2	4.9	5.3
Channel Geometry Function, f(CG)	0.507	0.494	0.534	0.521
Bottom Shear				
Shear Velocity, V_s (ft/s)	1.73	1.82	2.18	2.29
Reynolds Number, R_e	1.9E+05	2.0E+05	2.4E+05	2.5E+05
Shield's Parameter, F^*	0.143	0.149	0.150	0.150
Safety Factor, SF	1.47	1.50	1.50	1.50
Maximum Shear Stress, τ_d (lb/ft ²)	5.79	6.40	9.17	10.20
Permissible Shear Stress, $S_o \leq 10\%$, τ_p (lb/ft ²)	19.5	20.33	20.5	20.47
Stability Number, η	0.28	0.29	0.42	0.46
Steepest Channel Side Slope, z	4	4	4	4
Channel Side Slope Angle, θ (radians)	0.24	0.24	0.24	0.24
Channel Bottom Slope Angle, α (radians)	0.08	0.08	0.15	0.15
Riprap Angle of Repose, ϕ , (radians)	0.730	0.730	0.730	0.730
Weight Vector Angle, B (radians)	0.45	0.48	0.60	0.64
Channel Geometry and Riprap Size Func, Δ	1.14	1.16	1.23	1.24
Permissible Shear Stress, $S_o \geq 5\%$, τ_p (lb/ft ²)	17.1	17.48	16.6	16.57
Permissible Shear based on Slope, τ_p (lb/ft ²)	17.1	17.5	16.6	16.6
Adjusted Permissible Shear, τ_p/SF (lb/ft ²)	11.6	11.7	11.1	11.0
Bottom Lining Stable (Yes or No)	Yes	Yes	Yes	Yes
Stable D_{50} (ft)	0.66	0.73	1.10	1.23
Side Shear				
Channel Side to Bottom Shear Stress Ratio, K_1	0.93	0.93	0.93	0.93

Channel Side Shear Stress, τ_s (lb/ft ²)	5.38	5.95	8.53	9.49
Side Slope Angle, θ (radians)	0.245	0.245	0.245	0.245
Side Slope Angle, θ (degrees)	14.0	14.0	14.0	14.0
Tractive Force Ratio, K_2	0.93	0.93	0.93	0.93
Permissible Side Tractive Force, τ_{ps} (lb/ft ²)				
Side Lining Stable (Yes or No)				
Stable D_{50} (ft)				
<i>Bend Shear</i>				
Curvature Radius, R_c (ft)	0	0	0	0
Ratio of Radius of Curvature to Top Width, R_c/T	N/A	N/A	N/A	N/A
f(Channel Bend and Bottom Shear Stress), K_b	N/A	N/A	N/A	N/A
Shear Stress on the Channel Bottom, τ_b (lb/ft ²)	N/A	N/A	N/A	N/A
Bottom in Bend Stable (Yes or No)	N/A	N/A	N/A	N/A
Shear Stress on the Channel Side, τ_{bs} (lb/ft ²)	N/A	N/A	N/A	N/A
Side in Bend Stable (Yes or No)	N/A	N/A	N/A	N/A
Downstream Length of Protection, L_p (ft)	N/A	N/A	N/A	N/A
Addition Freeboard Required, Δd (ft)	N/A	N/A	N/A	N/A

Ditch Transition Sizing

Rock Chute Design Data

(Version 4.03 - 11/29/11, Based on Design of Rock Chutes by Robinson, Rice, Kadavy, ASAE, 1998)

Project: WPL Lansing Ph 2 Final Cover
Designer: JMO
Date: 06/17/15

County: Allamakee
Checked by: BJM
Date: 10/14/15


Input Channel Geometry

Inlet Channel	Chute	Outlet Channel
Bw = 0.0 ft.	Bw = 0.0 ft.	Bw = 5.0 ft.
Side slopes = 4.3 (m:1)	Factor of safety = 1.20 (F_s)	Side slopes = 3.0 (m:1)
n-value = 0.070	Side slopes = 4.0 (m:1) → 2.0:1 max.	n-value = 0.045
Bed slope = 0.0170 ft./ft.	Bed slope (6.7:1) = 0.150 ft./ft. → 2.5:1 max.	Bed slope = 0.0150 ft./ft.
Minimum Fill = 0.0 ft.	Outlet apron depth, d = 1.0 ft.	Base flow = 0.0 cfs
Freeboard = 0.5 ft.		

Design Storm Data (Table 2, NHCP, NRCS Grade Stabilization Structure No. 410)


Drainage area = _____ acres	Rainfall = <input type="radio"/> 0 - 3 in. <input checked="" type="radio"/> 3 - 5 in. <input type="radio"/> 5+ in.	Note: The total required capacity is routed through the chute (principal spillway) or in combination with an auxiliary spillway.
Apron elev. --- Inlet = 712.0 ft. --- Outlet = 682.0 ft. --- ($H_{drop} = 29$ ft.)		
Chute capacity = Q25-year	Minimum capacity (based on a 5-year, 24-hour storm with a 3 - 5 inch rainfall)	Input tailwater (T_w): T_w (ft.) = Program 0.15
Total capacity = Q100-year		
$Q_{high} = 26.1$ cfs	High flow storm through chute	T_w (ft.) = Program 0.15
$Q_{low} = 18.9$ cfs	Low flow storm through chute	T_w (ft.) = Program

Profile and Cross Section (Output)

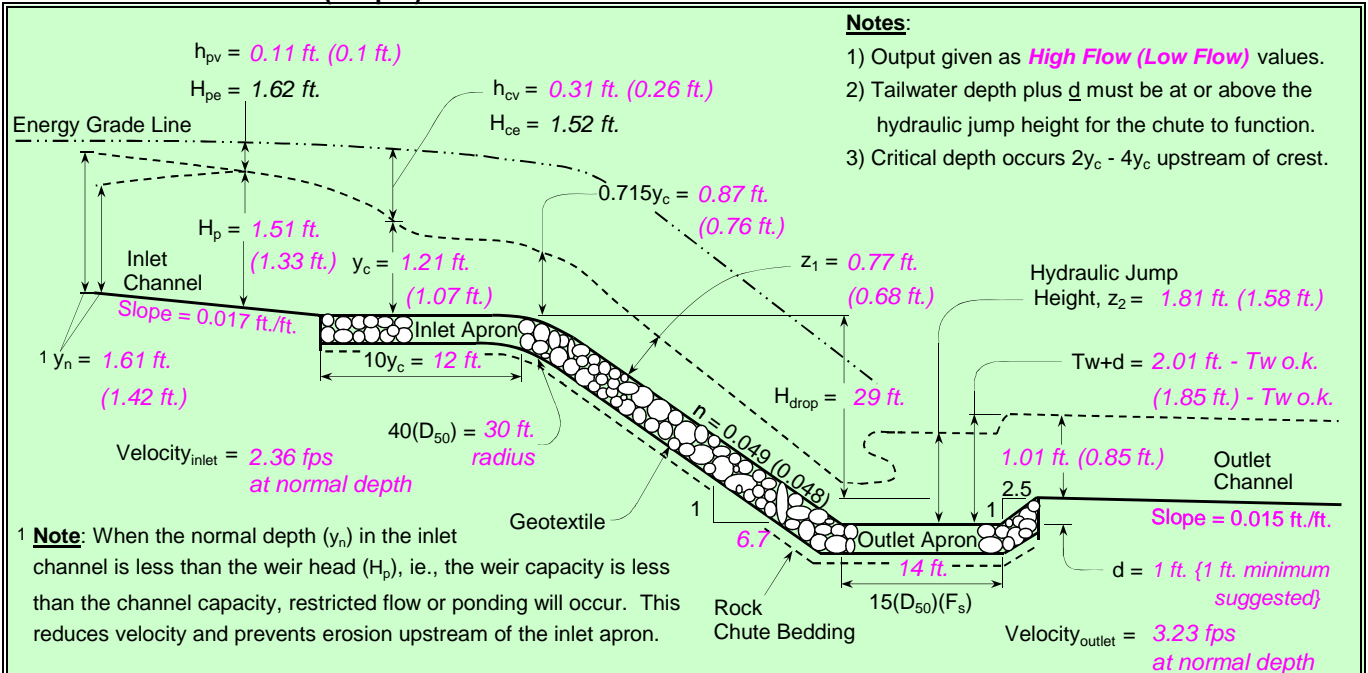

Note: When the normal depth (y_n) in the inlet channel is less than the weir head (H_p), i.e., the weir capacity is less than the channel capacity, restricted flow or ponding will occur. This reduces velocity and prevents erosion upstream of the inlet apron.

Profile Along Centerline of Chute

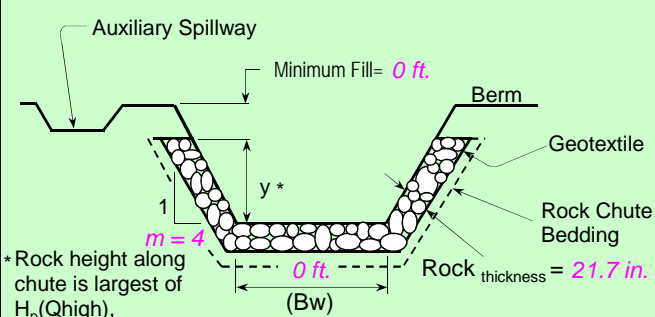

$q_t = 7.6$ cfs/ft.	Equivalent unit discharge
$F_s = 1.20$	Factor of safety (multiplier)
$z_1 = 0.77$ ft.	Normal depth in chute
n-value = 0.049	Manning's roughness coefficient
$D_{50}(F_s) = 10.9$ in. (94 lbs.)	angular riprap
$2(D_{50})(F_s) = 21.7$ in.	Rock chute thickness
$T_w + d = 2.01$ ft.	Tailwater above outlet apron
$z_2 = 1.81$ ft.	Hydraulic jump height
*** The outlet will function adequately	

Typical Cross Section

High Flow Storm Information

Perimeter Ditch Transition

Rock Chute Design Data

(Version 4.03 - 11/29/11, Based on Design of Rock Chutes by Robinson, Rice, Kadavy, ASAE, 1998)

Project: WPL Lansing Ph 2 Final Cover
Designer: JMO
Date: 06/18/15

County: Allamakee
Checked by: BJM
Date: 10/14/15


Input Channel Geometry

Inlet Channel	Chute	Outlet Channel
Bw = 0.0 ft.	Bw = 5.0 ft.	Bw = 5.0 ft.
Side slopes = 4.3 (m:1)	Factor of safety = 1.20 (F _s)	Side slopes = 3.0 (m:1)
n-value = 0.040	Side slopes = 3.0 (m:1) → 2.0:1 max.	n-value = 0.030
Bed slope = 0.0200 ft./ft.	Bed slope (2.5:1) = 0.400 ft./ft. → 2.5:1 max.	Bed slope = 0.0150 ft./ft.
Minimum Fill = 0.0 ft.	Outlet apron depth, d = 1.0 ft.	Base flow = 0.0 cfs
Freeboard = 0.5 ft.		


Design Storm Data (Table 2, NHCP, NRCS Grade Stabilization Structure No. 410)

Drainage area = _____ acres	Rainfall = <input type="radio"/> 0 - 3 in. <input checked="" type="radio"/> 3 - 5 in. <input type="radio"/> 5+ in.	Note: The total required capacity is routed through the chute (principal spillway) or in combination with an auxiliary spillway.
Apron elev. --- Inlet = 684.0 ft. --- Outlet = 680.0 ft. --- (H _{drop} = 3 ft.)		
Chute capacity = Q5-year	Minimum capacity (based on a 5-year, 24-hour storm with a 3 - 5 inch rainfall)	Input tailwater (Tw):
Total capacity = Q10-year		
Q _{high} = 62.0 cfs	High flow storm through chute	Tw (ft.) = Program 0.40
Q _{low} = 39.9 cfs	Low flow storm through chute	Tw (ft.) = Program

Profile and Cross Section (Output)

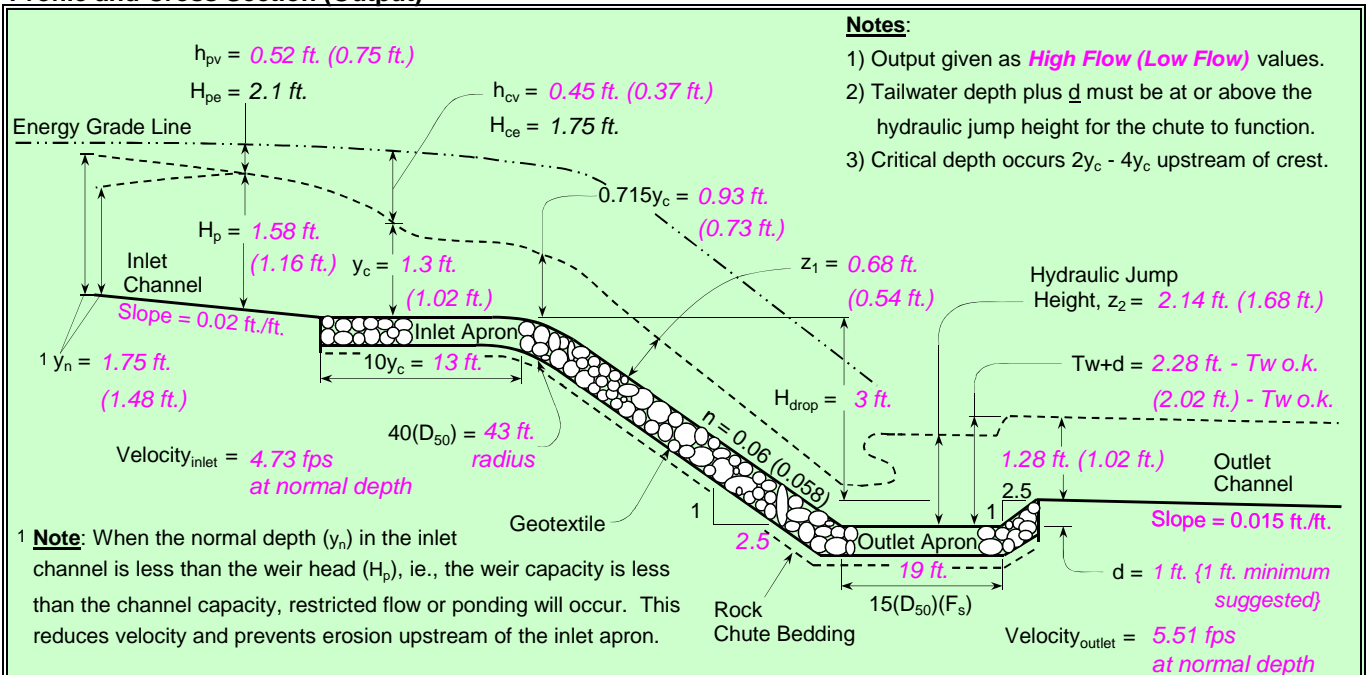

Profile Along Centerline of Chute

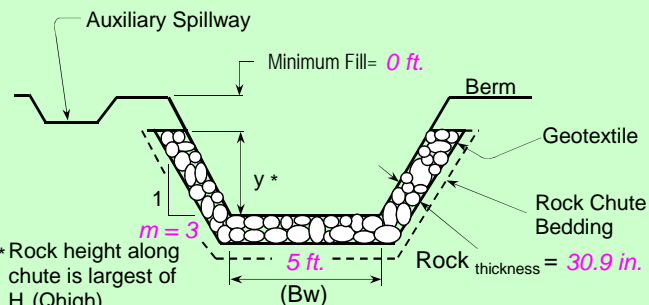

Typical Cross Section

q _t = 8.36 cfs/ft.	Equivalent unit discharge
F _s = 1.20	Factor of safety (multiplier)
z ₁ = 0.68 ft.	Normal depth in chute
n-value = 0.06	Manning's roughness coefficient
D ₅₀ (F _s) = 15.5 in. (269 lbs.)	angular riprap
2(D ₅₀)(F _s) = 30.9 in.	Rock chute thickness
Tw + d = 2.28 ft.	Tailwater above outlet apron
z ₂ = 2.14 ft.	Hydraulic jump height
*** The outlet will function adequately	

High Flow Storm Information