

2024 Annual Groundwater Monitoring and Corrective Action Report

Nelson Dewey Generating Station Slag Pond
Cassville, Wisconsin

Prepared for:

Alliant Energy



SCS ENGINEERS

25224071.00 | January 31, 2025

2830 Dairy Drive
Madison, WI 53718-6751
608-224-2830

OVERVIEW OF CURRENT STATUS

Nelson Dewey Generating Station, Slag Pond 2024 Annual Report

In accordance with §257.90(e)(6), this section at the beginning of the annual report provides an overview of the current status of groundwater monitoring and corrective action programs for the coal combustion residual (CCR) units. Supporting information is provided in the text of the annual report.

Category	Rule Requirement	Site Status
Monitoring Status – Start of Year	(i) At the start of the current annual reporting period, whether the CCR unit was operating under the detection monitoring program in §257.94 or the assessment monitoring program in §257.95;	Detection
Monitoring Status – End of Year	(ii) At the end of the current annual reporting period, whether the CCR unit was operating under the detection monitoring program in §257.94 or the assessment monitoring program in §257.95;	Detection
Statistically Significant Increases (SSIs)	(iii) If it was determined that there was an SSI over background for one or more constituents listed in Appendix III to this part pursuant to §257.94(e): (A) Identify those constituents listed in Appendix III to this part and the names of the monitoring wells associated with such an increase; and	<u>October 2023</u> Boron: B-7R, B-11A, B-11B, B-11R, B-31A, B-31R Calcium: B-31R Field pH: B-11A, B-11B, B-31A Sulfate: B-11A, B-11B, B-11R, B-31R Total Dissolved Solids (TDS): B-11B, B-31R <u>April 2024</u> Boron: B-7R, B-11A, B-11B, B-11R, B-31A, B-31R Calcium: B-11B Fluoride: B-11B Field pH: B-11A, B-31A Sulfate: B-11A, B-11B, B-11R, B-31R TDS: B-11B, B-11R

Category	Rule Requirement	Site Status
	(B) Provide the date when the assessment monitoring program was initiated for the CCR unit.	Alternative Source Demonstrations prepared for October 2023 and April 2024 events during 2024. Assessment monitoring not required.
Statistically Significant Levels (SSL) Above Groundwater Protection Standard (GPS)	(iv) If it was determined that there was an SSL above the GPS for one or more constituents listed in appendix IV to this part pursuant to §257.95(g) include all of the following:	Not applicable In detection monitoring
	(A) Identify those constituents listed in appendix IV to this part and the names of the monitoring wells associated with such an increase;	
	(B) Provide the date when the assessment of corrective measures was initiated for the CCR unit;	
	(C) Provide the date when the public meeting was held for the assessment of corrective measures for the CCR unit; and	
	(D) Provide the date when the assessment of corrective measures was completed for the CCR unit.	
Selection of Remedy	(v) Whether a remedy was selected pursuant to §257.97 during the current annual reporting period, and if so, the date of remedy selection; and	Not applicable In detection monitoring
Corrective Action	(vi) Whether remedial activities were initiated or are ongoing pursuant to §257.98 during the current annual reporting period.	Not applicable In detection monitoring

Table of Contents

Section	Page
Overview of Current Status	i
1.0 Introduction.....	1
2.0 Background.....	1
2.1 Geologic and Hydrogeologic Setting.....	1
2.1.1 Regional Information.....	1
2.1.2 Site Information	2
2.2 CCR Monitoring System	2
3.0 § 257.90(e) Annual Report Requirements.....	2
3.1 § 257.90(e)(1) Site Map.....	3
3.2 § 257.90(e)(2) Monitoring System Changes.....	3
3.3 § 257.90(e)(3) Summary of Sampling Events.....	3
3.4 § 257.90(e)(4) Monitoring Transition Narrative.....	4
3.5 § 257.90(e)(5) Other Requirements.....	4
3.5.1 § 257.90(e) General Requirements.....	4
3.5.2 § 257.94(d) Alternative Detection Monitoring Frequency.....	5
3.5.3 § 257.94(e)(2) Alternative Source Demonstration for Detection Monitoring	5
3.5.4 § 257.95(c) Alternative Assessment Monitoring Frequency	6
3.5.5 § 257.95(d)(3) Assessment Monitoring Results and Standards	6
3.5.6 § 257.95(g)(3)(ii) Alternative Source Demonstration for Assessment Monitoring	6
3.5.7 § 257.96(a) Extension of Time for Corrective Measures Assessment	6
3.6 257.90(e)(6) Overview	6
4.0 References.....	6

Tables

Table 1.	Groundwater Monitoring Well Network
Table 2.	CCR Rule Groundwater Samples Summary
Table 3.	Water Level Summary
Table 4A.	Horizontal Gradients and Flow Velocity
Table 4B.	Summary of Calculated Vertical Hydraulic Gradients
Table 5.	Groundwater Analytical Results Summary – October 2023 and April 2024
Table 6.	Groundwater Field Data Summary

Figures

- Figure 1. Site Location Map
- Figure 2. Site Aerial View
- Figure 3. Site Plan and Monitoring Well Locations
- Figure 4. Water Table Flow Map – April 2024
- Figure 5. Water Table Flow Map – October 2024

Appendices

- Appendix A Summary of Regional Geologic and Hydrogeologic Information
- Appendix B Boring Logs, Well Construction, and Well Development Forms
- Appendix C Laboratory Analytical Reports
- Appendix D Historical Monitoring Results
- Appendix E Alternative Source Demonstration Reports
 - E1 Alternative Source Demonstration, October 2023 Detection Monitoring
 - E2 Alternative Source Demonstration, April 2024 Detection Monitoring

I:\25224071.00\Deliverables\2024 - Annual CCR Report\250131_2024 NED Fed CCR Annual Report_Final.docx

1.0 INTRODUCTION

This 2024 Annual Groundwater Monitoring and Corrective Action Report was prepared to support compliance with the groundwater monitoring requirements of the Coal Combustion Residuals (CCR) Rule [40 CFR 257.50-107]. Specifically, this report was prepared to fulfill the requirements of 40 CFR 257.90(e). The applicable sections of the Rule are provided below in *italics*, followed by applicable information relative to the 2024 Annual Groundwater Monitoring and Corrective Action Report for the CCR Unit. The site location is shown on **Figure 1**.

This report covers the period of groundwater monitoring from January 1, 2024, through December 31, 2024.

The groundwater monitoring system for the Nelson Dewey Generating Station (NED) Slag Pond monitors a single CCR unit:

- NED Slag Pond (existing surface impoundment – closed January 2018)

The system is designed to detect monitored constituents at the waste boundary of the Slag Pond as required by 40 CFR 257.91(d). The groundwater monitoring system consists of one background well and six downgradient monitoring wells (**Table 1** and **Figure 3**).

During 2017 and early 2018, the Slag Pond CCR unit was closed by leaving the CCR in place and installing a final cover system, in accordance with §257.102(d). Closure certification was completed on January 31, 2018.

The closed CCR landfill adjacent to the Slag Pond is not subject to regulation under the CCR rule and is regulated by the Wisconsin Department of Natural Resources. The CCR landfill was initially licensed in 1976 and received fly ash from NED until it was closed in phases between 1996 and 2001.

2.0 BACKGROUND

To provide context for the annual report, the following background information is provided in this section of the report, prior to the annual report requirements sections:

- Geologic and hydrogeologic setting
- CCR Rule monitoring system

2.1 GEOLOGIC AND HYDROGEOLOGIC SETTING

2.1.1 Regional Information

The uppermost geologic formation beneath the NED plant that meets the definition of the “uppermost aquifer,” as defined by section 257.53 of the CCR Rule, is the surficial alluvial aquifer. The alluvial aquifer consists of Mississippi River valley sand and gravel deposits. This deposit is prevalent along the edges of the entire Mississippi River valley in southwestern Wisconsin. A map of the regional glacial geology in the area is included in **Appendix A**.

The alluvial aquifer is underlain by dolomitic bedrock of the Prairie du Chien Group. A bedrock geology map of the area is provided in **Appendix A**. The dolomite bedrock is also an aquifer and is likely hydraulically connected to the alluvial aquifer above.

Regionally, groundwater flow is generally to the southwest and discharges to the Mississippi River.

2.1.2 Site Information

Soil boring logs for monitoring wells installed at the site also generally indicate sand and gravel soils within the monitored depths. During drilling of CCR well B-7R, the unconsolidated materials were identified as consisting primarily of poorly graded, medium to coarse grained sand, and silty sand. The boring log for the previously installed background monitoring well B-26 shows silt and poorly graded sand as the primary unconsolidated materials at this location. The boring logs for the CCR monitoring wells are provided in **Appendix B**. All CCR monitoring wells are screened within the unconsolidated glacial aquifer.

The groundwater flow direction in the vicinity of the former plant area is generally southwest toward the Mississippi River. Historically, infiltration at the former Slag Pond, former fly ash basin, and the former Wisconsin Pollutant Discharge Elimination System (WPDES) ponds caused groundwater mounding to be present around these features; however, these ponds have now all been closed and are no longer sources of infiltration.

Although historic site water level measurements have generally indicated that groundwater flow is toward the Mississippi River, groundwater flow in the Slag Pond area is influenced by variations in river water levels. During periods of high river water levels, the flow temporarily reverses and the river discharges to the shallow sand and gravel aquifer. The water table map for the April 2024 monitoring event (**Figure 4**) shows groundwater flow to the east and north/northeast away from the river. The water table map for the October 2024 monitoring event (**Figure 5**) shows flow to the south and west toward the river. The groundwater elevations for the CCR monitoring wells and additional wells in the state monitoring program for the closed CCR landfill are provided in **Table 3**. Calculated horizontal gradients and flow velocities for flow to the north/northwest in April 2024 and south in October 2024 are provided in **Table 4A**. Vertical gradients are provided in **Table 4B**.

2.2 CCR MONITORING SYSTEM

The groundwater monitoring system established in accordance with the CCR Rule consists of one upgradient (background) monitoring well and six downgradient monitoring wells (**Table 1** and **Figure 3**). The background well is B-26. The downgradient wells include B-7R, B-11A, B-11B, B-11R, B-31A, and B-31R. The CCR Rule wells are installed within the surficial alluvium aquifer. Well depths range from approximately 23 to 114 feet, measured from the top of the well casing.

3.0 § 257.90(E) ANNUAL REPORT REQUIREMENTS

Annual groundwater monitoring and corrective action report. For existing CCR landfills and existing CCR surface impoundments, no later than January 31, 2018, and annually thereafter, the owner or operator must prepare an annual groundwater monitoring and corrective action report. For new CCR landfills, new CCR surface impoundments, and all lateral expansions of CCR units, the owner or operator must prepare the initial annual groundwater monitoring and corrective action report no later than January 31 of the year following the calendar year a groundwater monitoring system has been established for such CCR unit as required by this subpart, and annually thereafter. For CCR management units, the owner or operator must prepare the initial annual groundwater monitoring

and corrective action report no later than January 31, 2029, and annually thereafter. For the preceding calendar year, the annual report must document the status of the groundwater monitoring and corrective action program for the CCR unit, summarize key actions completed, describe any problems encountered, discuss actions to resolve the problems, and project key activities for the upcoming year. For purposes of this section, the owner or operator has prepared the annual report when the report is placed in the facility's operating record as required by §257.105(h)(1). At a minimum, the annual groundwater monitoring and corrective action report must contain the following information, to the extent available:

3.1 § 257.90(E)(1) SITE MAP

A map, aerial image, or diagram showing the CCR unit and all background (or upgradient) and downgradient monitoring wells, to include the well identification numbers, that are part of the groundwater monitoring program for the CCR unit;

A map showing the site location is provided on **Figure 1**. A map showing site features is provided on **Figure 2**. A map showing the CCR unit and all background (or upgradient) and downgradient monitoring wells with identification numbers for the groundwater monitoring program is provided on **Figure 3**. The Slag Pond CCR unit is closed, and the map shows the post-closure conditions.

3.2 § 257.90(E)(2) MONITORING SYSTEM CHANGES

Identification of any monitoring wells that were installed or decommissioned during the preceding year, along with a narrative description of why those actions were taken;

No new monitoring wells were installed and no wells were decommissioned as part of the groundwater monitoring program for the CCR unit in 2024.

3.3 § 257.90(E)(3) SUMMARY OF SAMPLING EVENTS

In addition to all the monitoring data obtained under §§ 257.90 through 257.98, a summary including the number of groundwater samples that were collected for analysis for each background and downgradient well, the dates the samples were collected, and whether the sample was required by the detection monitoring or assessment monitoring programs;

Two groundwater sampling events were completed in 2024 at the NED Slag Pond as part of ongoing detection monitoring.

Groundwater samples collected during the semiannual events, in April and October 2024, were analyzed for the Appendix III constituents. A summary including the number of groundwater samples that were collected for analysis for each background and downgradient well, the dates the samples were collected, and whether the sample was required by the detection monitoring or assessment monitoring program is included in **Table 2**.

The validation and evaluation of the October 2023 monitoring event data was completed and transmitted to WPL on January 23, 2023. The validation and evaluation of the April 2024 monitoring event data was completed and transmitted to WPL on August 14, 2024. The validation and evaluation of the October 2024 monitoring event data was in progress at the end of 2024 and will be transmitted to WPL in 2025; therefore, the October 2024 monitoring results will be included in the 2025 annual report. The October 2024 groundwater elevation data is included in this report.

The sampling results for Appendix III parameters in October 2023 and April 2024 are summarized in **Table 5**. Field parameter results for the October 2023 and April 2024 sampling events are provided in **Table 6**. The analytical laboratory reports for the October 2023 and April 2024 sampling events are provided in **Appendix C**. Historical results for each monitoring well through April 2024 are summarized in **Appendix D**.

3.4 § 257.90(E)(4) MONITORING TRANSITION NARRATIVE

A narrative discussion of any transition between monitoring programs (e.g., the date and circumstances for transitioning from detection monitoring to assessment monitoring in addition to identifying the constituent(s) detected at a statistically significant increase over background levels);

There was no monitoring program transition in 2024. The NED Slag Pond remained in the detection monitoring program.

In 2024, the monitoring results for the October 2023 and April 2024 monitoring events were evaluated for statistically significant increases (SSIs) in detection monitoring parameters relative to background. The comparison to background was based on a prediction limit approach, comparing the results to interwell upper prediction limits (UPLs) based on background monitoring results from the upgradient well (B-26). The interwell UPLs were updated in July 2023 using background data collected through April 2023. The Unified Guidance for Statistical Analysis of Groundwater Monitoring Data at Resource Conservation and Recovery Act (RCRA) Facilities (U.S. EPA, 2009; Section 5.3.1) recommends periodic updating of background for both introwell and interwell analyses. For semiannual monitoring, an update interval of 2 to 3 years is recommended. The next update for UPLs is planned for 2025.

For the October 2023 and April 2024 events, SSIs were identified at one or more wells for boron, calcium, fluoride, field pH, sulfate, and total dissolved solids (TDS) (**Table 5**).

Alternative source demonstrations were completed in 2024 for SSIs identified in the October 2023 and April 2024 events, demonstrating that sources other than the Slag Pond were the likely cause of the observed SSIs. The Alternative Source Demonstration (ASD) reports are provided in **Appendix E**. Based on the findings of the ASDs, the NED Slag Pond remained in detection monitoring.

3.5 § 257.90(E)(5) OTHER REQUIREMENTS

Other information required to be included in the annual report as specified in §§ 257.90 through 257.98.

Additional potentially applicable requirements for the annual report, and the location of the requirement within the Rule, are provided in the following sections. For each cited section of the Rule, the portion referencing the annual report requirement is provided below in italics, followed by applicable information relative to the 2024 Annual Groundwater Monitoring and Corrective Action Report for the NED Slag Pond CCR unit.

3.5.1 § 257.90(e) General Requirements

For the preceding calendar year, the annual report must document the status of the groundwater monitoring and corrective action program for the CCR unit, summarize key actions completed, describe any problems encountered, discuss actions to resolve the problems, and project key activities for the upcoming year.

Status of Groundwater Monitoring and Corrective Action Program. The groundwater monitoring and corrective action program was in detection monitoring throughout 2024.

Summary of Key Actions Completed.

- Two semiannual groundwater sampling and analysis events (April and October 2024).
- Statistical evaluation and determination of SSIs for the October 2023 and April 2024 monitoring events.
- ASD reports for the SSIs identified from the October 2023 and April 2024 monitoring events.

Description of Any Problems Encountered. No issues were encountered in 2024.

Discussion of Actions to Resolve the Problems. Not applicable. No issues were encountered in 2024.

Projection of Key Activities for the Upcoming Year (2025).

- Two semiannual groundwater sampling and analysis events (April and October 2025).
- Statistical evaluation and determination of any SSIs for the October 2024 and April 2025 monitoring events.
- If an SSI is determined, then within 90 days either:
 - Complete ASD (if applicable), or
 - Establish an assessment monitoring program.

3.5.2 § 257.94(d) Alternative Detection Monitoring Frequency

The owner or operator must include the demonstration providing the basis for the alternative monitoring frequency and the certification by a qualified professional engineer in the annual groundwater monitoring and corrective action report required by § 257.90(e).

Not applicable. No alternative detection monitoring frequency has been proposed.

3.5.3 § 257.94(e)(2) Alternative Source Demonstration for Detection Monitoring

The owner or operator must also include the demonstration in the annual groundwater monitoring and corrective action report required by § 257.90(e), in addition to the certification by a qualified professional engineer.

The ASD reports prepared to address the SSIs observed for the October 2023 and April 2024 sampling events are provided in **Appendix E**. The ASD reports are certified by a qualified professional engineer.

3.5.4 § 257.95(c) Alternative Assessment Monitoring Frequency

The owner or operator must include the demonstration providing the basis for the alternative monitoring frequency and the certification by a qualified professional engineer in the annual groundwater monitoring and corrective action report required by § 257.90(e).

Not applicable. Assessment monitoring has not been initiated.

3.5.5 § 257.95(d)(3) Assessment Monitoring Results and Standards

Include the recorded concentrations required by paragraph (d)(1) of this section, identify the background concentrations established under § 257.94(b), and identify the groundwater protection standards established under paragraph (d)(2) of this section in the annual groundwater monitoring and corrective action report required by § 257.90(e).

Not applicable. Assessment monitoring has not been initiated.

3.5.6 § 257.95(g)(3)(ii) Alternative Source Demonstration for Assessment Monitoring

The owner or operator must also include the demonstration in the annual groundwater monitoring and corrective action report required by § 257.90(e), in addition to the certification by a qualified professional engineer.

Not applicable. Assessment monitoring has not been initiated.

3.5.7 § 257.96(a) Extension of Time for Corrective Measures Assessment

The assessment of corrective measures must be completed within 90 days, unless the owner or operator demonstrates the need for additional time to complete the assessment of corrective measure due to site-specific conditions or circumstances. The owner or operator must obtain a certification from a qualified professional engineer attesting that the demonstration is accurate. The 90-day deadline to complete the assessment of corrective measures may be extended for longer than 60 days. The owner or operator must also include the demonstration in the annual groundwater monitoring and corrective action report required by § 257.90(e), in addition to the certification by a qualified professional engineer.

Not applicable. Corrective measures assessment has not been initiated.

3.6 257.90(E)(6) OVERVIEW

A section at the beginning of the annual report that provides an overview of the current status of groundwater monitoring and corrective action programs for the CCR unit.

The specific requirements for the overview under §257.90(e)(6) are listed and the information is provided at the beginning of this report, before the Table of Contents.

4.0 REFERENCES

U.S. Environmental Protection Agency (U.S. EPA), 2009, Statistical Analysis of Groundwater Monitoring Data at RCRA Facilities, Unified Guidance, EPA 530-R-09-007, March 2009.

Tables

- 1 Groundwater Monitoring Well Network
- 2 CCR Rule Groundwater Samples Summary
- 3 Water Level Summary
- 4A Horizontal Gradients and Flow Velocity
- 4B Summary of Calculated Vertical Hydraulic Gradients
- 5 Groundwater Analytical Results Summary – October 2023 and April 2024
- 6 Groundwater Field Data Summary

Table 1. Groundwater Monitoring Well Network
Nelson Dewey Closed Ash Disposal Facility / SCS Engineers Project #25224071.00

Monitoring Well	Location in Monitoring Network	Role in Monitoring Network
B-26	Upgradient / Sidegradient	Background
B-7R	Downgradient	Compliance
B-11R	Downgradient	Compliance
B-11A	Downgradient	Compliance
B-11B	Downgradient	Compliance
B-31R	Downgradient	Compliance
B-31A	Downgradient	Compliance

Last revision by: NLB
Checked by: LH

Date: 11/19/2024
Date: 11/27/2024

Table 2. CCR Rule Groundwater Samples Summary
Nelson Dewey Closed Ash Disposal Facility / SCS Engineers Project #25224071.00

Sample Dates	Downgradient Wells						Upgradient Well
	B-7R	B-11R	B-11A	B-11B	B-31R	B-31A	
April 23-24, 2024	D	D	D	D	D	D	D
October 7-8, 2024	D	D	D	D	D	D	D
Total Samples	2	2	2	2	2	2	2

Abbreviations:

D = Required by Detection Monitoring Program

Last revision by: NLB Date: 11/19/2024
 Checked by: LH Date: 11/27/2024

Table 3. Water Level Summary
Nelson Dewey Closed Ash Disposal Facility / SCS Engineers Project #25224071.00

Well Number	Ground Water Elevation in feet above mean sea level (amsl)																								
	B-7R	B-8R	B-11R	B-11A	B-11B	B-21R**#	B-26	B-26A	B-28	B-30R	B-30AR	B-31R	B-31A	B-32	B-32A	B-35	B-35A*	B-36	B-36A	B-37	B-37A	B-39	B-40	Barge Gauge (SG-12)**	Pond Gauge (SG-13)^
Top of Casing Elevation (feet amsl)	623.35	627.51	622.62	622.12	621.89	623.31	626.40	626.40	616.81	621.81	622.4	622.42	622.69	614.18	614.4	620.78	621.09	621.11	621.33	614.85	614.85	626.48	623.84	622.34	See notes
Screen Length (ft)	10	10	10	5	5	10	10	5	10	10	5	10	5	10	5	10	5	9	4.5	10	5	10	10		
Total Depth (ft from top of casing)	23.05	27.25	24.15	52.00	113.90	22.78	31.67	45.78	16.70	22.20	46.90	22.82	35.52	14.79	52.00	16.60	47.00	20.5	50	19.95	48.20	26.90	27.00		
Top of Well Screen Elevation (ft)	610.30	610.26	608.47	575.12	512.99	610.53	604.73	585.62	610.11	609.61	580.50	609.60	592.17	609.39	567.40	614.18	579.20	609.60	575.50	604.90	571.65	609.58	606.84		
Measurement Date																				--	--	--	--	--	
April 2, 2013	607.04	608.01	606.15	607.20	607.17	606.30	605.60	605.64	605.90	605.91	605.93	607.13	607.13	606.11	606.14	606.13	606.25	--	--	606.99	607.02	--	--	--	
October 16-17, 2013	604.51	605.89	604.17	603.90	603.87	604.11	604.31	604.32	604.36	604.08	604.06	604.87	604.00	604.53	604.56	604.46	604.44	--	--	604.05	604.04	--	--	--	
April 10, 2014	607.42	608.97	607.45	607.28	607.26	--	607.22	607.23	--	--	607.37	607.28	--	--	607.46	607.39	--	--	607.25	607.26	--	--	--		
October 14-15, 2014	605.67	606.82	605.17	604.90	604.91	614.92	605.00	605.01	605.13	604.92	604.92	606.36	605.54	605.41	605.45	605.36	605.33	--	--	604.94	604.99	--	--	--	
April 16, 2015	607.26	608.50	607.11	607.15	607.05	--	606.40	606.41	--	--	607.37	607.09	--	--	606.73	606.78	--	--	606.99	606.88	--	--	--		
October 1-2, 2015	605.14	604.66	604.53	604.42	604.38	604.36	604.43	604.50	604.54	604.34	604.32	605.13	604.38	604.76	604.82	604.76	604.75	--	--	604.30	604.39	--	--	--	
December 8, 2015	606.69	--	606.71	606.30	606.26	--	606.80	--	--	--	607.40	606.39	--	--	--	--	--	--	--	--	607.54	--	--	--	
April 12, 2016	609.32	609.36	609.32	608.71	608.68	--	609.81	609.72	--	--	609.34	609.01	--	--	609.73	609.65	--	--	608.79	608.79	610.23	--	--		
July 18-19, 2016	606.54	--	606.14	606.76	606.74	--	606.09	--	--	--	606.55	606.73	--	--	--	--	--	--	--	--	606.28	--	--	--	
October 19-20, 2016	608.59	608.46	608.35	608.21	608.19	608.37	608.84	608.76	608.63	608.45	608.46	608.51	608.20	608.69	608.73	608.78	608.74	--	--	608.20	608.18	609.09	--	--	
January 11-12, 2017	608.02	--	607.96	607.83	607.78	--	608.56	--	--	--	607.90	607.84	--	--	--	--	--	--	--	--	608.92	--	--	--	
April 17, 2017	609.08	608.82	608.34	609.05	608.99	--	608.59	608.54	609.94	608.57	608.64	607.20	608.98	608.96	608.98	609.00	609.02	--	--	609.02	609.02	610.23	--	--	
June 8, 2017	610.74	--	610.42	609.81	610.08	--	611.25	--	--	--	609.63	610.50	--	--	--	--	--	--	--	--	611.53	--	--	--	
August 1-2, 2017	607.02	--	606.73	605.57	605.50	--	607.39	--	--	--	606.84	605.69	--	--	--	--	--	--	--	--	608.71	--	--	--	
October 9-10, 2017	606.93	606.51	606.25	607.01	606.94	--	606.22	606.13	606.33	606.44	606.45	606.68	606.93	606.57	606.61	606.65	606.71	--	--	--	--	--	--	--	
October 19, 2017	609.60	--	609.42	609.58	609.65	--	608.84	--	--	--	609.47	609.43	--	--	--	--	--	--	--	--	609.40	609.40	608.55	--	
November 17, 2017	--	--	--	--	--	606.35	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	
December 19, 2017	--	--	--	--	--	604.81	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	
February 7, 2018	605.37	--	605.33	604.96	604.92	--	--	--	616.81	--	--	605.31	605.01	--	--	--	--	--	--	--	606.19	--	--	--	
March 16, 2018	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	
April 20, 2018 **	604.82	606.61	606.27	606.63	606.55	606.52	606.49	606.37	606.39	606.46	606.43	604.44	606.46	606.58	606.66	606.68	606.70	--	--	606.77	606.83	606.19	--	--	
May 23, 2018	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	
October 8-10, 2018	610.76	610.68	610.67	610.28	610.24	610.02	610.34	610.28	610.83	610.09	610.05	610.39	610.27	611.05	610.94	610.72	610.54	--	--	--	--	611.44	--	--	
November 11, 2018	--	--	--	--	609.14	--	--	--	--	--	609.11	--	--	--	--	--	--	--	--	--	608.40	--	--	--	
April 22-23, 2019	615.28	615.66	615.28	615.29	615.28	614.98	615.49	615.31	615.40	615.36	615.35	615.01	615.33	--	--	615.87	615.98	--	--	615.40	--	615.17	<615.06		
October 14-16, 2019	613.43	613.11	613.06	613.29	613.18	612.47	613.10	613.10	612.71	612.83	612.78	612.50	613.20	613.10	613.00	613.10	613.15	--	--	--	--	613.35	--	612.33	<615.06
April 13-14, 2020	614.12	613.76	614.39	613.88	613.86	613.22	613.76	613.7																	

Table 4A. Horizontal Gradients and Flow Velocity
Nelson Dewey Generating Station / SCS Engineers Project #25224071.00

Flowpath - North/Northeast					
Sampling Dates	h1 (ft)	h2 (ft)	Δl (ft)	Δh/Δl (ft/ft)	V (ft/d)
April 23-24, 2024	606.72	606.30	367	0.0011	0.02

Flowpath - South					
Sampling Dates	h1 (ft)	h2 (ft)	Δl (ft)	Δh/Δl (ft/ft)	V (ft/d)
October 7-8, 2024	604.00	603.6	228	0.00176	0.036

Wells	K Values (cm/sec)	K Values (ft/d)	Assumed Porosity, n
Geometric Mean	2.9E-03	8.2	0.40

Note: K value derived from averaging previous slug tests

Groundwater flow velocity equation: $V = [K * (\Delta h / \Delta l)] / n$

ft = feet

ft/d = feet per day

K = hydraulic conductivity

n = effective porosity

V = groundwater flow velocity

h1, h2 = point interpreted groundwater elevation at locations 1 and 2

Δl = distance between location 1 and 2

Δh/Δl = hydraulic gradient

Last revision by: NLB
 Checked by: LH

Date: 12/6/2024
 Date: 12/6/2024

Table 4B. Summary of Calculated Vertical Hydraulic Gradients
Nelson Dewey Generating Station / SCS Engineers Project #25224071.00

Vertical Hydraulic Gradients	B-11A/B-11B		B-31R/B-31A	
Shallow Well	B-11A		B-31R	
Screen midpoint (feet amsl)	572.62		604.60	
Deep Well	B-11B		B-31A	
Screen midpoint (feet amsl)	510.49		589.67	
Measurement Date	midpoints (ft)	Vertical Gradient (ft/ft)	midpoints (ft)	Vertical Gradient (ft/ft)
April 23-24, 2024	62.13	-0.00322	13.44	0.0015
October 7-8, 2024	62.13	-0.00097	11.99	-0.0108

Notes:

1. A positive vertical gradient indicates upward flow potential, and a negative vertical gradient indicates downward flow potential.
2. Well screen at B-31R was partially submerged during the April and October 2024 sampling event. The effective screen midpoint is calculated at the midpoint between the water table elevation and screen bottom elevation, and this value is used to calculate Distance Between Midpoints.

Last revision by: NLB
 Checked by: LH

Date: 11/20/2024
 Date: 11/27/2024

Table 5. Groundwater Analytical Results Summary - October 2023 and April 2024
Nelson Dewey Closed Ash Disposal Facility, Cassville, WI / SCS Engineers Project #25224071.00

		Background Well		Compliance Wells											
Parameter Name	UPL	B-26		B-7R		B-11A		B-11B		B-11R		B-31A		B-31R	
		10/3/2023	4/24/2024	10/3/2023	4/23/2024	10/3/2023	4/24/2024	10/3/2023	4/23/2024	10/3/2023	4/24/2024	10/2/2023	4/23/2024	10/2/2023	4/23/2024
Groundwater Elevation (ft above msl)		604.20	606.51	604.39	606.66	603.97	606.86	603.91	606.66	603.93	606.72	603.95	606.63	603.98	606.61
Appendix III															
Boron, µg/L	70.5	44.8	44.8	144	134	231	715	5,040	5,630	3,120	2,640	191	187	519	659
Calcium, µg/L	104,000	85,100	79,600	41000 P6	52300	60,300	63,900	80,600	171,000	90,600	96,700	48,300	46,000	114,000	89,300
Chloride, mg/L	72.7	50.2	43.5	4.7	8.2 J,D 3	43.9	35.1	25.5	25.1	41.6	35.8	55.7	51.0	19.3	35.4
Fluoride, mg/L	0.20	<0.095	0.16 J	<0.095 M0	<0.48 D3, M0	0.16 J	0.23 J	<0.95 D3	0.43	0.2 J	0.27 J	0.14 J	0.15 J	0.14 J	0.31 J
Field pH, Std. Units	7.64	7.47	7.23	6.30	6.33	7.66	7.82	7.84	7.36	6.80	6.89	7.67	7.74	6.82	6.73
Sulfate, mg/L	47.1	42.5	29.8	4.5	<2.2 D3	86.0	155.0	403	435	58	64.8	20.00	19.00	103.0	113.0
Total Dissolved Solids, mg/L	536	418	448	184	232	352	478	918	1010	456	536	274.00	306.00	536	506

7.81

Blue shaded cell indicates the compliance well result exceeds the UPL (background) and the Limit of Quantitation (LOQ).

Abbreviations:

UPL = Upper Prediction Limit

LOQ = Limit of LOQ = Limit of Quantitation

µg/L = micrograms per liter

SSI = Statistically Significant Increase

LOD = Limit of LOD = Limit of Detection

mg/L = milligrams per liter

DQ = Double Quantification

Lab Notes:

J = Estimated concentration at or above the LOD and below the LOQ.

D3 = Sample was diluted due to the presence of high levels of non-target analytes or other matrix interference.

M0 = Matrix Spike recovery and/or matrix spike duplicate recovery was outside laboratory control limits.

Notes:

1. An individual result above the UPL may not constitute an SSI above background. See the accompanying report text for identification of statistically significant results.

2. Interwell UPLs calculated based on results from background well B-26. UPLs are based on a 1-of-2 retesting approach.

3. Interwell UPLs were updated in July 2023 with background well results from December 2015 through April 2023.

Created by: LMH	Date: 9/26/2022
Last revision by: EMS	Date: 9/19/2024
Checked by: JM	Date: 9/20/2024
Proj Mgr QA/QC: TK	Date: 1/12/2025

Table 6. Groundwater Field Data Summary
Nelson Dewey Closed Ash Disposal Facility / SCS Engineers Project #25224071.00


Well	Sample Date	Groundwater Elevation (feet)	Field Temperature (deg C)	Field pH (Std. Units)	Field Specific Conductance (umhos/cm)	Oxygen, Dissolved (mg/L)	Field Oxidation Potential (mV)	Turbidity (NTU)
B-7R	10/3/2023	604.39	24.8	6.3	427	0.39	-79.3	7.4
	4/23/2024	606.66	11.5	6.33	460	2.07	-297.3	3.2
B-11A	10/3/2023	603.97	13.7	7.66	628	0.11	-27.1	0.00
	4/24/2024	606.86	12.5	7.82	716	0.59	-261.5	2.84
B-11B	10/3/2023	603.91	15.1	7.84	1346	0.3	40.6	0.00
	4/23/2024	606.66	13.4	7.36	1301	1.17	-248.7	0.40
B-11R	10/3/2023	603.93	13.8	6.8	810	0.21	-11.9	0.00
	4/24/2024	606.72	11.4	6.89	878	0.3	-40.1	3.25
B-26	10/3/2023	604.20	11.2	7.47	810	8.35	106.3	0.00
	4/24/2024	606.51	11.1	7.23	760	9.28	31.4	3.11
B-31A	10/2/2023	603.95	13.4	7.67	523	0.27	-32.3	0.00
	4/23/2024	606.63	13.3	7.74	505	0.11	-35.4	0.00
B-31R	10/2/2023	603.98	14.2	6.82	898	0.19	-36.7	4.56
	4/23/2024	606.61	12.8	6.73	750	0.19	-14.6	0.27

Last revision by: EMS
 Checked by: JM

Date: 9/19/2024
 Date: 9/20/2024

Figures

- 1 Site Location Map
- 2 Site Aerial View
- 3 Site Plan and Monitoring Well Locations
- 4 Water Table Flow Map – April 2024
- 5 Water Table Flow Map – October 2024

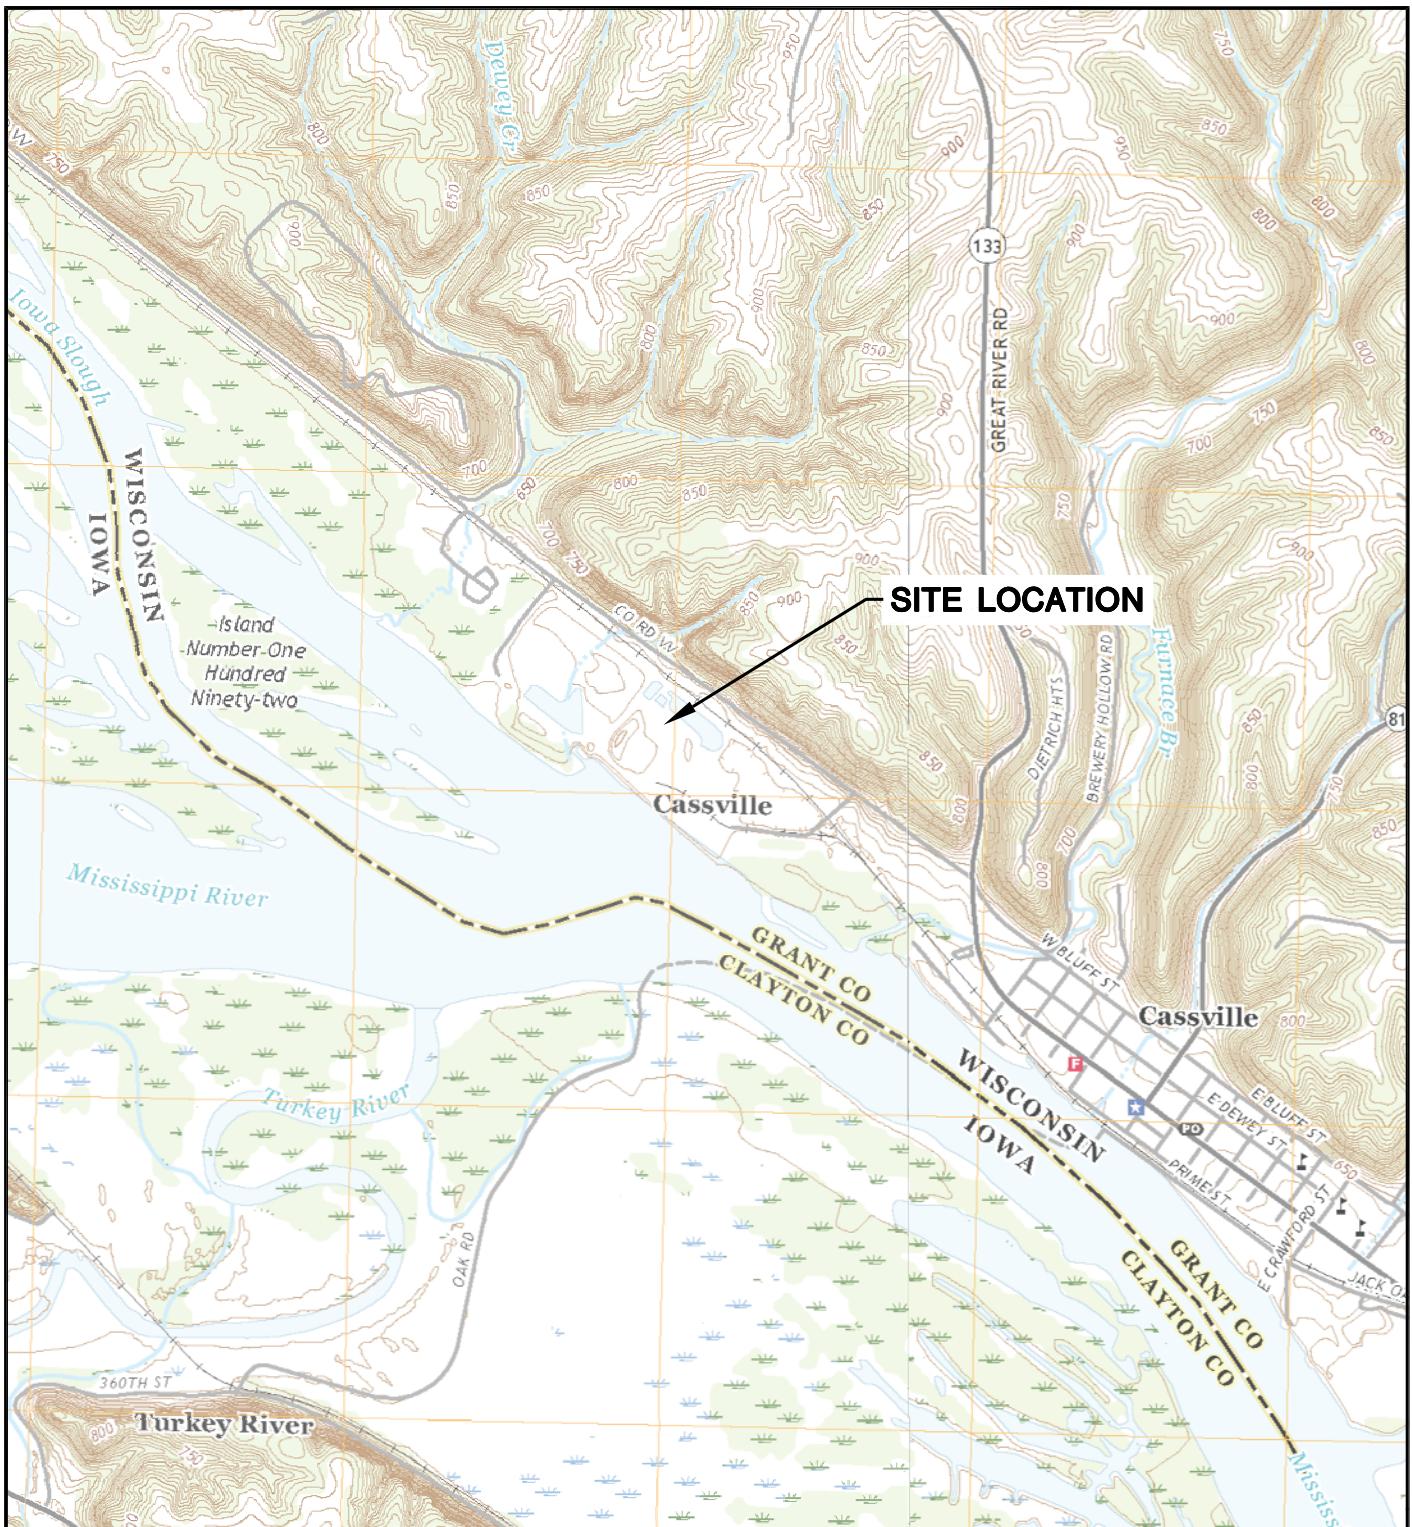

CASSVILLE AND TURKEY RIVER QUADRANGLES

WISCONSIN-IAWA


7.5 MINUTE SERIES (TOPOGRAPHIC)

2018

SCALE: 1" = 2,000'



CLIENT ALLIANT ENERGY 4902 N. BILTMORE LANE, #1000 MADISON, WI 53718	SITE NELSON DEWEY GENERATING STATION CASSVILLE, WISCONSIN	SITE LOCATION MAP	
PROJECT NO. 25220071.00	DRAWN BY: BSS	ENGINEER	FIGURE
DRAWN: 11/27/2019	CHECKED BY: MDB	SCS ENGINEERS 2830 DAIRY DRIVE MADISON, WI 53718-6751 PHONE: (608) 224-2830	
REVISED: 01/14/2020	APPROVED BY: TK 04/10/2020		1

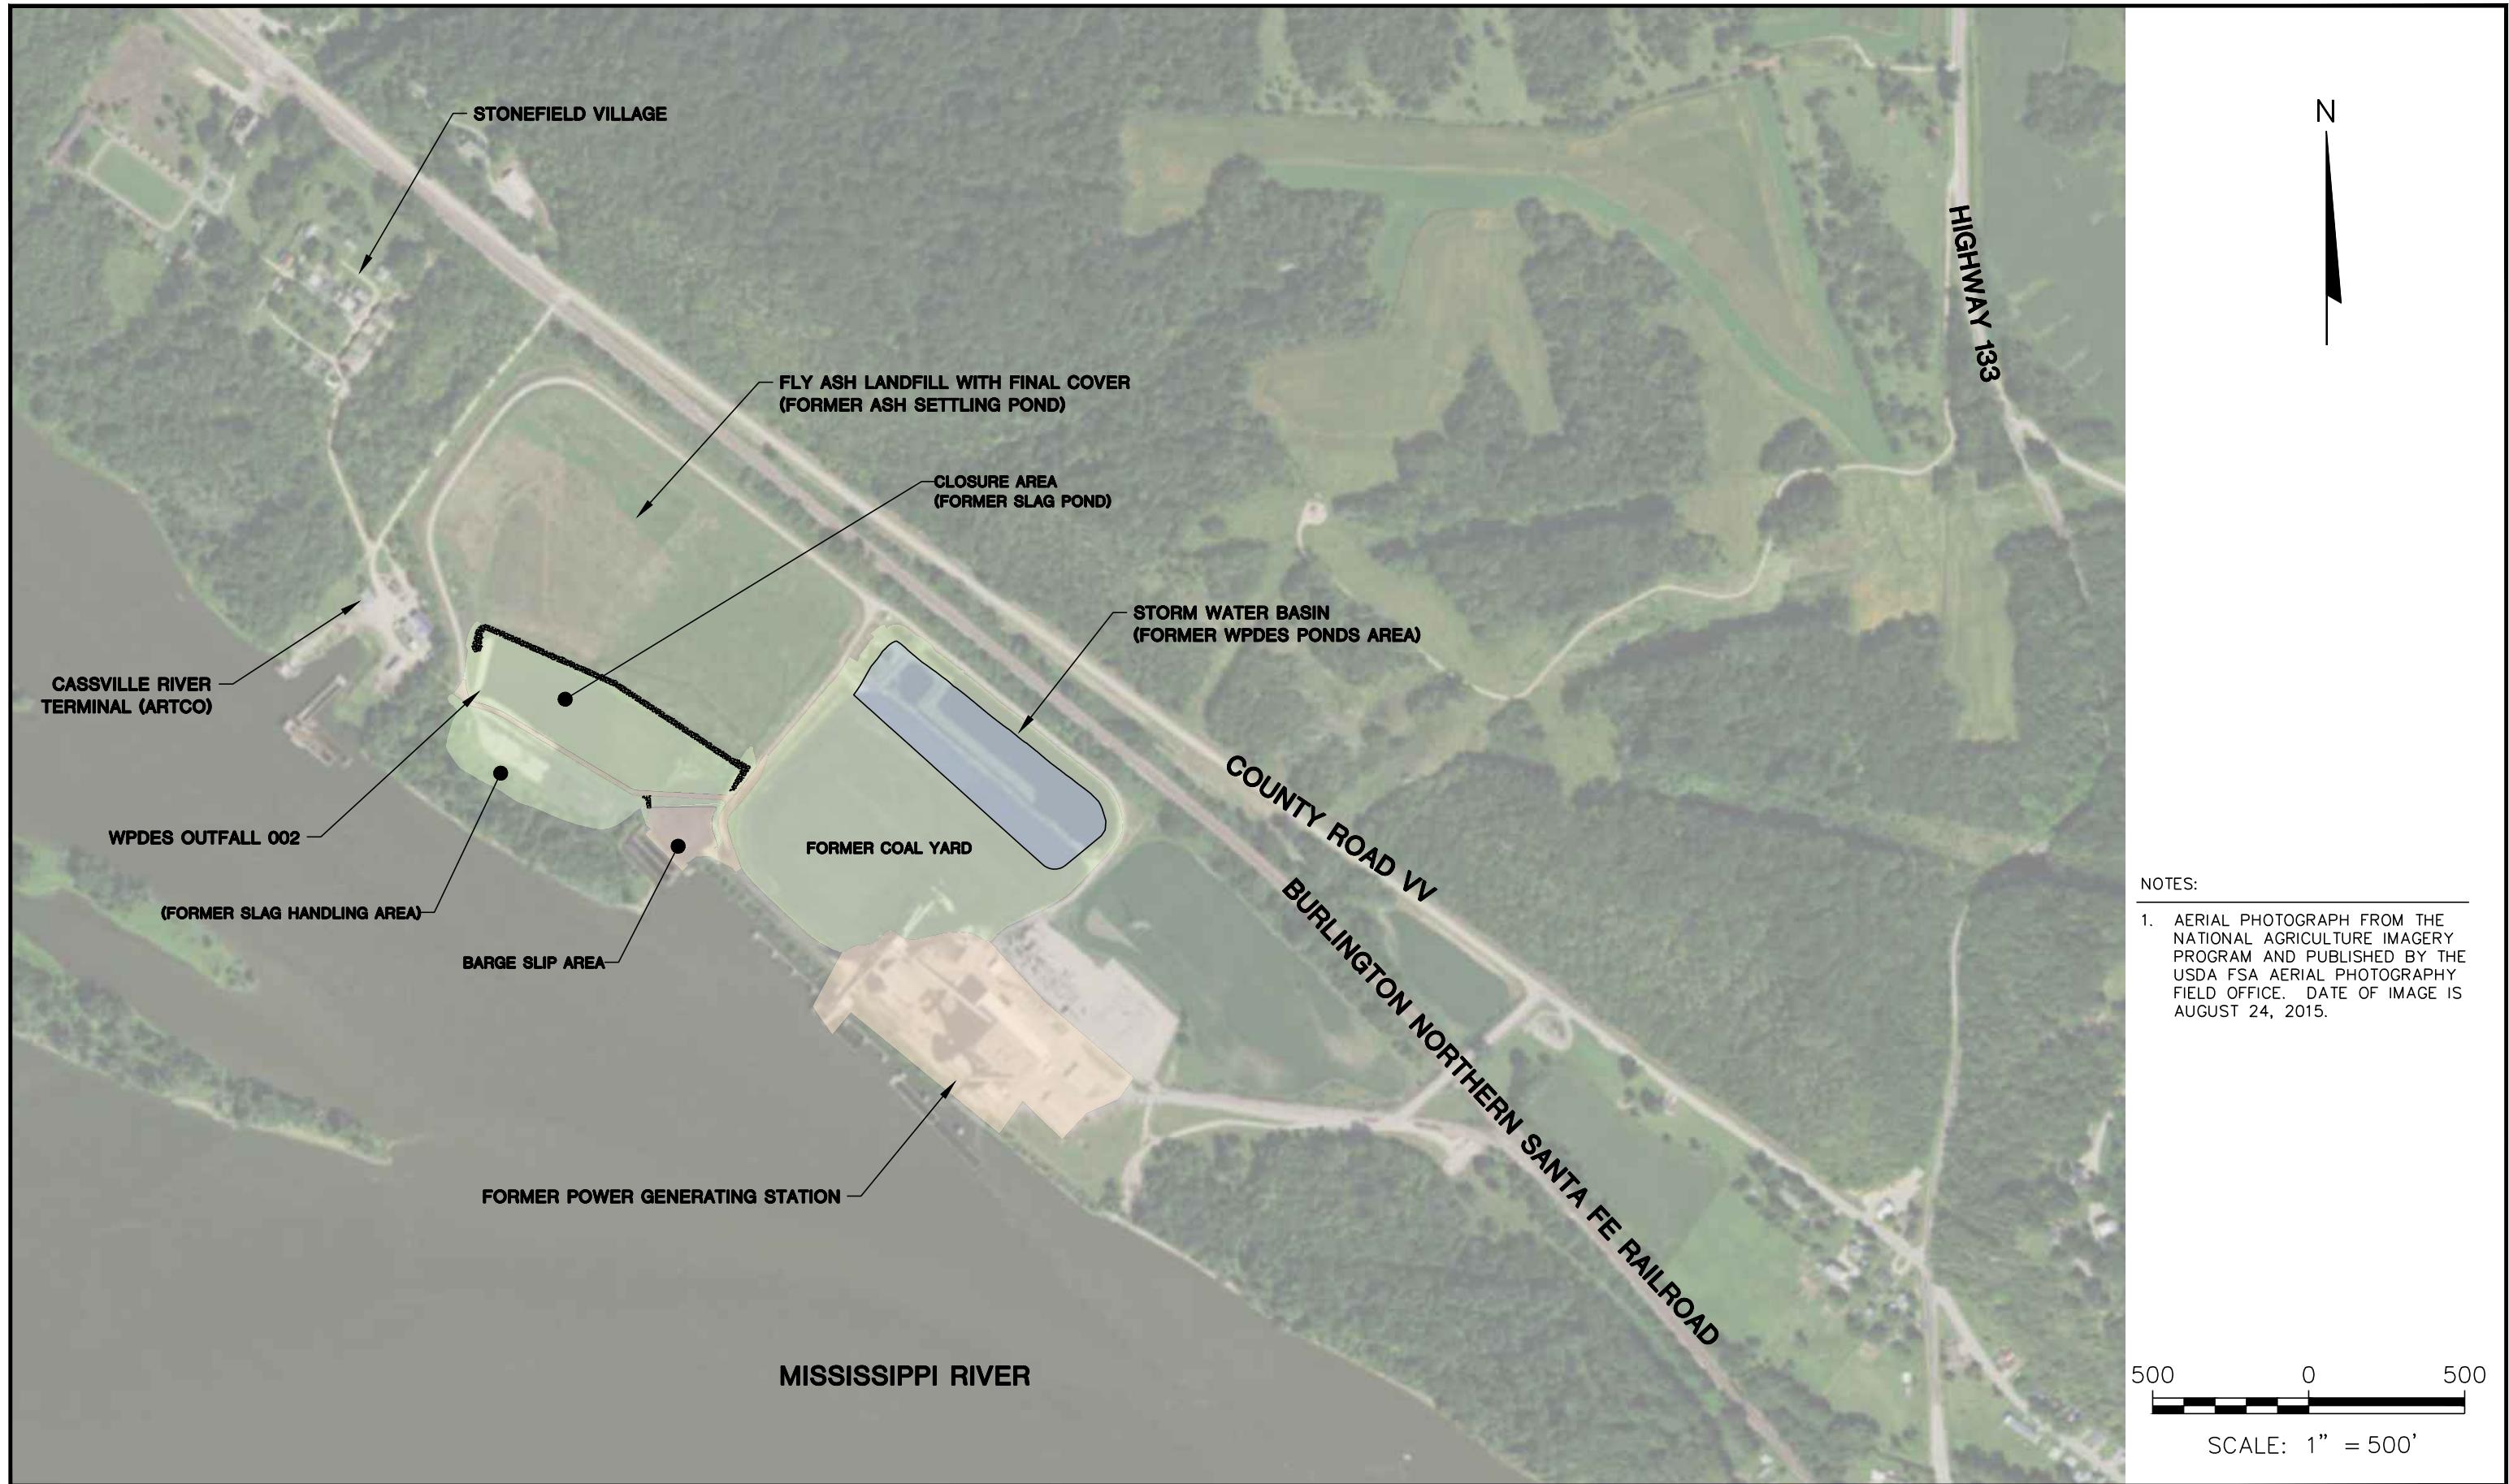

PROJECT NO.	25220071.00	DRAWN BY:	BJM
DRAWN:	12/18/13	CHECKED BY:	KAK
REVISED:	01/22/20	APPROVED BY:	TK 04/10/2020

SCS ENGINEERS
2830 DAIRY DRIVE MADISON, WI 53718-6751
PHONE: (608) 224-2830


CLIENT
WISCONSIN POWER AND LIGHT CO.
NELSON DEWEY GENERATING STATION
11999 COUNTY HIGHWAY VV
CASSVILLE WI, 53806


SITE


WISCONSIN POWER AND LIGHT
NELSON DEWEY GENERATING STATION
CASSVILLE WISCONSIN

AERIAL VIEW

FIGURE
2

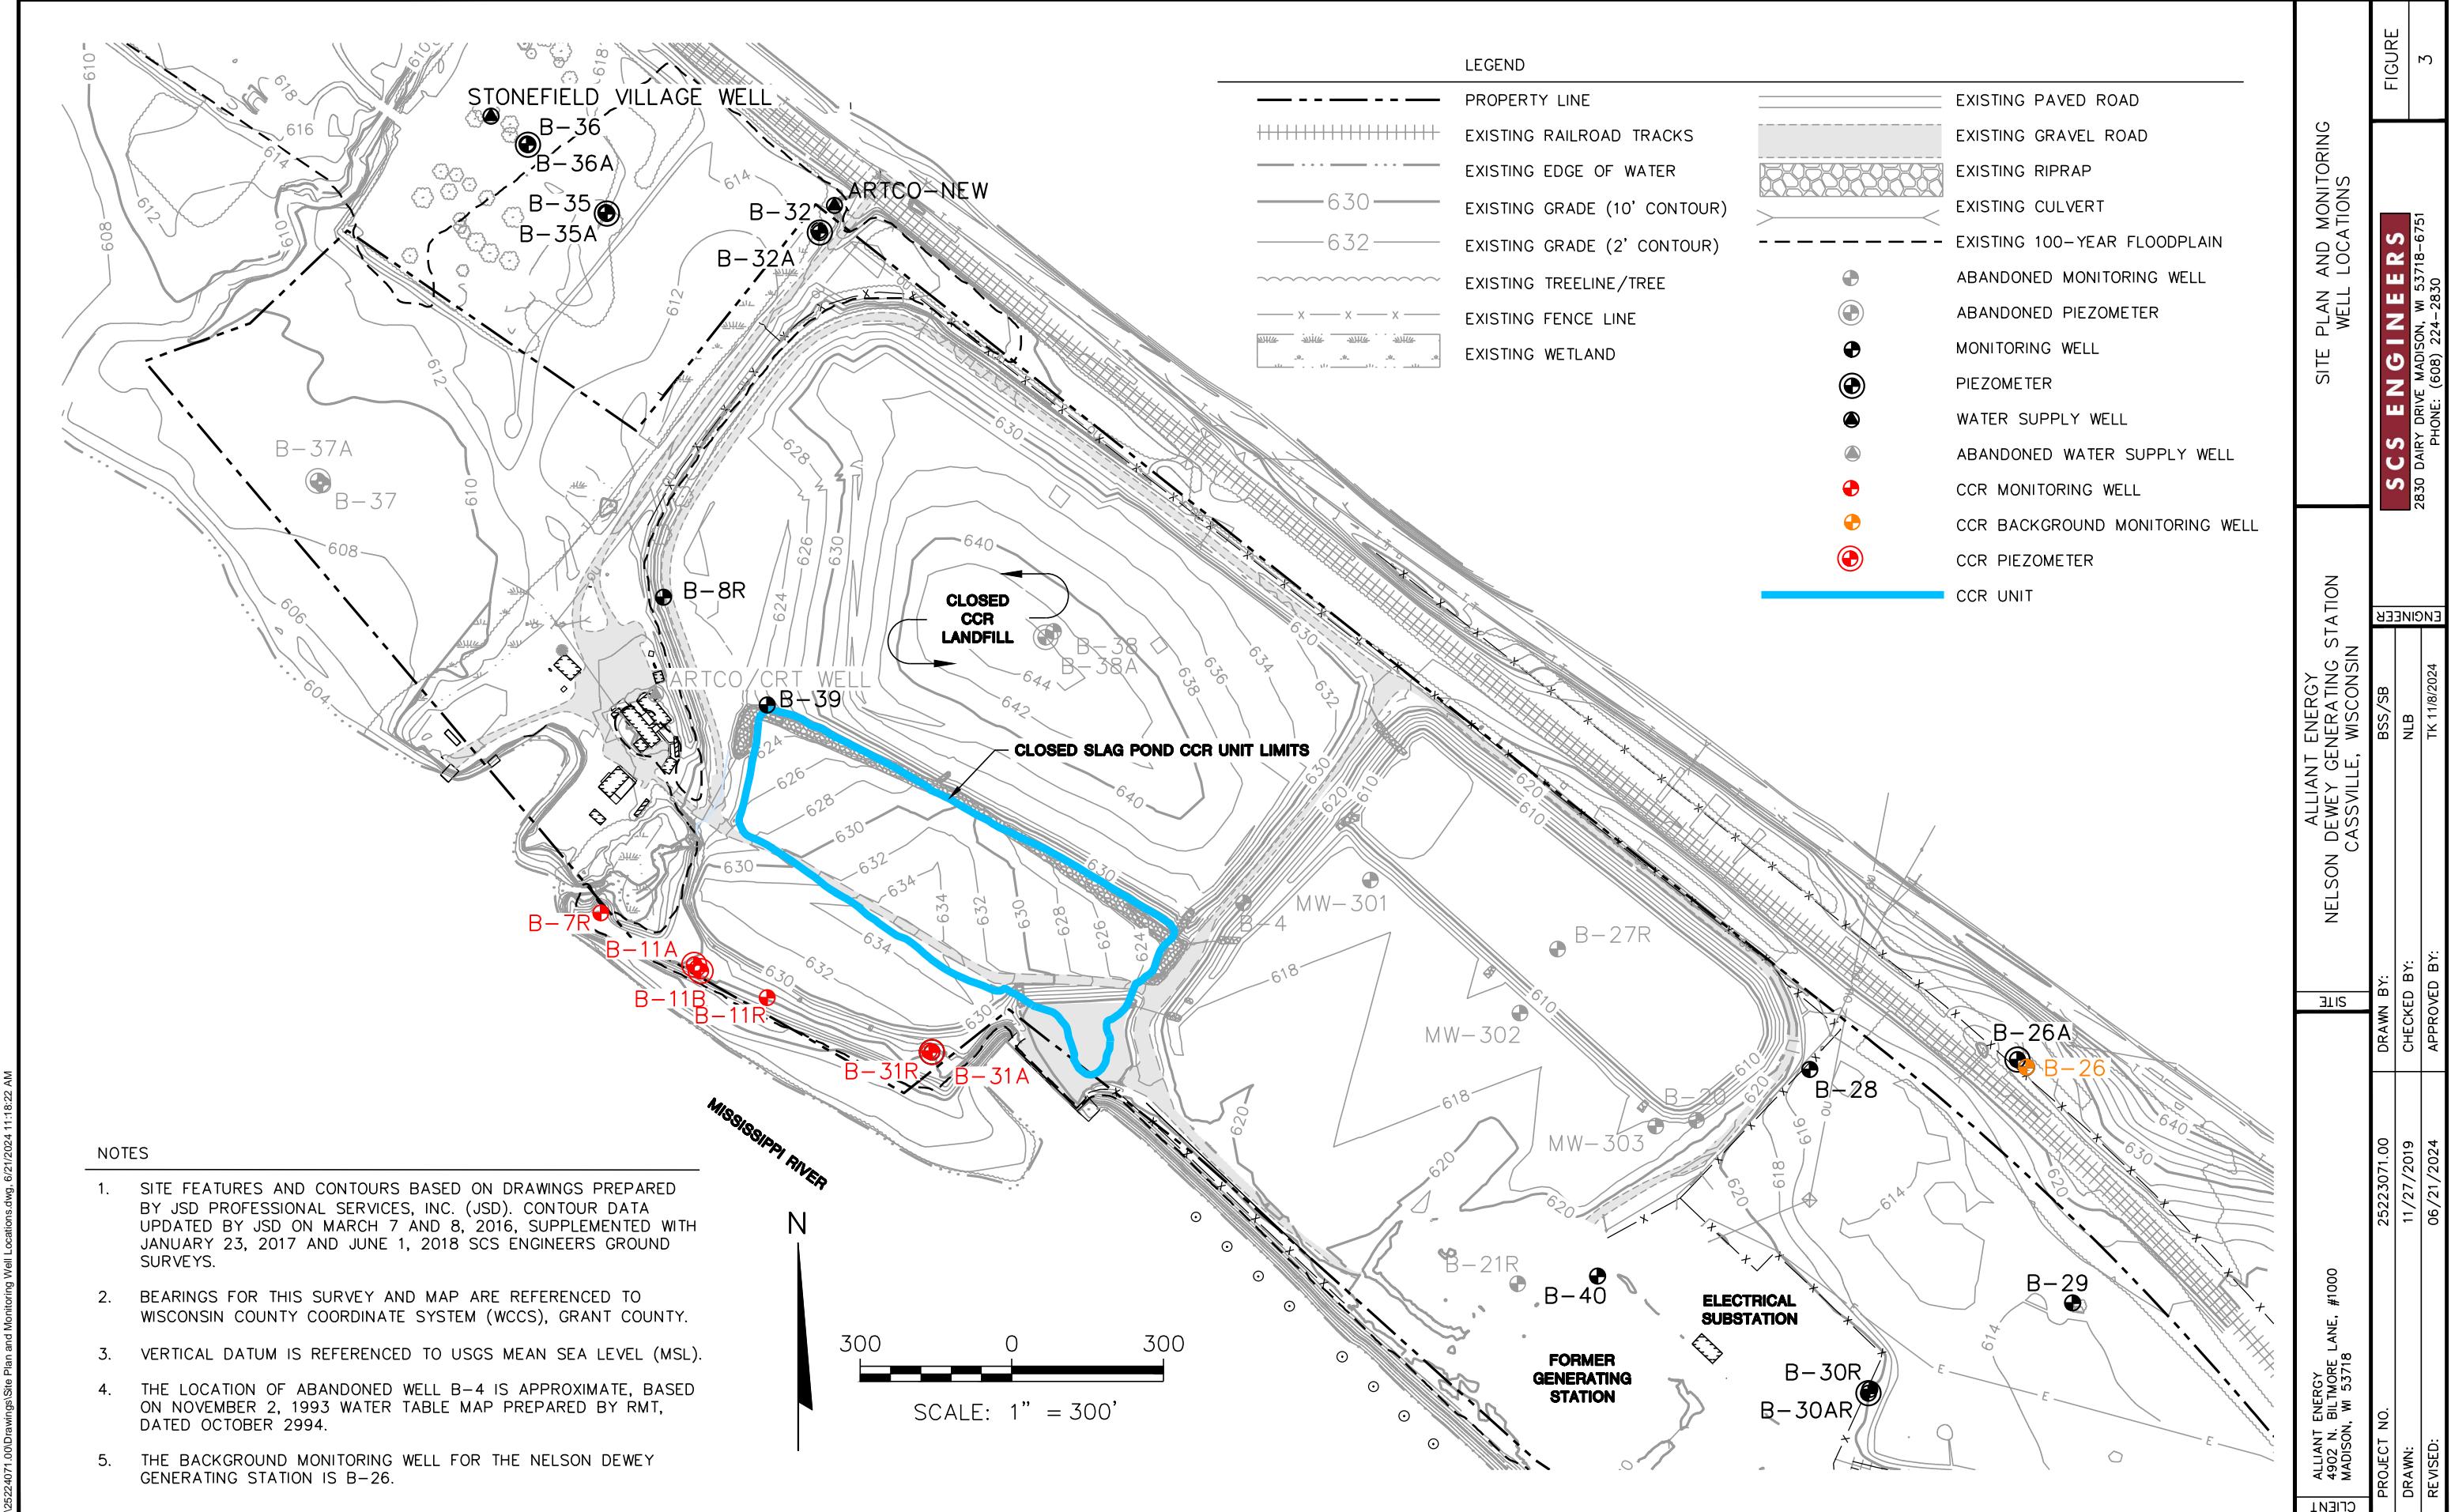

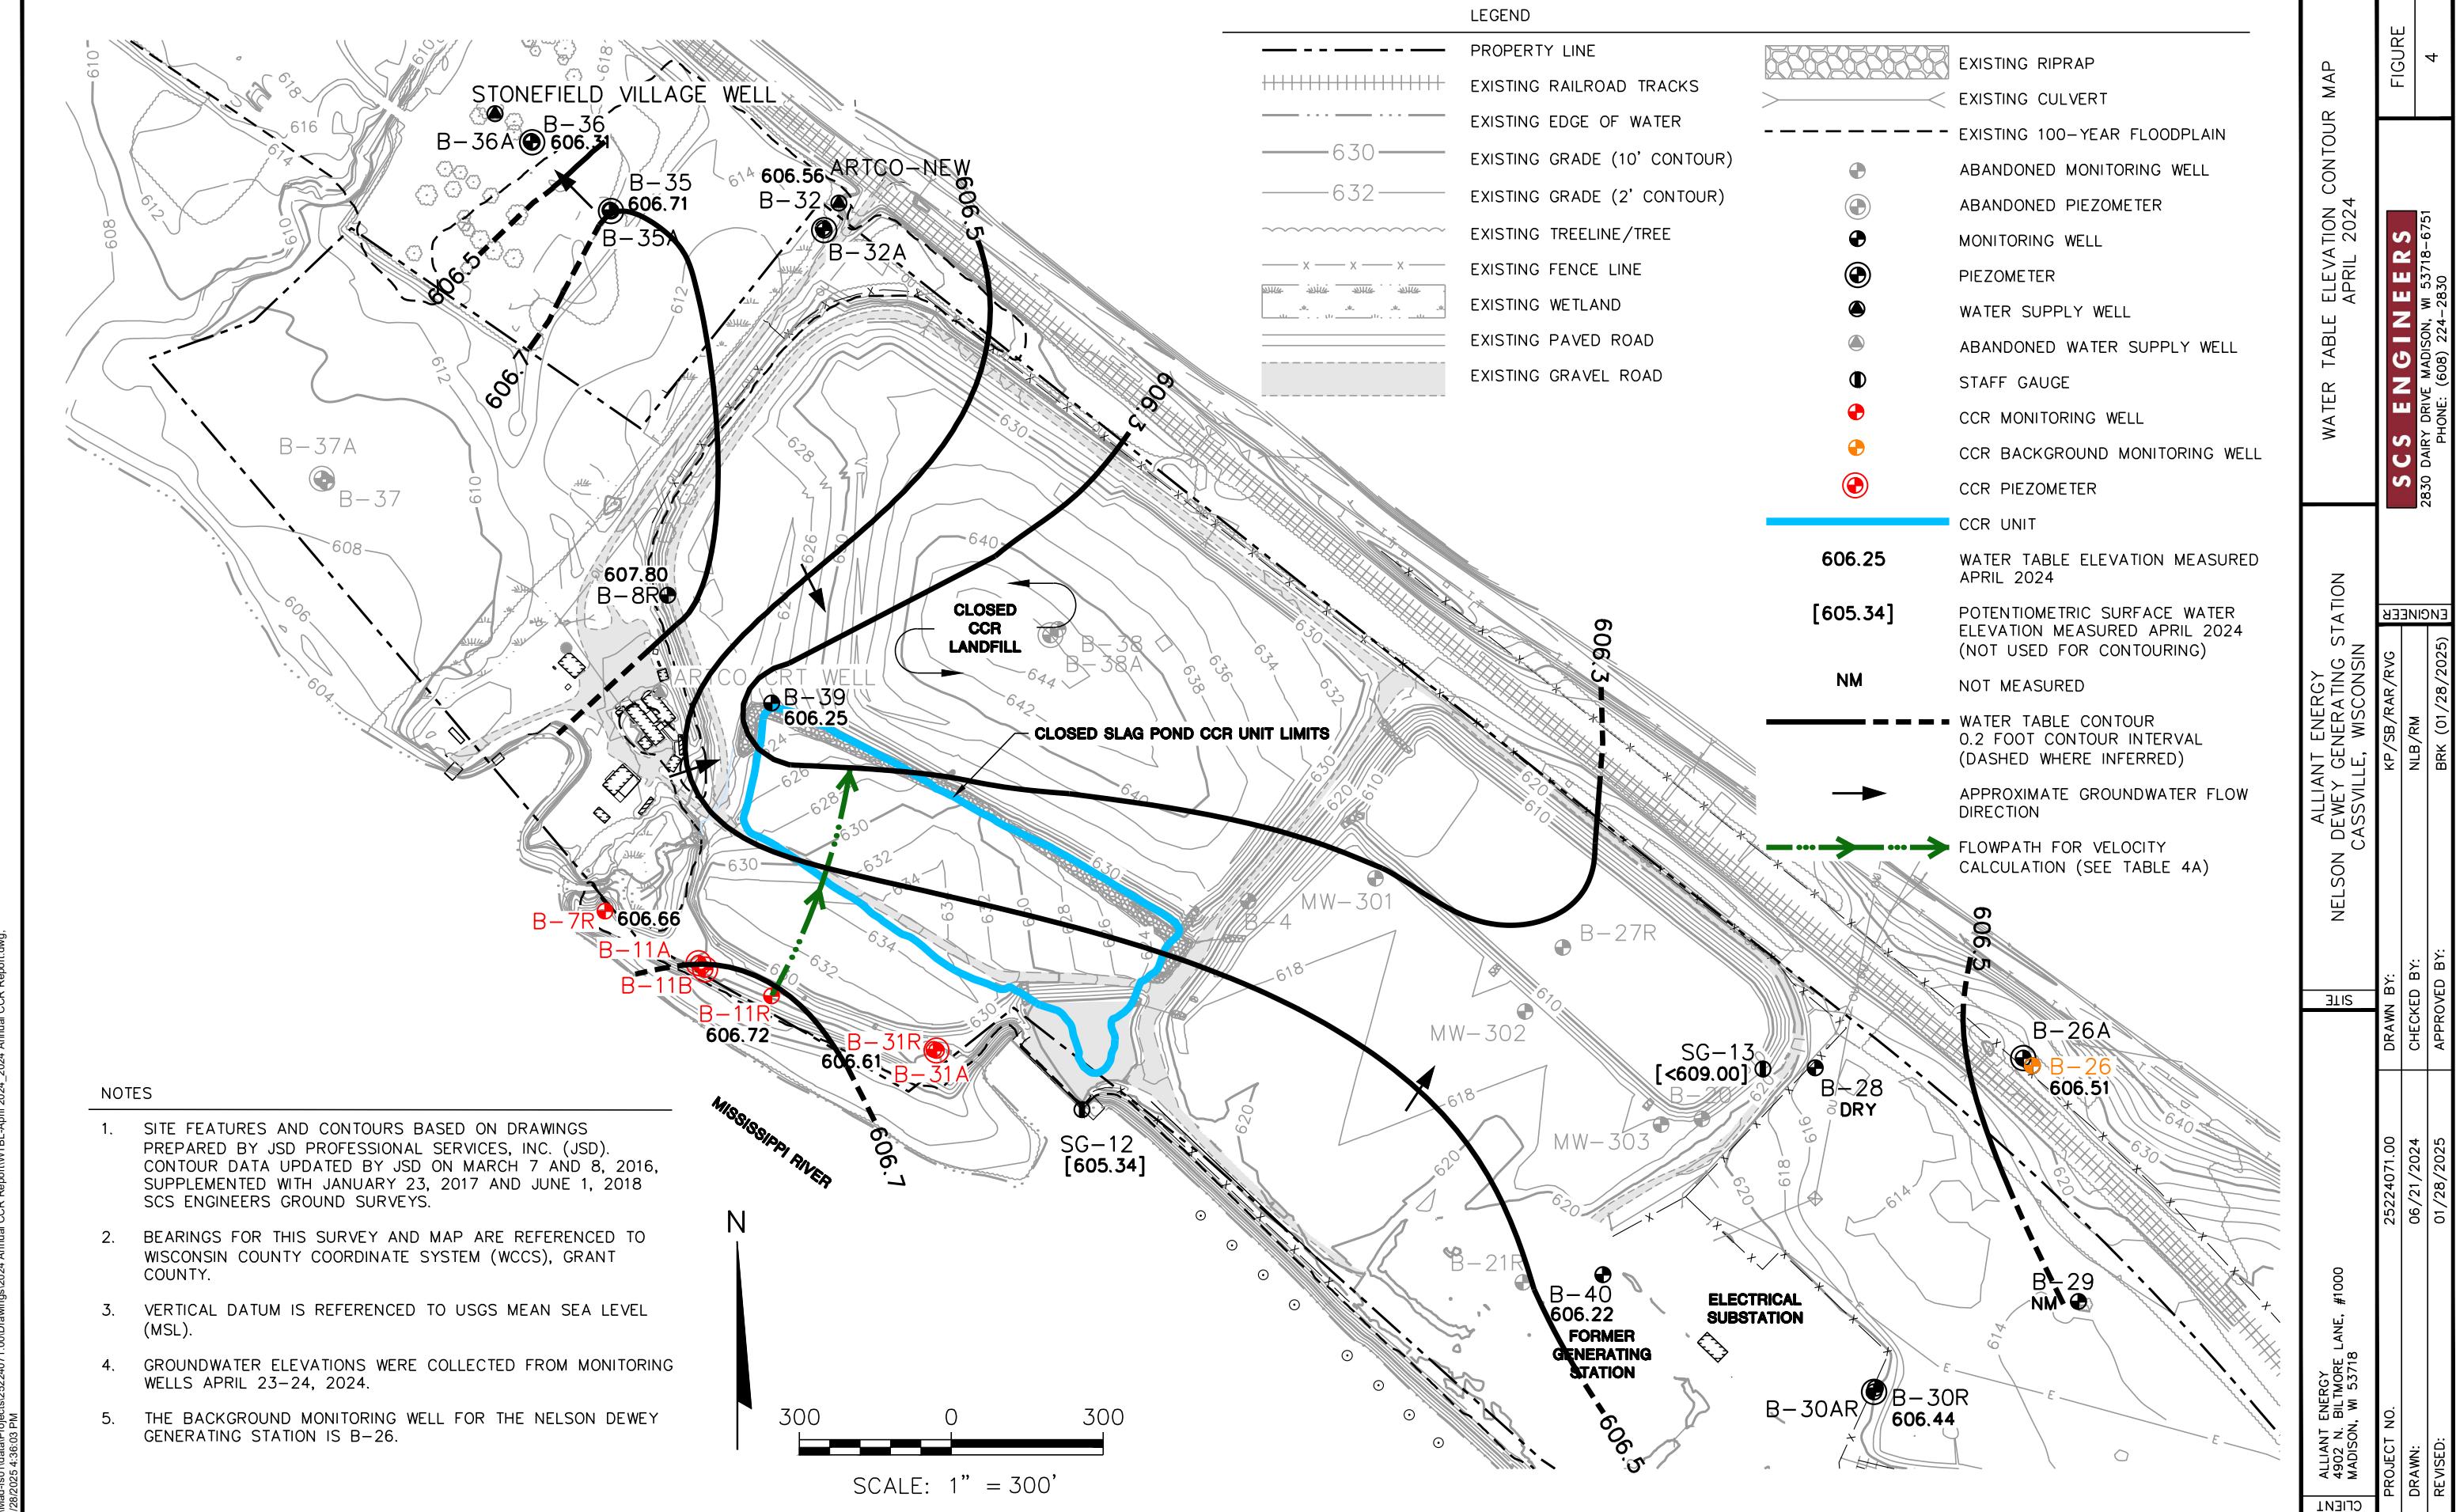

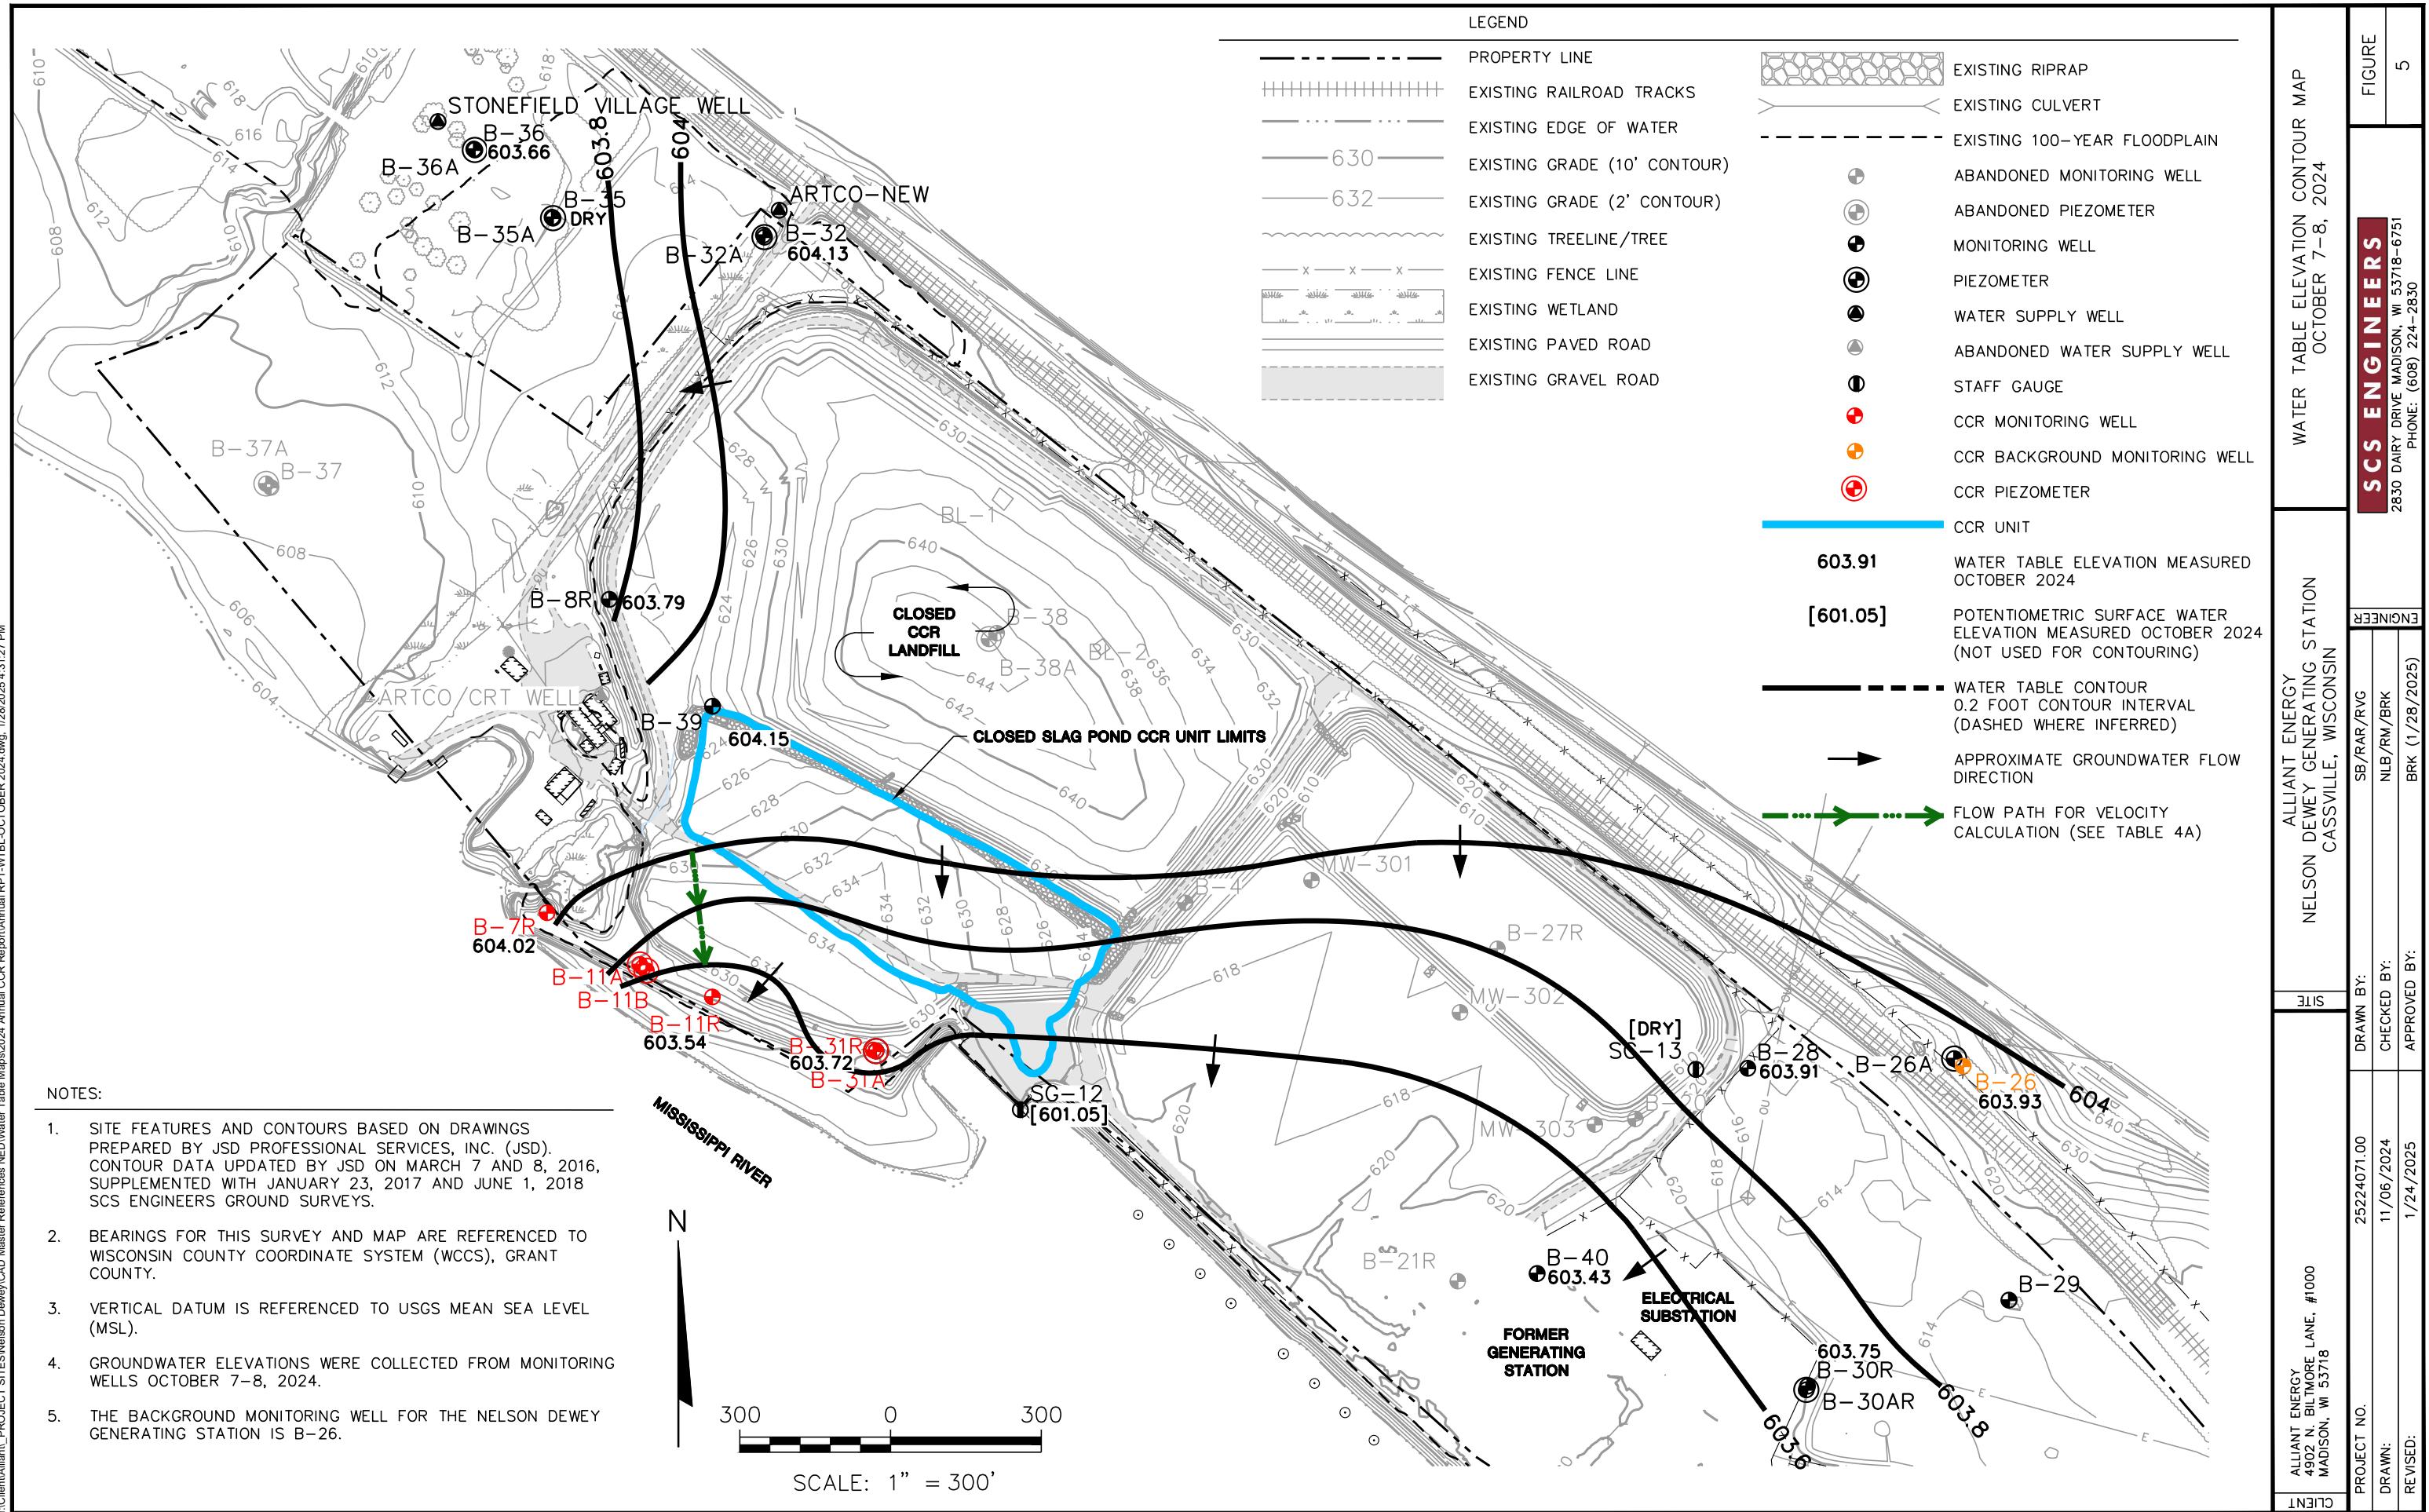**NOTES:**

1. SITE FEATURES AND CONTOURS BASED ON DRAWINGS PREPARED BY JSD PROFESSIONAL SERVICES, INC. (JSD). CONTOUR DATA UPDATED BY JSD ON MARCH 7 AND 8, 2016, SUPPLEMENTED WITH JANUARY 23, 2017 AND JUNE 1, 2018 SCS ENGINEERS GROUND SURVEYS.
2. BEARINGS FOR THIS SURVEY AND MAP ARE REFERENCED TO WISCONSIN COUNTY COORDINATE SYSTEM (WCCS), GRANT COUNTY.
3. VERTICAL DATUM IS REFERENCED TO USGS MEAN SEA LEVEL (MSL).
4. GROUNDWATER ELEVATIONS WERE COLLECTED FROM MONITORING WELLS OCTOBER 7-8, 2024.
5. THE BACKGROUND MONITORING WELL FOR THE NELSON DEWEY GENERATING STATION IS B-26.

SCALE: 1" = 300'

Appendix A

Summary of Regional Geologic and Hydrogeologic Information

Regional Glacial Geology

Alluvial

al Alluvium. Primarily sand or slightly gravelly sand on modern valley bottoms; most deposited during the last part of the Holocene; overlain by thin peat and thin silty overbank sediment in many places.

ato Alluvial sediment of the Elderon-phase terrace. Sand or gravelly sand, at least a few meters thick up to 15 m thick, deposited by streams carrying meltwater from the margins of the Laurentide Ice Sheet during the Elderon phase of the late Wisconsin glaciation. Occurs as terraces formed during subsequent down-cutting during the latest Wisconsin and Holocene.

ats Alluvial sediment of the Savanna terrace. Sand or gravelly sand, at least a few meters thick up to 15 m thick, deposited by streams carrying meltwater from the margins of the Laurentide Ice Sheet during the late Wisconsin glaciation. Occurs as the Savanna terrace formed during subsequent down-cutting during the latest Wisconsin and Holocene.

atb Alluvial sediment of the Bridgeport terrace. Sand or gravelly sand, at least a few meters thick up to 15 m thick, deposited by streams carrying meltwater from the margins of the Laurentide Ice Sheet during the late Wisconsin glaciation. Occurs as remnants of the Bridgeport terrace; the terrace surface is likely largely underlain by a bedrock strath.

af Alluvial fan. Moderately to well-sorted cobbles, gravel, pebbles, and fine sediment forming fan-shaped deposits on valley floors. Typically forms at the base of steep slopes and particularly at the mouths of steep tributaries.

Colluvial

cc Coarse-grained colluvium. Unsorted slope sediment, derived from erosion of Paleozoic bedrock and windblown silt from upland surfaces moving downslope due to gravity. Typically associated with bedrock incision by major streams, and occurring on relatively steep slopes adjacent to major stream systems and deposits.

ls Landslide. Poorly sorted gravel, boulder, and blocky debris. Forms chaotic, hummocky lobes on valley floors and at bases of slopes; may have associated scarps on adjacent upslope surfaces.

Windblown



lb Loess on Paleozoic bedrock. Windblown silt, more than 1.5 m thick; generally thickest in western areas (as much as 15 m) and thinning toward the east. Noncalcareous, unbedded, and massive; shows evidence of soil formation. Primarily composed of the Peoria, Roxana, and Loveland Members of the Keeler Formation. Roxana Member commonly contains abundant spruce fragments and charcoal. Although distribution is patchy and uncertain due to the thickness of the loess, heavily weathered residual clay of the Rountree Formation, derived from underlying Paleozoic bedrock, is common at the base.

lt Loess on till. Windblown silt, typically more than 5 m thick. Noncalcareous, unbedded, and massive, shows evidence of soil formation. Primarily composed of the Peoria, Roxana, and Loveland Members of the Keeler Formation. Roxana Member commonly contains abundant spruce fragments and charcoal. Deposited on patchy, discontinuous pre-Illinoian till; occurrence confined to western Grant County, which was the easternmost extent of pre-Illinoian ice flowing from Minnesota and Iowa.

ws Windblown sand. More than about 1.5 m thick; dunes generally no more than a few meters high.

Symbols

Geologic contact. Position shown on map is judged to be generally within 0.2 km of actual position. Dashed where approximate.

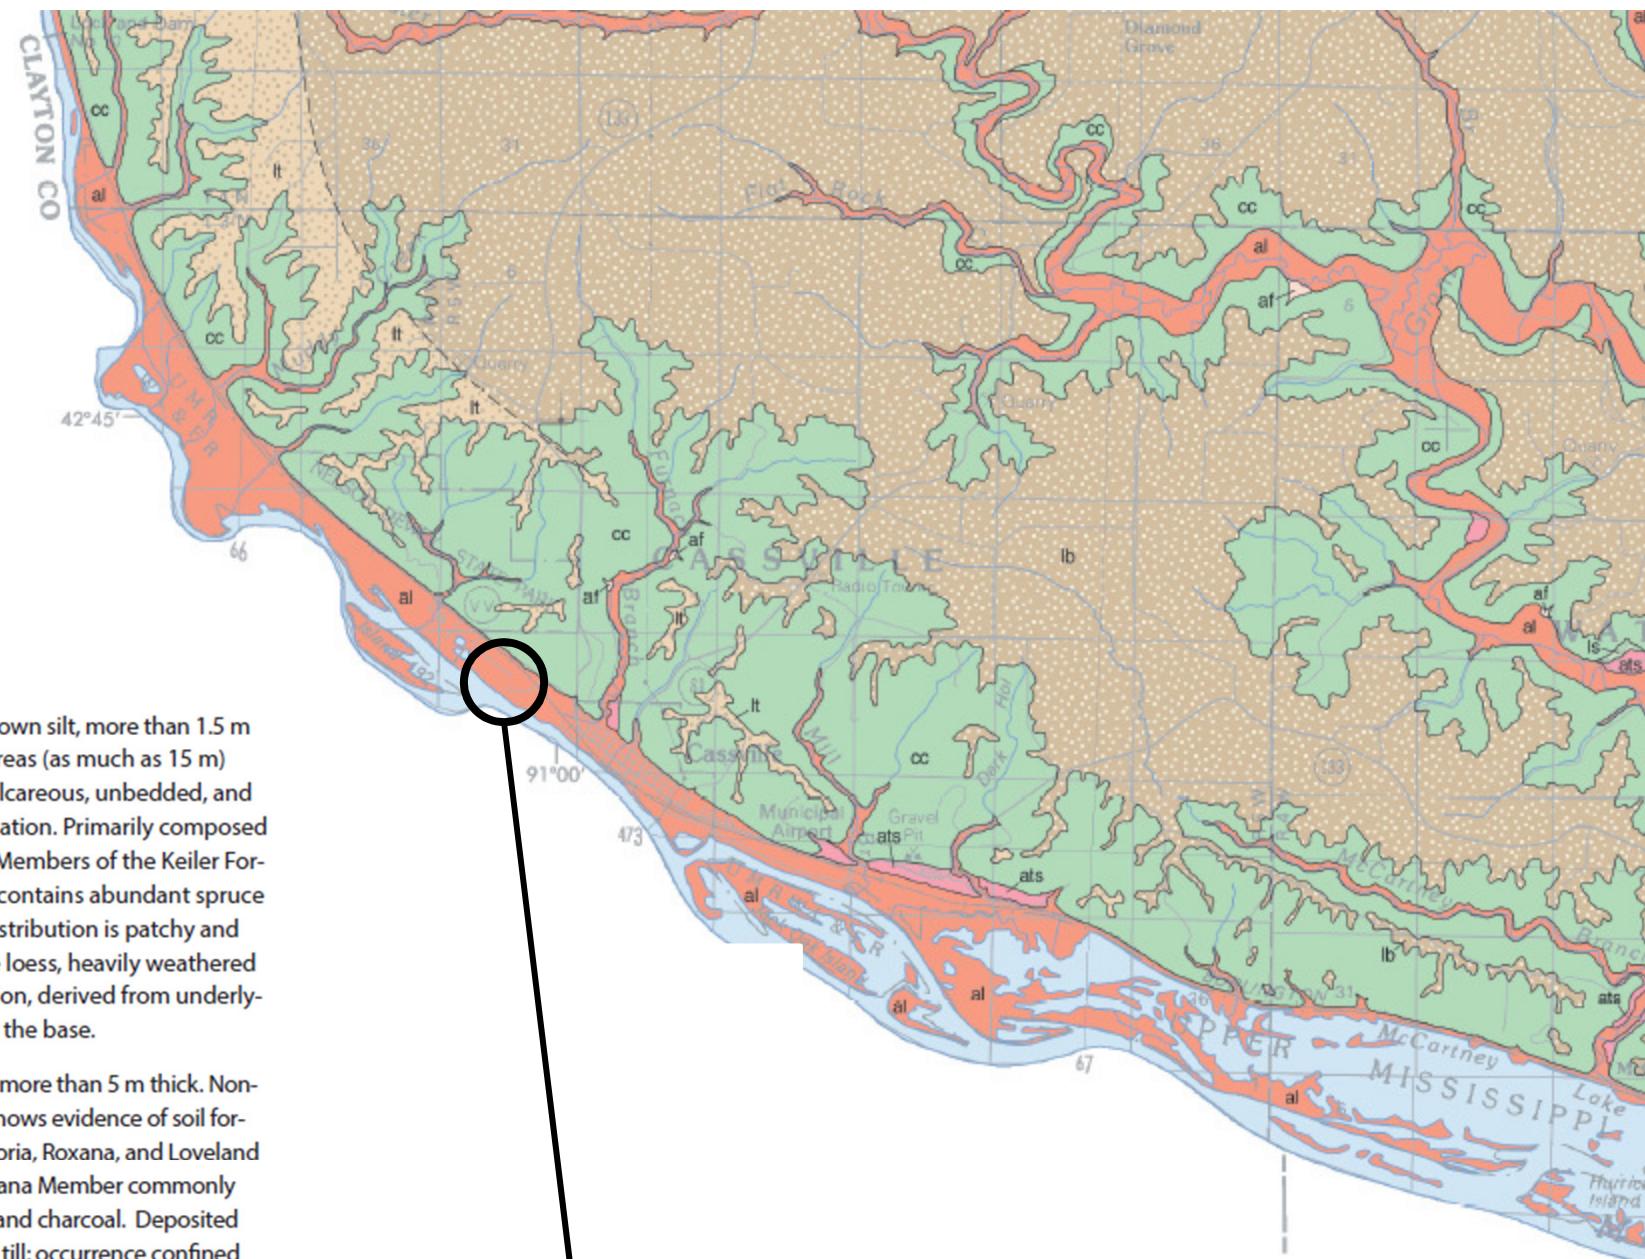


SCALE 1:100,000

1 0 1 2 3 4 5 MILES

1 0 1 2 3 4 5 6 7 8 KILOMETERS

Source: Carson, Eric C., Preliminary Quaternary Geology of Grant County, Wisconsin, Wisconsin Geological and Natural History Survey Open File Report 2012-06.

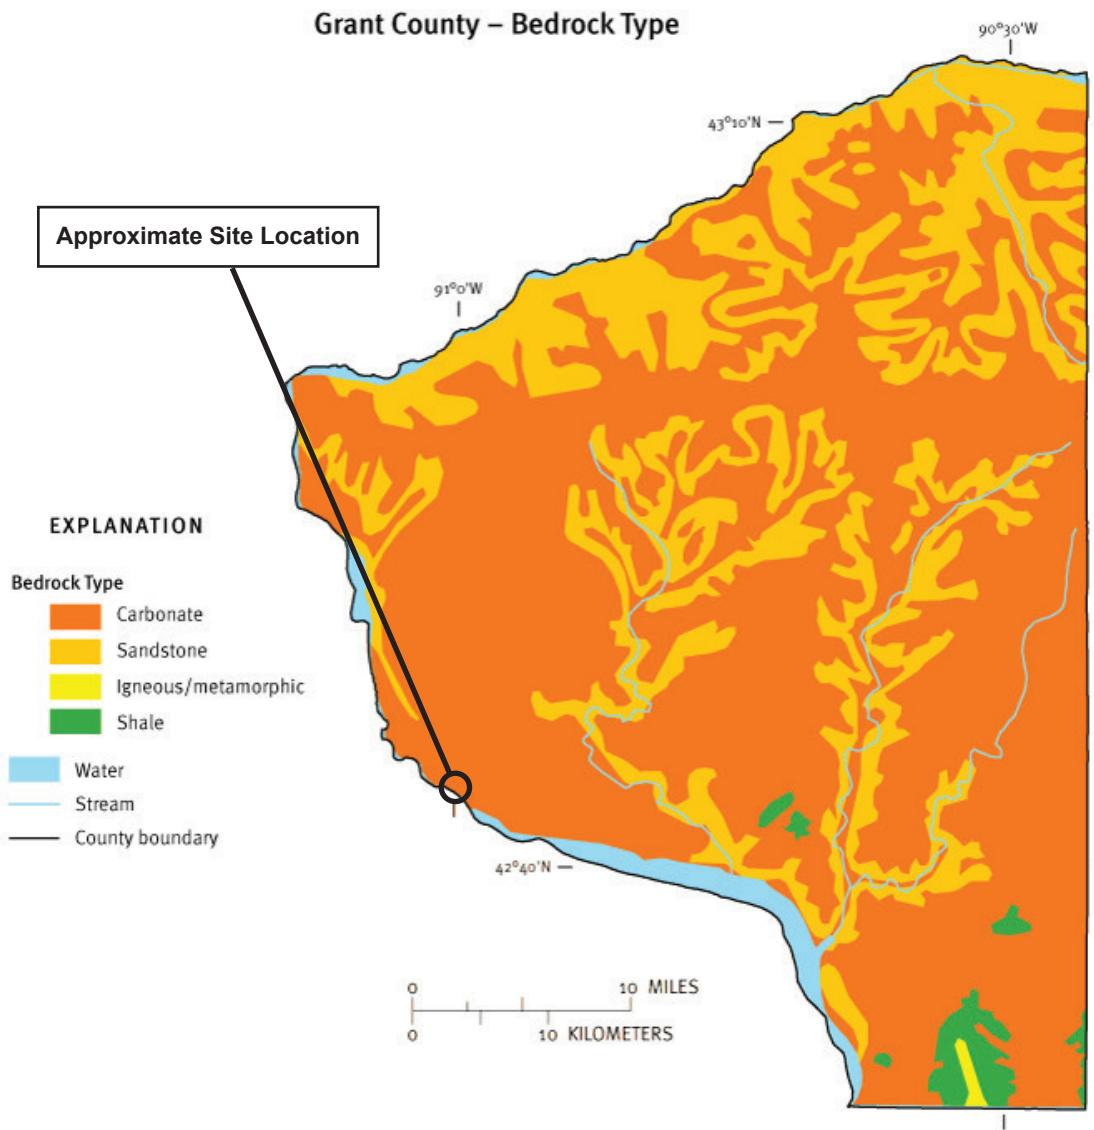


This resource characteristic map was derived from generalized statewide information at small scales, and cannot be used for any site-specific purposes.

Map source: Schmidt, R.R., 1987, Groundwater contamination susceptibility map and evaluation: Wisconsin Department of Natural Resources, Wisconsin's Groundwater Management Plan Report 5, PUBL-WR-177-87, 27 p.

Figure created for the "Protecting Wisconsin's Groundwater Through Comprehensive Planning" web site, 2007,
<http://wi.water.usgs.gov/gwcomp/>

When bedrock is less than 50 feet from the land surface and the water table occurs in the bedrock, the type of bedrock is important in determining how easily a contaminant can reach the groundwater. Bedrock types that allow water to pass quickly through them will offer less protection from contaminants. In Wisconsin, these types of bedrock are typically limestone and dolomite which are highly fractured. Igneous and metamorphic rocks (e.g. granite) and sandstone are less fractured and offer some protection from infiltrating water which may contain contaminants. On the other hand, shale bedrock is almost impermeable, and doesn't allow water and accompanying contaminants to pass through it as easily. The bedrock categories used for this project are carbonates, sandstone, igneous/metamorphic/volcanic, and shale.

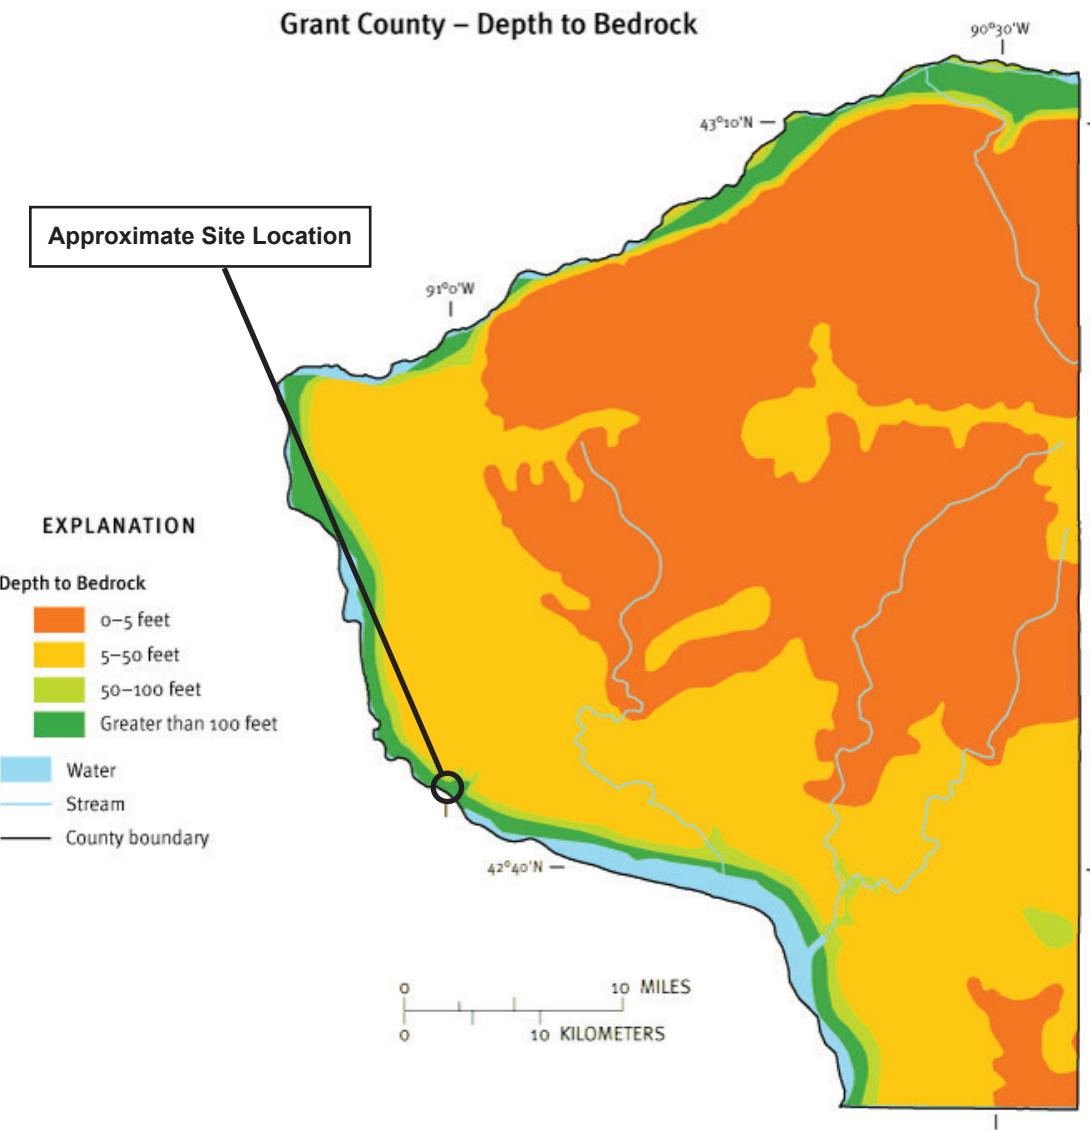

This resource characteristic map was derived from generalized statewide information at small scales, and cannot be used for any site-specific purposes.

Map source: Schmidt, R.R., 1987, Groundwater contamination susceptibility map and evaluation: Wisconsin Department of Natural Resources, Wisconsin's Groundwater Management Plan Report 5, PUBL-WR-177-87, 27 p.

Figure created for the "Protecting Wisconsin's Groundwater Through Comprehensive Planning" web site, 2007,
<http://wi.water.usgs.gov/gwcomp/>

The depth to bedrock indicates the amount of soil and surficial deposits that exist in an area and, therefore how important the type of bedrock is in evaluating pollution potential. Information on the depth to bedrock map is used to determine the relative weight given to the other resource characteristic maps. For example, where the bedrock surface is deep and the water table occurs above the bedrock, the type of bedrock is not considered in determining groundwater contamination susceptibility. Where the depth to bedrock is shallow (less than 50 feet below the land surface), the water table is likely to occur in the bedrock. In that case, the type of bedrock is considered because it could influence a contaminant's ability to reach the groundwater. This map identifies areas where the depth to bedrock is 0-5 feet (in at least 35% of the area), 5-50 feet, 50-100 feet and greater than 100 feet.

Appendix B

Boring Logs, Well Construction, and Well Development Forms


State of Wisconsin
Department of Natural Resources

Route to: Watershed/Wastewater Waste Management
Remediation/Redevelopment Other

MONITORING WELL CONSTRUCTION
Form 4400-113A Rev. 7-98

Facility/Project Name WPL- Nelson Dewey Generating St.		Local Grid Location of Well 479422.6 ft. N. S. 737324.8 ft. E. W.	Well Name B-39
Facility License, Permit or Monitoring No.		Local Grid Origin <input type="checkbox"/> (estimated: <input type="checkbox"/> or Well Location <input type="checkbox"/> Lat. <input type="checkbox"/> Long. <input type="checkbox"/> or	Wis. Unique Well No. <input type="checkbox"/> DNR Well ID No. <input type="checkbox"/>
Facility ID		St. Plane <input type="checkbox"/> ft. N. <input type="checkbox"/> ft. E. S/C/N	Date Well Installed 10 / 20 / 2015 m m d d y y y y
Type of Well Well Code 11 / MW		Section Location of Waste/Source SE 1/4 of NW 1/4 of Sec. 19, T. 3 N, R. 5 E	Well Installed By: Name (first, last) and Firm Dave Cruise- Badger State Drilling Kyle Kramer- SCS Engineers
Distance from Waste/ Source <input type="checkbox"/> ft.	Enf. Stds. Apply <input type="checkbox"/>	Location of Well Relative to Waste/Source u <input type="checkbox"/> Upgradient s <input type="checkbox"/> Sidegradient d <input type="checkbox"/> Downgradient n <input type="checkbox"/> Not Known	Gov. Lot Number
<p>A. Protective pipe, top elevation <input type="checkbox"/> 626 . 65 ft. MSL</p> <p>B. Well casing, top elevation <input type="checkbox"/> 626 . 48 ft. MSL</p> <p>C. Land surface elevation <input type="checkbox"/> 623 . 58 ft. MSL</p> <p>D. Surface seal, bottom <input type="checkbox"/> 623 . 08 ft. MSL or <input type="checkbox"/> 0.5 ft.</p> <p>12. USCS classification of soil near screen: <input checked="" type="checkbox"/> GP <input type="checkbox"/> GM <input type="checkbox"/> GC <input type="checkbox"/> GW <input type="checkbox"/> SW <input type="checkbox"/> SP <input checked="" type="checkbox"/> S <input type="checkbox"/> SM <input type="checkbox"/> SC <input type="checkbox"/> ML <input type="checkbox"/> MH <input type="checkbox"/> CL <input type="checkbox"/> CH <input type="checkbox"/> Bedrock <input type="checkbox"/></p> <p>13. Sieve analysis performed? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No</p> <p>14. Drilling method used: Rotary <input type="checkbox"/> 50 Hollow Stem Auger <input checked="" type="checkbox"/> 41 Other <input type="checkbox"/></p> <p>15. Drilling fluid used: Water <input type="checkbox"/> 0 2 Air <input type="checkbox"/> 0 1 Drilling Mud <input type="checkbox"/> 0 3 None <input checked="" type="checkbox"/> 9 9</p> <p>16. Drilling additives used? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No Describe _____</p> <p>17. Source of water (attach analysis, if required): _____ _____ _____</p>			
E. Bentonite seal, top <input type="checkbox"/> 623 . 08 ft. MSL or <input type="checkbox"/> 0.5 ft.	F. Fine sand, top <input type="checkbox"/> 613.58 ft. MSL or <input type="checkbox"/> 10 ft.	G. Filter pack, top <input type="checkbox"/> 611.58 ft. MSL or <input type="checkbox"/> 12 ft.	1. Cap and lock? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No
H. Screen joint, top <input type="checkbox"/> 609.58 ft. MSL or <input type="checkbox"/> 14 ft.	I. Well bottom <input type="checkbox"/> 599.58 ft. MSL or <input type="checkbox"/> 24 ft.	J. Filter pack, bottom <input type="checkbox"/> 596.58 ft. MSL or <input type="checkbox"/> 27 ft.	2. Protective cover pipe: a. Inside diameter: <input type="checkbox"/> 6 in. b. Length: <input type="checkbox"/> 4 ft. c. Material: Steel <input checked="" type="checkbox"/> 0 4 Other <input type="checkbox"/> <input type="checkbox"/> Yes <input type="checkbox"/> No
K. Borehole, bottom <input type="checkbox"/> 596.58 ft. MSL or <input type="checkbox"/> 27 ft.	L. Borehole, diameter <input type="checkbox"/> 8.5 in.	M. O.D. well casing <input type="checkbox"/> 2.4 in.	3. Surface seal: Bentonite <input checked="" type="checkbox"/> 3 0 Concrete <input type="checkbox"/> 0 1 Other <input type="checkbox"/> Bentonite _____
N. I.D. well casing <input type="checkbox"/> 2.04 in.			4. Material between well casing and protective pipe: Bentonite <input type="checkbox"/> 3 0 #5 Filter Sand - Ohio <input type="checkbox"/> Other <input type="checkbox"/> <input type="checkbox"/>
			5. Annular space seal: a. Granular/Chipped Bentonite <input checked="" type="checkbox"/> 3 3 b. _____ Lbs/gal mud weight ... Bentonite-sand slurry <input type="checkbox"/> 3 5 c. _____ Lbs/gal mud weight Bentonite slurry <input type="checkbox"/> 3 1 d. _____ % Bentonite Bentonite-cement grout <input type="checkbox"/> 5 0 e. _____ ft ³ volume added for any of the above f. How installed: Tremie <input type="checkbox"/> 0 1 Tremie pumped <input type="checkbox"/> 0 2 Gravity <input checked="" type="checkbox"/> 0 8 Other <input type="checkbox"/>
			6. Bentonite seal: a. Bentonite granules <input type="checkbox"/> 3 3 b. <input type="checkbox"/> /4 in. <input checked="" type="checkbox"/> 3/8 in. <input type="checkbox"/> 1/2 in. Bentonite chips <input checked="" type="checkbox"/> 3 2 c. _____
			7. Fine sand material: Manufacturer, product name & mesh size a. #7 Fine Sand - Ohio <input type="checkbox"/> b. Volume added _____ ft ³
			8. Filter pack material: Manufacturer, product name & mesh size a. #5 Filter Sand - Ohio <input type="checkbox"/> b. Volume added _____ ft ³
			9. Well casing: Flush threaded PVC schedule 40 <input checked="" type="checkbox"/> 2 3 Flush threaded PVC schedule 80 <input type="checkbox"/> 2 4 Other <input type="checkbox"/>
			10. Screen material: 40 PVC a. Screen type: Factory cut <input checked="" type="checkbox"/> 1 1 Continuous slot <input type="checkbox"/> 0 1 Other <input type="checkbox"/> b. Manufacturer Monoflex <input type="checkbox"/> c. Slot size: 0 . 10 in. d. Slotted length: 10 ft.
			11. Backfill material (below filter pack): #5 Coarse - Ohio <input type="checkbox"/> None <input type="checkbox"/> 1 4 Other <input type="checkbox"/>

I hereby certify that the information on this form is true and correct to the best of my knowledge.

Signature 



Firm

SCS ENGINEERS, 2830 Dairy Drive, Madison, WI 53718-6751


Please complete both Forms 4400-113A and 4400-113B and return them to the appropriate DNR office and bureau. Completion of these reports is required by chs. 160, 281, 283, 289, 291, 292, 293, 295, and 299, Wis. Stats., and ch. NR 141, Wis. Adm. Code. In accordance with chs. 281, 289, 291, 292, 293, 295, and 299, Wis. Stats., failure to file these forms may result in a forfeiture of between \$10 and \$25,000, or imprisonment for up to one year, depending on the program and conduct involved. Personally identifiable information on these forms is not intended to be used for any other purpose. NOTE: See the instructions for more information, including where the completed forms should be sent.

Route To: Watershed/Wastewater Waste Management
Remediation/Redevelopment Other

Page 1 of 2

Facility/Project Name WPL- Nelson Dewey Generating Station SCS#: 25215135.30			License/Permit/Monitoring Number		Boring Number B-39								
Boring Drilled By: Name of crew chief (first, last) and Firm Dave Cruise Badger State Drilling			Date Drilling Started 10/20/2015	Date Drilling Completed 10/20/2015	Drilling Method hollow stem auger								
WI Unique Well No.	DNR Well ID No.	Common Well Name	Final Static Water Level Feet	Surface Elevation 623.58 Feet	Borehole Diameter 8.5 in.								
Local Grid Origin <input type="checkbox"/> (estimated: <input type="checkbox"/>) or Boring Location <input type="checkbox"/> State Plane 479,423 N, 737,325 E S/C/N NW 1/4 of NW 1/4 of Section 19, T 3 N, R 5 W			Lat <input type="checkbox"/> ° <input type="checkbox"/> ' <input type="checkbox"/> "	Long <input type="checkbox"/> ° <input type="checkbox"/> ' <input type="checkbox"/> "	Local Grid Location <input type="checkbox"/> N <input type="checkbox"/> E Feet <input type="checkbox"/> S <input type="checkbox"/> W								
Facility ID		County Grant	County Code 22	Civil Town/City/ or Village Cassville									
Number and Type Sample	Length Att. & Recovered (in)	Blow Counts	Depth In Feet	Soil Properties				RQD/ Comments					
				U S C S	Graphic Log	Well Diagram	PID/FID		Pocket Penetration (tsf)	Moisture Content	Liquid Limit	Plasticity Index	P 200
S1	20	20 25 29 33	1 2 3 4 5 6 7 8 9 10 11 12 13 14 15	TOPSOIL, with medium grained sand, light brown. POORLY GRADED SLAG, coarse grained, very dark brown (10YR 2/2), fly ash.	TOPSOIL FILL			M					
S2	21	14 32 44 31	1 2 3 4 5 6 7 8 9 10 11 12 13 14 15	POORLY GRADED SAND, fine grained, dark gray (10YR4/1).	SP			M					
S3	10	12 10 15 8	1 2 3 4 5 6 7 8 9 10 11 12 13 14 15	POORLY GRADED SAND, fine grained, dark gray (10YR4/1).				M					
S4	18	3 4 4 4	1 2 3 4 5 6 7 8 9 10 11 12 13 14 15					M					

I hereby certify that the information on this form is true and correct to the best of my knowledge.

Signature  Firm **SCS Engineers**
2830 Dairy Drive Madison, WI 53711 Tel: (608) 224-2830
Fax:

This form is authorized by Chapters 281, 283, 289, 291, 292, 293, 295, and 299, Wis. Stats. Completion of this form is mandatory. Failure to file this form may result in forfeiture of between \$10 and \$25,000, or imprisonment for up to one year, depending on the program and conduct involved. Personally identifiable information on this form is not intended to be used for any other purpose. NOTE: See instructions for more information, including where the completed form should be sent.

Boring Number

B-39

Use only as an attachment to Form 4400-122.

Page 2 of 2

Sample Number and Type	Length Att. & Recovered (in)	Blow Counts	Depth In Feet	Soil/Rock Description And Geologic Origin For Each Major Unit	U S C S	Graphic Log	Well Diagram	PID/FID	Soil Properties				RQD/ Comments
									Pocket Penetration (tsf)	Moisture Content	Liquid Limit	Plasticity Index	
S5	15	4 5 5 6	15 16	POORLY GRADED SAND, fine grained, dark gray (10YR 4/1).						M			
S6	16	3 4 4 6	16 17 18	POORLY GRADED GRAVEL WITH SAND, pebble size gravel, dark gray (10YR 4/1).	SP					S			Saturation @ 16.5ft bgs
S7	22	4 6 8 11	19 20 21	POORLY GRADED SAND, coarse grained, dark gray (10YR 4/1).	GP					S			
S8	14	7 4 4 5	22 23							S			
S9	6	4 7 8 10	24 25		SP					S			
S10	14	4 3 4 21	26 27	Trace pebbles EOB @ 27' bgs.						S			

Route To: Watershed/Wastewater Waste Management
Remediation/Redevelopment Other

Page 1 of 2

Facility/Project Name WPL - Nelson Dewey Generating Station			License/Permit/Monitoring Number 02525			Boring Number B-07R					
Boring Drilled By: Name of crew chief (first, last) and Firm Wes Imhoff Layne Christensen, Co.			Date Drilling Started 4/28/2009		Date Drilling Completed 4/28/2009		Drilling Method Rotosonic				
WI Unique Well No. VU600	DNR Well ID No. 156	Common Well Name B-07R	Final Static Water Level Feet MSL	Surface Elevation 620.5 Feet MSL		Borehole Diameter 6.0 inches					
Local Grid Origin <input type="checkbox"/> (estimated: <input type="checkbox"/>) or Boring Location <input checked="" type="checkbox"/>			Lat ° ' "			Local Grid Location					
State Plane 265,999 N, 1,695,529 E S/C/N			Long ° ' "			N <input type="checkbox"/> E <input type="checkbox"/>					
NW 1/4 of NW 1/4 of Section 19, T 3 N, R 5 W						Feet <input type="checkbox"/> S <input type="checkbox"/> W <input type="checkbox"/>					
Facility ID 122014530		County Grant	County Code 22	Civil Town/City/ or Village Cassville							
Number and Type	Length Att. & Recovered (in)	Blow Counts	Depth In Feet	Soil/Rock Description And Geologic Origin For Each Major Unit		Soil Properties				RQD/Comments	
				U S C S	Graphic Log Well Diagram	PID/FID	Compressive Strength	Moisture Content	Liquid Limit		Plasticity Index
1 CS	60 42		1 2 3 4 5 6 7 8 9 10 11 12	WELL GRADED SAND WITH SILT (SW-SM), non-plastic, 5YR 4/4 reddish brown, no odor, moist, some siltier layers at 4.5 feet.							
2 CS	60 48		1 2 3 4 5 6 7 8 9 10 11 12	Same as above.		SW-SM					
3 CS	60 60		1 2 3 4 5 6 7 8 9 10 11 12	Silty organic sand layer from 9 to 9.5 feet.							
				Same as above, color change to 7.5YR 4/1 dark gray, moist to wet above clay.							

WDNR_SBL_98 03026W.GRD WI.DNR8.GDT 8/27/09

I hereby certify that the information on this form is true and correct to the best of my knowledge.

Signature  Firm **RMT, Inc.** Tel: 608-831-4444
744 Heartland Trail Madison, WI 53717 Fax: 608-831-3334

This form is authorized by Chapters 281, 283, 289, 291, 292, 293, 295, and 299, Wis. Stats. Completion of this form is mandatory. Failure to file this form may result in forfeiture of between \$10 and \$25,000, or imprisonment for up to one year, depending on the program and conduct involved. Personally identifiable information on this form is not intended to be used for any other purpose. NOTE: See instructions for more information, including where the completed form should be sent.

Boring Number		B-07R		Use only as an attachment to Form 4400-122.			Page 2 of 2							
Number and Type	Sample	Blow Counts	Depth In Feet	Soil/Rock Description And Geologic Origin For Each Major Unit			U S C S	Graphic Log	Well Diagram	Soil Properties				RQD/Comments
Length Att. & Recovered (in)							PID/FID			Compressive Strength	Moisture Content	Liquid Limit	Plasticity Index	P 200
4 CS	60	60	13				SW-SM							
			14	LEAN CLAY WITH SAND (CL) , fine sand, plastic, 7.5YR 3/1 very dark gray, no odor, wet.			CL							
			15	WELL GRADED SAND WITH SILT AND CLAY (SW-SM) , trace gravel, very low plasticity, 5YR 4/3 reddish brown, no odor, wet.			SW-SM							
			16											
			17											
			18											
			19											
			20	End of boring at 20.0 feet.										

Route To:

Watershed/Wastewater Remediation/Redevelopment

Waste Management Other

MONITORING WELL CONSTRUCTION
Form 4400-113A Rev. 7-98

Facility/Project Name

WPL - Nelson Dewey Generating Station

Facility License, Permit or Monitoring No.

02525

Facility ID

122014530

Type of Well

Well Code 11/mw

Distance from Waste/

Source

350 ft.

Enf. Stds.
Apply

Local Grid Location of Well

ft. N. S. ft. E. W.

Well Name

B-07R

Local Grid Origin (estimated:) or Well Location

Lat. \circ ' " Long. \circ ' " or

St. Plane 265,999 ft N., 1,695,529 ft. E. S/C/N

Section Location of Waste/Source

NW 1/4 of NW 1/4 of Sec. 19, T. 3 N. R. 5 E

Location of Well Relative to Waste/Source

u Upgradient s Sidegradient

d Downgradient n Not Known

Wis. Unique Well No.

VU600

156

Date Well Installed

04/28/2009

Well Installed By: (Person's Name and Firm)

Wes Imhoff

Layne Christensen, Co.

A. Protective pipe, top elevation

623.50 ft. MSL

Cap and lock? Yes No

B. Well casing, top elevation

623.35 ft. MSL

2. Protective cover pipe:

a. Inside diameter: 4.0 in.

b. Length: 5.0 ft.

c. Material: Steel 0.4
Other

C. Land surface elevation

620.5 ft. MSL

d. Additional protection? Yes No

If yes, describe: _____

D. Surface seal, bottom

618.5 ft. MSL or 2.0 ft.

3. Surface seal: Bentonite 3.0
Concrete 0.1
Other

4. Material between well casing and protective pipe: Bentonite 3.0
Upper Filter Sand/Lower Bentonite Other

5. Annular space seal: a. Granular/Chipped Bentonite 3.3
b. _____ Lbs/gal mud weight ... Bentonite-sand slurry 3.5
c. _____ Lbs/gal mud weight ... Bentonite slurry 3.1
d. _____ % Bentonite ... Bentonite-cement grout 5.0
e. _____ 1.5 ft³ volume added for any of the above

f. How installed: Tremie 0.1
Tremie pumped 0.2
Gravity 0.8

6. Bentonite seal: a. Bentonite granules 3.3
b. 1/4 in. 3/8 in. 1/2 in. Bentonite chips 3.2
c. _____ Other

7. Fine sand material: Manufacturer, product name & mesh size NA
a. _____
b. Volume added _____ ft³

8. Filter pack material: Manufacturer, product name & mesh size Red Flint Filter Sand
a. _____
b. Volume added 2.1 ft³

9. Well casing: Flush threaded PVC schedule 40 2.3
Flush threaded PVC schedule 80 2.4
Other

10. Screen material: PVC
a. Screen Type: Factory cut 1.1
Continuous slot 0.1
Other

b. Manufacturer _____
c. Slot size: 0.010 in.
d. Slotted length: 10.0 ft.

11. Backfill material (below filter pack): None 1.4
Other

12. USCS classification of soil near screen:

GP GM GC GW SW SP
SM SC ML MH CL CH
Bedrock

13. Sieve analysis attached? Yes No

14. Drilling method used: Rotary 5.0
Hollow Stem Auger 4.1
Rotosonic Other

15. Drilling fluid used: Water 0.2 Air 0.1
Drilling Mud 0.3 None 9.9

16. Drilling additives used? Yes No

Describe _____

17. Source of water (attach analysis, if required): on-site hydrant

E. Bentonite seal, top 618.5 ft. MSL or 2.0 ft.

F. Fine sand, top 612.6 ft. MSL or 7.9 ft.

G. Filter pack, top 612.6 ft. MSL or 7.9 ft.

H. Screen joint, top 610.5 ft. MSL or 10.0 ft.

I. Well bottom 600.5 ft. MSL or 20.0 ft.

J. Filter pack, bottom 600.5 ft. MSL or 20.0 ft.

K. Borehole, bottom 600.5 ft. MSL or 20.0 ft.

L. Borehole, diameter 6.0 in.

M. O.D. well casing 2.38 in.

N. I.D. well casing 2.07 in.

I hereby certify that the information on this form is true and correct to the best of my knowledge.

Signature

Firm RMTINC

Tel:

Fax:

Please complete both Forms 4400-113A and 4400-113B and return them to the appropriate DNR office and bureau. Completion of these reports is required by chs. 160, 281, 283, 289, 291, 292, 293, 295, and 299, Wis. Stats., and ch. NR 141, Wis. Adm. Code. In accordance with chs. 281, 289, 291, 292, 293, 295, and 299, Wis. Stats., failure to file these forms may result in a forfeiture of between \$10 and \$25,000, or imprisonment for up to one year, depending on the program and conduct involved. Personally identifiable information on these forms is not intended to be used for any other purpose. NOTE: See the instructions for more information, including where the completed forms should be sent.

Route To: Watershed/Wastewater
Remediation/Redevelopment

Waste Management
Other

Facility/Project Name	County	Well Name	
WPL - Nelson Dewey Generating Station		B-07R	
Facility License, Permit or Monitoring Number	County Code	Wis. Unique Well Number	DNR Well Number
02525	22	VU600	156

1. Can this well be purged dry?	<input type="checkbox"/> Yes <input type="checkbox"/> No	Before Development After Development		
2. Well development method:		11. Depth to Water (from top of well casing)	a.	15.50 ft. 17.85 ft.
surged with bailer and bailed	<input type="checkbox"/> 4 1	Date	b.	4/29/2009 4/29/2009
surged with bailer and pumped	<input type="checkbox"/> 6 1	Time	c.	07:55 <input type="checkbox"/> a.m. 09:50 <input checked="" type="checkbox"/> a.m. <input type="checkbox"/> p.m. <input type="checkbox"/> p.m.
surged with block and bailed	<input type="checkbox"/> 4 2	12. Sediment in well bottom		inches inches
surged with block and pumped	<input type="checkbox"/> 6 2	13. Water clarity	Clear <input type="checkbox"/> 1 0	Clear <input checked="" type="checkbox"/> 2 0
surged with block, bailed, and pumped	<input type="checkbox"/> 7 0	Turbid <input checked="" type="checkbox"/> 1 5	Turbid <input type="checkbox"/> 2 5	
compressed air	<input type="checkbox"/> 2 0	(Describe)	dark reddish brown, no odor	light brown, no odor
bailed only	<input type="checkbox"/> 1 0			
pumped only	<input type="checkbox"/> 5 1			
pumped slowly	<input type="checkbox"/> 5 0			
other <u>surged and pumped with Whaler pump</u>				
3. Time spent developing well	115 min.			
4. Depth of well (from top of well casing)	23.0 ft.			
5. Inside diameter of well	2.07 in.			
6. Volume of water in filter pack and well casing	1.5 gal.			
7. Volume of water removed from well	20.0 gal.	Fill in if drilling fluids were used and well is at solid waste facility:		
8. Volume of water added (if any)	10.0 gal.	14. Total suspended solids	mg/l	96.7 mg/l
9. Source of water added	<u>fire suppression system hydrant</u>	15. COD	mg/l	mg/l
10. Analysis performed on water added?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No (If yes, attach results)	16. Well developed by: Person's Name and Firm		
17. Additional comments on development:		Roy Buckenberger		
		Layne Christensen, Co.		


Facility Address or Owner/Responsible Party Address	I hereby certify that the above information is true and correct to the best of my knowledge.
Name: <u>Nathaniel Sievers</u>	
Firm: <u>Nelson Dewey Generating Station</u>	Signature: <u>Nate Keller / Jo</u>
Street: <u>11999 County Rd VV</u>	Print Name: <u>Nathaniel Keller</u>
City/State/Zip: <u>Cassville, WI 53806</u>	Firm: <u>RMT, Inc.</u>

NOTE: See instructions for more information including a list of county codes and well type codes.

Facility/Project Name WP&L - Nelson Dewey 4293.02			License/Permit/Monitoring Number 2525		Boring Number B-11R								
Boring Drilled By (Firm name and name of crew chief) Environmental & Foundation Drilling; Crew Chief: Kevin Hargis			Date Drilling Started 11/17/97	Date Drilling Completed 11/17/97	Drilling Method 4 1/4 HSA								
DNR Facility Well No. 155	WI Unique Well No.	Common Well Name	Final Static Water Level Feet MSL 620.4	Surface Elevation Feet MSL 620.4	Borehole Diameter 8.0 Inches								
Boring Location State Plane NW 1/4 of WW 1/4 of Section N, E 19 T 3 N,R 5 W			Lat 0 9 "	Long 0 9 "	Local Grid Location (If applicable) 265,843 <input checked="" type="checkbox"/> 1,695,868 <input checked="" type="checkbox"/> E Feet <input type="checkbox"/> S <input type="checkbox"/> Feet <input type="checkbox"/> W								
County Grant	Sample Number	Length (In) Recovered	DNR County Code 22	Civil Town/City/ or Village Cassville									
Sample Number	Length (In) Recovered	Blow Counts Depth In Feet	Soil/Rock Description And Geologic Origin For Each Major Unit	S U	Graphic Log	Well Diagram	PID/FID	Soil Properties					Comments
								Standard Penetration	Moisture Content	Liquid Limit	Plastic Limit	P 200	
1			Boring B-11R was blind drilled to a depth of 23 ft. See boring log B-11 for geologic description.	SP/SW									
2													
3													
4													
5													
6													
7													
8													
9													
10													
11													
12													
13													
14													
15													
16													
17													
18													
19													
20													
21													
22													
23													

I hereby certify that the information on this form is true and correct to the best of my knowledge.

Signature



Firm

RMT
744 Heartland Trail, Madison Wisconsin
Tel: 608-831-4444, Fax: 608-831-3334

This form is authorized by Chapters 144, 147 and 162, Wis. Stats. Completion of this report is mandatory. Penalties: Forfeit not less than \$10 nor more than \$5,000 for each violation. Fined not less than \$10 or more than \$100 or imprisoned not less than 30 days, or both for each violation. Each day of continued violation is a separate offense, pursuant to ss 144.99 and 162.06, Wis. Stats.

State of Wisconsin
Department of Natural Resources

Route to: Solid Waste Haz. Waste Wastewater
Env. Response & Repair Underground Tanks Other

MONITORING WELL CONSTRUCTION
Form 4400-113A Rev. 4-90

Facility/Project Name WP&L Nelson Dewey	4293.01	Local Grid Location of Well ____ ft. <input type="checkbox"/> N. <input type="checkbox"/> E. ____ ft. <input type="checkbox"/> S. <input type="checkbox"/> W.	Well Name B-11R
Facility License, Permit or Monitoring Number 2525	Grid Origin Location Lat. ____ ° ____ ' Long. ____ ° ____ ' or St. Plane 265,843 ft. N. 1,695,868 ft. E.	Wis. Unique Well Number 155	DNR Well Number 155
Distance Well is From Waste/Source Boundary ft.	Section Location of Waste/Source NW $\frac{1}{4}$ of NW $\frac{1}{4}$ of Sec. 19, T3N, R5 <input type="checkbox"/> E. <input checked="" type="checkbox"/> W.	Date Well Installed 11/17/97 MM DD YY	
Type of Well: Water Table Observation Well <input checked="" type="checkbox"/> 11 Piezometer <input type="checkbox"/> 12	Location of Well Relative to Waste/Source U <input type="checkbox"/> Upgradient S <input type="checkbox"/> Sidegradient D <input checked="" type="checkbox"/> Downgradient N <input type="checkbox"/> Not Known	Well Installed By: (Person's Name and Firm) Kevin Hargis Environmental and Foundation Drilling Waunakee, Wisconsin	
Is Well A Point of Enforcement Std. Application? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No			

Protective pipe, top elevation 622.56 ft. MSL	1. Cap and lock? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No
Casing, top elevation 622.62 ft. MSL	2. Protective cover pipe: a. Inside diameter: 4.0 in. b. Length: 7.0 ft. c. Material: Steel <input checked="" type="checkbox"/> 04 Other <input type="checkbox"/> d. Additional protection? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No If yes, describe: _____
Surface elevation 620.4 ft. MSL	3. Surface seal: Bentonite <input checked="" type="checkbox"/> 30 Concrete <input type="checkbox"/> 01 Other <input type="checkbox"/>
Surface seal, bottom 619.4 ft. MSL or 1.0 ft.	4. Material between well casing and protective pipe: Bentonite <input checked="" type="checkbox"/> 30 Annular space seal <input type="checkbox"/> Other <input type="checkbox"/>
USCS classification of soil near screen: GP <input type="checkbox"/> GM <input type="checkbox"/> GC <input type="checkbox"/> GW <input type="checkbox"/> SW <input type="checkbox"/> SP <input type="checkbox"/> SM <input checked="" type="checkbox"/> SC <input type="checkbox"/> ML <input type="checkbox"/> MH <input type="checkbox"/> CL <input type="checkbox"/> CH <input type="checkbox"/> Bedrock <input type="checkbox"/>	5. Annular space seal: a. Granular Bentonite <input checked="" type="checkbox"/> 33 b. Lbs/gal mud weight... Bentonite-sand slurry <input type="checkbox"/> 35 c. Lbs/gal mud weight..... Bentonite slurry <input type="checkbox"/> 31 d. % Bentonite..... Bentonite-cement grout <input type="checkbox"/> 50 e. Ft ³ volume added for any of the above <input type="checkbox"/> f. How installed: Tremie <input type="checkbox"/> 01 Tremie pumped <input type="checkbox"/> 02 Gravity <input type="checkbox"/> 08
Soil analysis attached? Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	6. Bentonite seal: a. Bentonite granules <input checked="" type="checkbox"/> 33 b. <input type="checkbox"/> 1/4 in. <input checked="" type="checkbox"/> 3/8 in. <input type="checkbox"/> 1/2 in. Bentonite pellets <input checked="" type="checkbox"/> 32 c. Other <input type="checkbox"/>
Drilling method used: Rotary <input type="checkbox"/> 50 Hollow Stem Auger <input checked="" type="checkbox"/> 41 Other <input type="checkbox"/>	7. Fine sand material: Manufacturer, product name, mesh size a. <u>Badger Mining Corp.</u>
Drilling fluid used: Water <input type="checkbox"/> 02 Air <input type="checkbox"/> 01 Drilling Mud <input type="checkbox"/> 03 None <input checked="" type="checkbox"/> 99	8. Filter pack material: Manufacturer, product, mesh size a. <u>30 - 50</u> b. Volume added <u>20</u> lbs
Drilling additives used? Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> Describe: _____	9. Well casing: Flush threaded PVC schedule 40 <input checked="" type="checkbox"/> 23 Flush threaded PVC schedule 80 <input type="checkbox"/> 24 Other <input type="checkbox"/>
Source of water (attach analysis): _____	10. Screen Material: Sch 40 PVC a. Screen type: Factory cut <input checked="" type="checkbox"/> 11 Continuous slot <input type="checkbox"/> 01 Other <input type="checkbox"/> b. Manufacturer <u>Boart Longyear</u> c. Slot size: 0.010 in. d. Slotted length: 5.0 ft.
Seal, top 619.4 ft. MSL or 1.0 ft.	11. Backfill material (below filter pack): None <input checked="" type="checkbox"/> 14 Other <input type="checkbox"/>
Seal, top 606.4 ft. MSL or 14 ft.	
Seal, top 605.4 ft. MSL or 15 ft.	
Seal, top 603.4 ft. MSL or 17 ft.	
Seal, bottom 598.4 ft. MSL or 22 ft.	
Seal, bottom 597.4 ft. MSL or 23 ft.	
Seal, bottom 597.4 ft. MSL or 23 ft.	
Diameter 8.25 in.	
Casing 2.38 in.	
Screening 2.00 in.	

I certify that the information on this form is true and correct to the best of my knowledge.

Firm
RMT, Inc.

Failure to file both sides of this form and return to the appropriate DNR office listed at the top of this form as required by chs. 144, 147 and 160, Wis. Stats., and ch. NR 141, Wis. Admin. Code. In accordance with ch. 144, Wis. Stats., failure to file this form may result in a forfeiture of not less than \$10, nor more than \$5,000 for each day of violation. In accordance with ch. 147, Wis. Stats., failure to file this form in a timely manner may result in a forfeiture of not more than \$10,000 for each day of violation. NOTE: Shaded areas are for DNR use only. See instructions for more information including where the completed form

Route to: Solid Waste Haz. Waste Wastewater
Env. Response & Repair Underground Tanks Other

Facility/Project Name WP&L Nelson Dewey	County Name Grant	Well Name B-11R		
Facility License, Permit or Monitoring Number 2525	County Code <u>22</u>	Wis. Unique Well Number _____	DNR Well Number <u>155</u>	
1. Can this well be purged dry? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Before Development After Development			
2. Well development method surged with bailer and bailed surged with bailer and pumped surged with block and bailed surged with block and pumped surged with block, bailed and pumped compressed air bailed only pumped only pumped slowly Other _____	<input type="checkbox"/> 41 <input checked="" type="checkbox"/> 61 <input type="checkbox"/> 42 <input type="checkbox"/> 62 <input type="checkbox"/> 70 <input type="checkbox"/> 20 <input type="checkbox"/> 10 <input type="checkbox"/> 51 <input type="checkbox"/> 50 <input type="checkbox"/>	11. Depth to Water (from top of well casing) a. <u>17.5 ft</u>	<u>17.5 ft</u>	
3. Time spent developing well	<u>35 min.</u>	Date b. <u>11/18/97</u> mm/dd/yy	<u>11/18/97</u> mm/dd/yy	
4. Depth of well (from top of well casing)	<u>25.5 ft.</u>	Time c. <u>13:45</u> <input type="checkbox"/> a.m. <input checked="" type="checkbox"/> p.m.	<u>14:20</u> <input type="checkbox"/> a.m. <input checked="" type="checkbox"/> p.m.	
5. Inside diameter of well	<u>2.0 in.</u>	12. Sediment in well bottom <u>0.5 inches</u>	<u>0.0 inches</u>	
6. Volume of water in filter pack and well casing	<u>3.0 gal.</u>	13. Water clarity Clear Turbid (Describe)	<input type="checkbox"/> 10 <input checked="" type="checkbox"/> 15 Clear Turbid (Describe)	
7. Volume of water removed from well	<u>35 gal.</u>	Fill in if drilling fluids were used and well is at solid waste facility:		
8. Volume of water added (if any)	<u>0 gal.</u>	14. Total suspended solids	<u>mg/l</u>	<u>110 mg/L</u>
9. Source of water added		15. COD	<u>mg/l</u>	<u>mg/L</u>
10. Analysis performed on water added? (If yes, attach results)	<input type="checkbox"/> Yes <input type="checkbox"/> No			
16. Additional comments on development:				

Well developed by: Person's Name and Firm Name: <u>Kevin Baker</u> Firm: <u>RMT, Inc.</u>	I hereby certify that the above information is true and correct to the best of my knowledge. Signature: Print Initials: <u>K L B</u> Firm:
---	---

NOTE: Shaded areas are for DNR use only. See instructions for more information including a list of county codes.

- Solid Waste Haz. Waste
 Emergency Response Underground Tanks
 Wastewater Water Resources
 Other

Page 1 of 3

Facility/Project Name WP&L Nelson Dewey 3314.01				License/Permit/Monitoring Number Boring Number B11A										
Boring Drilled By (Firm name and name of crew chief) Environmental & Foundation Drilling, Crew Chief: G. Markgraf				Date Drilling Started 12/1/94	Date Drilling Completed 12/1/94	Drilling Method DTRC								
DNR Facility Well No.	WI Unique Well No.	Common Well Name	Final Static Water Level Feet MSL	Surface Elevation 620.2 Feet MSL	Borehole Diameter 7.5 Inches									
Boring Location State Plane 265903.10 N, 1727265.86 E NE 1/4 of NE — 1/4 of Section 19 T 3 N.R 5W			Lat o, "	Local Grid Location (If applicable)										
County Grant			DNR County Code 22	Civil Town/City/ or Village Cassville										
Number	Length (In) Recovered	Blow Counts	Depth In Feet	Soil/Rock Description And Geologic Origin For Each Major Unit				U S C Graphic Log	Well Diagram	PID/FID	Soil Properties			
				Standard Penetration	Moisture Content	Liquid Limit	Plastic Limit				P 200	Comments		
1														
2														
3														
4														
5														
6														
7														
8														
9														
10				Boring blind drilled to 50' bgs. See log of B-11A for geologic description.										
11														
12														
13														
14														
15														
16														
17														
18														
19														
20														

I hereby certify that the information on this form is true and correct to the best of my knowledge.

Signature

Firm

RMT

744 Heartland Trail, Madison Wisconsin
Tel: 608-831-4444, Fax: 608-831-3334

This form is authorized by Chapters 144, 147 and 162, Wis. Stats. Completion of this report is mandatory. Penalties: Forfeit not less than \$10 nor more than \$5,000 for each violation. Fined not less than \$10 or more than \$100 or imprisoned not less than 30 days, or both for each violation. Each day of continued violation is a separate offense, pursuant to ss 144.99 and 162.06, Wis. Stats.

Boring Number

B11A

Use only as an attachment to Form 4400-122.

Page 2 of 3

Number	Length (In) Recovered	Blow Counts	Depth In Feet	Soil/Rock Description And Geologic Origin For Each Major Unit	U S C S	Graphic Log	Well Diagram	PID/FID	Soil Properties				Comments
									Standard Penetration	Moisture Content	Liquid Limit	Plastic Limit	
			21										
			22	-									
			23										
			24										
			25										
			26										
			27										
			28										
			29										
			30										
			31										
			32										
			33										
			34										
			35										
			36										
			37										
			38										
			39										
			40										
			41										
			42										
			43										
			44										
			45										
			46										
			47										
			48										
			49										
			50										
			51										
			52										
			53										

Boring Number

B11A

Use only as an attachment to Form 4400-122.


Page 3 of 3

Number	Length (In) Recovered	Blow Counts	Depth In Feet	Soil/Rock Description And Geologic Origin For Each Major Unit	U S C S	Graphic Log	Well Diagram	Soil Properties				Comments	
								PID/FID	Standard Penetration	Moisture Content	Liquid Limit	Plastic Limit	
			54	Drill rod to 53'.									P 200
			55										
			56	End of Boring at 56 Ft.									

Facility/Project Name WP&L Nelson Dewey 3314.01	Local Grid Location of Well Lat. _____ N. _____ ft. S. _____ ft. E. _____ W. _____ ft.	Well Name B-119-A MLCM 12/30/94
Facility License, Permit or Monitoring Number	Grid Origin Location Lat. _____ Long. _____ or St. Plane _____ ft. N. _____ ft. E. 265903.10N, 1,727,265.86E	Wis. Unique Well Number DNR Well Number _____
Type of Well: Water Table Observation Well <input type="checkbox"/> 11 Piezometer <input checked="" type="checkbox"/> 12	Section Location of Waste/Source <u>NEX</u> of <u>NEX</u> of Sec. 19, T_3N, R_5 <input type="checkbox"/> E. <input checked="" type="checkbox"/> W.	Date Well Installed 12 / 01 / 94 MM DD YY
Distance Well is From Waste/Source Boundary Approx. 300' ft.	Location of Well Relative to Waste/Source U <input type="checkbox"/> Upgradient S <input type="checkbox"/> Sidegradient D <input checked="" type="checkbox"/> Downgradient N <input type="checkbox"/> Not Known	Well Installed By: (Persons' Name and Firm) Greg Markgraf, Environmental & Foundation Drilling
Is Well A Point of Enforcement Std. Application? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		

- A. Protective pipe, top elevation 622.20 ft MSL
 B. Well casing, top elevation 622.12 ft MSL
 C. Land surface elevation 620.2 ft MSL
 D. Surface seal, bottom _____ ft MSL or _____ ft

12. USCS classification of soil near screen:
 GP GM GC GW SW SP
 SM SC ML MH CL CH
 Bedrock
13. Sieve analysis attached? Yes No
14. Drilling method used: Rotary 50
 Hollow Stem Auger 41
Dual tube reverse circulation Other
15. Drilling fluid used: Water 02 Air 01
 Drilling Mud 03 None 99
16. Drilling additives used? Yes No
 Describe _____
17. Source of water (attach analysis):

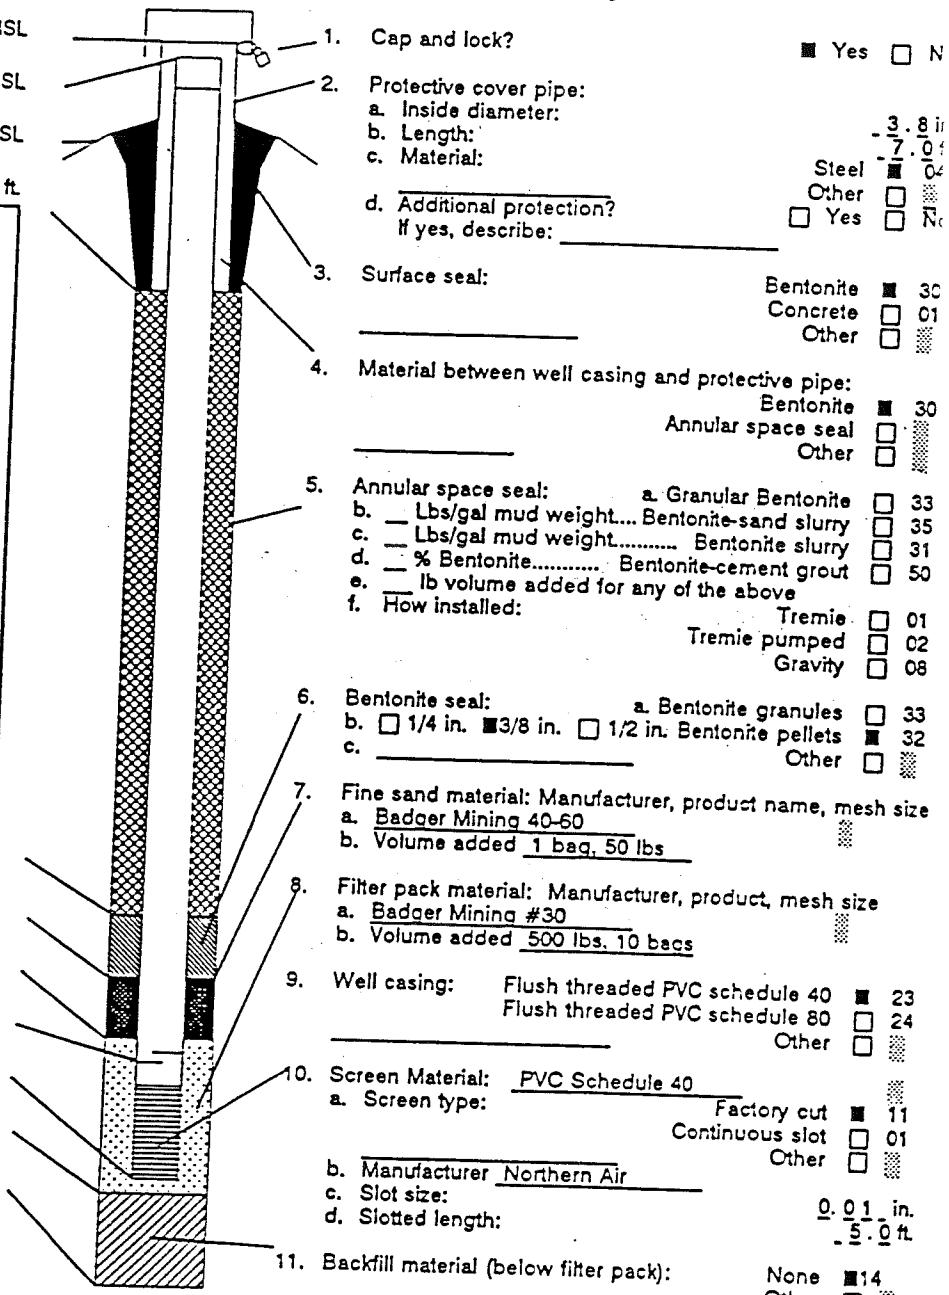

I hereby certify that the information on this form is true and correct to the best of my knowledge.
 Signature Maddie Gotberg 12/21/94 Firm RMT, Inc.

Please complete both sides of this form and return to the appropriate DNR office listed at the top of this form as required by chs. 144, 147 and 160, Wis. Stats., and ch. NR 141, Wis. Adm. Code. In accordance with ch. 144, Wis. Stats., failure to file this form may result in a forfeiture of not less than \$10, nor more than \$5,000 for each day of violation. In accordance with ch. 147, Wis. Stats., failure to file this form may result in a forfeiture of not more than \$10,000 for each day of violation. NOTE: Shaded areas are for DNR use only. See instructions for more information including where the completed form should be sent.


Route to: Solid Waste Haz. Waste Wastewater
Env. Response & Repair Underground Tanks Other

Facility Project Name WP & L Nelson Dewey: Cassville		County Name Grant	Well Name B-118A Mtn 12/30
Facility License, Permit or Monitoring Number		County Code	Wix Unique Well Number
			DNR Well Number
<p>1. Can this well purged dry? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No</p> <p>2. Well development method surged with bailer and bailed surged with bailer and pumped surged with block and bailed surged with block and pumped surged with block, bailed and pumped compressed air bailed only pumped only pumped slowly Other _____</p> <p>3. Time spent developing well — 4 5 min.</p> <p>4. Depth of well (from top of well casing) 5 2 1 ft.</p> <p>5. Inside diameter of well — 2 0 3 in.</p> <p>6. Volume of water in filter pack and well casing — 2 2 gal. ft</p> <p>7. Volume of water removed from well 1 0 0 0 0 gal.</p> <p>8. Volume of water added (if any) — gal.</p> <p>9. Source of water added _____</p> <p>10. Analysis performed on water added? (If yes, attach results) <input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>16. Additional comments on development:</p>			
<p>11. Depth of Water (from top of well casing) <input type="checkbox"/> 4 1 <input checked="" type="checkbox"/> 6 1 <input type="checkbox"/> 4 2 <input type="checkbox"/> 6 2 <input type="checkbox"/> 7 0 <input type="checkbox"/> 2 0 <input type="checkbox"/> 1 0 <input type="checkbox"/> 5 1 <input type="checkbox"/> 5 0 <input type="checkbox"/> 6 0</p> <p>12. Sediment in well bottom — 0 . 0 inches</p> <p>13. Water Clarity Clear <input type="checkbox"/> 1 0 Turbid <input checked="" type="checkbox"/> 1 5 (Describe) _____</p> <p>14. Total suspended solids — mg/l</p> <p>15. COD — mg/l</p> <p>Fill in if drilling fluids were used and well is at solid waste facility:</p>			

Well developed by: Person's Name and Firm

Name: Charles MarkgrafFirm: Environmental & Foundation Drilling, Inc.


I hereby certify that the above information is true and correct to the best of my knowledge.

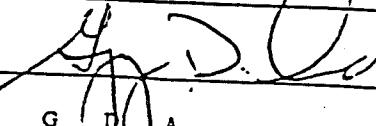Signature: Print Initials: G D AFirm: Environmental & Foundation Drilling, Inc.

NOTE: Shaded areas are for DNR use only. See instructions for more information including a list of county codes.

- Solid Waste Haz. Waste
 Emergency Response Underground Tanks
 Wastewater Water Resources
 Other

Page 1 of 4

Facility/Project Name WP&L Nelson Dewey 3314.01			License/Permit/Monitoring Number			Boring Number B11B							
Boring Drilled By (Firm name and name of crew chief) Environmental & Foundation Drilling, Crew Chief: G. Markgraf			Date Drilling Started 11/29/94		Date Drilling Completed 11/30/94	Drilling Method DTRC							
DNR Facility Well No.		WI Unique Well No.	Common Well Name	Final Static Water Level Feet MSL	Surface Elevation 619.7 Feet MSL	Borehole Diameter 7.5 Inches							
Boring Location State Plane 265907.89 N, 1727255.90 E NE 1/4 of NE - 1/4 of Section 19 T 3 N.R 5W			Lat o, "	Long o, "	Local Grid Location (If applicable) <input type="checkbox"/> N <input type="checkbox"/> S <input type="checkbox"/> E <input type="checkbox"/> W								
County Grant			DNR County Code 22	Civil Town/City/ or Village Cassville									
Sample			Soil/Rock Description And Geologic Origin For Each Major Unit			Soil Properties							
Number	Length (In) Recovered	Blow Counts	Depth In Feet	U S C	Graphic Log	Well Diagram	PID/FID	Standard Penetration	Moisture Content	Liquid Limit	Plastic Limit	P 200	Comments
A			1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20	SP					D				
B			As above, brown 10YR 4/3.						M				
C			As above, yellowish brown 10YR 5/6.						M				

I hereby certify that the information on this form is true and correct to the best of my knowledge.
Signature

Firm	RMT 744 Heartland Trail, Madison Wisconsin Tel: 608-831-4444, Fax: 608-831-3334
------	---

This form is authorized by Chapters 144, 147 and 162, Wis. Stats. Completion of this report is mandatory. Penalties: Forfeit not less than \$10 nor more than \$5,000 for each violation. Fined not less than \$10 or more than \$100 or imprisoned not less than 30 days, or both for each violation. Each day of continued violation is a separate offense, pursuant to ss 144.99 and 162.06, Wis. Stats.

Boring Number **B11B**

Use only as an attachment to Form 4400-122.

Page 2 of 4

Sample Number	Length (In) Recovered	Blow Counts	Depth In Feet	Soil/Rock Description And Geologic Origin For Each Major Unit	U S C S	Graphic Log	Well Diagram	PJD/FID	Soil Properties				Comments
									Standard Penetration	Moisture Content	Liquid Limit	Plastic Limit	
D			21	As above.						W			
			22										
			23										
			24										
E			25	As above.						W			
			26										
			27										
			28										
			29										
F			30	As above, sand medium grained, grains are light yellowish brown, yellowish brown and very dark brown.						W			
			31										
			32										
			33										
			34										
G			35	As above, fine grained, light yellowish brown 10YR 6/4.						W			
			36										
			37										
			38										
			39										
H			40	As above, slightly coarser grained sand than at 35', fine to medium grained.						W			
			41										
			42										
			43										
			44										
I			45	As above.						W			
			46										
			47										
			48										
			49										
J			50	As above.						W			
			51										
			52										
			53										

Boring Number **B11B**

Use only as an attachment to Form 4400-122.

Page 3 of 4

Sample		Blow Counts	Depth In Feet	Soil/Rock Description And Geologic Origin For Each Major Unit	U S C S	Graphic Log	Well Diagram	PID/FID	Soil Properties				Comments
Number	Length (In) Recovered								Standard Penetration	Moisture Content	Liquid Limit	Plastic Limit	
K			54										
			55	As above, sand finer grained than at 50', yellowish brown 10YR 5/4.									
			56										
			57										
			58										
			59										
L			60	As above, sand medium grained.									
			61										
			62										
			63										
			64										
M			65	As above.									
			66										
			67										
			68										
N			69										
			70	As above.									
			71										
			72										
			73										
O			74										
			75	As above, 75% medium and 25% coarse grained sand.									
			76										
			77										
			78										
			79										
P			80	As above, sand fine grained.									
			81										
			82										
			83										
			84										
Q			85										
			86	As above, 75% fine grained and 25% medium grained sand.									

Boring Number

B11B

Use only as an attachment to Form 4400-122.


Page 4 of 4

Sample				Soil Properties						Comments				
	Number	Length (In) Recovered	Blow Counts	Depth In Feet	U S C S	Graphic Log	Well Diagram	PID/FID	Standard Penetration	Moisture Content	Liquid Limit	Plastic Limit	P 200	
R				87										
				88										
				--										
				90										
				91										
				92										
				93										
				94										
S				95										
				96										
				As above.										
T				97										
				98										
				99										
				100										
				101										
				102										
				103										
				104										
U				105										
				106										
				As above, 90% medium and 10% coarse sand.										
V				107										
				108										
				109										
				110										
				111										
				As above, 50% medium and 50% coarse sand.										
				112										
				113										
				114										
				115										
				116										
				As above.										
				117										
				End of Boring at 117 Ft.										

Facility/Project Name WP&L Nelson Dewey 3314.01	Local Grid Location of Well N. <input type="checkbox"/> S. <input type="checkbox"/> ft. <input type="checkbox"/> E. <input type="checkbox"/> W. <input type="checkbox"/>	Well Name B-11A B MCM 12/30/94
Facility License, Permit or Monitoring Number	Grid Origin Location Lat _____ Long. _____ or St. Plane _____ ft N, _____ ft E. 265907.89 N, 1,727,255.90 E	Wis. Unique Well Number DNR Well Number
Type of Well: Water Table Observation Well <input type="checkbox"/> 11 Piezometer <input checked="" type="checkbox"/> 12	Section Location of Waste/Source NE ^{1/4} of NE ^{1/4} of Sec. 19, T 3N, R 5 <input type="checkbox"/> E. <input checked="" type="checkbox"/> W.	Date Well Installed 11 / 30 / 94 MM DD YY
Distance Well is From Waste/Source Boundary Approx. 300' ft	Location of Well Relative to Waste/Source U <input type="checkbox"/> Upgradient S <input type="checkbox"/> Sidegradient D <input checked="" type="checkbox"/> Downgradient N <input type="checkbox"/> Not Known	Well Installed By: (Persons' Name and Firm) Greg Markgraf, Environmental & Foundation Drilling
Is Well A Point of Enforcement Std. Application? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		

- A. Protective pipe, top elevation 622.02 ft MSL
 B. Well casing, top elevation 621.89 ft MSL
 C. Land surface elevation 619.7 ft MSL
 D. Surface seal, bottom ft MSL or 15.0 ft
12. USCS classification of soil near screen:
 GP GM GC GW SW SP
 SM SC ML MH CL CH
 Bedrock
13. Sieve analysis attached? Yes No
14. Drilling method used: Rotary 50
 Hollow Stem Auger 41
Dual-tube reverse circulation Other 8
15. Drilling fluid used: Water 02 Air 01
 Drilling Mud 03 None 99
16. Drilling additives used? Yes No
 Describe _____
17. Source of water (attach analysis):

- E. Bentonite seal, top ft MSL or 95.0 ft
 F. Fine sand, top ft MSL or 101.5 ft
 G. Filter pack, top ft MSL or 103.5 ft
 H. Screen joint, top ft MSL or 106.3 ft
 I. Well bottom ft MSL or 111.3 ft
 J. Filter pack, bottom ft MSL or 111.3 ft
 K. Borehole, bottom ft MSL or 117.0 ft
 L. Borehole, diameter .7.5 in.
 M. O.D. well casing .2.38 in.
 N. I.D. well casing .1.89 in.

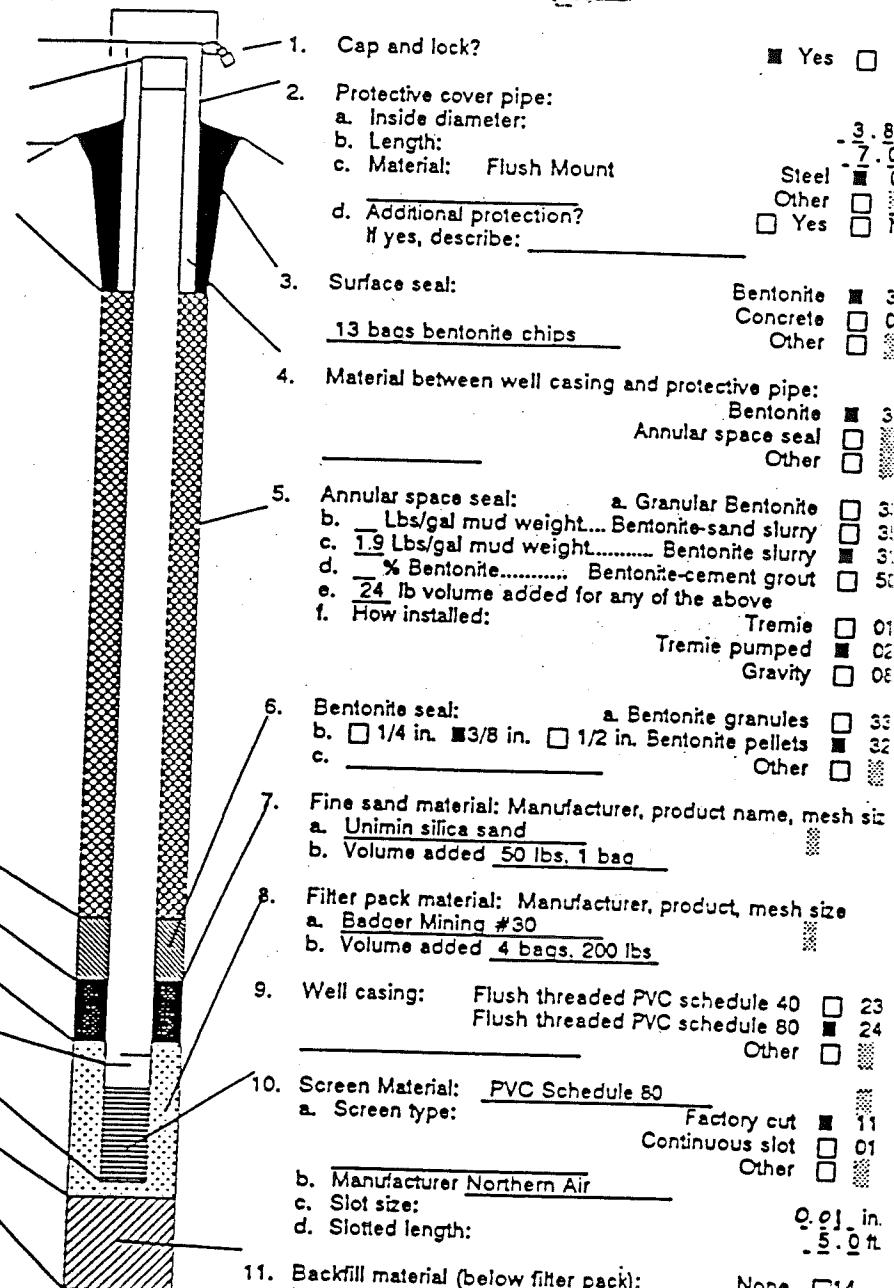

I hereby certify that the information on this form is true and correct to the best of my knowledge.
 Signature _____

Firm: RMT, Inc.


Please complete both sides of this form and return to the appropriate DNR office listed at the top of this form as required by chs. 144, 147 and 160, Wis. Stats., and ch. NR 141, Wis. Adm. Code. In accordance with ch. 144, Wis. Stats., failure to file this form may result in a forfeiture of not less than \$10, nor more than \$5,000 for each day of violation. In accordance with ch. 147, Wis. Stats., failure to file this form may result in a forfeiture of not more than \$10,000 for each day of violation. NOTE: Shaded areas are for DNR use only. See instructions for more information including where the completed form should be sent.

Route to: Solid Waste Haz. Waste Wastewater
Env. Response & Repair Underground Tanks Other

Facility Project Name WP & L Nelson Dewey-Cassville	County Name Grant	Well Name B-11XB ACM 12/3	
Facility License, Permit or Monitoring Number	County Code	Wis. Unique Well Number	
		DNR Well Number	
1. Can this well purged dry? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No		<u>Before Development</u>	
2. Well development method surged with bailer and bailed <input type="checkbox"/> 41 surged with bailer and pumped <input checked="" type="checkbox"/> 61 surged with block and bailed <input type="checkbox"/> 42 surged with block and pumped <input type="checkbox"/> 62 surged with block, bailed and pumped <input type="checkbox"/> 70 compressed air <input type="checkbox"/> 20 bailed only <input type="checkbox"/> 10 pumped only <input type="checkbox"/> 51 pumped slowly <input type="checkbox"/> 50 Other _____		11. Depth of Water (from top of well casing) Date <u>a 1 6 . 4</u> ft <u>1 5 . 8</u> ft mm dd yy mm dd yy	
		Time <u>c 1 0 : 0 0</u> <input type="checkbox"/> a.m. <u>1 0 : 4 5</u> <input type="checkbox"/> p.m.	
3. Time spent developing well <u>4 5</u> min.		12. Sediment in well bottom <u>0 . 0</u> inches <u>0 . 0</u> inches	
4. Depth of well (from top of well casing) <u>1 1 3 . 5</u> ft		13. Water Clarity Clear <input type="checkbox"/> 10 Turbid <input checked="" type="checkbox"/> 15 (Describe)	
5. Inside diameter of well <u>2 . 0 3</u> in.			
6. Volume of water in filter pack and well casing <u>2 . 2</u> gal.ft			
7. Volume of water removed from well <u>1 3 5 0 . 0</u> gal.		Fill in if drilling fluids were used and well is at solid waste facility:	
8. Volume of water added (if any) <u>-----</u> gal.		14. Total suspended solids <u>-----</u> mg/l <u>-----</u> mg/l	
9. Source of water added _____		15. COD <u>-----</u> mg/l <u>-----</u> mg/l	
10. Analysis performed on water added? (If yes, attach results) <input type="checkbox"/> Yes <input type="checkbox"/> No			
16. Additional comments on development:			

Well developed by: Person's Name and Firm Name: <u>Charles Markgraf</u> Firm: <u>Environmental & Foundation Drilling, Inc.</u>	I hereby certify that the above information is true and correct to the best of my knowledge. Signature: <u>Sgt D. A.</u> Print Initials: <u>G D A</u> Firm: <u>Environmental & Foundation Drilling, Inc.</u>
--	---

NOTE: Shaded areas are for DNR use only. See instructions for more information including a list of county codes.

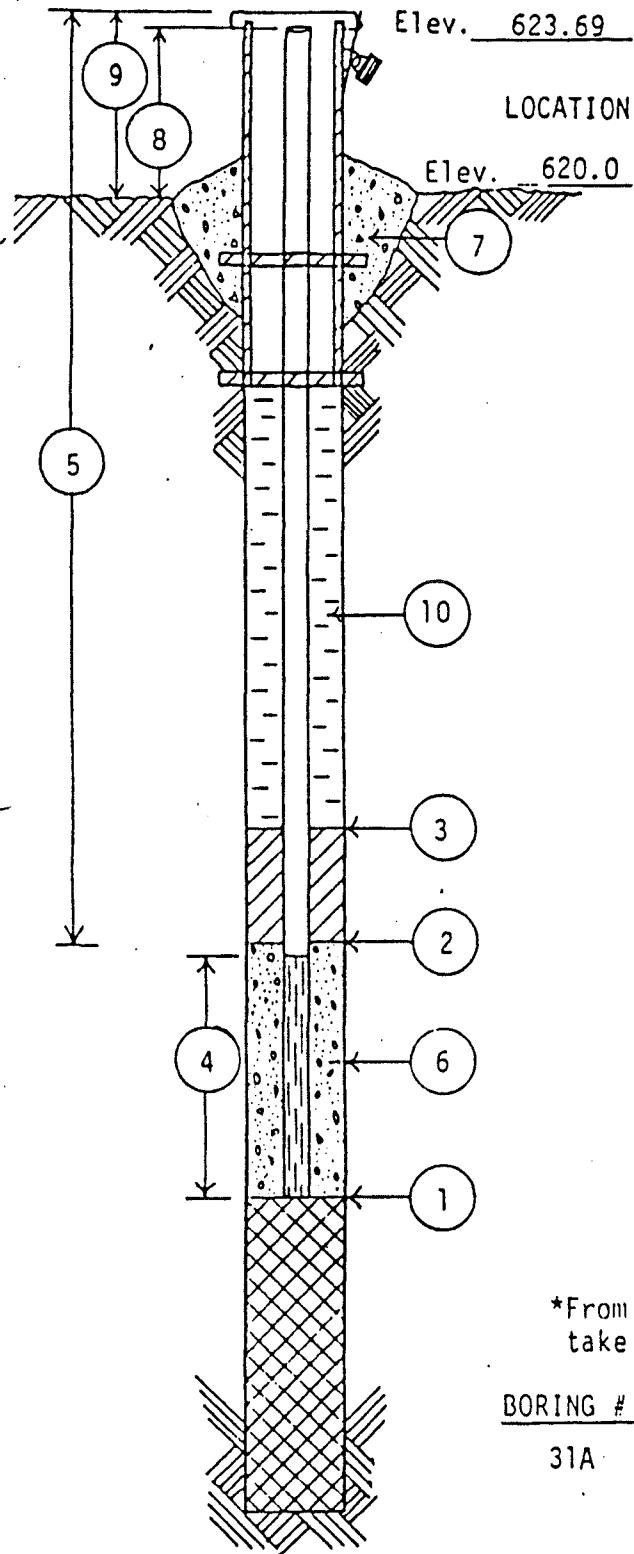

JOB NO. C 9065

BORING NO. B 31A

DATE 2/28/80

CHIEF D. Braun

LOCATION Cassville, Wisconsin

All depth measurements of well detail assumed to be from ground surface unless otherwise indicated.

- 1 DEPTH TO BOTTOM OF WELL POINT OR SLOTTED PIPE 34' FEET.
- 2 DEPTH OF BOTTOM OF SEAL (if installed) 28 FEET.
- 3 DEPTH TO TOP OF SEAL (if installed) 25 FEET.
- 4 LENGTH OF WELL POINT, PVC WELL SCREEN OR SLOTTED PIPE 5 FEET. (Circle One)
- 5 TOTAL LENGTH OF PIPE 33 FEET @ 2 IN. DIAMETER.
- 6 TYPE OF FILTER MATERIAL AROUND WELL POINT OR SLOTTED PIPE Sand.
- 7 CONCRETE CAP, YES NO (Circle One)
- 8 HEIGHT OF WELL CASING ABOVE GROUND 4 FEET.
- 9 PROTECTIVE CASING? YES NO (Circle One)
HEIGHT ABOVE GROUND
LOCKING CAP? YES NO (Circle One)
- 10 TYPE OF BACKFILL: Soil & Bentonite Mix

WATER LEVEL CHECKS

*From top of casing, if protective casing higher, take measurement from top of protective casing.

BORING #	DATE	TIME	DEPTH TO WATER	REMARKS
31A	2/28/80		10.5'	½ hour

WARZYN
ENGINEERING INC



LOG OF TEST BORING

Project Monitoring Well
 Location Cassville, Wisconsin

Boring No. 31
 Surface Elevation
 Job No. C.9065
 Sheet 1 of 1

1408 EMIL STREET • P.O. BOX 8538, MADISON, WIS. 53715 • TEL. (608) 257-4848

SAMPLE			VISUAL CLASSIFICATION and Remarks			SOIL PROPERTIES				
No.	Type	↓	Moisture		Depth	Qe	W	LL	PL	D
			↓	N						
					5'					
					10'					
					15'					
					20'					
					25'					
					30'					
					35'					
					40'					
WATER LEVEL OBSERVATIONS						GENERAL NOTES				
While Drilling _____						Start 2/28/80	Complete 2/28/80			
Upon Completion of Drilling _____						Crew Chief DB	Rig Bomb			
Time After Drilling _____						Drilling Method				
Depth to Water _____										
Depth to Cave In _____										

WARZYN

LOG OF TEST BORING

Project WP&L
 Nelson Dewey Generating Station
 Location Cassville, Wisconsin

Boring No. B-31R
 Surface Elevation _____
 Job No. 13758
 Sheet 1 of 1

ONE SCIENCE COURT • P.O. BOX 5385, MADISON, WIS. 53705 • TEL. (608) 273-0440

SAMPLE					VISUAL CLASSIFICATION and Remarks		SOIL PROPERTIES				
No.	T y p e E	Rec (in.)	Moist	N	Depth		q _u (qa) (tsf)	w	ll	pl	li
						TOPSOIL - Brown Silty Sand					
						FILL					
					5						
					10						
					15	Loose, Tan Fine to Medium SAND (SW)					
					20	Medium Dense, Tan Medium to Coarse SAND (SW)					
					25	End Boring at 22.0'					
1	18	W	8								
2	18	W	12								
WATER LEVEL OBSERVATIONS					GENERAL NOTES						
While Drilling	☒	Upon Completion of Drilling			Start 4/25/89 End 4/25/89						
Time After Drilling					Driller E&F Chief G.A. Rig CME						
Depth to Water					Logger WB Editor AJS 65						
Depth to Cave in					Drill Method HSA 0-22'						
The stratification lines represent the approximate boundary between soil types and the transition may be gradual.											




LOG OF TEST BORING

Project Nelson Dewey Generating Station
Location Cassville, Wisconsin

Boring No. B. 31A
Surface Elevation 6200
Job No. C. 9065
Sheet 1 of 1

1409 EMIL STREET • P.O. BOX 9538, MADISON, WIS. 53715 • TEL. (608) 257-4848

SAMPLE					VISUAL CLASSIFICATION and Remarks	SOIL PROPERTIES				
No.	Type	Recovery ↓	Moisture ↓	N		Q#	W	LL	PL	D
1	SS	X	M	33	TOPSOIL-Brown Silty SAND					
2	SS	X	M	11	5					
3	SS	X	W	6	FILL					
4	SS	X	W	3	10					
5	SS	X	W	8	15	Tan Fine to Medium SAND				
6	SS	X	W	18	20	Tan Medium to Coarse SAND, Trace Gravel				
7	SS	X	W	11	25					
8	SS	NR	W	15	30					
9	SS	X	W	27	35	Very Fine Tan SAND, Little Silt				
					40	End Boring at 35'				
WATER LEVEL OBSERVATIONS										GENERAL NOTES
While Drilling _____										Start 2/28/80 Complete 2/28/80
Upon Completion of Drilling _____										Crew Chief DB Rig Bomb
Time After Drilling $\frac{1}{4}$ hour _____										Drilling Method 0-10' Auger
Depth to Water 10.5'										10-35' Wash Bore
Depth to Cave In _____										

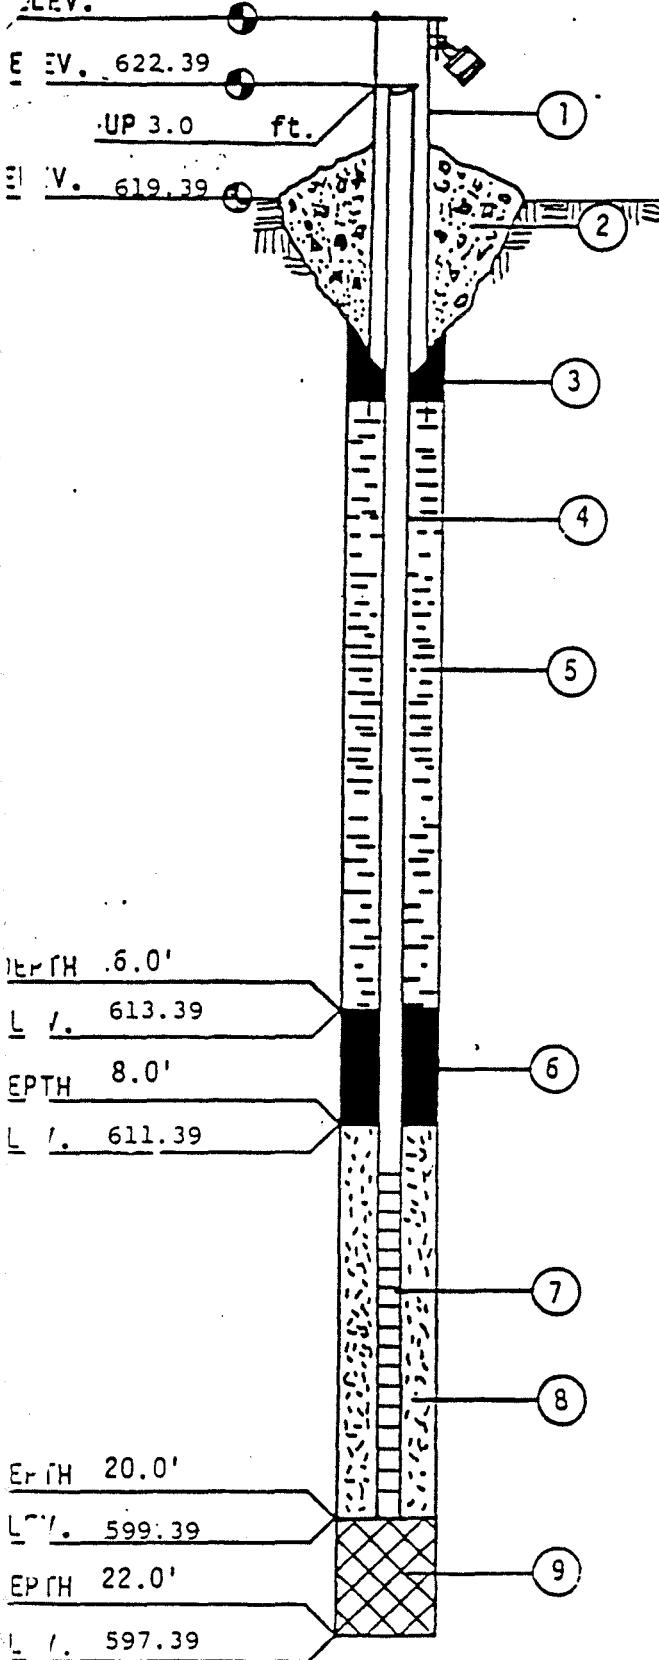

MONITORING WELL CONSTRUCTION INFORMATION

JOB NO. 13758

BORING/WELL NO. B-31R

DATE 4/25/89

CHIEF/UNIT Greg Anderson/CME 65

1. PROTECTIVE CASING YES NO

LOCKING YES NO

2. CONCRETE SEAL YES NO

3. TYPE OF SURFACE SEAL (IF INSTALLED) Granular Bentonite

4. SOLID PIPE TYPE PVC

SOLID PIPE LENGTH 13.0 ft.

JOINT TYPE SLIP/GLUED THREADED

5. TYPE OF BACKFILL Granular Bentonite

HOW INSTALLED - TREMIE
FROM SURFACE

6. TYPE OF LOWER SEAL (IF INSTALLED) Bentonite Pellets

7. SCREEN TYPE PVC

SCREEN LENGTH 10.0 ft

SLOT-SIZE 0.010" LENGTH 10 ft.

SCREEN DIAMETER 2.0 in.

8. TYPE OF BACKFILL AROUND SCREEN #20 Flint Sand

9. TYPE OF BACKFILL Natural Cave-in

10. DRILLING METHOD HSA

11. ADDITIVES USED (IF ANY)

WATER LEVEL 14.0' DATE 4/25/89

*ALL DEPTHS MEASURED FROM GROUND SURFACE.

WELL DETAIL INFORMATION SHEET

JOB NO. C 9036


BORING NO. 26

DATE 2/28/80

CHIEF D. Braun

LOCATION Nelson Dewey G.S.; Cassville, Wisconsin

* All depth measurements of well detail assumed to be from ground surface unless otherwise indicated.

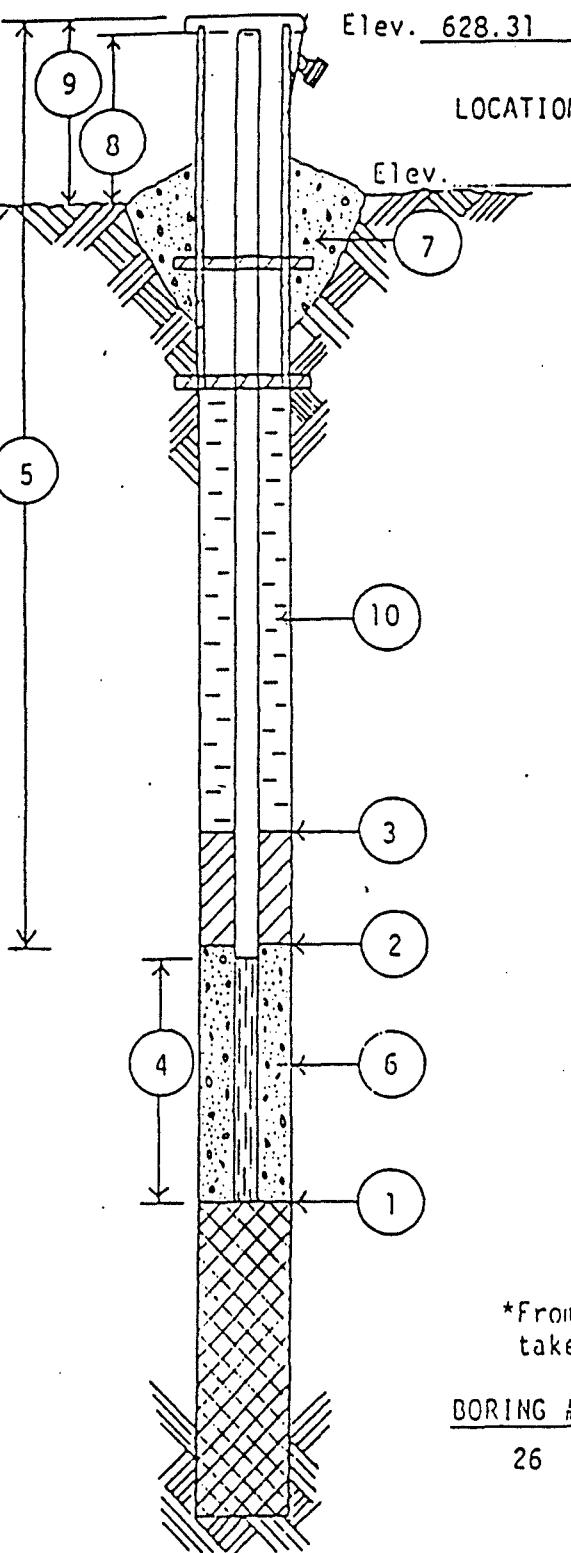

- (1) DEPTH TO BOTTOM OF WELL POINT OR SLOTTED PIPE 29.5 FEET.
- (2) DEPTH OF BOTTOM OF SEAL (if installed) 3 FEET.
- (3) DEPTH TO TOP OF SEAL (if installed) 0 FEET.
- (4) LENGTH OF WELL POINT, PVC WELL SCREEN OR SLOTTED PIPE 10 FEET. (Circle One)
- (5) TOTAL LENGTH OF PIPE 23.5 FEET @ 2 IN. DIAMETER.
- (6) TYPE OF FILTER MATERIAL AROUND WELL POINT OR SLOTTED PIPE Sand.
- (7) CONCRETE CAP, YES NO (Circle One)
- (8) HEIGHT OF WELL CASING ABOVE GROUND 4 FEET.
- (9) PROTECTIVE CASING? YES NO (Circle One)
HEIGHT ABOVE GROUND
LOCKING CAP? YES NO (Circle One)
- (10) TYPE OF BACKFILL: Soil & Bentonite Mix

WATER LEVEL CHECKS

*From top of casing, if protective casing higher, take measurement from top of protective casing.

BORING #	DATE	TIME	DEPTH TO WATER	REMARKS
26	2/28/80		17' 8"	½ hour

WARZYN
ENGINEERING INC



LOG OF TEST BORING

Project Nelson Dewey Generating Station
..... Proposed Slag Disposal Area
Location Cassville, Wisconsin

Boring No. B 26A
Surface Elevation 624.6
Job No. C 9036
Sheet 1 of 2

~~1409 EMIL STREET • P.O. BOX 9538, MADISON, WIS. 53715 • TEL. (608) 257-4848~~

SAMPLE					VISUAL CLASSIFICATION and Remarks		SOIL PROPERTIES				
No.	Type	Recovery	Moisture	Depth			q _s	w	ll	pl	d
1	SS	X	M	11		TOPSOIL					
2	SS	X	M	4	5	Brown SILT, Some Clay, Some Sand (CL-ML) Occasional Sand Lenses	4.5				
3	SS	X	M	5							
	SS	X	M	-							
4	SS	X	M	6	10						
	SS	X	M	-							
5	SS	X	M	9	15						
	SS	X	M	-							
6	SS	X	W	28	20	Tan Coarse to Medium SAND, Some to Trace Gravel, Trace Silt and Clay (SP)	25.4	19.9			
	SS	X	W	-							
7	SS	X	W	20	25						
	SS	X	W	-							
8	SS	X	W	11	30	Tan Medium to Fine SAND, Trace Gravel, Little to Trace Silt and Clay (SP)					
	SS	X	W	-							
9	SS	X	W	19	35						
	SS	X	W	-							
10	SS	X	W	27	40	Tan Coarse to Medium SAND, Some to Trace Gravel, Trace Silt and Clay (SP)					
	SS	X	W	-							
	SS	X	W	26	45	End Boring at 45'					

(Continued)




LOG OF TEST BORING

Project ... Nelson Dewey Generating Station
 Proposed Slag Disposal Area
 Location Cassville, Wisconsin

Boring No. B 26A
 Surface Elevation .. 624.6
 Job No. C 9036
 Sheet 2 of 2

1409 EMIL STREET • P.O. BOX 9538, MADISON, WIS. 53715 • TEL. (608) 257-4848

SAMPLE				VISUAL CLASSIFICATION and Remarks		SOIL PROPERTIES				
No.	Type	Recovery ↓	Moisture ↓	N	Depth	Qu	W	LL	PL	D
					50					
					55					
					60					
					65					
					70					
					75					
					80					
					85					
WATER LEVEL OBSERVATIONS										
While Drilling	19.5'									
Upon Completion of Drilling										
Time After Drilling	3/10/80									
Depth to Water	23.14									
Depth to Cave In										
GENERAL NOTES										
Start	2/27/80	Complete	2/27/80							
Crew Chief	DB..	Rig	Bomb...							
Drilling Method										
Auger	to 20'									
Wash Bore	to 45'									

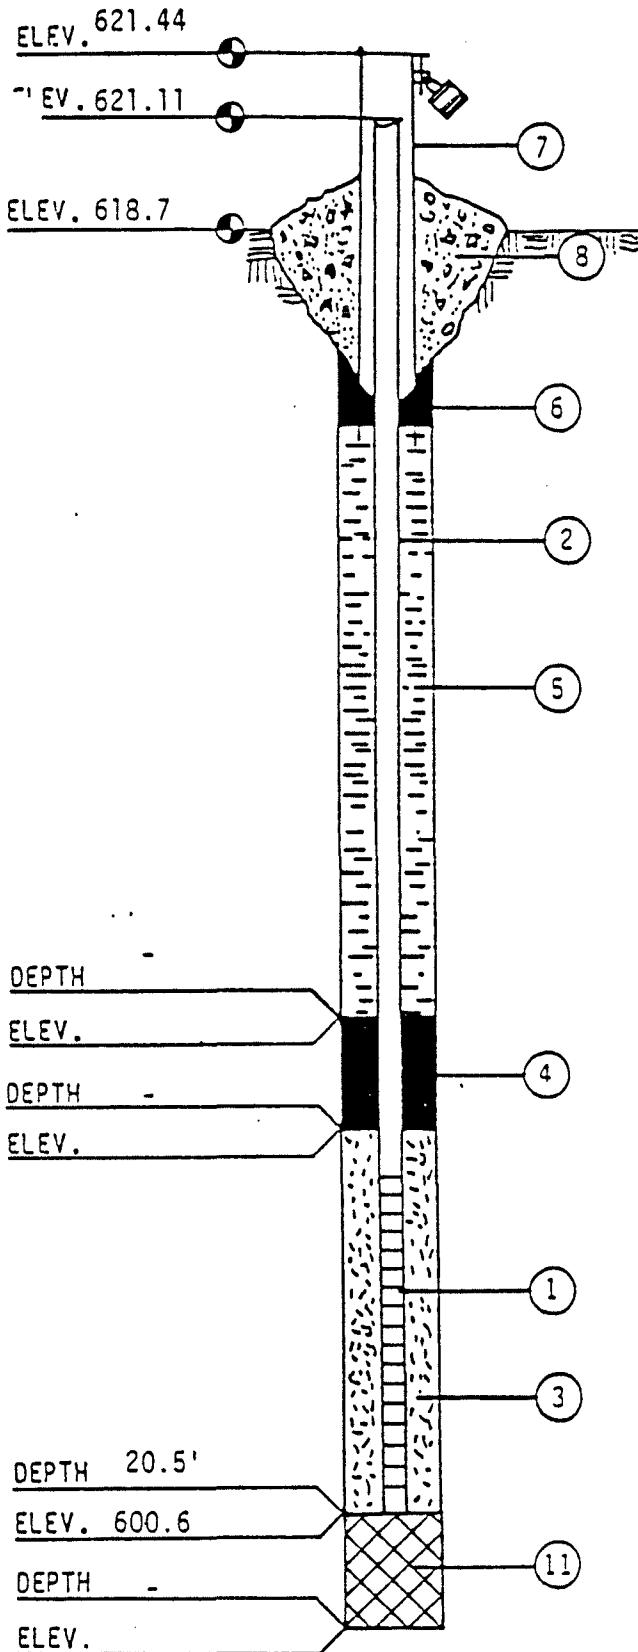

MONITORING WELL CONSTRUCTION INFORMATION

JOB NO. C 11254

BORING/WELL NO. B-36

DATE 3/27/85

CHIEF/UNIT MG/9920

1. SCREEN TYPE PVC

SLOTTED LENGTH 9.0 ft.

SLOT SIZE 0.010

SCREEN DIAMETER 2 in.

2. SOLID PIPE TYPE PVC

SOLID PIPE LENGTH 13 ft.

JOINT TYPE SLIP/GLOVED THREADED

3. TYPE OF BACKFILL AROUND SCREEN
Flint Sand

4. TYPE OF LOWER SEAL (IF INSTALLED)
-

5. TYPE OF BACKFILL Granular Bentonite

HOW INSTALLED - TREMIE
FROM SURFACE

6. TYPE OF SURFACE SEAL (IF INSTALLED)
Granular Bentonite

7. PROTECTIVE CASING YES NO

LOCKING YES NO

8. CONCRETE SEAL YES NO

9. DRILLING METHOD WB

10. ADDITIVES USED (IF ANY)
Quick Gel

11. TYPE OF BACKFILL -

WATER LEVEL 7.5' DATE 3/27/85

*ALL DEPTHS MEASURED FROM GROUND SURFACE.





LOG OF TEST BORING

Project Ash Lagoon
..... WP&L Plant
Location Cassville, Wisconsin

Boring No. 8-36
Surface Elevation 618.7
Job No. C 11254
Sheet of

1408 EMIL STREET • P.O. BOX 1438, MADISON, WIS. 53718 • TEL. (608) 237-4848



LOG OF TEST BORING

Project Ash Lagoon
 WP&L Plant
 Location Cassville, Wisconsin

Boring No. B 36A
 Surface Elevation 618.7
 Job No. C 11254
 Sheet 1 of 2

1409 EMIL STREET • P.O. BOX 9538, MADISON, WIS. 53715 • TEL. (608) 257-4848

SAMPLE					VISUAL CLASSIFICATION and Remarks	SOIL PROPERTIES							
Recovery	Moisture	No.	Type	↓		↓	M	Depth	q _s	w	ll	pl	d
					Brown Fine to Coarse SAND, Some Fine to Coarse Gravel (FILL)								
1	SS X M 5			5	Dark Brown TOPSOIL								
					Brown Silty CLAY								
2	SS X W 8			10	Dark Brown Fine SAND, Some Silt (SM)								
					Brown Fine to Medium SAND, Little Fine to Coarse Gravel, Trace Silt (SP)								
3	SS X W 15			15									
4	SS X W 10			20									
5	SS X W 8			25									
6	SS X W 19			30									
7	SS X W 23			35									
8	SS X W 46			40									
9	SS X W 32			45									

(Continued)




LOG OF TEST BORING

Project Ash Lagoon
 WP&L Plant
 Location Cassville, Wisconsin

Boring No. B 36A
 Surface Elevation ..618.7....
 Job No.C.11254.....
 Sheet 2 of 2

1409 EMIL STREET • P.O. BOX 9536, MADISON, WIS. 53715 • TEL. (608) 257-4848

SAMPLE				VISUAL CLASSIFICATION and Remarks	SOIL PROPERTIES				
Recovery		Moisture			Q	W	LL	PL	D
No.	Type	↓	↓	H	Depth				
10	SS	X	W	38	50	Brown Fine to Medium SAND, Little Fine to Coarse Gravel, Trace Silt (SP)			
					55	End Boring at 50'			
					60				
					65				
					70				
					75				
					80				
					85				
WATER LEVEL OBSERVATIONS									
While Drilling _____									
Upon Completion of Drilling _____									
Time After Drilling	1/2 hour	_____	_____	_____	_____	_____	_____	_____	_____
Depth to Water	9'	_____	_____	_____	_____	_____	_____	_____	_____
Depth to Cave In	_____	_____	_____	_____	_____	_____	_____	_____	_____
GENERAL NOTES									
Start 3/27/85 Complete 3/27/85									
Crew Chief MG. Rig 9920									
Drilling Method DC 0-5' RB 0-50									

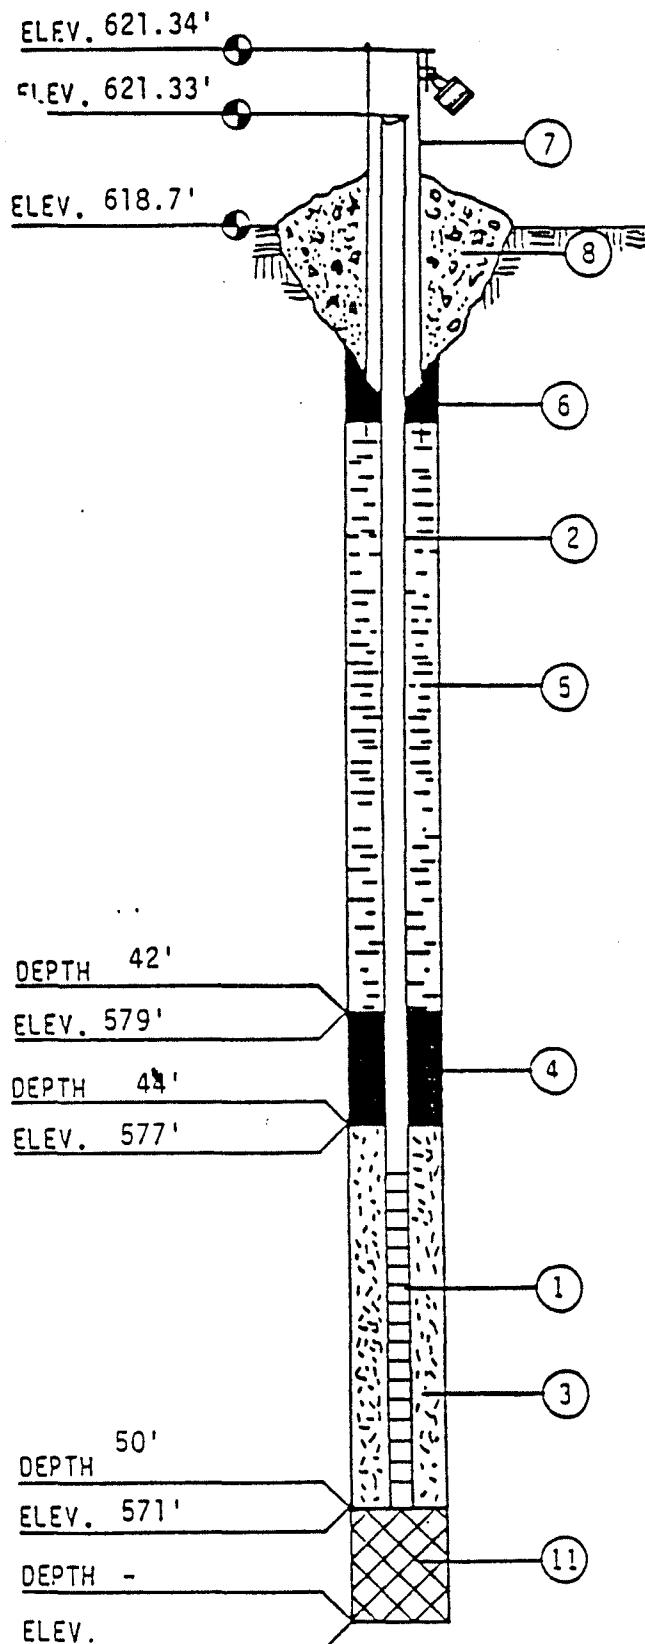

MONITORING WELL CONSTRUCTION INFORMATION

JOB NO. C 11254

BORING/WELL NO. B-36A

DATE 3/27/85

CHIEF/UNIT MG/9920

1. SCREEN TYPE PVC

SLOTTED LENGTH 4.5 ft.

SLOT SIZE 0.010

SCREEN DIAMETER 2 in.

2. SOLID PIPE TYPE PVC

SOLID PIPE LENGTH 47.5 ft.

JOINT TYPE SLIP/GLUED THREADED

3. TYPE OF BACKFILL AROUND SCREEN
Flint Sand

4. TYPE OF LOWER SEAL (IF INSTALLED)
Bentonite Pellets

5. TYPE OF BACKFILL Bentonite Grout

HOW INSTALLED TREMIE
FROM SURFACE

6. TYPE OF SURFACE SEAL (IF INSTALLED)
Granular Bentonite

7. PROTECTIVE CASING YES NO

LOCKING YES NO

8. CONCRETE SEAL YES NO

9. DRILLING METHOD Wash Bore

10. ADDITIVES USED (IF ANY)
Quick Gel

11. TYPE OF BACKFILL -

WATER LEVEL 9' DATE 3/27/85

*ALL DEPTHS MEASURED FROM GROUND SURFACE.



Appendix C

Laboratory Analytical Reports



Pace Analytical Services, LLC
1241 Bellevue Street - Suite 9
Green Bay, WI 54302
(920)469-2436

October 24, 2023

Meghan Blodgett
SCS ENGINEERS
2830 Dairy Drive
Madison, WI 53718

RE: Project: 25223071 ALLIANT NEL DEW CCR
Pace Project No.: 40269072

Dear Meghan Blodgett:

Enclosed are the analytical results for sample(s) received by the laboratory between October 05, 2023 and October 17, 2023. The results relate only to the samples included in this report. Results reported herein conform to the applicable TNI/NELAC Standards and the laboratory's Quality Manual, where applicable, unless otherwise noted in the body of the report.

The test results provided in this final report were generated by each of the following laboratories within the Pace Network:

- Pace Analytical Services - Green Bay

If you have any questions concerning this report, please feel free to contact me.

Sincerely,

Dan Milewsky
dan.milewsky@pacelabs.com
(920)469-2436
Project Manager

Enclosures

cc: Matt Bizjack, Alliant Energy
Natalie Burris, SCS ENGINEERS
Sherren Clark, SCS Engineers
Jenny Coughlin, Alliant Energy
Tom Karwoski, SCS ENGINEERS
Ryan Matzuk, SCS Engineers
Jeff Maxted, ALLIANT ENERGY



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



Pace Analytical Services, LLC
1241 Bellevue Street - Suite 9
Green Bay, WI 54302
(920)469-2436

CERTIFICATIONS

Project: 25223071 ALLIANT NEL DEW CCR
Pace Project No.: 40269072

Pace Analytical Services Green Bay

1241 Bellevue Street, Green Bay, WI 54302
Florida/NELAP Certification #: E87948
Illinois Certification #: 200050
Kentucky UST Certification #: 82
Louisiana Certification #: 04168
Minnesota Certification #: 055-999-334
New York Certification #: 12064
North Dakota Certification #: R-150

South Carolina Certification #: 83006001
Texas Certification #: T104704529-21-8
Virginia VELAP Certification ID: 11873
Wisconsin Certification #: 405132750
Wisconsin DATCP Certification #: 105-444
USDA Soil Permit #: P330-21-00008
Federal Fish & Wildlife Permit #: 51774A

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

Page 2 of 23



SAMPLE SUMMARY

Project: 25223071 ALLIANT NEL DEW CCR

Pace Project No.: 40269072

Lab ID	Sample ID	Matrix	Date Collected	Date Received
40269072001	B-7R	Water	10/03/23 15:00	10/05/23 09:20
40269072002	B-11R	Water	10/03/23 09:45	10/05/23 09:20
40269072003	B-11A	Water	10/03/23 10:30	10/05/23 09:20
40269072004	B-11B	Water	10/03/23 11:45	10/05/23 09:20
40269072005	B-26	Water	10/03/23 12:35	10/05/23 09:20
40269072006	B-31R	Water	10/02/23 14:05	10/05/23 09:20
40269072007	B-31A	Water	10/02/23 18:20	10/05/23 09:20
40269072008	FIELD BLANK	Water	10/02/23 18:35	10/05/23 09:20
40269072009	B-39	Water	10/03/23 00:00	10/17/23 16:58

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

Page 3 of 23



SAMPLE ANALYTE COUNT

Project: 25223071 ALLIANT NEL DEW CCR
Pace Project No.: 40269072

Lab ID	Sample ID	Method	Analysts	Analytes Reported
40269072001	B-7R	EPA 6020B	KXS	2
			AG1	7
		SM 2540C	TMK	1
		EPA 9040	HML	1
		EPA 300.0	HMB	3
40269072002	B-11R	EPA 6020B	KXS	2
			AG1	7
		SM 2540C	TMK	1
		EPA 9040	HML	1
		EPA 300.0	HMB	3
40269072003	B-11A	EPA 6020B	KXS	2
			AG1	7
		SM 2540C	TMK	1
		EPA 9040	HML	1
		EPA 300.0	HMB	3
40269072004	B-11B	EPA 6020B	KXS	2
			AG1	7
		SM 2540C	TMK	1
		EPA 9040	HML	1
		EPA 300.0	HMB	3
40269072005	B-26	EPA 6020B	KXS	2
			AG1	7
		SM 2540C	TMK	1
		EPA 9040	HML	1
		EPA 300.0	HMB	3
40269072006	B-31R	EPA 6020B	KXS	2
			AG1	7
		SM 2540C	TMK	1
		EPA 9040	HML	1
		EPA 300.0	HMB	3
40269072007	B-31A	EPA 6020B	KXS	2
			AG1	7
		SM 2540C	TMK	1
		EPA 9040	HML	1
		EPA 300.0	HMB	3
40269072008	FIELD BLANK	EPA 6020B	KXS	2
		SM 2540C	TMK	1

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



Pace Analytical Services, LLC
1241 Bellevue Street - Suite 9
Green Bay, WI 54302
(920)469-2436

SAMPLE ANALYTE COUNT

Project: 25223071 ALLIANT NEL DEW CCR
Pace Project No.: 40269072

Lab ID	Sample ID	Method	Analysts	Analytes Reported
		EPA 9040	HML	1
		EPA 300.0	HMB	3
40269072009	B-39		AG1	1

PASI-G = Pace Analytical Services - Green Bay

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

Page 5 of 23



ANALYTICAL RESULTS

Project: 25223071 ALLIANT NEL DEW CCR

Pace Project No.: 40269072

Sample: B-7R	Lab ID: 40269072001	Collected: 10/03/23 15:00	Received: 10/05/23 09:20	Matrix: Water					
Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS	Analytical Method: EPA 6020B Preparation Method: EPA 3010A Pace Analytical Services - Green Bay								
Boron	144	ug/L	10.0	3.0	1	10/06/23 06:32	10/09/23 19:05	7440-42-8	
Calcium	41000	ug/L	254	76.2	1	10/06/23 06:32	10/09/23 19:05	7440-70-2	P6
Field Data	Analytical Method: Pace Analytical Services - Green Bay								
Field pH	6.30	Std. Units			1		10/03/23 15:00		
Field Specific Conductance	427.4	umhos/cm			1		10/03/23 15:00		
Oxygen, Dissolved	0.39	mg/L			1		10/03/23 15:00	7782-44-7	
REDOX	-79.3	mV			1		10/03/23 15:00		
Turbidity	7.40	NTU			1		10/03/23 15:00		
Static Water Level	604.39	feet			1		10/03/23 15:00		
Temperature, Water (C)	24.8	deg C			1		10/03/23 15:00		
2540C Total Dissolved Solids	Analytical Method: SM 2540C Pace Analytical Services - Green Bay								
Total Dissolved Solids	184	mg/L	20.0	8.7	1		10/05/23 21:48		
9040 pH	Analytical Method: EPA 9040 Pace Analytical Services - Green Bay								
pH at 25 Degrees C	6.4	Std. Units	0.10	0.010	1		10/06/23 13:32		H6
300.0 IC Anions	Analytical Method: EPA 300.0 Pace Analytical Services - Green Bay								
Chloride	4.7	mg/L	2.0	0.59	1		10/17/23 17:19	16887-00-6	
Fluoride	<0.095	mg/L	0.32	0.095	1		10/17/23 17:19	16984-48-8	M0
Sulfate	4.5	mg/L	2.0	0.44	1		10/17/23 17:19	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: 25223071 ALLIANT NEL DEW CCR

Pace Project No.: 40269072

Sample: B-11R	Lab ID: 40269072002	Collected: 10/03/23 09:45	Received: 10/05/23 09:20	Matrix: Water					
Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS	Analytical Method: EPA 6020B Preparation Method: EPA 3010A Pace Analytical Services - Green Bay								
Boron	3120	ug/L	100	30.3	10	10/06/23 06:32	10/10/23 10:15	7440-42-8	
Calcium	90600	ug/L	254	76.2	1	10/06/23 06:32	10/09/23 19:34	7440-70-2	
Field Data	Analytical Method: Pace Analytical Services - Green Bay								
Field pH	6.80	Std. Units			1		10/03/23 09:45		
Field Specific Conductance	810	umhos/cm			1		10/03/23 09:45		
Oxygen, Dissolved	0.21	mg/L			1		10/03/23 09:45	7782-44-7	
REDOX	-11.9	mV			1		10/03/23 09:45		
Turbidity	0.00	NTU			1		10/03/23 09:45		
Static Water Level	603.93	feet			1		10/03/23 09:45		
Temperature, Water (C)	13.8	deg C			1		10/03/23 09:45		
2540C Total Dissolved Solids	Analytical Method: SM 2540C Pace Analytical Services - Green Bay								
Total Dissolved Solids	456	mg/L	20.0	8.7	1		10/05/23 21:48		
9040 pH	Analytical Method: EPA 9040 Pace Analytical Services - Green Bay								
pH at 25 Degrees C	7.1	Std. Units	0.10	0.010	1		10/06/23 13:38		H6
300.0 IC Anions	Analytical Method: EPA 300.0 Pace Analytical Services - Green Bay								
Chloride	41.6	mg/L	2.0	0.59	1		10/17/23 18:03	16887-00-6	
Fluoride	0.20J	mg/L	0.32	0.095	1		10/17/23 18:03	16984-48-8	
Sulfate	58.0	mg/L	2.0	0.44	1		10/17/23 18:03	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: 25223071 ALLIANT NEL DEW CCR
Pace Project No.: 40269072

Sample: B-11A	Lab ID: 40269072003	Collected: 10/03/23 10:30	Received: 10/05/23 09:20	Matrix: Water					
Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS	Analytical Method: EPA 6020B Preparation Method: EPA 3010A Pace Analytical Services - Green Bay								
Boron	231	ug/L	10.0	3.0	1	10/06/23 06:32	10/09/23 19:49	7440-42-8	
Calcium	60300	ug/L	254	76.2	1	10/06/23 06:32	10/09/23 19:49	7440-70-2	
Field Data	Analytical Method: Pace Analytical Services - Green Bay								
Field pH	7.66	Std. Units			1		10/03/23 10:30		
Field Specific Conductance	628	umhos/cm			1		10/03/23 10:30		
Oxygen, Dissolved	0.11	mg/L			1		10/03/23 10:30	7782-44-7	
REDOX	-27.1	mV			1		10/03/23 10:30		
Turbidity	0.00	NTU			1		10/03/23 10:30		
Static Water Level	603.97	feet			1		10/03/23 10:30		
Temperature, Water (C)	13.7	deg C			1		10/03/23 10:30		
2540C Total Dissolved Solids	Analytical Method: SM 2540C Pace Analytical Services - Green Bay								
Total Dissolved Solids	352	mg/L	20.0	8.7	1		10/05/23 21:48		
9040 pH	Analytical Method: EPA 9040 Pace Analytical Services - Green Bay								
pH at 25 Degrees C	7.7	Std. Units	0.10	0.010	1		10/06/23 13:41		H6
300.0 IC Anions	Analytical Method: EPA 300.0 Pace Analytical Services - Green Bay								
Chloride	43.9	mg/L	2.0	0.59	1		10/17/23 18:18	16887-00-6	
Fluoride	0.16J	mg/L	0.32	0.095	1		10/17/23 18:18	16984-48-8	
Sulfate	86.0	mg/L	10.0	2.2	5		10/23/23 13:26	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: 25223071 ALLIANT NEL DEW CCR

Pace Project No.: 40269072

Sample: B-11B	Lab ID: 40269072004	Collected: 10/03/23 11:45	Received: 10/05/23 09:20	Matrix: Water					
Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS	Analytical Method: EPA 6020B Preparation Method: EPA 3010A Pace Analytical Services - Green Bay								
Boron	5040	ug/L	200	60.6	20	10/06/23 06:32	10/10/23 10:30	7440-42-8	
Calcium	80600	ug/L	254	76.2	1	10/06/23 06:32	10/09/23 19:56	7440-70-2	
Field Data	Analytical Method: Pace Analytical Services - Green Bay								
Field pH	7.84	Std. Units			1		10/03/23 11:45		
Field Specific Conductance	1346	umhos/cm			1		10/03/23 11:45		
Oxygen, Dissolved	0.30	mg/L			1		10/03/23 11:45	7782-44-7	
REDOX	40.6	mV			1		10/03/23 11:45		
Turbidity	0.00	NTU			1		10/03/23 11:45		
Static Water Level	603.91	feet			1		10/03/23 11:45		
Temperature, Water (C)	15.1	deg C			1		10/03/23 11:45		
2540C Total Dissolved Solids	Analytical Method: SM 2540C Pace Analytical Services - Green Bay								
Total Dissolved Solids	918	mg/L	20.0	8.7	1		10/05/23 21:48		
9040 pH	Analytical Method: EPA 9040 Pace Analytical Services - Green Bay								
pH at 25 Degrees C	7.8	Std. Units	0.10	0.010	1		10/06/23 13:43		H6
300.0 IC Anions	Analytical Method: EPA 300.0 Pace Analytical Services - Green Bay								
Chloride	25.5	mg/L	20.0	5.9	10		10/17/23 18:33	16887-00-6	
Fluoride	<0.95	mg/L	3.2	0.95	10		10/17/23 18:33	16984-48-8	D3
Sulfate	403	mg/L	20.0	4.4	10		10/17/23 18:33	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: 25223071 ALLIANT NEL DEW CCR

Pace Project No.: 40269072

Sample: B-26	Lab ID: 40269072005	Collected: 10/03/23 12:35	Received: 10/05/23 09:20	Matrix: Water					
Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS	Analytical Method: EPA 6020B Preparation Method: EPA 3010A Pace Analytical Services - Green Bay								
Boron	44.8	ug/L	10.0	3.0	1	10/06/23 06:32	10/09/23 20:04	7440-42-8	
Calcium	85100	ug/L	254	76.2	1	10/06/23 06:32	10/09/23 20:04	7440-70-2	
Field Data	Analytical Method: Pace Analytical Services - Green Bay								
Field pH	7.47	Std. Units			1		10/03/23 12:35		
Field Specific Conductance	810	umhos/cm			1		10/03/23 12:35		
Oxygen, Dissolved	8.35	mg/L			1		10/03/23 12:35	7782-44-7	
REDOX	106.3	mV			1		10/03/23 12:35		
Turbidity	0.00	NTU			1		10/03/23 12:35		
Static Water Level	604.20	feet			1		10/03/23 12:35		
Temperature, Water (C)	11.2	deg C			1		10/03/23 12:35		
2540C Total Dissolved Solids	Analytical Method: SM 2540C Pace Analytical Services - Green Bay								
Total Dissolved Solids	418	mg/L	20.0	8.7	1		10/05/23 21:49		
9040 pH	Analytical Method: EPA 9040 Pace Analytical Services - Green Bay								
pH at 25 Degrees C	7.2	Std. Units	0.10	0.010	1		10/06/23 13:49		H6
300.0 IC Anions	Analytical Method: EPA 300.0 Pace Analytical Services - Green Bay								
Chloride	50.2	mg/L	2.0	0.59	1		10/17/23 18:48	16887-00-6	
Fluoride	<0.095	mg/L	0.32	0.095	1		10/17/23 18:48	16984-48-8	
Sulfate	42.5	mg/L	2.0	0.44	1		10/17/23 18:48	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: 25223071 ALLIANT NEL DEW CCR

Pace Project No.: 40269072

Sample: B-31R	Lab ID: 40269072006	Collected: 10/02/23 14:05	Received: 10/05/23 09:20	Matrix: Water					
Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS	Analytical Method: EPA 6020B Preparation Method: EPA 3010A Pace Analytical Services - Green Bay								
Boron	519	ug/L	10.0	3.0	1	10/06/23 06:32	10/09/23 20:41	7440-42-8	
Calcium	114000	ug/L	254	76.2	1	10/06/23 06:32	10/09/23 20:41	7440-70-2	
Field Data	Analytical Method: Pace Analytical Services - Green Bay								
Field pH	6.82	Std. Units			1		10/02/23 14:05		
Field Specific Conductance	898	umhos/cm			1		10/02/23 14:05		
Oxygen, Dissolved	0.19	mg/L			1		10/02/23 14:05	7782-44-7	
REDOX	-36.7	mV			1		10/02/23 14:05		
Turbidity	4.56	NTU			1		10/02/23 14:05		
Static Water Level	603.98	feet			1		10/02/23 14:05		
Temperature, Water (C)	14.2	deg C			1		10/02/23 14:05		
2540C Total Dissolved Solids	Analytical Method: SM 2540C Pace Analytical Services - Green Bay								
Total Dissolved Solids	536	mg/L	20.0	8.7	1		10/05/23 21:45		
9040 pH	Analytical Method: EPA 9040 Pace Analytical Services - Green Bay								
pH at 25 Degrees C	6.8	Std. Units	0.10	0.010	1		10/06/23 13:53		H6
300.0 IC Anions	Analytical Method: EPA 300.0 Pace Analytical Services - Green Bay								
Chloride	19.3	mg/L	2.0	0.59	1		10/17/23 19:03	16887-00-6	
Fluoride	0.14J	mg/L	0.32	0.095	1		10/17/23 19:03	16984-48-8	
Sulfate	103	mg/L	10.0	2.2	5		10/23/23 13:41	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: 25223071 ALLIANT NEL DEW CCR

Pace Project No.: 40269072

Sample: B-31A	Lab ID: 40269072007	Collected: 10/02/23 18:20	Received: 10/05/23 09:20	Matrix: Water					
Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS	Analytical Method: EPA 6020B Preparation Method: EPA 3010A Pace Analytical Services - Green Bay								
Boron	191	ug/L	10.0	3.0	1	10/06/23 06:32	10/09/23 20:48	7440-42-8	
Calcium	48300	ug/L	254	76.2	1	10/06/23 06:32	10/09/23 20:48	7440-70-2	
Field Data	Analytical Method: Pace Analytical Services - Green Bay								
Field pH	7.67	Std. Units			1		10/02/23 18:20		
Field Specific Conductance	522.8	umhos/cm			1		10/02/23 18:20		
Oxygen, Dissolved	0.27	mg/L			1		10/02/23 18:20	7782-44-7	
REDOX	-32.3	mV			1		10/02/23 18:20		
Turbidity	0.00	NTU			1		10/02/23 18:20		
Static Water Level	603.95	feet			1		10/02/23 18:20		
Temperature, Water (C)	13.4	deg C			1		10/02/23 18:20		
2540C Total Dissolved Solids	Analytical Method: SM 2540C Pace Analytical Services - Green Bay								
Total Dissolved Solids	274	mg/L	20.0	8.7	1		10/05/23 21:45		
9040 pH	Analytical Method: EPA 9040 Pace Analytical Services - Green Bay								
pH at 25 Degrees C	7.7	Std. Units	0.10	0.010	1		10/06/23 13:56		H6
300.0 IC Anions	Analytical Method: EPA 300.0 Pace Analytical Services - Green Bay								
Chloride	55.7	mg/L	2.0	0.59	1		10/17/23 20:04	16887-00-6	
Fluoride	0.14J	mg/L	0.32	0.095	1		10/17/23 20:04	16984-48-8	
Sulfate	20.0	mg/L	2.0	0.44	1		10/17/23 20:04	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: 25223071 ALLIANT NEL DEW CCR

Pace Project No.: 40269072

Sample: FIELD BLANK	Lab ID: 40269072008	Collected: 10/02/23 18:35	Received: 10/05/23 09:20	Matrix: Water					
Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS	Analytical Method: EPA 6020B Preparation Method: EPA 3010A Pace Analytical Services - Green Bay								
Boron	<3.0	ug/L	10.0	3.0	1	10/06/23 06:32	10/09/23 18:58	7440-42-8	
Calcium	<76.2	ug/L	254	76.2	1	10/06/23 06:32	10/09/23 18:58	7440-70-2	
2540C Total Dissolved Solids	Analytical Method: SM 2540C Pace Analytical Services - Green Bay								
Total Dissolved Solids	<8.7	mg/L	20.0	8.7	1		10/05/23 21:45		
9040 pH	Analytical Method: EPA 9040 Pace Analytical Services - Green Bay								
pH at 25 Degrees C	6.1	Std. Units	0.10	0.010	1		10/06/23 14:06		H6
300.0 IC Anions	Analytical Method: EPA 300.0 Pace Analytical Services - Green Bay								
Chloride	<0.59	mg/L	2.0	0.59	1		10/17/23 20:18	16887-00-6	
Fluoride	<0.095	mg/L	0.32	0.095	1		10/17/23 20:18	16984-48-8	
Sulfate	<0.44	mg/L	2.0	0.44	1		10/17/23 20:18	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



Pace Analytical Services, LLC
1241 Bellevue Street - Suite 9
Green Bay, WI 54302
(920)469-2436

ANALYTICAL RESULTS

Project: 25223071 ALLIANT NEL DEW CCR

Pace Project No.: 40269072

Sample: B-39 Lab ID: 40269072009 Collected: 10/03/23 00:00 Received: 10/17/23 16:58 Matrix: Water

Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
Field Data	Analytical Method: Pace Analytical Services - Green Bay								
Static Water Level	604.04	feet			1		10/03/23 00:00		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

Date: 10/24/2023 03:55 PM

Page 14 of 23

02/26/2025 - Classification: Internal - ECRM13462147



QUALITY CONTROL DATA

Project: 25223071 ALLIANT NEL DEW CCR

Pace Project No.: 40269072

QC Batch:	456780	Analysis Method:	EPA 6020B
QC Batch Method:	EPA 3010A	Analysis Description:	6020B MET
Laboratory:	Pace Analytical Services - Green Bay		
Associated Lab Samples:	40269072001, 40269072002, 40269072003, 40269072004, 40269072005, 40269072006, 40269072007, 40269072008		

METHOD BLANK: 2623041 Matrix: Water

Associated Lab Samples: 40269072001, 40269072002, 40269072003, 40269072004, 40269072005, 40269072006, 40269072007, 40269072008

Parameter	Units	Blank	Reporting		Qualifiers
		Result	Limit	Analyzed	
Boron	ug/L	<3.0	10.0	10/09/23 15:37	
Calcium	ug/L	<76.2	254	10/09/23 15:37	

LABORATORY CONTROL SAMPLE: 2623042

Parameter	Units	Spike	LCS	LCS	% Rec	Qualifiers
		Conc.	Result	% Rec	Limits	
Boron	ug/L	250	218	87	80-120	
Calcium	ug/L	10000	10400	104	80-120	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 2623043 2623044

Parameter	Units	MS	MSD	MS	MSD	MS	MSD	% Rec	% Rec	RPD	RPD	Max
		40269072001	Spike	Spike	Result	Result	% Rec	Limits	RPD	RPD	Qual	
Boron	ug/L	144	250	250	364	355	88	84	75-125	2	20	
Calcium	ug/L	41000	10000	10000	54200	52000	132	110	75-125	4	20	P6

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,

without the written consent of Pace Analytical Services, LLC.

Date: 10/24/2023 03:55 PM

Page 15 of 23

02/26/2025 - Classification: Internal - ECRM13462147



QUALITY CONTROL DATA

Project: 25223071 ALLIANT NEL DEW CCR

Pace Project No.: 40269072

QC Batch:	456763	Analysis Method:	SM 2540C
QC Batch Method:	SM 2540C	Analysis Description:	2540C Total Dissolved Solids
		Laboratory:	Pace Analytical Services - Green Bay
Associated Lab Samples:	40269072001, 40269072002, 40269072003, 40269072004, 40269072005, 40269072006, 40269072007, 40269072008		

METHOD BLANK: 2622975 Matrix: Water

Associated Lab Samples: 40269072001, 40269072002, 40269072003, 40269072004, 40269072005, 40269072006, 40269072007, 40269072008

Parameter	Units	Blank Result	Reporting Limit	Analyzed	Qualifiers
Total Dissolved Solids	mg/L	<8.7	20.0	10/05/23 21:44	

LABORATORY CONTROL SAMPLE: 2622976

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Total Dissolved Solids	mg/L	587	508	87	80-120	

SAMPLE DUPLICATE: 2622977

Parameter	Units	40268964001 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	460	444	4	10	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



QUALITY CONTROL DATA

Project: 25223071 ALLIANT NEL DEW CCR

Pace Project No.: 40269072

QC Batch: 456823 Analysis Method: EPA 9040

QC Batch Method: EPA 9040 Analysis Description: 9040 pH

Laboratory: Pace Analytical Services - Green Bay

Associated Lab Samples: 40269072001, 40269072002, 40269072003, 40269072004, 40269072005, 40269072006, 40269072007,
40269072008

SAMPLE DUPLICATE: 2623217

Parameter	Units	40268907001 Result	Dup Result	RPD	Max RPD	Qualifiers
pH at 25 Degrees C	Std. Units	8.2	8.2	0	20	H6

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,

without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: 25223071 ALLIANT NEL DEW CCR

Pace Project No.: 40269072

QC Batch:	457421	Analysis Method:	EPA 300.0
QC Batch Method:	EPA 300.0	Analysis Description:	300.0 IC Anions
		Laboratory:	Pace Analytical Services - Green Bay
Associated Lab Samples:	40269072001, 40269072002, 40269072003, 40269072004, 40269072005, 40269072006, 40269072007, 40269072008		

METHOD BLANK: 2626813 Matrix: Water

Associated Lab Samples: 40269072001, 40269072002, 40269072003, 40269072004, 40269072005, 40269072006, 40269072007, 40269072008

Parameter	Units	Blank	Reporting		Qualifiers
		Result	Limit	Analyzed	
Chloride	mg/L	<0.59	2.0	10/17/23 13:32	
Fluoride	mg/L	<0.095	0.32	10/17/23 13:32	
Sulfate	mg/L	<0.44	2.0	10/17/23 13:32	

LABORATORY CONTROL SAMPLE: 2626814

Parameter	Units	Spike	LCS		% Rec		Qualifiers
		Conc.	Result	% Rec	Limits		
Chloride	mg/L	20	21.2	106	90-110		
Fluoride	mg/L	2	2.1	107	90-110		
Sulfate	mg/L	20	21.3	106	90-110		

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 2626815 2626816

Parameter	Units	MS		MSD				% Rec	Limits	RPD	Max
		40269050001	Spike	Spike	MS	MSD	MS				
Chloride	mg/L	415	400	400	807	800	98	96	90-110	1	15
Sulfate	mg/L	47.0	400	400	461	457	103	103	90-110	1	15

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 2626817 2626818

Parameter	Units	MS		MSD				% Rec	Limits	RPD	Max
		40269072001	Spike	Spike	MS	MSD	MS				
Chloride	mg/L	4.7	20	20	25.2	25.5	102	104	90-110	1	15
Fluoride	mg/L	<0.095	2	2	2.3	2.3	114	115	90-110	1	15
Sulfate	mg/L	4.5	20	20	25.5	25.7	105	106	90-110	1	15

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,

without the written consent of Pace Analytical Services, LLC.

Date: 10/24/2023 03:55 PM

Page 18 of 23

02/26/2025 - Classification: Internal - ECRM13462147

QUALIFIERS

Project: 25223071 ALLIANT NEL DEW CCR

Pace Project No.: 40269072

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above LOD.

J - Estimated concentration at or above the LOD and below the LOQ.

LOD - Limit of Detection adjusted for dilution factor, percent moisture, initial weight and final volume.

LOQ - Limit of Quantitation adjusted for dilution factor, percent moisture, initial weight and final volume.

DL - Adjusted Method Detection Limit.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected at or above the adjusted LOD.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

ANALYTE QUALIFIERS

D3 Sample was diluted due to the presence of high levels of non-target analytes or other matrix interference.

H6 Analysis initiated outside of the 15 minute EPA required holding time.

M0 Matrix spike recovery and/or matrix spike duplicate recovery was outside laboratory control limits.

P6 Matrix spike recovery was outside laboratory control limits due to a parent sample concentration notably higher than the spike level.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: 25223071 ALLIANT NEL DEW CCR

Pace Project No.: 40269072

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
40269072001	B-7R	EPA 3010A	456780	EPA 6020B	456850
40269072002	B-11R	EPA 3010A	456780	EPA 6020B	456850
40269072003	B-11A	EPA 3010A	456780	EPA 6020B	456850
40269072004	B-11B	EPA 3010A	456780	EPA 6020B	456850
40269072005	B-26	EPA 3010A	456780	EPA 6020B	456850
40269072006	B-31R	EPA 3010A	456780	EPA 6020B	456850
40269072007	B-31A	EPA 3010A	456780	EPA 6020B	456850
40269072008	FIELD BLANK	EPA 3010A	456780	EPA 6020B	456850
40269072001	B-7R				
40269072002	B-11R				
40269072003	B-11A				
40269072004	B-11B				
40269072005	B-26				
40269072006	B-31R				
40269072007	B-31A				
40269072009	B-39				
40269072001	B-7R	SM 2540C	456763		
40269072002	B-11R	SM 2540C	456763		
40269072003	B-11A	SM 2540C	456763		
40269072004	B-11B	SM 2540C	456763		
40269072005	B-26	SM 2540C	456763		
40269072006	B-31R	SM 2540C	456763		
40269072007	B-31A	SM 2540C	456763		
40269072008	FIELD BLANK	SM 2540C	456763		
40269072001	B-7R	EPA 9040	456823		
40269072002	B-11R	EPA 9040	456823		
40269072003	B-11A	EPA 9040	456823		
40269072004	B-11B	EPA 9040	456823		
40269072005	B-26	EPA 9040	456823		
40269072006	B-31R	EPA 9040	456823		
40269072007	B-31A	EPA 9040	456823		
40269072008	FIELD BLANK	EPA 9040	456823		
40269072001	B-7R	EPA 300.0	457421		
40269072002	B-11R	EPA 300.0	457421		
40269072003	B-11A	EPA 300.0	457421		
40269072004	B-11B	EPA 300.0	457421		
40269072005	B-26	EPA 300.0	457421		
40269072006	B-31R	EPA 300.0	457421		
40269072007	B-31A	EPA 300.0	457421		
40269072008	FIELD BLANK	EPA 300.0	457421		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
 without the written consent of Pace Analytical Services, LLC.

402C9072



Submitting a sample via this chain of custody constitutes acknowledgment and acceptance of the Pace Terms and Conditions found at <https://info.pacelabs.com/hubs/pas-standard-terms.pdf>

Section A Required Client Information:		Section B Required Project Information:		Section C Invoice Information:		Page : 1 Of 1																																																																																							
Company Address Madison, WI 53718 Email Phone Requested Due Date	SCS ENGINEERS 2830 Dairy Drive mblodgett@scsengineers.com 608-216-7362 Standard TAT	Report To Copy To Purchase Order # Project Name Project #	Meghan Blodgett Pace Quote 25216071 Alliant Nelson Dewey CCR dan.mlewsky@pacelabs.com, 25223071	Attention Company Name Address Pace Project Manager Pace Profile #.			Regulatory Agency State / Location WI																																																																																						
ITEM #	SAMPLE ID One Character per box. (A-Z, 0-9 / , -) Sample Ids must be unique	MATRIX Drinking Water Water Waste Water Product Soil/Solid Oil Wipe Air Other Tissue	CODE DW WT WW P SL OL WP AR OT TS	MATRIX CODE (see valid codes to left) (G=GRAB C=COMP) SAMPLE TYPE	COLLECTED		SAMPLE TEMP AT COLLECTION # OF CONTAINERS	Preservatives						Requested Analysis Filtered (Y/N)						Residual Chlorine (Y/N)																																																																									
					START DATE	TIME		END DATE	TIME	H2SO4	HNO3	HCl	NaOH	Na2SO3	Methanol	Other	Analyses Test Y/N	Metals, Total (B, Cd) N	Chloride, Fluoride & Sulfate, Total pH		TDS																																																																								
1	B-7R	WT	10/3	1500			3	2	1			X	X	X	X							001																																																																							
2	B-11R	WT	10/3	945			1	1	1			X	X	X	X							002																																																																							
3	B-11A	WT	10/3	1030			1	1	1			X	X	X	X							003																																																																							
4	B-11B	WT	10/3	1145			1	1	1			X	X	X	X							004																																																																							
5	B-26	WT	10/3	1235			1	1	1			X	X	X	X							005																																																																							
6	B-31R	WT	10/2	1405			1	1	1			X	X	X	X							006																																																																							
7	B-31A	WT	10/2	1820			1	1	1			X	X	X	X							007																																																																							
8	Field Blank	WT	10/2	1835			1	1	1			X	X	X	X							008																																																																							
9																																																																																													
10																																																																																													
11																																																																																													
12																																																																																													
ADDITIONAL COMMENTS				RELINQUISHED BY / AFFILIATION		DATE	TIME	ACCEPTED BY / AFFILIATION						DATE	TIME	SAMPLE CONDITIONS																																																																													
				Bri Salome/SCS Logistics		10/4	1230	Lynn Kyle Pace 10/5/23 0920						10/4/2023	10:00	Y	Y	Y																																																																											
<table border="1"> <tr> <td colspan="18">SAMPLER NAME AND SIGNATURE</td> </tr> <tr> <td colspan="18">PRINT Name of SAMPLER: Bri Salome</td> </tr> <tr> <td colspan="12">SIGNATURE of SAMPLER: </td> <td colspan="6">DATE Signed 10/4/2023</td> </tr> <tr> <td colspan="18"></td> </tr> </table>																		SAMPLER NAME AND SIGNATURE																		PRINT Name of SAMPLER: Bri Salome																		SIGNATURE of SAMPLER:												DATE Signed 10/4/2023																								TEMP in C	Received on Ice (Y/N)	Custody Sealed Cooler (Y/N)	Samples Intact (Y/N)
SAMPLER NAME AND SIGNATURE																																																																																													
PRINT Name of SAMPLER: Bri Salome																																																																																													
SIGNATURE of SAMPLER:												DATE Signed 10/4/2023																																																																																	

Effective Date: 8/16/2022

Client Name: *SCS*All containers needing preservation have been checked and noted below
Lab Lot# of pH paper.

Sample Preservation Receipt Form

Project # *40269072* Yes No N/ALab Std #ID of preservation (if pH adjusted) *10022723*Initial when completed. *8/16/22*
Date/ Time.

Pace Lab #	AG1U	BG1U	AG1H	AG4S	AG5U	AG2S	BG3U	BP1U	BP3U	BP3B	BP3N	BP2Z	VG9C	DG9T	VG9U	VG9H	VG9M	VG9D	JGFU	JG9U	WGFU	WPFU	SP5T	ZPLC	GN 1	GN 2	VOA Vials (>6mm)*	H2SO4 pH ≤2	NaOH+Zn Act pH ≥9	NaOH pH ≥12	HNO3 pH ≤2	pH after adjusted	Volume (mL)
001								2																						2.5 / 5			
002								2																						2.5 / 5			
003								2																						2.5 / 5			
004								2																						2.5 / 5			
005								2																						2.5 / 5			
006								2																						2.5 / 5			
007								2																						2.5 / 5			
008								2																						2.5 / 5			
009	/																													2.5 / 5			
010																														2.5 / 5			
011																														2.5 / 5			
012																														2.5 / 5			
013																														2.5 / 5			
014																														2.5 / 5			
015																														2.5 / 5			
016																														2.5 / 5			
017																														2.5 / 5			
018																														2.5 / 5			
019																														2.5 / 5			
020																														2.5 / 5			

Exceptions to preservation check VOA, Coliform, TOC, TOX, TOH, O&G, WI DRO, Phenolics, Other:

Headspace in VOA Vials (>6mm) Yes No N/A *If yes look in headspace column

AG1U	1 liter amber glass	BP1U	1 liter plastic unpres	VG9C	40 mL clear ascorbic w/ HCl	JGFU	4 oz amber jar unpres
BG1U	1 liter clear glass	BP3U	250 mL plastic unpres	DG9T	40 mL amber Na Thio	JG9U	9 oz amber jar unpres
AG1H	1 liter amber glass HCL	BP3B	250 mL plastic NaOH	VG9U	40 mL clear vial unpres	WGFU	4 oz clear jar unpres
AG4S	125 mL amber glass H2SO4	BP3N	250 mL plastic HNO3	VG9H	40 mL clear vial HCL	WPFU	4 oz plastic jar unpres
AG5U	100 mL amber glass unpres	BP3S	250 mL plastic H2SO4	VG9M	40 mL clear vial MeOH	SP5T	120 mL plastic Na Thiosulfate
AG2S	500 mL amber glass H2SO4	BP2Z	500 mL plastic NaOH + Zn	VG9D	40 mL clear vial DI	ZPLC	ziploc bag
BG3U	250 mL clear glass unpres					GN 1	
						GN 2	

Page 1 of *2*

Sample Condition Upon Receipt Form (SCUR)

Project #:

Client Name: SCSCourier: CS Logistics Fed Ex Speedee UPS Waltco
 Client Pace Other: _____

WO# : 40269072



40269072

Tracking #:

Custody Seal on Cooler/Box Present: yes no Seals intact: yes noCustody Seal on Samples Present: yes no Seals intact: yes noPacking Material: Bubble Wrap Bubble Bags None OtherThermometer Used SR - 117 Type of Ice: Wet Blue Dry None Meltwater OnlyCooler Temperature Uncorr. 0.5 /Corr. 1.0Temp Blank Present: yes noBiological Tissue is Frozen: yes no

Temp should be above freezing to 6°C.

Biota Samples may be received at ≤ 0°C if shipped on Dry Ice.

Person examining contents:

Date: 10/05/23 Initials: SCULabeled By Initials: R.A

Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1.
Chain of Custody Filled Out:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	2.
Chain of Custody Relinquished:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	3.
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	4.
Samples Arrived within Hold Time: - DI VOA Samples frozen upon receipt	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	5. Date/Time:
Short Hold Time Analysis (<72hr):	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	6.
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	7.
Sufficient Volume: For Analysis: <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No MS/MSD: <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	8.	
Correct Containers Used:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	9.
Correct Type <u>Pace Green Bay, Pace IR, Non-Pace</u>		
Containers Intact:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	10.
Filtered volume received for Dissolved tests	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	11.
Sample Labels match COC: -Includes date/time/ID/Analysis	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	12. <u>003 - time 1050.</u> <u>10/05/23</u> <u>SCU</u>
Trip Blank Present:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	13.
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	
Pace Trip Blank Lot # (if purchased):		

Client Notification/ Resolution:

If checked, see attached form for additional comments

Person Contacted: _____ Date/Time: _____

Comments/ Resolution: _____

PM Review is documented electronically in LIMs. By releasing the project, the PM acknowledges they have reviewed the sample log in

Page 2 of 2



Pace Analytical Services, LLC
1241 Bellevue Street - Suite 9
Green Bay, WI 54302
(920)469-2436

May 16, 2024

Meghan Blodgett
SCS ENGINEERS
2830 Dairy Drive
Madison, WI 53718

RE: Project: 25224071 ALLIANT NELS DEW CCR
Pace Project No.: 40277408

Dear Meghan Blodgett:

Enclosed are the analytical results for sample(s) received by the laboratory between April 26, 2024 and May 06, 2024. The results relate only to the samples included in this report. Results reported herein conform to the applicable TNI/NELAC Standards and the laboratory's Quality Manual, where applicable, unless otherwise noted in the body of the report.

The test results provided in this final report were generated by each of the following laboratories within the Pace Network:

- Pace Analytical Services - Green Bay

If you have any questions concerning this report, please feel free to contact me.

Sincerely,

Tod Noltemeyer

Tod Noltemeyer for
Dan Milewsky
dan.milewsky@pacelabs.com
(920)469-2436
Project Manager

Enclosures

cc: Matt Bizjack, Alliant Energy
Natalie Burris, SCS ENGINEERS
Sherren Clark, SCS Engineers
Jenny Coughlin, Alliant Energy
Tom Karwoski, SCS ENGINEERS
Ryan Matzuk, SCS Engineers
Jeff Maxted, ALLIANT ENERGY



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



CERTIFICATIONS

Project: 25224071 ALLIANT NELS DEW CCR
Pace Project No.: 40277408

Pace Analytical Services Green Bay

1241 Bellevue Street, Green Bay, WI 54302
Florida/NELAP Certification #: E87948
Illinois Certification #: 200050
Kentucky UST Certification #: 82
Louisiana Certification #: 04168
Minnesota Certification #: 055-999-334
New York Certification #: 12064
North Dakota Certification #: R-150

South Carolina Certification #: 83006001
Texas Certification #: T104704529-21-8
Virginia VELAP Certification ID: 11873
Wisconsin Certification #: 405132750
Wisconsin DATCP Certification #: 105-444
USDA Soil Permit #: P330-21-00008
Federal Fish & Wildlife Permit #: 51774A

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



SAMPLE SUMMARY

Project: 25224071 ALLIANT NELS DEW CCR
Pace Project No.: 40277408

Lab ID	Sample ID	Matrix	Date Collected	Date Received
40277408001	B-7R	Water	04/23/24 14:45	04/26/24 08:00
40277408002	B-11R	Water	04/24/24 09:55	04/26/24 08:00
40277408003	B-11A	Water	04/24/24 10:05	04/26/24 08:00
40277408004	B-11B	Water	04/23/24 17:30	04/26/24 08:00
40277408005	B-26	Water	04/24/24 11:55	04/26/24 08:00
40277408006	B-31R	Water	04/23/24 15:50	04/26/24 08:00
40277408007	B-31A	Water	04/23/24 16:50	04/26/24 08:00
40277408008	FIELD BLANK	Water	04/24/24 15:00	04/26/24 08:00
40277408009	B-39	Water	04/24/24 00:00	05/06/24 00:00

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



SAMPLE ANALYTE COUNT

Project: 25224071 ALLIANT NELS DEW CCR
Pace Project No.: 40277408

Lab ID	Sample ID	Method	Analysts	Analytes Reported
40277408001	B-7R	EPA 6020B	KXS	2
			LB	7
		SM 2540C	LMB	1
		EPA 9040	HML	1
		EPA 300.0	HMB	3
40277408002	B-11R	EPA 6020B	KXS	2
			LB	7
		SM 2540C	LMB	1
		EPA 9040	HML	1
		EPA 300.0	HMB	3
40277408003	B-11A	EPA 6020B	KXS	2
			LB	7
		SM 2540C	LMB	1
		EPA 9040	HML	1
		EPA 300.0	HMB	3
40277408004	B-11B	EPA 6020B	KXS	2
			LB	7
		SM 2540C	LMB	1
		EPA 9040	HML	1
		EPA 300.0	HMB	3
40277408005	B-26	EPA 6020B	KXS	2
			LB	7
		SM 2540C	LMB	1
		EPA 9040	HML	1
		EPA 300.0	HMB	3
40277408006	B-31R	EPA 6020B	KXS	2
			LB	7
		SM 2540C	LMB	1
		EPA 9040	HML	1
		EPA 300.0	HMB	3
40277408007	B-31A	EPA 6020B	KXS	2
			LB	7
		SM 2540C	LMB	1
		EPA 9040	HML	1
		EPA 300.0	HMB	3
40277408008	FIELD BLANK	EPA 6020B	KXS	2
		SM 2540C	LMB	1

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



Pace Analytical Services, LLC
1241 Bellevue Street - Suite 9
Green Bay, WI 54302
(920)469-2436

SAMPLE ANALYTE COUNT

Project: 25224071 ALLIANT NELS DEW CCR

Pace Project No.: 40277408

Lab ID	Sample ID	Method	Analysts	Analytes Reported
		EPA 9040	HML	1
		EPA 300.0	HMB	3
40277408009	B-39		LB	1

PASI-G = Pace Analytical Services - Green Bay

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

Page 5 of 24



ANALYTICAL RESULTS

Project: 25224071 ALLIANT NELS DEW CCR

Pace Project No.: 40277408

Sample: B-7R	Lab ID: 40277408001	Collected: 04/23/24 14:45	Received: 04/26/24 08:00	Matrix: Water					
Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS	Analytical Method: EPA 6020B Preparation Method: EPA 3010A Pace Analytical Services - Green Bay								
Boron	134	ug/L	10.0	3.0	1	05/01/24 05:47	05/03/24 22:18	7440-42-8	
Calcium	52300	ug/L	254	76.2	1	05/01/24 05:47	05/03/24 22:18	7440-70-2	
Field Data	Analytical Method: Pace Analytical Services - Green Bay								
Field pH	6.33	Std. Units			1		04/23/24 14:45		
Field Specific Conductance	459.6	umhos/cm			1		04/23/24 14:45		
Oxygen, Dissolved	2.07	mg/L			1		04/23/24 14:45	7782-44-7	
REDOX	-297.3	mV			1		04/23/24 14:45		
Turbidity	3.20	NTU			1		04/23/24 14:45		
Static Water Level	606.66	feet			1		04/23/24 14:45		
Temperature, Water (C)	11.5	deg C			1		04/23/24 14:45		
2540C Total Dissolved Solids	Analytical Method: SM 2540C Pace Analytical Services - Green Bay								
Total Dissolved Solids	232	mg/L	20.0	8.7	1		04/29/24 14:46		
9040 pH	Analytical Method: EPA 9040 Pace Analytical Services - Green Bay								
pH at 25 Degrees C	8.2	Std. Units	0.10	0.010	1		05/07/24 16:24		H6
300.0 IC Anions	Analytical Method: EPA 300.0 Pace Analytical Services - Green Bay								
Chloride	8.2J	mg/L	10.0	3.0	5		05/13/24 13:11	16887-00-6	D3
Fluoride	<0.48	mg/L	1.6	0.48	5		05/13/24 13:11	16984-48-8	D3,M0, R1
Sulfate	<2.2	mg/L	10.0	2.2	5		05/13/24 13:11	14808-79-8	D3

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: 25224071 ALLIANT NELS DEW CCR

Pace Project No.: 40277408

Sample: B-11R	Lab ID: 40277408002	Collected: 04/24/24 09:55	Received: 04/26/24 08:00	Matrix: Water					
Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS	Analytical Method: EPA 6020B Preparation Method: EPA 3010A Pace Analytical Services - Green Bay								
Boron	2640	ug/L	200	60.6	20	05/01/24 05:47	05/06/24 15:17	7440-42-8	
Calcium	96700	ug/L	254	76.2	1	05/01/24 05:47	05/03/24 22:28	7440-70-2	
Field Data	Analytical Method: Pace Analytical Services - Green Bay								
Field pH	6.89	Std. Units			1		04/24/24 09:55		
Field Specific Conductance	878	umhos/cm			1		04/24/24 09:55		
Oxygen, Dissolved	0.30	mg/L			1		04/24/24 09:55	7782-44-7	
REDOX	-40.1	mV			1		04/24/24 09:55		
Turbidity	3.25	NTU			1		04/24/24 09:55		
Static Water Level	606.72	feet			1		04/24/24 09:55		
Temperature, Water (C)	11.4	deg C			1		04/24/24 09:55		
2540C Total Dissolved Solids	Analytical Method: SM 2540C Pace Analytical Services - Green Bay								
Total Dissolved Solids	536	mg/L	20.0	8.7	1		04/30/24 13:15		
9040 pH	Analytical Method: EPA 9040 Pace Analytical Services - Green Bay								
pH at 25 Degrees C	8.4	Std. Units	0.10	0.010	1		05/07/24 16:27		H6
300.0 IC Anions	Analytical Method: EPA 300.0 Pace Analytical Services - Green Bay								
Chloride	35.8	mg/L	2.0	0.59	1		05/13/24 14:37	16887-00-6	
Fluoride	0.27J	mg/L	0.32	0.095	1		05/13/24 14:37	16984-48-8	
Sulfate	64.8	mg/L	10.0	2.2	5		05/14/24 05:14	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: 25224071 ALLIANT NELS DEW CCR

Pace Project No.: 40277408

Sample: B-11A	Lab ID: 40277408003	Collected: 04/24/24 10:05	Received: 04/26/24 08:00	Matrix: Water					
Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS	Analytical Method: EPA 6020B Preparation Method: EPA 3010A Pace Analytical Services - Green Bay								
Boron	715	ug/L	10.0	3.0	1	05/01/24 05:47	05/03/24 22:34	7440-42-8	
Calcium	63900	ug/L	254	76.2	1	05/01/24 05:47	05/03/24 22:34	7440-70-2	
Field Data	Analytical Method: Pace Analytical Services - Green Bay								
Field pH	7.82	Std. Units			1		04/24/24 10:05		
Field Specific Conductance	716	umhos/cm			1		04/24/24 10:05		
Oxygen, Dissolved	0.59	mg/L			1		04/24/24 10:05	7782-44-7	
REDOX	-261.5	mV			1		04/24/24 10:05		
Turbidity	2.84	NTU			1		04/24/24 10:05		
Static Water Level	606.86	feet			1		04/24/24 10:05		
Temperature, Water (C)	12.5	deg C			1		04/24/24 10:05		
2540C Total Dissolved Solids	Analytical Method: SM 2540C Pace Analytical Services - Green Bay								
Total Dissolved Solids	478	mg/L	20.0	8.7	1		04/30/24 13:16		
9040 pH	Analytical Method: EPA 9040 Pace Analytical Services - Green Bay								
pH at 25 Degrees C	8.5	Std. Units	0.10	0.010	1		05/07/24 16:31		H6
300.0 IC Anions	Analytical Method: EPA 300.0 Pace Analytical Services - Green Bay								
Chloride	35.1	mg/L	2.0	0.59	1		05/13/24 14:52	16887-00-6	
Fluoride	0.23J	mg/L	0.32	0.095	1		05/13/24 14:52	16984-48-8	
Sulfate	155	mg/L	20.0	4.4	10		05/14/24 06:12	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: 25224071 ALLIANT NELS DEW CCR

Pace Project No.: 40277408

Sample: B-11B	Lab ID: 40277408004	Collected: 04/23/24 17:30	Received: 04/26/24 08:00	Matrix: Water					
Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS	Analytical Method: EPA 6020B Preparation Method: EPA 3010A Pace Analytical Services - Green Bay								
Boron	5630	ug/L	500	152	50	05/01/24 05:47	05/06/24 15:23	7440-42-8	
Calcium	171000	ug/L	254	76.2	1	05/01/24 05:47	05/03/24 22:50	7440-70-2	
Field Data	Analytical Method: Pace Analytical Services - Green Bay								
Field pH	7.36	Std. Units			1		04/23/24 17:30		
Field Specific Conductance	1301	umhos/cm			1		04/23/24 17:30		
Oxygen, Dissolved	1.17	mg/L			1		04/23/24 17:30	7782-44-7	
REDOX	-248.7	mV			1		04/23/24 17:30		
Turbidity	0.40	NTU			1		04/23/24 17:30		
Static Water Level	606.66	feet			1		04/23/24 17:30		
Temperature, Water (C)	13.4	deg C			1		04/23/24 17:30		
2540C Total Dissolved Solids	Analytical Method: SM 2540C Pace Analytical Services - Green Bay								
Total Dissolved Solids	1010	mg/L	20.0	8.7	1		04/29/24 14:46		
9040 pH	Analytical Method: EPA 9040 Pace Analytical Services - Green Bay								
pH at 25 Degrees C	8.4	Std. Units	0.10	0.010	1		05/07/24 16:33		H6
300.0 IC Anions	Analytical Method: EPA 300.0 Pace Analytical Services - Green Bay								
Chloride	25.1	mg/L	2.0	0.59	1		05/13/24 15:06	16887-00-6	
Fluoride	0.43	mg/L	0.32	0.095	1		05/13/24 15:06	16984-48-8	
Sulfate	435	mg/L	40.0	8.9	20		05/14/24 13:21	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: 25224071 ALLIANT NELS DEW CCR

Pace Project No.: 40277408

Sample: B-26	Lab ID: 40277408005	Collected: 04/24/24 11:55	Received: 04/26/24 08:00	Matrix: Water					
Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS	Analytical Method: EPA 6020B Preparation Method: EPA 3010A Pace Analytical Services - Green Bay								
Boron	44.8	ug/L	10.0	3.0	1	05/01/24 05:47	05/03/24 22:55	7440-42-8	
Calcium	79600	ug/L	254	76.2	1	05/01/24 05:47	05/03/24 22:55	7440-70-2	
Field Data	Analytical Method: Pace Analytical Services - Green Bay								
Field pH	7.23	Std. Units			1		04/24/24 11:55		
Field Specific Conductance	760	umhos/cm			1		04/24/24 11:55		
Oxygen, Dissolved	9.28	mg/L			1		04/24/24 11:55	7782-44-7	
REDOX	31.4	mV			1		04/24/24 11:55		
Turbidity	3.11	NTU			1		04/24/24 11:55		
Static Water Level	606.51	feet			1		04/24/24 11:55		
Temperature, Water (C)	11.1	deg C			1		04/24/24 11:55		
2540C Total Dissolved Solids	Analytical Method: SM 2540C Pace Analytical Services - Green Bay								
Total Dissolved Solids	448	mg/L	20.0	8.7	1		04/30/24 13:16		
9040 pH	Analytical Method: EPA 9040 Pace Analytical Services - Green Bay								
pH at 25 Degrees C	8.6	Std. Units	0.10	0.010	1		05/07/24 16:36		H6
300.0 IC Anions	Analytical Method: EPA 300.0 Pace Analytical Services - Green Bay								
Chloride	43.5	mg/L	2.0	0.59	1		05/13/24 15:20	16887-00-6	
Fluoride	0.16J	mg/L	0.32	0.095	1		05/13/24 15:20	16984-48-8	
Sulfate	29.8	mg/L	2.0	0.44	1		05/13/24 15:20	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: 25224071 ALLIANT NELS DEW CCR

Pace Project No.: 40277408

Sample: B-31R	Lab ID: 40277408006	Collected: 04/23/24 15:50	Received: 04/26/24 08:00	Matrix: Water					
Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS	Analytical Method: EPA 6020B Preparation Method: EPA 3010A Pace Analytical Services - Green Bay								
Boron	659	ug/L	10.0	3.0	1	05/01/24 05:47	05/03/24 23:00	7440-42-8	
Calcium	89300	ug/L	254	76.2	1	05/01/24 05:47	05/03/24 23:00	7440-70-2	
Field Data	Analytical Method: Pace Analytical Services - Green Bay								
Field pH	6.73	Std. Units			1		04/23/24 15:50		
Field Specific Conductance	750	umhos/cm			1		04/23/24 15:50		
Oxygen, Dissolved	0.19	mg/L			1		04/23/24 15:50	7782-44-7	
REDOX	-14.6	mV			1		04/23/24 15:50		
Turbidity	0.27	NTU			1		04/23/24 15:50		
Static Water Level	606.61	feet			1		04/23/24 15:50		
Temperature, Water (C)	12.8	deg C			1		04/23/24 15:50		
2540C Total Dissolved Solids	Analytical Method: SM 2540C Pace Analytical Services - Green Bay								
Total Dissolved Solids	506	mg/L	20.0	8.7	1		04/29/24 14:46		
9040 pH	Analytical Method: EPA 9040 Pace Analytical Services - Green Bay								
pH at 25 Degrees C	8.6	Std. Units	0.10	0.010	1		05/07/24 16:38		H6
300.0 IC Anions	Analytical Method: EPA 300.0 Pace Analytical Services - Green Bay								
Chloride	35.4	mg/L	2.0	0.59	1		05/13/24 15:35	16887-00-6	
Fluoride	0.31J	mg/L	0.32	0.095	1		05/13/24 15:35	16984-48-8	
Sulfate	113	mg/L	10.0	2.2	5		05/14/24 13:36	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: 25224071 ALLIANT NELS DEW CCR

Pace Project No.: 40277408

Sample: B-31A	Lab ID: 40277408007	Collected: 04/23/24 16:50	Received: 04/26/24 08:00	Matrix: Water					
Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS	Analytical Method: EPA 6020B Preparation Method: EPA 3010A Pace Analytical Services - Green Bay								
Boron	187	ug/L	10.0	3.0	1	05/01/24 05:47	05/03/24 23:06	7440-42-8	
Calcium	46000	ug/L	254	76.2	1	05/01/24 05:47	05/03/24 23:06	7440-70-2	
Field Data	Analytical Method: Pace Analytical Services - Green Bay								
Field pH	7.74	Std. Units			1		04/23/24 16:50		
Field Specific Conductance	504.8	umhos/cm			1		04/23/24 16:50		
Oxygen, Dissolved	0.11	mg/L			1		04/23/24 16:50	7782-44-7	
REDOX	-35.4	mV			1		04/23/24 16:50		
Turbidity	0.00	NTU			1		04/23/24 16:50		
Static Water Level	606.63	feet			1		04/23/24 16:50		
Temperature, Water (C)	13.3	deg C			1		04/23/24 16:50		
2540C Total Dissolved Solids	Analytical Method: SM 2540C Pace Analytical Services - Green Bay								
Total Dissolved Solids	306	mg/L	20.0	8.7	1		04/29/24 14:47		
9040 pH	Analytical Method: EPA 9040 Pace Analytical Services - Green Bay								
pH at 25 Degrees C	8.6	Std. Units	0.10	0.010	1		05/07/24 16:40		H6
300.0 IC Anions	Analytical Method: EPA 300.0 Pace Analytical Services - Green Bay								
Chloride	51.0	mg/L	2.0	0.59	1		05/13/24 15:49	16887-00-6	
Fluoride	0.15J	mg/L	0.32	0.095	1		05/13/24 15:49	16984-48-8	
Sulfate	19.0	mg/L	2.0	0.44	1		05/13/24 15:49	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: 25224071 ALLIANT NELS DEW CCR

Pace Project No.: 40277408

Sample: FIELD BLANK	Lab ID: 40277408008	Collected: 04/24/24 15:00	Received: 04/26/24 08:00	Matrix: Water					
Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS	Analytical Method: EPA 6020B Preparation Method: EPA 3010A Pace Analytical Services - Green Bay								
Boron	<3.0	ug/L	10.0	3.0	1	05/01/24 05:47	05/03/24 23:11	7440-42-8	
Calcium	<76.2	ug/L	254	76.2	1	05/01/24 05:47	05/03/24 23:11	7440-70-2	
2540C Total Dissolved Solids	Analytical Method: SM 2540C Pace Analytical Services - Green Bay								
Total Dissolved Solids	14.0J	mg/L	20.0	8.7	1		04/30/24 13:16		
9040 pH	Analytical Method: EPA 9040 Pace Analytical Services - Green Bay								
pH at 25 Degrees C	7.0	Std. Units	0.10	0.010	1		05/07/24 16:50		H6
300.0 IC Anions	Analytical Method: EPA 300.0 Pace Analytical Services - Green Bay								
Chloride	<0.59	mg/L	2.0	0.59	1		05/13/24 16:03	16887-00-6	
Fluoride	<0.095	mg/L	0.32	0.095	1		05/13/24 16:03	16984-48-8	
Sulfate	<0.44	mg/L	2.0	0.44	1		05/13/24 16:03	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



Pace Analytical Services, LLC
1241 Bellevue Street - Suite 9
Green Bay, WI 54302
(920)469-2436

ANALYTICAL RESULTS

Project: 25224071 ALLIANT NELS DEW CCR

Pace Project No.: 40277408

Sample: B-39 Lab ID: 40277408009 Collected: 04/24/24 00:00 Received: 05/06/24 00:00 Matrix: Water

Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
Field Data	Analytical Method: Pace Analytical Services - Green Bay								
Static Water Level	606.25	feet			1		04/24/24 00:00		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

Date: 05/16/2024 04:13 PM

Page 14 of 24

02/26/2025 - Classification: Internal - ECRM13462147



QUALITY CONTROL DATA

Project: 25224071 ALLIANT NELS DEW CCR

Pace Project No.: 40277408

QC Batch:	473196	Analysis Method:	EPA 6020B
QC Batch Method:	EPA 3010A	Analysis Description:	6020B MET
Laboratory:			Pace Analytical Services - Green Bay
Associated Lab Samples:			40277408001, 40277408002, 40277408003, 40277408004, 40277408005, 40277408006, 40277408007, 40277408008

METHOD BLANK:	2710104	Matrix:	Water
Associated Lab Samples:			40277408001, 40277408002, 40277408003, 40277408004, 40277408005, 40277408006, 40277408007, 40277408008

Parameter	Units	Blank Result	Reporting Limit	Analyzed	Qualifiers
Boron	ug/L	<3.0	10.0	05/03/24 21:46	
Calcium	ug/L	<76.2	254	05/03/24 21:46	

LABORATORY CONTROL SAMPLE:	2710105	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Boron	ug/L	250	251	100	80-120	
Calcium	ug/L	10000	10200	102	80-120	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE:	2710106	MS 40277342001	MSD Spike Conc.	MS 250	MSD Spike Conc.	MS 1700	MSD Result	MS 1730	MSD % Rec	MSD 104	% Rec Limits	117	Max 75-125	RPD 2	RPD 20	Qual
Boron	ug/L	1440	Spike Conc.	250	MSD Spike Conc.	250	MSD Result	1700	MSD % Rec	104	MSD % Rec	117	Max 75-125	RPD 2	RPD 20	Qual
Calcium	ug/L	8160	10000	10000	17100	19300	89	111	75-125	12	20					

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



QUALITY CONTROL DATA

Project: 25224071 ALLIANT NELS DEW CCR

Pace Project No.: 40277408

QC Batch:	472965	Analysis Method:	SM 2540C
QC Batch Method:	SM 2540C	Analysis Description:	2540C Total Dissolved Solids
		Laboratory:	Pace Analytical Services - Green Bay

Associated Lab Samples: 40277408001, 40277408004, 40277408006, 40277408007

METHOD BLANK: 2709005 Matrix: Water

Associated Lab Samples: 40277408001, 40277408004, 40277408006, 40277408007

Parameter	Units	Blank Result	Reporting Limit	Analyzed	Qualifiers
Total Dissolved Solids	mg/L	<8.7	20.0	04/29/24 14:43	

LABORATORY CONTROL SAMPLE: 2709006

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Total Dissolved Solids	mg/L	616	572	93	80-120	

SAMPLE DUPLICATE: 2709007

Parameter	Units	40277224001 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	382	368	4	10	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



QUALITY CONTROL DATA

Project: 25224071 ALLIANT NELS DEW CCR

Pace Project No.: 40277408

QC Batch:	473095	Analysis Method:	SM 2540C
QC Batch Method:	SM 2540C	Analysis Description:	2540C Total Dissolved Solids
		Laboratory:	Pace Analytical Services - Green Bay
Associated Lab Samples:	40277408002, 40277408003, 40277408005, 40277408008		

METHOD BLANK: 2709412 Matrix: Water

Associated Lab Samples: 40277408002, 40277408003, 40277408005, 40277408008

Parameter	Units	Blank Result	Reporting Limit	Analyzed	Qualifiers
Total Dissolved Solids	mg/L	<8.7	20.0	04/30/24 13:12	

LABORATORY CONTROL SAMPLE: 2709413

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Total Dissolved Solids	mg/L	616	582	94	80-120	

SAMPLE DUPLICATE: 2709420

Parameter	Units	40277303001 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	732	726	1	10	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



QUALITY CONTROL DATA

Project: 25224071 ALLIANT NELS DEW CCR

Pace Project No.: 40277408

QC Batch:	473722	Analysis Method:	EPA 9040
QC Batch Method:	EPA 9040	Analysis Description:	9040 pH
		Laboratory:	Pace Analytical Services - Green Bay
Associated Lab Samples:	40277408001, 40277408002, 40277408003, 40277408004, 40277408005, 40277408006, 40277408007, 40277408008		

SAMPLE DUPLICATE: 2713045

Parameter	Units	Result	Dup Result	RPD	Max RPD	Qualifiers
pH at 25 Degrees C	Std. Units	8.5	8.6	0	20	H6

SAMPLE DUPLICATE: 2713046

Parameter	Units	Result	Dup Result	RPD	Max RPD	Qualifiers
pH at 25 Degrees C	Std. Units	8.0	7.9	0	20	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



QUALITY CONTROL DATA

Project: 25224071 ALLIANT NELS DEW CCR

Pace Project No.: 40277408

QC Batch:	474037	Analysis Method:	EPA 300.0
QC Batch Method:	EPA 300.0	Analysis Description:	300.0 IC Anions
Laboratory:	Pace Analytical Services - Green Bay		
Associated Lab Samples:	40277408001, 40277408002, 40277408003, 40277408004, 40277408005, 40277408006, 40277408007, 40277408008		

METHOD BLANK: 2714516 Matrix: Water

Associated Lab Samples: 40277408001, 40277408002, 40277408003, 40277408004, 40277408005, 40277408006, 40277408007, 40277408008

Parameter	Units	Blank	Reporting		Qualifiers
		Result	Limit	Analyzed	
Chloride	mg/L	<0.59	2.0	05/13/24 11:30	
Fluoride	mg/L	<0.095	0.32	05/13/24 11:30	
Sulfate	mg/L	<0.44	2.0	05/13/24 11:30	

LABORATORY CONTROL SAMPLE: 2714517

Parameter	Units	Spike	LCS	LCS	% Rec	Qualifiers
		Conc.	Result	% Rec	Limits	
Chloride	mg/L	20	19.5	97	90-110	
Fluoride	mg/L	2	1.9	96	90-110	
Sulfate	mg/L	20	19.5	97	90-110	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 2714518 2714519

Parameter	Units	MS		MSD		MS	MSD	% Rec	% Rec	RPD	Max
		40277408001	Spike	Spike	MS						
Chloride	mg/L	8.2J	100	100	115	116	107	107	90-110	0	15
Fluoride	mg/L	<0.48	10	10	8.9	11.0	89	110	90-110	21	15 M0,R1
Sulfate	mg/L	<2.2	100	100	109	110	108	109	90-110	1	15

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,

without the written consent of Pace Analytical Services, LLC.

Date: 05/16/2024 04:13 PM

Page 19 of 24

02/26/2025 - Classification: Internal - ECRM13462147

QUALIFIERS

Project: 25224071 ALLIANT NELS DEW CCR

Pace Project No.: 40277408

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above LOD.

J - The reported result is an estimated value.

LOD - Limit of Detection adjusted for dilution factor, percent moisture, initial weight and final volume.

LOQ - Limit of Quantitation adjusted for dilution factor, percent moisture, initial weight and final volume.

DL - Adjusted Method Detection Limit.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Analyte was not detected and is reported as less than the LOD or as defined by the customer.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

ANALYTE QUALIFIERS

D3 Sample was diluted due to the presence of high levels of non-target analytes or other matrix interference.

H6 Analysis initiated outside of the 15 minute EPA required holding time.

M0 Matrix spike recovery and/or matrix spike duplicate recovery was outside laboratory control limits.

R1 RPD value was outside control limits.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: 25224071 ALLIANT NELS DEW CCR

Pace Project No.: 40277408

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
40277408001	B-7R	EPA 3010A	473196	EPA 6020B	473307
40277408002	B-11R	EPA 3010A	473196	EPA 6020B	473307
40277408003	B-11A	EPA 3010A	473196	EPA 6020B	473307
40277408004	B-11B	EPA 3010A	473196	EPA 6020B	473307
40277408005	B-26	EPA 3010A	473196	EPA 6020B	473307
40277408006	B-31R	EPA 3010A	473196	EPA 6020B	473307
40277408007	B-31A	EPA 3010A	473196	EPA 6020B	473307
40277408008	FIELD BLANK	EPA 3010A	473196	EPA 6020B	473307
40277408001	B-7R				
40277408002	B-11R				
40277408003	B-11A				
40277408004	B-11B				
40277408005	B-26				
40277408006	B-31R				
40277408007	B-31A				
40277408009	B-39				
40277408001	B-7R	SM 2540C	472965		
40277408002	B-11R	SM 2540C	473095		
40277408003	B-11A	SM 2540C	473095		
40277408004	B-11B	SM 2540C	472965		
40277408005	B-26	SM 2540C	473095		
40277408006	B-31R	SM 2540C	472965		
40277408007	B-31A	SM 2540C	472965		
40277408008	FIELD BLANK	SM 2540C	473095		
40277408001	B-7R	EPA 9040	473722		
40277408002	B-11R	EPA 9040	473722		
40277408003	B-11A	EPA 9040	473722		
40277408004	B-11B	EPA 9040	473722		
40277408005	B-26	EPA 9040	473722		
40277408006	B-31R	EPA 9040	473722		
40277408007	B-31A	EPA 9040	473722		
40277408008	FIELD BLANK	EPA 9040	473722		
40277408001	B-7R	EPA 300.0	474037		
40277408002	B-11R	EPA 300.0	474037		
40277408003	B-11A	EPA 300.0	474037		
40277408004	B-11B	EPA 300.0	474037		
40277408005	B-26	EPA 300.0	474037		
40277408006	B-31R	EPA 300.0	474037		
40277408007	B-31A	EPA 300.0	474037		
40277408008	FIELD BLANK	EPA 300.0	474037		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
 without the written consent of Pace Analytical Services, LLC.

40277408



CHAIN-OF-CUSTODY / Analytical Request Document

The Chain-of-Custody is a LEGAL DOCUMENT. All relevant fields must be completed accurately.

Submitting a sample via this chain of custody constitutes acknowledgment and acceptance of the Pace Terms and Conditions found at <https://info.pacelabs.com/hubs/pas-standard-terms.pdf>.

Page : 1 Of 1

Section A		Section B		Section C	
Required Client Information:		Required Project Information:		Invoice Information:	
Company.	SCS ENGINEERS	Report To	Meghan Blodgett	Attention	
Address.	2830 Dairy Drive	Copy To		Company Name	
Madison, WI 53718				Address	
Email	mblodgett@scsengineers.com	Purchase Order #		Pace Quote	Regulatory Agency
Phone	608-216-7362	Project Name.	25224071 Alliant Nelson Dewey CCR	Pace Project Manager.	dan.milewsky@pacelabs.com,
Requested Due Date.	Standard TAT	Project #.	25224071	Pace Profile #:	State / Location WI

ITEM #	SAMPLE ID <small>One Character per box. (A-Z, 0-9, -,)</small> <small>Sample IDs must be unique</small>	MATRIX Drinking Water Water Waste Water Product Soil/Solid Oil Wipe Air Other Tissue	CODE DW WT WW P P/L WP AR GT TS	MATRIX CODE (see valid codes to left) <small>G=GRAB C=COMP</small>	COLLECTED				SAMPLE TEMP AT COLLECTION <small># OF CONTAINERS</small>	Preservatives						Requested Analysis Filtered (Y/N)								Residual Chlorine (Y/N)				
					START		END			H2SO4	HNO3	HCl	NaOH	Na2S2O3	Methanol	Other	Analyses Test	Y/N	N	N	N	N	N	N				
					DATE	TIME	DATE	TIME		Unpreserved							Metals, Total (B, Ca)		Chloride, Fluoride & Sulfate, Total		pH	TDS						
1	B-7R		WT			4/23	1445		3	2						X	X	X	X						001			
2	B-11R		WT			4/24	0955		3	2						X	X	X	X						002			
3	B-11A		WT			4/24	1005		3	2						X	X	X	X						003			
4	B-11B		WT			4/23	1730		3	2						X	X	X	X						004			
5	B-26		WT			4/24	1155		3	2						X	X	X	X						005			
6	B-31R		WT			4/23	1550		3	2						X	X	X	X						006			
7	B-31A		WT			4/23	1650		3	2						X	X	X	X						007			
8	Field Blank		WT			4/24	1500		3	2						X	X	X	X						008			
9																												
10																												
11																												
12																												
ADDITIONAL COMMENTS				RELINQUISHED BY / AFFILIATION				DATE	TIME	ACCEPTED BY / AFFILIATION				DATE	TIME	SAMPLE CONDITIONS				TEMP in C	Received on Ice (Y/N)	Custody Sealed Cooler (Y/N)	Samples Intact (Y/N)					
								04/26/2024	08:00	Matt Van Amburgh Pace				04/26/2024	08:00	0.0 Y Y Y												

SAMPLER NAME AND SIGNATURE

PRINT Name of SAMPLER:

SIGNATURE of SAMPLER:

DATE Signed: 4/25/24

Client Name: SCS Engineers

All containers needing preservation have been checked and noted below:

Sample Preservation Receipt Form

Project # 40277408 Yes No N/ALab Lot# of pH paper: 10D1034

Lab Std #ID of preservation (if pH adjusted):

Initial when completed: MIC Date/ Time:

Pace Lab #	AG1U	BG1U	AG1H	AG4S	AG5U	AG2S	BG3U	BP1U	BP3U	BP3B	BP3N	BP3S	BP2Z	VG9C	DG9T	VG9U	VG9H	VG9M	VG9D	JGFU	JG9U	WGFU	WPFU	SP5T	ZPLC	GN 1	GN 2	VOA Vials (>6mm)*	H2SO4 pH ≤2	NaOH+Zn Act pH ≥9	NaOH pH ≥12	HNO3 pH ≤2	pH after adjusted	Volume (mL)	
001																																			
002																																			2.5 / 5
003																																			2.5 / 5
004																																			2.5 / 5
005																																			2.5 / 5
006																																			2.5 / 5
007																																			2.5 / 5
008																																			2.5 / 5
009																																			2.5 / 5
010																																			2.5 / 5
011																																			2.5 / 5
012																																			2.5 / 5
013																																			2.5 / 5
014																																			2.5 / 5
015																																			2.5 / 5
016																																			2.5 / 5
017																																			2.5 / 5
018																																			2.5 / 5
019																																			2.5 / 5
020																																			2.5 / 5

Exceptions to preservation check: VOA, Coliform, TOC, TOX, TOH, O&G, WI DRO, Phenolics, Other:

Headspace in VOA Vials (>6mm): Yes No N/A *If yes look in headspace column

G1U	1 liter amber glass
G1H	1 liter clear glass
G1H	1 liter amber glass HCl
G4S	125 mL amber glass H2SO4
G5U	100 mL amber glass unpres
G2S	500 mL amber glass H2SO4
G3U	250 mL clear glass unpres

BP1U	1 liter plastic unpres
BP3U	250 mL plastic unpres
BP3B	250 mL plastic NaOH
BP3N	250 mL plastic HNO3
BP3S	250 mL plastic H2SO4
BP2Z	500 mL plastic NaOH + Zn

JGFU	4 oz amber jar unpres
JG9U	9 oz amber jar unpres
WGFU	4 oz clear jar unpres
WPFU	4 oz plastic jar unpres
SP5T	120 mL plastic Na Thiosulfate ziploc bag
ZPLC	
GN 1	
GN 2	

Page 1 of 2

Sample Condition Upon Receipt Form (SCUR)

Client Name: SCS Engineers

Project #:

Courier: CS Logistics Fed Ex Speedee UPS Waltco
 Client Pace Other: _____

WO# : 40277408



40277408

Tracking #:

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Custody Seal on Samples Present: yes no Seals intact: yes no

Packing Material: Bubble Wrap Bubble Bags None Other

Thermometer Used SR - 121 Type of Ice: Wet Blue Dry None

Cooler Temperature Uncorr: 0.5 /Corr: 0.0 Meltwater Only

Temp Blank Present: yes no Biological Tissue is Frozen: yes no

Temp should be above freezing to 6°C.

Biota Samples may be received at ≤ 0°C if shipped on Dry Ice.

Person examining contents:
Date: 04/26/2021 Initials: MJF

Labeled By Initials: JFA

Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1.
Chain of Custody Filled Out:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	2.
Chain of Custody Relinquished:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	3.
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	4.
Samples Arrived within Hold Time: - DI VOA Samples frozen upon receipt	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	5. Date/Time:
Short Hold Time Analysis (<72hr):	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	6.
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	7.
Sufficient Volume: For Analysis: <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No MS/MSD: <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A		8.
Correct Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	9.
Correct Type: <u>Pace Green Bay, Pace IR, Non-Pace</u>		
Containers Intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	10.
Filtered volume received for Dissolved tests	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	11.
Sample Labels match COC: -Includes date/time/ID/Analysis	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	12.
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	13.
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	
Pace Trip Blank Lot # (if purchased):		

Client Notification/ Resolution:

If checked, see attached form for additional comments

Person Contacted: _____

Date/Time: _____

Comments/ Resolution: _____

PM Review is documented electronically in LIMs. By releasing the project, the PM acknowledges they have reviewed the sample log in

Page 2 of 2

Appendix D

Historical Monitoring Results

Single Location

Name: WPL - Nelson

Dewey

Location ID: B-7R

Number of Sampling Dates: 22

Parameter Name	Units	12/9/2015	4/13/2016	7/18/2016	10/19/2016	1/12/2017	4/17/2017	6/7/2017	8/1/2017	10/19/2017	4/2/2018	10/9/2018	4/22/2019	10/14/2019	4/13/2020	10/13/2020	4/20/2021
Boron	ug/L	110	115	164	154	159	129	110	129	159	121	73	93.5	139	96	145	104
Calcium	ug/L	31700	42300	44400	56600	56700	61400	51600	50400	56200	49200	38500	59400	57700	58700	41900	56100
Chloride	mg/L	45.2	4.6	7.1	22	19.7	13.1	12.8	8.1	12	10.1	1.9	10.9	11.5	14.3	6.7	9.5
Fluoride	mg/L	<1	<0.2	<0.2	<0.5	<0.5	<0.5	<0.5	<0.1	<0.5	<0.5	<0.1	<0.5	<0.5	<0.5	<0.48	<0.48
Field pH	Std. Units	6.74	6.8	6.29	6.55	7.43	6.6	6.65	6.28	6.88	6.57	6.23	6.63	6.62	6.6	6.35	6.54
Sulfate	mg/L	17	2.5	2.4	<5	<5	<5	<5	3.7	<5	<5	3.2	<5	<5	7.5	<2.2	<2.2
Total Dissolved Solids	mg/L	198	218	220	288	240	278	240	220	242	220	186	254	208	306	208	248
Antimony	ug/L	0.28	<0.073	0.25	0.086	0.2	0.18	<0.15	0.33	--	<0.15	--	--	--	--	--	--
Arsenic	ug/L	5	2	1.8	5.7	6.6	3.5	2.6	2	--	2.6	--	--	--	--	--	--
Barium	ug/L	77.8	67.8	54.5	78.8	98.4	83.3	65.8	54.2	--	89.3	--	--	--	--	--	--
Beryllium	ug/L	<0.13	<0.13	<0.13	<0.13	0.16	<0.13	<0.18	<0.18	--	<0.18	--	--	--	--	--	--
Cadmium	ug/L	0.17	<0.089	<0.089	0.13	0.16	0.11	<0.081	0.23	--	<0.081	--	--	--	--	--	--
Chromium	ug/L	0.5	<0.39	<0.39	<0.39	0.62	0.41	<1	<1	--	<1	--	--	--	--	--	--
Cobalt	ug/L	1.3	0.88	0.69	1.8	1.5	1.4	1.1	1.3	--	0.42	--	--	--	--	--	--
Lead	ug/L	0.21	0.16	0.078	0.14	0.42	0.26	<0.2	0.29	--	<0.2	--	--	--	--	--	--
Lithium	ug/L	0.45	0.14	0.18	0.23	0.35	0.26	<0.14	0.41	--	0.22	--	--	--	--	--	--
Mercury	ug/L	<0.1	<0.18	<0.13	<0.13	<0.13	<0.13	<0.13	<0.13	--	<0.13	--	--	--	--	--	--
Molybdenum	ug/L	9.6	1.4	1.4	4.3	3.3	2.1	2.8	1.9	--	0.84	--	--	--	--	--	--
Selenium	ug/L	0.44	0.24	0.26	0.23	0.47	0.39	<0.32	0.56	--	<0.32	--	--	--	--	--	--
Thallium	ug/L	0.2	<0.14	<0.14	<0.14	<0.14	0.22	<0.14	0.36	--	<0.14	--	--	--	--	--	--
Total Radium	pCi/L	0.933	1.18	0.598	0.118	0.828	0.747	0.181	0.967	--	0.339	--	--	--	--	--	--
Radium-226	pCi/L	0.341	0.436	-0.089	-0.243	-0.253	0.345	0.181	0.379	--	0.339	--	--	--	--	--	--
Radium-228	pCi/L	0.592	0.746	0.598	0.118	0.828	0.402	-0.057	0.588	--	-0.032	--	--	--	--	--	--
Field Specific Conductance	umhos/cm	367.8	410.9	422.3	583.4	1054	532	303	411.8	480.9	342.5	336	603.7	576.6	623.8	414.4	535
Oxygen, Dissolved	mg/L	4.88	1.29	0.55	0.37	0.1	0.1	0.22	0.47	0.31	0.3	1.24	0.17	0.11	2.18	1.68	0.19
Field Oxidation Potential	mV	-48.2	-46.1	-26.6	137.3	-122.2	-83.3	-12.6	-3	112.8	-74.1	54.5	-100.9	-132.2	-124	142.1	-23.4
Groundwater Elevation	feet	606.69	609.32	606.54	608.59	604.94	609.08	610.74	607.02	609.6	604.82	610.76	615.28	613.43	614.12	605.09	608.83
Temperature	deg C	13.9	11.7	15.1	16	11.7	10.9	13.5	16.5	16	9.2	16.3	10.5	15.2	8.2	13.7	9.3
Turbidity	NTU	--	4.8	4.3	2.22	2.69	3.53	3.28	1.31	3	4.17	29.56	17.05	4.25	8.2	54.78	0.99
pH at 25 Degrees C	Std. Units	6.3	6.5	6.4	7.1	6.6	6.8	7.7	6.6	6.6	6.8	6.6	6.6	6.9	6.6	6.4	6.6

Single Location

Name: WPL - Nelson

Dewey

Location ID: B-7R

Number of Sampling Dates: 22

Parameter Name	Units	10/7/2021	4/26/2022	10/18/2022	4/3/2023	10/3/2023	4/23/2024
Boron	ug/L	--	98.1	--	120	144	134
Calcium	ug/L	--	59200	--	48800	41000	52300
Chloride	mg/L	--	12	--	7.9	4.7	8.2
Fluoride	mg/L	--	<0.48	--	<0.48	<0.095	<0.48
Field pH	Std. Units	--	6.43	--	6.18	6.3	6.33
Sulfate	mg/L	--	3.7	--	<2.2	4.5	<2.2
Total Dissolved Solids	mg/L	--	318	--	224	184	232
Antimony	ug/L	--	--	--	--	--	--
Arsenic	ug/L	--	--	--	--	--	--
Barium	ug/L	--	--	--	--	--	--
Beryllium	ug/L	--	--	--	--	--	--
Cadmium	ug/L	--	--	--	--	--	--
Chromium	ug/L	--	--	--	--	--	--
Cobalt	ug/L	--	--	--	--	--	--
Lead	ug/L	--	--	--	--	--	--
Lithium	ug/L	--	--	--	--	--	--
Mercury	ug/L	--	--	--	--	--	--
Molybdenum	ug/L	--	--	--	--	--	--
Selenium	ug/L	--	--	--	--	--	--
Thallium	ug/L	--	--	--	--	--	--
Total Radium	pCi/L	--	--	--	--	--	--
Radium-226	pCi/L	--	--	--	--	--	--
Radium-228	pCi/L	--	--	--	--	--	--
Field Specific Conductance	umhos/cm	--	614.1	--	442.9	427.4	459.6
Oxygen, Dissolved	mg/L	--	0.82	--	0.16	0.39	2.07
Field Oxidation Potential	mV	--	-86.1	--	57.8	-79.3	-297.3
Groundwater Elevation	feet	604.05	609.84	603.81	607.51	604.39	606.66
Temperature	deg C	--	8.5	--	9.2	24.8	11.5
Turbidity	NTU	--	3.56	--	21.98	7.4	3.2
pH at 25 Degrees C	Std. Units	--	6.6	--	6.6	6.4	8.2

Single Location

Name: WPL -
Nelson Dewey

Location ID: B-11A

Number of Sampling 22

Dates:

Parameter Name	Units	12/9/2015	4/13/2016	7/19/2016	10/19/2016	1/12/2017	4/17/2017	6/8/2017	8/1/2017	10/19/2017	4/2/2018	10/9/2018	4/22/2019	10/14/2019	4/13/2020	10/12/2020	4/19/2021
Boron	ug/L	124	116	104	112	106	100	102	105	116	91	94.2	93.9	80.7	86.3	99.3	88.1
Calcium	ug/L	58800	60100	54000	54600	54500	54800	57800	54500	55000	53300	48600	60400	56600	57500	55600	50600
Chloride	mg/L	40.4	43	46.6	46.5	46.6	45.4	46.9	46.7	49.9	54.7	57.8	83.6	96.6	93.7	65.3	59.1
Fluoride	mg/L	0.3	0.38	0.35	0.36	0.43	0.36	0.37	0.37	0.32	0.24	0.29	0.29	0.26	0.27	0.28	0.23
Field pH	Std. Units	7.7	7.75	7.42	7.47	7.89	7.38	7.78	7.67	7.96	8.04	7.43	7.62	7.66	7.75	7.74	7.65
Sulfate	mg/L	3.2	3.8	2.7	3	2.3	<1	1.4	2.4	5.1	12.3	6	1.9	<1	1.4	1	2.9
Total Dissolved Solids	mg/L	338	362	336	340	322	326	338	326	322	336	332	386	348	394	364	366
Antimony	ug/L	0.42	0.14	0.17	0.44	0.22	0.51	<0.15	0.27	--	<0.15	--	--	--	--	--	--
Arsenic	ug/L	0.27	0.19	0.18	0.51	0.19	0.4	<0.28	<0.28	--	<0.28	--	--	--	--	--	--
Barium	ug/L	202	206	171	181	187	192	194	184	--	170	--	--	--	--	--	--
Beryllium	ug/L	<0.13	<0.13	<0.13	<0.13	<0.13	<0.13	<0.18	<0.18	--	<0.18	--	--	--	--	--	--
Cadmium	ug/L	<0.089	<0.089	<0.089	0.26	<0.089	0.24	<0.081	<0.081	--	<0.081	--	--	--	--	--	--
Chromium	ug/L	<0.39	<0.39	<0.39	<0.39	0.46	0.52	<1	<1	--	<1	--	--	--	--	--	--
Cobalt	ug/L	1.3	1.4	0.97	1.3	1.2	1.4	1.1	1.3	--	1.1	--	--	--	--	--	--
Lead	ug/L	0.083	<0.04	<0.04	0.34	<0.04	0.33	<0.2	<0.2	--	<0.2	--	--	--	--	--	--
Lithium	ug/L	5.9	6.1	5.8	5.9	5.9	5.9	6.1	4.9	--	5.1	--	--	--	--	--	--
Mercury	ug/L	<0.1	<0.18	<0.13	<0.13	<0.13	<0.13	<0.13	<0.13	--	<0.13	--	--	--	--	--	--
Molybdenum	ug/L	22.7	24.1	22.5	21.8	21.8	22.4	22.2	20	--	18.2	--	--	--	--	--	--
Selenium	ug/L	<0.21	<0.21	<0.21	0.27	<0.21	0.36	<0.32	<0.32	--	<0.32	--	--	--	--	--	--
Thallium	ug/L	0.14	<0.14	<0.14	0.5	<0.14	0.46	<0.14	0.15	--	<0.14	--	--	--	--	--	--
Total Radium	pCi/L	1.08	1.48	0.937	0.95	0.845	1.4	1.88	0.917	--	0.848	--	--	--	--	--	--
Radium-226	pCi/L	0.579	0.148	0.179	0.172	0	0.948	0.454	0.0728	--	0.405	--	--	--	--	--	--
Radium-228	pCi/L	0.503	1.33	0.758	0.778	0.845	0.447	1.43	0.844	--	0.443	--	--	--	--	--	--
Field Specific Conductance	umhos/cm	660	658	598.1	631	1049	583.3	407.9	588.8	519.1	481.9	654	721	708	720	674	638
Oxygen, Dissolved	mg/L	0.49	0.03	0.08	0.37	0.19	0.11	0.23	0.1	0.51	0.12	0.08	0.07	0.14	0.19	0.09	0.21
Field Oxidation Potential	mV	9.8	-31.2	84.2	-76.8	-88.3	-103.6	31.4	-44.1	112.1	-42.1	-47.9	218.3	-59	-31	55.1	135.4
Groundwater Elevation	feet	606.3	608.71	606.76	608.21	604.36	609.05	609.81	605.57	609.58	606.63	610.28	615.29	613.29	613.88	604.54	608.72
Temperature	deg C	14.8	14.8	14.8	14.9	14.2	14.4	14.3	14.7	14.9	13.9	15	13.8	14.3	13.4	14.2	13.4
Turbidity	NTU	--	0.23	0.01	0.15	0.21	0.51	0.39	0.12	0.78	0.5	3.15	0	2.58	0	0	0
pH at 25 Degrees C	Std. Units	7.4	7.5	7.5	7.9	7.7	7.7	7.7	7.7	7.6	7.8	7.7	7.7	7.8	7.6	7.7	7.7

Single Location

Name: WPL -
Nelson Dewey

Location ID: B-11A

Number of Sampling 22

Dates:

Parameter Name	Units	10/7/2021	4/26/2022	10/18/2022	4/4/2023	10/3/2023	4/24/2024
Boron	ug/L	85.4	88.6	95.2	119	231	715
Calcium	ug/L	51400	51600	46000	51700	60300	63900
Chloride	mg/L	58.8	58.3	49.1	40.7	43.9	35.1
Fluoride	mg/L	0.22	<0.095	0.22	0.22	0.16	0.23
Field pH	Std. Units	7.57	7.53	7.61	7.62	7.66	7.82
Sulfate	mg/L	7	8.5	22.7	70.8	86	155
Total Dissolved Solids	mg/L	356	350	332	394	352	478
Antimony	ug/L	--	--	--	--	--	--
Arsenic	ug/L	--	--	--	--	--	--
Barium	ug/L	--	--	--	--	--	--
Beryllium	ug/L	--	--	--	--	--	--
Cadmium	ug/L	--	--	--	--	--	--
Chromium	ug/L	--	--	--	--	--	--
Cobalt	ug/L	--	--	--	--	--	--
Lead	ug/L	--	--	--	--	--	--
Lithium	ug/L	--	--	--	--	--	--
Mercury	ug/L	--	--	--	--	--	--
Molybdenum	ug/L	--	--	--	--	--	--
Selenium	ug/L	--	--	--	--	--	--
Thallium	ug/L	--	--	--	--	--	--
Total Radium	pCi/L	--	--	--	--	--	--
Radium-226	pCi/L	--	--	--	--	--	--
Radium-228	pCi/L	--	--	--	--	--	--
Field Specific Conductance	umhos/cm	621	633.7	608	605.6	628	716
Oxygen, Dissolved	mg/L	1.27	0.15	0.12	0.25	0.11	0.59
Field Oxidation Potential	mV	61.4	0.3	91.5	-30.4	-27.1	-261.5
Groundwater Elevation	feet	603.79	610	603.63	607.92	603.97	606.86
Temperature	deg C	13.9	13	13.3	12.7	13.7	12.5
Turbidity	NTU	0	0	0.72	1.23	0	2.84
pH at 25 Degrees C	Std. Units	8	7.7	7.9	7.8	7.7	8.5

Single Location

Name: WPL -

Nelson Dewey

Location ID: B-11B

Number of Sampling 23

Dates:

Parameter Name	Units	12/9/2015	4/13/2016	7/19/2016	10/20/2016	1/12/2017	4/17/2017	6/8/2017	8/1/2017	10/19/2017	4/2/2018	10/9/2018	11/12/2018	4/22/2019	10/14/2019	4/13/2020	10/12/2020
Boron	ug/L	1140	1360	1210	1460	1540	1760	1880	1800	1500	2020	3620	--	6830	4630	5380	3350
Calcium	ug/L	64100	65400	59000	59100	63900	67400	68200	61400	52400	59000	66300	--	83300	91400	115000	91200
Chloride	mg/L	31.2	32.7	33.6	34.3	36.1	36.3	33.9	35.9	36.1	31.3	21.9	--	28.4	32.3	30.9	33.4
Fluoride	mg/L	0.44	0.49	0.45	0.53	0.52	0.58	0.59	0.6	0.59	0.65	0.61	--	0.64	0.62	<0.95	<0.095
Field pH	Std. Units	8.06	8.14	7.77	7.91	8.18	7.83	8.07	7.77	7.77	8.42	7.74	8.05	7.91	7.92	7.89	7.8
Sulfate	mg/L	134	148	165	178	182	181	191	179	175	200	197	--	303	339	378	388
Total Dissolved Solids	mg/L	494	512	520	496	488	502	516	498	510	550	602	594	742	728	872	906
Antimony	ug/L	0.32	<0.073	0.097	0.21	0.12	0.098	<0.15	<0.15	--	<0.15	--	--	--	--	--	--
Arsenic	ug/L	0.67	0.38	0.36	0.52	0.4	0.47	<0.28	<0.28	--	0.29	--	--	--	--	--	--
Barium	ug/L	147	153	128	130	145	151	151	132	--	128	--	--	--	--	--	--
Beryllium	ug/L	<0.13	<0.13	<0.13	<0.25	<0.13	<0.13	<0.18	<0.18	--	<0.18	--	--	--	--	--	--
Cadmium	ug/L	0.23	<0.089	<0.089	0.18	<0.089	<0.089	<0.081	<0.081	--	<0.081	--	--	--	--	--	--
Chromium	ug/L	0.7	0.74	<0.39	<0.39	<0.39	0.45	<1	<1	--	<1	--	--	--	--	--	--
Cobalt	ug/L	0.44	0.23	0.21	0.38	0.3	0.29	0.26	0.2	--	0.17	--	--	--	--	--	--
Lead	ug/L	0.45	<0.04	<0.04	0.36	0.083	0.061	<0.2	<0.2	--	<0.2	--	--	--	--	--	--
Lithium	ug/L	21.7	21.3	18.4	19.8	20	19.5	19.4	17	--	15.4	--	--	--	--	--	--
Mercury	ug/L	<0.1	<0.18	<0.13	<0.13	<0.13	<0.13	<0.13	<0.13	--	<0.13	--	--	--	--	--	--
Molybdenum	ug/L	46.2	51.7	48.7	48.1	52.6	53.8	55.1	55.9	--	77.7	--	--	--	--	--	--
Selenium	ug/L	0.46	<0.21	<0.21	0.28	<0.21	<0.21	<0.32	<0.32	--	<0.32	--	--	--	--	--	--
Thallium	ug/L	0.35	<0.14	<0.14	0.32	<0.14	<0.14	0.16	<0.14	--	0.16	--	--	--	--	--	--
Total Radium	pCi/L	0.862	1.69	0.977	0.534	0.787	0.643	1.05	2.21	--	1.02	--	--	--	--	--	--
Radium-226	pCi/L	0.733	0.0581	0.284	-0.487	-0.434	0.193	0.389	0.766	--	0.518	--	--	--	--	--	--
Radium-228	pCi/L	0.129	1.63	0.693	0.534	0.787	0.45	0.661	1.44	--	0.505	--	--	--	--	--	--
Field Specific Conductance	umhos/cm	631	808	785	807	1342	799	534.3	776	709	671	954	863	1129	1132	1280	1348
Oxygen, Dissolved	mg/L	0.84	0.04	0.08	0.3	0.16	0.09	0.28	0.13	0.22	0.59	0.13	0.16	0.09	0.19	0.24	0.22
Field Oxidation Potential	mV	-50.9	-66.9	-69	-114.5	-135.7	-121.3	36.2	-81.1	93.7	116.3	13.2	45.8	207.8	-48.9	-57.9	225
Groundwater Elevation	feet	606.26	608.68	606.74	608.19	604.32	608.99	610.08	605.5	609.65	606.55	610.24	609.14	615.28	613.18	613.86	604.44
Temperature	deg C	14.4	14.3	14.6	14.6	14.1	14.2	14.1	14.5	14.8	13.5	14.8	14.1	13.6	14.3	13.5	14.3
Turbidity	NTU	--	0.21	0.01	0.33	0.38	0.36	0.7	0.07	1.01	0.78	2.98	2.65	0	1.5	0	0
pH at 25 Degrees C	Std. Units	7.7	7.8	7.8	8	7.9	7.9	8.1	7.9	7.7	8.1	7.9	--	7.9	7.8	7.8	7.9

Single Location

Name: WPL -

Nelson Dewey

Location ID: B-11B

Number of Sampling 23

Dates:

Parameter Name	Units	4/19/2021	10/7/2021	4/26/2022	10/18/2022	4/4/2023	10/3/2023	4/23/2024
Boron	ug/L	4440	2480	2590	3010	4740	5040	5630
Calcium	ug/L	93400	100000	97100	75100	84400	80600	171000
Chloride	mg/L	28.3	39.6	36.5	32.8	25.2	25.5	25.1
Fluoride	mg/L	0.36	<0.95	<0.48	0.47	0.65	<0.95	0.43
Field pH	Std. Units	8.07	7.81	7.63	7.74	7.68	7.84	7.36
Sulfate	mg/L	379	466	513	429	436	403	435
Total Dissolved Solids	mg/L	910	884	1000	920	980	918	1010
Antimony	ug/L	--	--	--	--	--	--	--
Arsenic	ug/L	--	--	--	--	--	--	--
Barium	ug/L	--	--	--	--	--	--	--
Beryllium	ug/L	--	--	--	--	--	--	--
Cadmium	ug/L	--	--	--	--	--	--	--
Chromium	ug/L	--	--	--	--	--	--	--
Cobalt	ug/L	--	--	--	--	--	--	--
Lead	ug/L	--	--	--	--	--	--	--
Lithium	ug/L	--	--	--	--	--	--	--
Mercury	ug/L	--	--	--	--	--	--	--
Molybdenum	ug/L	--	--	--	--	--	--	--
Selenium	ug/L	--	--	--	--	--	--	--
Thallium	ug/L	--	--	--	--	--	--	--
Total Radium	pCi/L	--	--	--	--	--	--	--
Radium-226	pCi/L	--	--	--	--	--	--	--
Radium-228	pCi/L	--	--	--	--	--	--	--
Field Specific Conductance	umhos/cm	1286	1337	1432	1395	1395	1346	1301
Oxygen, Dissolved	mg/L	0.13	1.29	0.22	0.22	0.32	0.3	1.17
Field Oxidation Potential	mV	44.7	46.9	45.4	104	128.7	40.6	-248.7
Groundwater Elevation	feet	608.67	603.74	609.98	603.57	607.9	603.91	606.66
Temperature	deg C	13.4	14	13	13.5	12.3	15.1	13.4
Turbidity	NTU	0	0	0	2.55	0	0	0.4
pH at 25 Degrees C	Std. Units	8	8	7.8	8	7.9	7.8	8.4

Single Location

Name: WPL - Nelson

Dewey

Location ID: B-11R

Number of Sampling Dates: 22

Parameter Name	Units	12/9/2015	4/13/2016	7/19/2016	10/20/2016	1/12/2017	4/17/2017	6/7/2017	8/1/2017	10/19/2017	4/2/2018	10/9/2018	4/22/2019	10/14/2019	4/13/2020	10/12/2020	4/19/2021
Boron	ug/L	4170	3410	3530	4120	3530	3520	3420	2040	3120	3180	576	1360	1440	2140	2870	3010
Calcium	ug/L	126000	141000	130000	128000	126000	123000	128000	139000	117000	124000	49900	82400	66000	117000	120000	115000
Chloride	mg/L	39.2	7	38.9	39.1	42.3	40.2	42	24.7	38.8	36.8	5.9	12.6	13.1	22.5	20.7	27.2
Fluoride	mg/L	<1	<0.2	0.22	<0.5	<0.5	<0.5	<0.5	0.25	<0.5	<0.5	0.15	0.2	0.26	<0.48	<0.48	<0.48
Field pH	Std. Units	7.07	6.78	6.69	6.77	6.98	7.11	6.8	6.7	7.22	7.14	6.55	6.82	6.83	6.8	6.83	7.11
Sulfate	mg/L	75.4	18.4	115	118	108	108	98.2	126	97.7	88.1	15.1	34.6	40.7	41.9	22.8	61.2
Total Dissolved Solids	mg/L	616	682	698	660	616	620	630	738	586	638	266	406	310	570	600	578
Antimony	ug/L	<0.073	<0.073	<0.073	0.22	<0.073	<0.073	<0.15	0.42	--	<0.15	--	--	--	--	--	--
Arsenic	ug/L	14.8	7	10.6	7.4	7.1	6.9	6.1	7.5	--	9.3	--	--	--	--	--	--
Barium	ug/L	204	169	187	159	144	149	152	168	--	144	--	--	--	--	--	--
Beryllium	ug/L	<0.13	<0.13	<0.13	0.36	<0.13	<0.13	<0.18	<0.18	--	<0.18	--	--	--	--	--	--
Cadmium	ug/L	<0.089	<0.089	<0.089	0.15	<0.089	<0.089	<0.081	0.32	--	<0.081	--	--	--	--	--	--
Chromium	ug/L	<0.39	<0.39	<0.39	<0.39	<0.39	<0.39	<1	<1	--	<1	--	--	--	--	--	--
Cobalt	ug/L	0.36	0.54	0.68	1	1.2	1.3	1.5	1.4	--	0.94	--	--	--	--	--	--
Lead	ug/L	0.21	<0.04	0.13	0.19	<0.04	0.12	<0.2	0.39	--	<0.2	--	--	--	--	--	--
Lithium	ug/L	2.3	1.5	1.6	2	1.4	1.4	1.3	2	--	1.6	--	--	--	--	--	--
Mercury	ug/L	<0.1	<0.18	<0.13	<0.13	<0.13	<0.13	<0.13	<0.13	--	<0.13	--	--	--	--	--	--
Molybdenum	ug/L	15.1	23.2	34.9	43.8	42.8	57.2	53.8	22.7	--	35.6	--	--	--	--	--	--
Selenium	ug/L	1.2	5	<0.21	0.3	<0.21	<0.21	<0.32	0.78	--	<0.32	--	--	--	--	--	--
Thallium	ug/L	<0.14	<0.14	<0.14	0.5	<0.14	<0.14	<0.14	0.47	--	<0.14	--	--	--	--	--	--
Total Radium	pCi/L	1.45	1.62	0.953	1.51	0.345	1.45	2.1	1.43	--	0.749	--	--	--	--	--	--
Radium-226	pCi/L	0.797	0.863	0.19	0.516	0	0.719	0.272	0.602	--	0.254	--	--	--	--	--	--
Radium-228	pCi/L	0.653	0.757	0.763	0.997	0.345	0.732	1.83	0.826	--	0.495	--	--	--	--	--	--
Field Specific Conductance	umhos/cm	931	1172	1160	1139	1876	1020	721	1192	870	839	463.2	737	612	993	1125	1003
Oxygen, Dissolved	mg/L	2.47	0.03	0.08	0.34	0.14	0.11	0.21	0.1	0.19	0.09	0.34	0.37	0.1	0.22	0.14	0.1
Field Oxidation Potential	mV	-114.2	-91	-94.7	-113.2	-72.9	-53.3	-26.8	-41.3	133.4	-128.6	-49.5	-20.9	-4.7	-75.8	-139.8	-64.5
Groundwater Elevation	feet	606.71	609.32	606.14	608.35	604.57	608.34	610.42	606.73	609.42	606.27	610.67	615.28	613.06	614.39	604.57	608.57
Temperature	deg C	14.5	10.9	14	15.5	12.7	11.7	11.9	14.4	15.1	11.1	16.2	10	14.5	10.1	14.3	10.6
Turbidity	NTU	--	3.18	2.11	1.66	2.51	3.85	1.72	1.04	2.5	3.58	10.05	8.88	7.5	8.97	6.58	8.4
pH at 25 Degrees C	Std. Units	6.9	6.8	6.8	7.3	6.9	7.2	7.1	6.9	6.8	7	6.9	6.9	7	6.8	7	7

Single Location

Name: WPL - Nelson

Dewey

Location ID: B-11R

Number of Sampling Dates: 22

Parameter Name	Units	10/7/2021	4/26/2022	10/18/2022	4/4/2023	10/3/2023	4/24/2024
Boron	ug/L	2940	2330	3090	3110	3120	2640
Calcium	ug/L	119000	114000	116000	105000	90600	96700
Chloride	mg/L	23.1	18	28.8	30.7	41.6	35.8
Fluoride	mg/L	<0.48	<0.48	0.16	<0.48	0.2	0.27
Field pH	Std. Units	6.86	7.01	6.76	6.81	6.8	6.89
Sulfate	mg/L	61.8	58.1	65.3	57	58	64.8
Total Dissolved Solids	mg/L	576	560	572	554	456	536
Antimony	ug/L	--	--	--	--	--	--
Arsenic	ug/L	--	--	--	--	--	--
Barium	ug/L	--	--	--	--	--	--
Beryllium	ug/L	--	--	--	--	--	--
Cadmium	ug/L	--	--	--	--	--	--
Chromium	ug/L	--	--	--	--	--	--
Cobalt	ug/L	--	--	--	--	--	--
Lead	ug/L	--	--	--	--	--	--
Lithium	ug/L	--	--	--	--	--	--
Mercury	ug/L	--	--	--	--	--	--
Molybdenum	ug/L	--	--	--	--	--	--
Selenium	ug/L	--	--	--	--	--	--
Thallium	ug/L	--	--	--	--	--	--
Total Radium	pCi/L	--	--	--	--	--	--
Radium-226	pCi/L	--	--	--	--	--	--
Radium-228	pCi/L	--	--	--	--	--	--
Field Specific Conductance	umhos/cm	1029	934	1014	908	810	878
Oxygen, Dissolved	mg/L	1.57	0.07	0.22	0.17	0.21	0.3
Field Oxidation Potential	mV	-42.6	-41.5	-18.9	-55.6	-11.9	-40.1
Groundwater Elevation	feet	603.85	609.75	603.59	607.83	603.93	606.72
Temperature	deg C	14.6	10.4	13.3	11	13.8	11.4
Turbidity	NTU	10.81	6.7	2.22	3.14	0	3.25
pH at 25 Degrees C	Std. Units	7.3	6.9	7	7	7.1	8.4

Single Location

Name: WPL - Nelson

Dewey

Location ID: B-26

Number of Sampling Dates: 22

Parameter Name	Units	12/9/2015	4/12/2016	7/19/2016	10/20/2016	1/12/2017	4/17/2017	6/7/2017	8/2/2017	10/19/2017	4/3/2018	10/8/2018	4/23/2019	10/15/2019	4/14/2020	10/13/2020	4/21/2021
Boron	ug/L	29.6	33.7	28.6	33	35.2	50.1	45.8	54.6	47.4	48	53.4	41.6	<3	66.1	63.6	63.6
Calcium	ug/L	81300	86200	82400	82700	89400	89000	105000	98100	102000	88100	78700	75300	<76.2	88500	76500	78700
Chloride	mg/L	45.5	51.3	55.6	52.8	54.5	56	59.6	52.6	79.3	54.4	33.2	40.8	30.5	54.9	35.3	42.6
Fluoride	mg/L	<0.2	<0.2	<0.2	0.13	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	0.11	<0.095	<0.095
Field pH	Std. Units	7.35	7.43	7.14	7.19	7.57	7.54	7.22	7.21	7.5	7.64	7.2	7.1	7.24	7.27	7.34	7.27
Sulfate	mg/L	37.1	38	36.2	35	35	32.4	31	28.5	25.3	19.1	25.1	26.7	36	30.2	37	35.3
Total Dissolved Solids	mg/L	424	456	504	466	446	468	538	496	542	464	450	458	404	464	448	470
Antimony	ug/L	0.075	<0.073	0.16	0.2	0.24	0.087	<0.15	<0.15	--	<0.15	--	--	--	--	--	--
Arsenic	ug/L	0.49	0.54	0.49	0.59	0.6	0.5	0.39	0.5	--	0.36	--	--	--	--	--	--
Barium	ug/L	73.7	81.8	77.8	81.2	89.2	91	107	100	--	91.5	--	--	--	--	--	--
Beryllium	ug/L	<0.13	<0.13	<0.13	<0.13	0.13	<0.13	<0.18	<0.18	--	<0.18	--	--	--	--	--	--
Cadmium	ug/L	<0.089	<0.089	<0.089	0.13	0.15	<0.089	<0.081	<0.081	--	0.085	--	--	--	--	--	--
Chromium	ug/L	0.94	4.1	1.1	0.83	1	1.1	<1	<1	--	<1	--	--	--	--	--	--
Cobalt	ug/L	0.17	0.13	0.086	0.21	0.25	0.13	<0.085	0.13	--	<0.085	--	--	--	--	--	--
Lead	ug/L	0.057	<0.04	<0.04	0.15	0.2	0.079	<0.2	<0.2	--	0.3	--	--	--	--	--	--
Lithium	ug/L	2.1	2.1	1.9	2.2	2.5	2.1	2.2	2	--	2.1	--	--	--	--	--	--
Mercury	ug/L	<0.1	<0.18	<0.13	<0.13	<0.13	<0.13	<0.13	<0.13	--	<0.13	--	--	--	--	--	--
Molybdenum	ug/L	0.19	0.5	0.15	0.39	0.34	0.2	<0.44	<0.44	--	<0.44	--	--	--	--	--	--
Selenium	ug/L	0.69	0.67	0.98	1.1	0.99	1.5	1.5	1.4	--	1.4	--	--	--	--	--	--
Thallium	ug/L	<0.14	<0.14	<0.14	0.27	0.16	<0.14	<0.14	<0.14	--	<0.14	--	--	--	--	--	--
Total Radium	pCi/L	1.22	0.773	0.416	0.713	0.672	0.867	0.646	0.681	--	0.449	--	--	--	--	--	--
Radium-226	pCi/L	0.404	-0.058	-0.089	0.353	0	0.398	0.124	0.224	--	0.261	--	--	--	--	--	--
Radium-228	pCi/L	0.82	0.773	0.416	0.36	0.672	0.469	0.522	0.457	--	0.188	--	--	--	--	--	--
Field Specific Conductance	umhos/cm	567	783	788	823	1394	800	575.9	836	786	655.2	661.9	815	753	852	782	778
Oxygen, Dissolved	mg/L	5.88	5.3	4.41	6.25	5.58	7.79	2.92	6.8	8.49	2.68	5.98	8.73	12.17	8.43	7.2	8.74
Field Oxidation Potential	mV	14.3	130.2	63.2	68.9	59.1	148.4	53.4	155.9	215.6	69.7	109.2	259.9	175.8	160.4	242.6	105.8
Groundwater Elevation	feet	606.8	609.81	606.09	608.84	604.52	608.59	611.25	607.39	608.84	606.49	610.34	615.49	613.1	613.76	604.92	608.55
Temperature	deg C	11.1	10.9	10.7	11.3	11.5	11.1	10.9	11.3	11.7	11.3	12	11.4	11.6	11.3	11.9	11
Turbidity	NTU	--	0.27	0.27	0.37	0.14	0.56	0.44	0.15	0.89	0.99	3.44	0	1.5	0	0	0
pH at 25 Degrees C	Std. Units	7.2	7.4	7.2	7.7	7.6	7.5	7.5	7.3	7.4	7.3	7.3	7.4	7.4	7.2	7.4	7.4

Single Location

Name: WPL - Nelson

Dewey

Location ID: B-26

Number of Sampling Dates: 22

Parameter Name	Units	10/8/2021	4/25/2022	10/18/2022	4/5/2023	10/3/2023	4/24/2024
Boron	ug/L	48.4	52.5	48.8	38.6	44.8	44.8
Calcium	ug/L	84900	75900	80300	77400	85100	79600
Chloride	mg/L	39.1	45.3	37.4	29.1	50.2	43.5
Fluoride	mg/L	<0.095	<0.48	<0.095	<0.095	<0.095	0.16
Field pH	Std. Units	7.18	7.19	7.15	7.05	7.47	7.23
Sulfate	mg/L	43.8	34.2	47.6	34.3	42.5	29.8
Total Dissolved Solids	mg/L	440	470	472	448	418	448
Antimony	ug/L	--	--	--	--	--	--
Arsenic	ug/L	--	--	--	--	--	--
Barium	ug/L	--	--	--	--	--	--
Beryllium	ug/L	--	--	--	--	--	--
Cadmium	ug/L	--	--	--	--	--	--
Chromium	ug/L	--	--	--	--	--	--
Cobalt	ug/L	--	--	--	--	--	--
Lead	ug/L	--	--	--	--	--	--
Lithium	ug/L	--	--	--	--	--	--
Mercury	ug/L	--	--	--	--	--	--
Molybdenum	ug/L	--	--	--	--	--	--
Selenium	ug/L	--	--	--	--	--	--
Thallium	ug/L	--	--	--	--	--	--
Total Radium	pCi/L	--	--	--	--	--	--
Radium-226	pCi/L	--	--	--	--	--	--
Radium-228	pCi/L	--	--	--	--	--	--
Field Specific Conductance	umhos/cm	788	826	784	750	810	760
Oxygen, Dissolved	mg/L	9.4	10.44	9.51	9.56	8.35	9.28
Field Oxidation Potential	mV	122.1	252.4	93.9	142.4	106.3	31.4
Groundwater Elevation	feet	604.21	610.12	603.99	607.36	604.2	606.51
Temperature	deg C	11.4	11	11	10.9	11.2	11.1
Turbidity	NTU	0	0.3	0	0	0	3.11
pH at 25 Degrees C	Std. Units	7.7	7.4	7.6	7.4	7.2	8.6

Single Location

Name: WPL - Nelson

Dewey

Location ID: B-31A

Number of Sampling Dates: 22

Parameter Name	Units	12/9/2015	4/13/2016	7/19/2016	10/20/2016	1/12/2017	4/17/2017	6/8/2017	8/1/2017	10/19/2017	4/2/2018	10/9/2018	4/22/2019	10/14/2019	4/13/2020	10/12/2020	4/19/2021
Boron	ug/L	59	79.2	67.2	63.7	76.4	69.9	58.5	56.3	63.9	74.8	71.8	86.2	98.5	132	127	172
Calcium	ug/L	48400	51900	48900	45800	46600	46900	49400	46000	49600	49300	46600	48200	52200	50900	47700	52100
Chloride	mg/L	35.3	35.8	36.4	39	39.9	40.3	40.9	40.8	40.8	42.7	40.2	40.8	47.1	51	57.9	64.8
Fluoride	mg/L	<0.2	0.22	<0.2	0.18	0.22	0.19	0.18	0.2	0.16	0.13	0.17	0.22	0.22	0.19	0.18	0.14
Field pH	Std. Units	7.65	7.63	7.25	7.54	7.82	7.83	7.74	7.56	7.92	8	7.48	7.61	7.69	7.71	7.78	7.9
Sulfate	mg/L	26.2	22.6	24.2	27.2	29.8	31	31.2	26.6	26.1	27.4	24.8	21.6	22.3	16.6	16.8	15.8
Total Dissolved Solids	mg/L	274	302	280	292	284	318	296	284	290	282	278	284	272	298	300	330
Antimony	ug/L	<0.073	<0.073	0.14	0.084	<0.073	<0.073	<0.15	<0.15	--	<0.15	--	--	--	--	--	--
Arsenic	ug/L	1.6	1.6	1.4	1.5	1.5	1.3	1.3	1.2	--	1.3	--	--	--	--	--	--
Barium	ug/L	132	147	130	128	146	146	150	133	--	139	--	--	--	--	--	--
Beryllium	ug/L	<0.13	<0.13	<0.13	<0.13	<0.13	<0.13	<0.18	<0.18	--	<0.18	--	--	--	--	--	--
Cadmium	ug/L	<0.089	<0.089	<0.089	<0.089	<0.089	<0.089	<0.081	<0.081	--	<0.081	--	--	--	--	--	--
Chromium	ug/L	<0.39	<0.39	<0.39	<0.39	<0.39	<0.39	<0.39	9.4	<1	--	<1	--	--	--	--	--
Cobalt	ug/L	2.2	2.3	1.8	1.8	2	1.9	2.2	1.8	--	1.8	--	--	--	--	--	--
Lead	ug/L	0.08	<0.04	<0.04	0.05	<0.04	0.36	<0.2	<0.2	--	<0.2	--	--	--	--	--	--
Lithium	ug/L	0.83	0.91	0.77	0.97	0.98	0.97	0.94	0.93	--	0.86	--	--	--	--	--	--
Mercury	ug/L	<0.1	<0.18	<0.13	<0.13	<0.13	<0.13	<0.13	<0.13	--	<0.13	--	--	--	--	--	--
Molybdenum	ug/L	25.3	29.8	23.4	22.6	23.9	23.8	22.9	22.9	--	24.8	--	--	--	--	--	--
Selenium	ug/L	<0.21	<0.21	<0.21	<0.21	<0.21	<0.21	<0.32	<0.32	--	<0.32	--	--	--	--	--	--
Thallium	ug/L	<0.14	<0.14	<0.14	0.2	<0.14	<0.14	<0.14	<0.14	--	<0.14	--	--	--	--	--	--
Total Radium	pCi/L	1.47	0.387	0.492	0.331	0.407	1.18	1.34	1.15	--	0.289	--	--	--	--	--	--
Radium-226	pCi/L	0.484	-0.152	-0.097	0	0	0.482	0.594	0.163	--	0.132	--	--	--	--	--	--
Radium-228	pCi/L	0.985	0.387	0.492	0.331	0.407	0.696	0.746	0.982	--	0.157	--	--	--	--	--	--
Field Specific Conductance	umhos/cm	405	505.8	487.2	509.7	858	486	334.2	479.5	433.5	398.9	503.8	517	514	556	557.3	563
Oxygen, Dissolved	mg/L	0.88	0.04	0.18	0.34	0.13	0.14	0.25	0.12	0.23	0.14	0.1	0.13	0.12	0.24	0.19	0.18
Field Oxidation Potential	mV	-84.7	-106.2	-71.1	-113	-98.4	-55.2	-19.8	-77.3	97.1	-111.6	-75.8	-4.5	-60.5	-68.2	-55.9	79.6
Groundwater Elevation	feet	606.39	609.01	606.73	608.2	607.84	608.98	609.63	605.69	609.43	606.46	610.27	615.33	613.2	613.79	604.54	608.63
Temperature	deg C	15.1	15.4	15.3	15	14.6	14.8	14.7	14.9	14.9	14.4	15	13.9	14.2	13.6	13.9	13.5
Turbidity	NTU	--	0.36	0.63	0.38	0.21	0.37	0.66	0.17	1.25	0.42	2.83	0	2.66	0.75	1.11	0
pH at 25 Degrees C	Std. Units	7.4	7.3	7.6	7.8	7.3	7.7	7.8	7.6	7.5	7.7	7.7	7.6	7.7	7.7	7.7	7.8

Single Location

Name: WPL - Nelson

Dewey

Location ID: B-31A

Number of Sampling Dates: 22

Parameter Name	Units	10/7/2021	4/26/2022	10/18/2022	4/4/2023	10/2/2023	4/23/2024
Boron	ug/L	178	198	213	193	191	187
Calcium	ug/L	53500	55300	45300	46100	48300	46000
Chloride	mg/L	60.3	56	53.9	50.4	55.7	51
Fluoride	mg/L	0.15	0.22	0.14	0.18	0.14	0.15
Field pH	Std. Units	7.44	7.82	7.63	7.59	7.67	7.74
Sulfate	mg/L	14.9	15.4	23	15.9	20	19
Total Dissolved Solids	mg/L	294	316	310	324	274	306
Antimony	ug/L	--	--	--	--	--	--
Arsenic	ug/L	--	--	--	--	--	--
Barium	ug/L	--	--	--	--	--	--
Beryllium	ug/L	--	--	--	--	--	--
Cadmium	ug/L	--	--	--	--	--	--
Chromium	ug/L	--	--	--	--	--	--
Cobalt	ug/L	--	--	--	--	--	--
Lead	ug/L	--	--	--	--	--	--
Lithium	ug/L	--	--	--	--	--	--
Mercury	ug/L	--	--	--	--	--	--
Molybdenum	ug/L	--	--	--	--	--	--
Selenium	ug/L	--	--	--	--	--	--
Thallium	ug/L	--	--	--	--	--	--
Total Radium	pCi/L	--	--	--	--	--	--
Radium-226	pCi/L	--	--	--	--	--	--
Radium-228	pCi/L	--	--	--	--	--	--
Field Specific Conductance	umhos/cm	553	556	558.1	522.6	522.8	504.8
Oxygen, Dissolved	mg/L	1.35	0.17	0.18	0.36	0.27	0.11
Field Oxidation Potential	mV	23.5	59.6	31.7	-68	-32.3	-35.4
Groundwater Elevation	feet	603.84	609.95	603.61	607.85	603.95	606.63
Temperature	deg C	13.5	13.2	13.2	12.9	13.4	13.3
Turbidity	NTU	0	0	0.94	1.17	0	0
pH at 25 Degrees C	Std. Units	7.9	7.6	7.9	7.9	7.7	8.6

Single Location

Name: WPL - Nelson

Dewey

Location ID: B-31R

Number of Sampling Dates: 23

Parameter Name	Units	12/9/2015	4/13/2016	7/19/2016	10/20/2016	1/12/2017	4/17/2017	6/8/2017	8/1/2017	10/19/2017	4/2/2018	10/9/2018	11/12/2018	4/22/2019	10/14/2019	4/13/2020	10/12/2020
Boron	ug/L	851	838	641	1020	749	929	895	1550	645	540	1430	--	906	915	730	702
Calcium	ug/L	77400	84900	76100	84200	73900	85600	90700	93400	75700	72900	125000	--	105000	110000	93800	95700
Chloride	mg/L	29.9	17.6	30.3	16.4	26	20.4	20.7	3.6	29	32.6	19.7	--	17.8	26	29.9	24.4
Fluoride	mg/L	<0.2	<0.2	<0.2	0.17	0.26	0.12	0.13	0.16	0.14	<0.1	<0.1	--	0.16	0.25	0.28	<0.48
Field pH	Std. Units	6.79	6.76	6.44	6.53	6.8	6.8	6.67	6.56	7.19	6.76	6.41	6.59	6.62	6.72	6.79	6.89
Sulfate	mg/L	28.8	34.1	38.5	49.7	34.9	43	41.1	55.6	19.2	22	186	162	121	146	89.4	49.4
Total Dissolved Solids	mg/L	374	404	406	452	380	416	426	432	358	374	668	596	516	480	464	462
Antimony	ug/L	0.47	0.15	0.21	0.24	0.18	0.22	<0.15	0.18	--	0.15	--	--	--	--	--	--
Arsenic	ug/L	0.47	0.24	0.37	0.37	0.22	0.29	<0.28	<0.28	--	<0.28	--	--	--	--	--	--
Barium	ug/L	86.2	93.5	85.3	92.6	86.7	91.1	93.9	97.4	--	72.1	--	--	--	--	--	--
Beryllium	ug/L	<0.13	<0.13	<0.13	<0.25	<0.13	<0.13	<0.18	<0.18	--	<0.18	--	--	--	--	--	--
Cadmium	ug/L	2.5	2.5	2	3	2.2	3	2.9	3.1	--	2	--	--	--	--	--	--
Chromium	ug/L	0.43	0.4	<0.39	<0.39	0.41	<0.39	<1	<1	--	<1	--	--	--	--	--	--
Cobalt	ug/L	3	3.5	5.4	5.2	6.6	3.1	2.3	4.4	--	3.3	--	--	--	--	--	--
Lead	ug/L	1.8	0.53	0.14	0.37	0.047	0.57	<0.2	<0.2	--	<0.2	--	--	--	--	--	--
Lithium	ug/L	18.6	18	18.1	22.3	21.4	21.7	21.4	22	--	16.2	--	--	--	--	--	--
Mercury	ug/L	<0.1	<0.18	<0.13	<0.13	<0.13	<0.13	<0.13	<0.13	--	<0.13	--	--	--	--	--	--
Molybdenum	ug/L	31.4	27.2	23.9	24.4	27.1	26.8	25.4	21.6	--	31.9	--	--	--	--	--	--
Selenium	ug/L	0.69	0.48	<0.21	0.29	0.63	0.96	<0.32	1.4	--	0.93	--	--	--	--	--	--
Thallium	ug/L	2.2	1.9	2	2.3	2.1	2.2	2.2	2	--	1.8	--	--	--	--	--	--
Total Radium	pCi/L	1.34	1.22	1.16	1.3	1.23	0.613	1.36	1.31	--	0.676	--	--	--	--	--	--
Radium-226	pCi/L	0.575	0.661	0.513	0.583	0.92	0.38	0.534	0.612	--	0.132	--	--	--	--	--	--
Radium-228	pCi/L	0.769	0.559	0.649	0.717	0.31	0.233	0.827	0.698	--	0.544	--	--	--	--	--	--
Field Specific Conductance	umhos/cm	543	674	660	742	1100	637	465.4	697	519.6	476.8	1016	858	827	837	763	826
Oxygen, Dissolved	mg/L	2.36	0.07	0.09	0.33	0.21	0.16	0.21	0.27	0.21	0.45	0.12	0.19	0.1	0.1	0.14	0.22
Field Oxidation Potential	mV	77.6	36.2	-11	5.8	12.3	676	64.7	2.9	153	28	-0.5	1	94.2	20.7	7.3	-60.7
Groundwater Elevation	feet	607.4	609.34	606.55	608.51	608.37	607.2	610.5	606.84	609.47	604.44	610.39	609.11	615.01	612.5	613.8	604.66
Temperature	deg C	15.8	15	15.1	15.2	14.5	13.8	13.6	14.8	15	13.8	15.9	15	11.8	14.2	12	14
Turbidity	NTU	--	1.01	1.5	0.7	0.72	0.62	0.92	1.18	1.53	1.29	3.94	3.83	0	2.81	0.01	0
pH at 25 Degrees C	Std. Units	6.7	6.8	6.6	7.1	6.8	6.8	6.8	6.8	6.8	6.8	6.8	--	6.8	7	6.8	7.1

Single Location

Name: WPL - Nelson

Dewey

Location ID: B-31R

Number of Sampling Dates: 23

Parameter Name	Units	4/19/2021	10/7/2021	4/25/2022	10/18/2022	4/4/2023	10/2/2023	4/23/2024
Boron	ug/L	621	353	454	327	589	519	659
Calcium	ug/L	91400	79000	81100	78500	88300	114000	89300
Chloride	mg/L	23.3	36.5	36	35.1	24.5	19.3	35.4
Fluoride	mg/L	0.19	0.22	<0.095	0.21	<0.48	0.14	0.31
Field pH	Std. Units	6.91	6.63	6.77	6.83	6.62	6.82	6.73
Sulfate	mg/L	45.3	24.9	60	29.6	50	103	113
Total Dissolved Solids	mg/L	454	372	428	386	440	536	506
Antimony	ug/L	--	--	--	--	--	--	--
Arsenic	ug/L	--	--	--	--	--	--	--
Barium	ug/L	--	--	--	--	--	--	--
Beryllium	ug/L	--	--	--	--	--	--	--
Cadmium	ug/L	--	--	--	--	--	--	--
Chromium	ug/L	--	--	--	--	--	--	--
Cobalt	ug/L	--	--	--	--	--	--	--
Lead	ug/L	--	--	--	--	--	--	--
Lithium	ug/L	--	--	--	--	--	--	--
Mercury	ug/L	--	--	--	--	--	--	--
Molybdenum	ug/L	--	--	--	--	--	--	--
Selenium	ug/L	--	--	--	--	--	--	--
Thallium	ug/L	--	--	--	--	--	--	--
Total Radium	pCi/L	--	--	--	--	--	--	--
Radium-226	pCi/L	--	--	--	--	--	--	--
Radium-228	pCi/L	--	--	--	--	--	--	--
Field Specific Conductance	umhos/cm	747	649	728	711	698	898	750
Oxygen, Dissolved	mg/L	0.12	1.81	0.38	0.45	0.18	0.19	0.19
Field Oxidation Potential	mV	16.3	16.7	-25.3	-28.4	95	-36.7	-14.6
Groundwater Elevation	feet	608.66	603.98	610.27	603.69	607.88	603.98	606.61
Temperature	deg C	12.1	13.8	11.3	12.7	11.9	14.2	12.8
Turbidity	NTU	11.39	0	3.68	1.27	2.38	4.56	0.27
pH at 25 Degrees C	Std. Units	6.9	7.3	6.9	7.3	7	6.8	8.6

Appendix E

Alternative Source Demonstration Reports

E1 Alternative Source Demonstration, October 2023

Detection Monitoring

Alternative Source Demonstration

October 2023 Detection Monitoring

Slag Pond
Nelson Dewey Generating Station
Cassville, Wisconsin

Prepared for:



SCS ENGINEERS

25224071.00 | April 22, 2024

2830 Dairy Drive
Madison, WI 53718-6751
608-224-2830

Table of Contents

Section	Page
PE Certification.....	iii
1.0 Introduction.....	1
1.1 §257.94(e)(2) Alternative Source Demonstration Requirements	1
1.2 Site Information and Map.....	1
1.3 Statistically Significant Increases Identified.....	2
1.4 Overview of Alternative Source Demonstration Approach.....	2
2.0 Background.....	3
2.1 Geologic and Hydrogeologic Setting.....	3
2.1.1 Regional Information.....	3
2.1.2 Site Information.....	3
2.2 Coal Combustion Residuals Rule Monitoring System.....	4
2.3 Other Monitoring Wells.....	4
3.0 Methodology and Analysis Review.....	4
3.1 Sampling and Field Analysis Review	4
3.2 Laboratory Analysis Review	4
3.3 Statistical Evaluation Review.....	5
3.4 Summary of Methodology and Analysis Review Findings	5
4.0 Alternative Sources.....	5
4.1 Potential Causes of Statistically Significant Increases	5
4.1.1 Natural Variation	5
4.1.2 Man-Made Alternative Sources	6
4.2 Lines of Evidence	6
4.2.1 Previous CCR Pond and Landfill Study.....	6
4.2.2 Slag Pond Closure Sampling Results	7
4.2.3 State Program Groundwater Monitoring Results	8
5.0 Alternative Source Demonstration Conclusions	8
6.0 Site Groundwater Monitoring Recommendations.....	8
7.0 References.....	8

Tables

- Table 1. Groundwater Analytical Results Summary – October 2023
Table 2. Historical Analytical Results for Parameters with SSIs
Table 3. Groundwater Elevation Summary – State and CCR Monitoring Wells
Table 4. Analytical Results – State Monitoring Program

Figures

- Figure 1. Site Location Map
- Figure 2. Aerial View
- Figure 3. Site Plan and Monitoring Well Locations
- Figure 4. Water Table Flow Map – October 2023

Appendices

- Appendix A CCR Well Trend Plots
- Appendix B 1994 RMT Environmental Contamination Assessment Information
- Appendix C 2016 Low-Hazard Waste Exemption Leaching Test Results – Slag and Ash

I:\25224071.00\Deliverables\2023 October ASD NED\240422_NED_Oct23 ASD.docx

PE CERTIFICATION

 <p>The seal is circular with a decorative border. The word "WISCONSIN" is at the top, "PROFESSIONAL ENGINEER" is at the bottom, and "SHERREN C. CLARK" is in the center. Below the name, it says "E-29863" and "MADISON, WIS."</p>	<p>I, Sherren Clark, hereby certify that the information in this alternative source demonstration is accurate and meets the requirements of 40 CFR 257.94(e)(2). This certification is based on my review of the groundwater data and related site information available for the Nelson Dewey Generating Station Slag Pond facility. I am a duly licensed Professional Engineer under the laws of the State of Wisconsin.</p> <p></p> <p>4/22/2024</p> <p>(signature) (date)</p> <p>Sherren Clark</p> <p>(printed or typed name)</p> <p>License number <u>E-29863</u></p> <p>My license renewal date is July 31, 2024.</p> <p>Pages or sheets covered by this seal:</p> <p>Alternative Source Demonstration, October 2023</p> <p>Detection Monitoring – Slag Pond</p> <p>Nelson Dewey Generating Station, Cassville</p> <p>(Entire Document)</p>
--	---

[This page left blank intentionally]

1.0 INTRODUCTION

This Alternative Source Demonstration (ASD) was prepared to support compliance with the groundwater monitoring requirements of the “Coal Combustion Residuals (CCR) Final Rule” published by the U.S. Environmental Protection Agency (U.S. EPA) in the *Hazardous and Solid Waste Management System; Disposal of Coal Combustion Residuals from Electric Utilities; Final Rule*, dated April 17, 2015 (U.S. EPA, 2015), and subsequent amendments. Specifically, this report was prepared to fulfill the requirements of 40 CFR 257.94(e)(2). The applicable sections of the Rule are provided below in *italics*.

1.1 §257.94(E)(2) ALTERNATIVE SOURCE DEMONSTRATION REQUIREMENTS

The owner and operator may demonstrate that a source other than the CCR Unit caused the statistically significant increase over background levels for a constituent or that the statistically significant increase resulted from error in sampling, analysis, statistical evaluation, or natural variation in groundwater quality. The owner or operator must complete the written demonstration within 90 days of detecting a statistically significant increase over background levels.

An ASD is completed when there are exceedances of one or more benchmarks established within the groundwater monitoring program to determine if any other sources are likely causes of the identified exceedance(s) of established benchmark(s) at the site. This ASD was performed in response to results indicating a statistically significant increase (SSI) over background levels during detection monitoring under the CCR Rule.

This ASD report evaluates the SSIs observed in the statistical evaluation of the October 2023 detection monitoring event at the Nelson Dewey Generating Station (NED). The first ASD prepared for this facility evaluated the SSIs observed in the statistical evaluation of the October 2017 detection monitoring event (SCS Engineers [SCS], 2018). The October 2017 ASD and subsequent semiannual updates have included several lines of evidence demonstrating that SSIs reported for Appendix III parameters in the downgradient monitoring wells were likely due to man-made sources other than the slag pond CCR Unit and/or naturally occurring constituents in the alluvial aquifer. The conclusions of this ASD are consistent with previous ASDs.

1.2 SITE INFORMATION AND MAP

The NED site is located along the east bank of the Mississippi River, north of the Village of Cassville, in Grant County, Wisconsin (**Figure 1**). The facility includes a decommissioned coal-fired generating plant, a CCR landfill that was closed in 2001, a closed Slag Pond, and a closed wastewater treatment pond. The layout of the site on an aerial photograph base is shown on **Figure 2**. The closed landfill at the NED facility was permitted under Wisconsin Department of Natural Resources (WDNR) License #02525.

The existing CCR Unit evaluated for this ASD is:

- Slag Pond (existing surface impoundment – closed January 2018)

A map showing the CCR Unit and all background (or upgradient) and downgradient monitoring wells with identification numbers for the CCR groundwater monitoring program and the state monitoring program is provided on **Figure 3**.

Operations at the facility began in the late 1950s, and a CCR impoundment that included what is now the Slag Pond closure area was commissioned at that time. The CCR landfill was initially licensed in 1976 and received fly ash from NED until it was closed in phases between 1996 and 2001. The CCR landfill was initially operated as a fly ash sluice basin, then transitioned to dry ash placement prior to closure. The wastewater ponds, now closed, were constructed in 1976 for the purpose of settling CCR from the NED process wastewater streams and sediment from storm water runoff prior to discharge. Both NED generating units were retired on December 31, 2015, and have since been decommissioned. The generating station was demolished in 2017. Closure of the slag pond was completed in January 2018.

1.3 STATISTICALLY SIGNIFICANT INCREASES IDENTIFIED

The statistical evaluation was completed in accordance with 40 CFR 257.93(f)(3) using a prediction interval procedure, in which an interval for each constituent is established from the distribution of the background data, and the level of each constituent in each compliance well is compared to the upper prediction limit (UPL). The initial evaluation was based on an interwell comparison. The UPLs were calculated based on a 1-of-2 resampling approach. The UPLs and the analytical results for the October 2023 monitoring event are summarized in the attached **Table 1**.

The initial evaluation indicated that the October 2023 monitoring event results represent an SSI over background for the following parameters and wells:

- Boron: B-7R, B-11A, B-11B, B-11R, B-31A, B-31R
- Calcium: B-31R
- Field pH: B-11A, B-11B, B-31A
- Sulfate: B-11A, B-11B, B-11R, B-31R
- Total Dissolved Solids (TDS): B-11B, B-31R

The SSIs are consistent with SSIs identified in previous detection monitoring results.

1.4 OVERVIEW OF ALTERNATIVE SOURCE DEMONSTRATION APPROACH

This ASD report includes:

- Background information (**Section 2.0**).
- Evaluation of potential that SSIs are due to methodology or analysis (**Section 3.0**).
- Evaluation of potential that SSIs are due to natural sources or man-made sources other than the CCR Units (**Section 4.0**).
- ASD conclusions (**Section 5.0**).
- Monitoring recommendations (**Section 6.0**).

Historical monitoring results from background and compliance sampling for the CCR Rule constituents with SSIs are provided in **Table 2**. The laboratory report for the October 2023 event will be included in the 2024 Annual Groundwater Monitoring and Corrective Action Report to be completed in January 2025. Complete laboratory reports for the background monitoring events and previous detection monitoring events were included in the previous annual groundwater monitoring and corrective action reports.

2.0 BACKGROUND

To provide context for the ASD evaluation, the following background information is provided in this section of the report, prior to the ASD evaluation sections:

- Geologic and hydrogeologic setting
- CCR Rule monitoring system
- Other monitoring wells

A more detailed discussion of the background information for the site is provided in the ASD for the October 2017 event (SCS, 2018).

2.1 GEOLOGIC AND HYDROGEOLOGIC SETTING

2.1.1 Regional Information

The uppermost geologic formation beneath the NED site is the surficial alluvial aquifer. The alluvial aquifer consists of Mississippi River valley sand and gravel deposits, and is the uppermost aquifer as defined in section 257.53 of the CCR Rule. This deposit is prevalent along the edges of the entire Mississippi River valley in southwestern Wisconsin.

The alluvial aquifer is underlain by dolomitic bedrock of the Prairie du Chien Group. The dolomite bedrock is also an aquifer and is likely hydraulically connected to the alluvial aquifer above.

Regionally, groundwater flow is generally to the southwest and discharges to the Mississippi River.

Additional details on the regional geology were provided in the October 2017 ASD (SCS, 2018).

2.1.2 Site Information

The thickness of the alluvium in the immediate vicinity of the site is over 125 feet, as evidenced by local water supply well logs (SCS, 2018). These logs are also evidence that the alluvial aquifer yields useable quantities of groundwater for supply wells in the area. Soil boring logs for monitoring wells installed at the site also generally indicate sand and gravel soils within the monitored depths.

The groundwater flow direction in the vicinity of the plant is generally southwest toward the Mississippi River, except when influenced by high river levels as discussed below. Historically, infiltration at the former Slag Pond, former fly ash basin, and the former Wisconsin Pollutant Discharge Elimination System (WPDES) ponds caused groundwater mounding to be present around these features; however, these ponds have now all been closed and are no longer sources of infiltration.

While site water level measurements typically indicate that groundwater flow is to the southwest, discharging to the Mississippi River, the local flow directions are influenced by changes in the river level. During periods of high river water levels, the flow temporarily reverses, and the river discharges to the shallow sand and gravel aquifer. The groundwater flow direction during the October 2023 detection monitoring event was generally to the south and southwest, toward the Mississippi River (**Figure 4**). The groundwater elevations are provided in **Table 3**.

2.2 COAL COMBUSTION RESIDUALS RULE MONITORING SYSTEM

The groundwater monitoring system established in accordance with the CCR Rule consists of one upgradient (background) monitoring well and six downgradient monitoring wells. The background well is B-26. The downgradient wells include B-7R, B-11A, B-11B, B-11R, B-31A, and B-31R. The CCR Rule wells are installed within the surficial alluvium aquifer. Well depths range from approximately 23 to 114 feet, measured from the top of the well casing.

2.3 OTHER MONITORING WELLS

There are several additional groundwater monitoring wells at the NED facility that are part of the monitoring system developed for the state monitoring program. All of the wells included in the CCR monitoring well network were already in use for the state monitoring program. The well locations are shown on **Figure 3**. The state program monitoring wells and two private wells are used to monitor groundwater conditions at the site under WDNR License Number 2525, which includes the closed CCR landfill and the closed Slag Pond. Monitoring wells for the state monitoring program are installed in the surficial sand and gravel aquifer, which is the uppermost aquifer as defined under 40 CFR 257.53.

3.0 METHODOLOGY AND ANALYSIS REVIEW

To evaluate the potential that an SSI is due to a source other than the regulated CCR Unit, SCS used a two-step evaluation process. First, the sample collection, field and laboratory analysis, and statistical evaluation were reviewed to identify any potential error or analysis that led to an exceedance of the benchmark. Second, potential alternative sources, including natural variation and man-made sources other than the CCR Unit, were evaluated. This section of the report provides the findings of the methodology and analysis review. **Section 4.0** of the report addresses the potential alternative sources.

3.1 SAMPLING AND FIELD ANALYSIS REVIEW

Field notes and sampling results were reviewed to determine if a sampling error may have caused or contributed to the observed SSIs. Potential field sampling errors or issues could include mislabeling of samples, improper sample handling, missed holding times, cross contamination during sampling, or other field error. Field blank sample results were also reviewed for any indication of potential contamination from sampling equipment or containers. Based on the review of the field notes and results, SCS did not identify any indication that the SSIs were due to a sampling error.

SCS did not identify any issues with the field sampling or field analysis based on review of the data and field notes.

3.2 LABORATORY ANALYSIS REVIEW

The laboratory reports for the October 2023 detection monitoring events were reviewed to evaluate whether any laboratory analysis error or issue may have caused or contributed to the observed SSIs. The laboratory report review included reviewing the laboratory quality control flags and narrative, verifying that correct methods were used and desired detection limits were achieved, and checking the field and laboratory blank sample results. Laboratory reports for the background monitoring events were reviewed for the October 2017 ASD. Laboratory reports for subsequent detection monitoring events were reviewed as part of the ASD preparation for each event.

Based on the review of the laboratory reports, SCS did not identify any indication that any SSI was due to a laboratory analysis error. There were no laboratory quality control flags or issues identified in the laboratory reports that affect the usability of the data for detection monitoring.

Time series plots for the parameters with SSIs were also reviewed for any anomalous results that might indicate a possible sampling or laboratory error (e.g., dilution error or incorrect sample labeling). The time series plots are provided in **Appendix A**. None of the time series plots included anomalous results that appeared to indicate a sampling or laboratory error.

3.3 STATISTICAL EVALUATION REVIEW

The review of the statistical results and methods included a quality control check of the following:

- Input analytical data vs. laboratory analytical reports
- Statistical method and process for each SSI

Based on the review of the statistical evaluation, SCS did not identify any errors or issues in the statistical evaluation that caused or contributed to the determination of interwell SSIs at the downgradient monitoring wells.

3.4 SUMMARY OF METHODOLOGY AND ANALYSIS REVIEW FINDINGS

In summary, there were no changes to the SSI determinations for the October 2023 detection monitoring events based on the methodology and analysis review. No errors or issues causing or contributing to the reported SSIs were identified.

4.0 ALTERNATIVE SOURCES

This section of the report discusses the potential alternative sources for the SSI constituents at the downgradient wells, identifies the most likely alternative source(s), and presents the lines of evidence indicating that an alternative source is the most likely cause of the observed SSIs.

4.1 POTENTIAL CAUSES OF STATISTICALLY SIGNIFICANT INCREASES

4.1.1 Natural Variation

The statistical analysis was completed using an interwell approach, comparing the October 2023 detection monitoring results to the UPLs calculated based on sampling of the background well (B-26). If concentrations of a constituent that is naturally present in the aquifer vary spatially, then the potential exists that the downgradient concentrations may be higher than upgradient concentrations due to natural variation.

Although natural variation is present in the shallow aquifer, it does not appear likely that natural variation is the primary source causing the boron, field pH, sulfate, and TDS SSIs. These parameters were detected at higher concentrations than would likely be present naturally.

Natural variation may have caused or contributed to the SSI for calcium at B-31R. As discussed in **Section 2.1.1**, the alluvial aquifer is underlain by dolomitic bedrock of the Prairie du Chien Group. The dolomite aquifer is also present in the bluffs northeast of the site, and groundwater from the dolomite likely discharges to the alluvial aquifer. Calcium is a typical constituent of groundwater in

dolomite aquifers. The calcium concentrations in upgradient well B-26 have exceeded those in at least three of the downgradient wells, suggesting that natural variability may contribute to the calcium concentrations observed in the downgradient monitoring wells.

4.1.2 Man-Made Alternative Sources

Man-made alternative sources that could potentially contribute to the boron, calcium, field pH, sulfate, and TDS SSIs could include the closed CCR landfill, the coal storage area, or other plant operations. Based on the groundwater flow directions and on previous investigations at the site, the closed landfill appears to be the most likely man-made cause of the SSIs for the downgradient wells B-7R, B-11A, B-11B, B-11R, B-31A, and B-31R.

4.2 LINES OF EVIDENCE

The lines of evidence indicating that the SSIs for boron, calcium, field pH, sulfate, and TDS in one or more compliance wells relative to the background well are more likely due to the closed landfill and prior fly ash sluicing than to the Slag Pond include:

1. A previous Environmental Contamination Assessment completed for the ash disposal facility indicated that the fly ash sluicing and landfill were the primary source of the groundwater impacts in the area, based on multiple lines of evidence.
2. Sampling performed in preparation for the Slag Pond closure indicated that the slag and the Slag Pond sediment had little potential to cause the SSIs for boron, sulfate, and TDS.
3. Past and current groundwater monitoring performed under the state monitoring program shows that groundwater quality has improved since the 1990s in response to termination of fly ash sluicing and closure and capping of the ash landfill. Recent concentration increases at some wells in the state monitoring program appear to be attributable to the closed CCR landfill source and to changes in groundwater flow at the site in response to closure of the Slag Pond.

The data supporting these lines of evidence are discussed below. Most of these lines of evidence and the supporting data were discussed in detail in the ASD for the October 2017 detection monitoring event (SCS, 2018), with the exception of the TDS SSI concentrations. For lines of evidence included in previous ASDs, the discussion focuses on any updated information collected since the previous ASD, with references to the previous ASD for additional details.

4.2.1 Previous CCR Pond and Landfill Study

A previous investigation titled *Environmental Contamination Assessment: Nelson Dewey Generating Station Ash Disposal Facility*, completed by RMT in 1994, found that groundwater impacts were associated with disposal of fly ash in the now-closed CCR landfill located immediately north of the Slag Pond (**Figure 3**). The purpose of the 1994 Environmental Contamination Assessment (ECA) was to investigate the impacts to groundwater at the NED landfill. The ECA was used to evaluate the feasibility of possible remedial alternatives. The remedial alternative that was ultimately selected was to convert the plant to dry fly ash handling.

The primary lines of evidence from the 1994 report that support the current ASD for boron, calcium, field pH, sulfate, and TDS include:

- Water leaching tests for ash and slag indicated that boron and sulfate concentrations in the slag leachate were orders of magnitude lower than in the fly ash leachate

(**Appendix B, Table 5**). Higher pH values were also reported for leach samples of Western coal fly ash in 1990 to 1992 than for the slag samples.

- Surface water samples from the then active fly ash sluice pond and the Slag Pond indicated that boron and sulfate concentrations in the Slag Pond were one or more orders of magnitude lower than in the ash sluice pond. The surface water pH measurement was also higher in the ash sluice pond. The surface water boron and sulfate concentrations in the Slag Pond were higher than leach test results, which was attributed to infiltration of ash sluice pond water through the berm between the ponds into the Slag Pond (**Appendix B, Table 6**).
- Groundwater sampling at monitoring wells B-38 and B-38A (now abandoned), which were installed through and screened below the ash disposal area (now closed landfill), indicated that groundwater affected by ash sluicing was characterized by high pH and elevated concentrations of boron, sulfate, and TDS (**Appendix B, Site Map**, and **Table 8**).

Although calcium was not included in the historical state groundwater monitoring program or evaluated in the 1994 report, hardness was monitored and provides an indication of relative calcium concentrations. Surface water samples from the then active ash sluice pond and the Slag Pond indicated that hardness in the Slag Pond was lower than in the ash sluice pond (**Appendix B, Table 6**). These results suggest that if the calcium SSI is not solely due to natural variation, then the closed CCR landfill is the most likely man-made source of calcium.

The results of the 1994 ECA were reported to WDNR in November 1994. The ECA investigation was then used for a feasibility study to determine appropriate ash disposal operation on site. Following the ECA, the plant converted to a dry ash handling system. Dry ash was placed in the CCR landfill through the 1990s, and the landfill was capped and closed in phases in 1996 through 2001. After that time, fly ash was not disposed of at the facility.

4.2.2 Slag Pond Closure Sampling Results

Results of leaching test analysis performed for slag, ash, soil, and sediment were submitted as part of a Low Hazard Exemption Request to the WDNR in March 2017 (SCS, 2017). The Exemption Request was submitted as part of the Closure Plan for the site and requested WDNR approval to consolidate materials from decommissioning activities in the Slag Pond and Slag Handling Area, which would then be capped with a composite final cover system. The sediment and soil samples were collected to characterize the materials that would remain on site under the Closure Plan. Leaching tests were performed using ASTM water leach test methods. The leaching test analytical results for parameters with SSIs that were included in the leaching test program (boron, sulfate, and TDS) are summarized in **Appendix C**.

The sampling results in the Exemption Request indicated that the materials to be consolidated and capped were not likely to cause groundwater standard exceedances for boron, sulfate, or TDS. The leach test results for slag, Slag Pond sediment, and soil in the Slag Handling Area were below the state groundwater standards for boron and sulfate. The parameter TDS does not currently have a state standard but the leach test results for slag, Slag Pond sediment, and soil in the Slag Handling Area were all below the calculated TDS UPL for the site (**Table 1** and **Appendix C**). The boron, sulfate, and TDS results were also below the concentrations in the downgradient CCR wells with SSIs, and well below the historical results for former well B-38, which was located within the CCR landfill area, upgradient from the Slag Pond (**Appendix B, Table 8**).

The Low Hazard Exemption was granted by the WDNR based on the sampling results and other information presented.

4.2.3 State Program Groundwater Monitoring Results

Past and current groundwater monitoring performed under the state monitoring program shows that groundwater quality has improved substantially since the 1990s in response to termination of fly ash sluicing, and closure and capping of the ash landfill (SCS, 2018). The long-term trends show that concentrations of boron and sulfate in groundwater have decreased or stabilized since termination of fly ash sluicing and closure of the landfill, in some cases by an order of magnitude or more. The results suggest that current pH levels and boron, sulfate, and TDS concentrations likely represent residual contamination from historical ash disposal in the CCR landfill area. Increases in boron, sulfate, and TDS concentrations at B-11B beginning in 2018 appear to be attributable to the closed CCR landfill and to changes in groundwater flow at the site related to a decrease in the volume of water discharged to the Slag Pond and subsequent closure of the Slag Pond. Concentrations of boron in samples from B-11B increased to a peak in April 2019 and have been lower since that event. Sulfate concentrations in samples from B-11B peaked in April 2022 and have been lower since that event. A summary of state analytical groundwater results is provided in Table 4.

5.0 ALTERNATIVE SOURCE DEMONSTRATION CONCLUSIONS

The lines of evidence discussed above regarding the SSIs reported for boron, calcium, field pH, sulfate, and TDS results in downgradient monitoring wells demonstrate that the SSIs are likely primarily due to sources other than the closed Slag Pond. The SSIs for boron, calcium, field pH, sulfate, and TDS appear to be due to historical ash disposal in the closed CCR landfill, which is not subject to the requirements of 40 CFR 257.50-107. The landfill is regulated by the WDNR under the solid waste program (License 02525). Natural variation in groundwater quality in the aquifer may also contribute to the SSI for calcium.

6.0 SITE GROUNDWATER MONITORING RECOMMENDATIONS

In accordance with section 257.94(e)(2) of the CCR Rule, the NED Slag Pond site may continue with detection monitoring based on this ASD. The ASD report will be included in the 2024 Annual Report due January 31, 2025.

7.0 REFERENCES

RMT, 1994, Environmental Contamination Assessment: Nelson Dewey Generating Station Ash Disposal Facility, November 1994.

SCS Engineers, 2017, Low Hazard Exemption Request, Nelson Dewey Generating Station, Cassville, WI, March 2017.

SCS Engineers, 2018, 2017 Alternative Source Demonstration, October 2017 Monitoring Event, Nelson Dewey Generating Station, April 2018.

U.S. Environmental Protection Agency (U.S. EPA), 2015, Hazardous and Solid Waste Management System; Disposal of Coal Combustion Residuals from Electric Utilities; Final Rule, April 2015.

Tables

- 1 Groundwater Analytical Results Summary – October 2023
- 2 Historical Analytical Results for Parameters with SSIs
- 3 Groundwater Elevation Summary – State and CCR Monitoring Wells
- 4 Analytical Results – State Monitoring Program

Table 1. Groundwater Analytical Results Summary
Nelson Dewey Slag Pond, Cassville, WI / SCS Engineers Project #25224071.00

Parameter Name	UPL	Background Well	Compliance Wells					
		B-26	B-7R	B-11A	B-11B	B-11R	B-31A	B-31R
		10/3/2023	10/3/2023	10/3/2023	10/3/2023	10/3/2023	10/2/2023	10/2/2023
Groundwater Elevation, ft amsl		604.20	604.39	603.97	603.91	603.93	603.95	603.98
Appendix III								
Boron, ug/L	70.5	44.8	144	231	5,040	3,120	191	519
Calcium, ug/L	104,000	85,100	41,000 P6	60,300	80,600	90,600	48,300	114,000
Chloride, mg/L	72.7	50.2	4.7	43.9	25.5	41.6	55.7	19.3
Fluoride, mg/L	0.2	<0.095	<0.095 M0	0.16 J	<0.95 D3	0.20 J	0.14 J	0.14 J
Field pH, Std. Units	7.64	7.47	6.30	7.66	7.84	6.80	7.67	6.82
Sulfate, mg/L	47.1	42.5	4.5	86	403	58	20	103
Total Dissolved Solids, mg/L	536	418	184	352	918	456	274	536

7.81 Blue shaded cell indicates the compliance well result exceeds the UPL (background) and the Limit of Quantitation (LOQ).

Abbreviations:

UPL = Upper Prediction Limit

ug/L = micrograms per liter

LOD = Limit of Detection

SSI = Statistically Significant Increase

mg/L = milligrams per liter

LOQ = Limit of Quantitation

ft amsl = feet above mean sea level

Lab Notes:

J = Estimated concentration at or above the LOD and below the LOQ.

D3 = Sample was diluted due to the presence of high levels of non-target analytes or other matrix interference.

M0 = Matrix Spike recovery and/or matrix spike duplicate recovery was outside laboratory control limits.

P6 = Matrix spike recovery was outside laboratory control limits due to a parent sample concentration notably higher than the spike level.

Notes:

- An individual result above the UPL may not constitute an SSI above background. See the accompanying letter text for identification of statistically significant results.
- Interwell UPLs calculated based on results from background well B-26. UPLs are based on a 1-of-2 retesting approach.
- Interwell UPLs updated July 2023 based on background well results from December 2015 through April 2023.

Created by: NDK	Date: 12/6/2022
Last revision by: RM	Date: 10/30/2023
Checked by: BR	Date: 11/2/2023
Proj Mgr QA/QC/Scientist: TK	Date: 1/5/2024

Table 2. Historical Analytical Results for Parameters with SSIs
Nelson Dewey Generating Station - Cassville, Wisconsin / SCS Engineers Project #25224071.00

Well Group	Well	Collection Date	Boron ($\mu\text{g/L}$)	Calcium ($\mu\text{g/L}$)	Field pH (Std. Units)	Sulfate (mg/L)	Total Dissolved Solids (mg/L)
Background	B-26	12/9/2015	29.6	81,300	7.35	37.1	424
		4/12/2016	33.7	86,200	7.43	38.0	456
		7/19/2016	28.6	82,400	7.14	36.2	504
		10/20/2016	33.0	82,700	7.19	35.0	466
		1/12/2017	35.2	89,400	7.57	35.0	446
		4/17/2017	50.1	89,000	7.54	32.4	468
		6/7/2017	45.8	105,000	7.22	31.0	538
		8/2/2017	54.6	98,100	7.21	28.5	496
		10/19/2017	47.4	102,000	7.50	25.3	542
		4/2/2018	48.0	88,100	7.64	19.1	464
		10/8/2018	53.4	78,700	7.20	25.1	450
		4/22/2019	41.6	75,300	7.10	26.7	458
		10/15/2019	<3.00	<76.2	7.24	36.0	404
		4/14/2020	66.1	88,500	7.27	30.2	464
		10/13/2020	63.6	76,500	7.34	37.0	448
		4/21/2021	63.6	78,700	7.27	35.3	470
		10/8/2021	48.4	84,900	7.18	43.8	440
		4/25/2022	52.5	75,900	7.19	34.2	470
		10/18/2022	48.8	80,300	7.15	47.6	472
		4/5/2023	38.6	77,400	7.05	34.3	448
		10/3/2023	44.8	85,100	7.47	42.5	418
Compliance	B-11A	12/9/2015	124	58,800	7.70	3.20 J	338
		4/13/2016	116	60,100	7.75	3.80 J	362
		7/19/2016	104	54,000	7.42	2.70 J	336
		10/19/2016	112	54,600	7.47	3.00 J	340
		1/12/2017	106	54,500	7.89	2.30 J	322
		4/17/2017	100	54,800	7.38	<1.00	326
		6/8/2017	102	57,800	7.78	1.40 J	338
		8/1/2017	105	54,500	7.67	2.40 J	326
		10/19/2017	116	55,000	7.96	5.10	322
		4/2/2018	91.0	53,300	8.04	12.3 M0	336
		10/9/2018	94.2	48,600	7.43	6.00	332
		4/22/2019	93.9	60,400	7.62	1.90 J	386
		10/14/2019	80.7	56,600	7.66	<1.00	348
		4/13/2020	86.3	57,500	7.75	1.40 J	394
		10/12/2020	99.3	55,600	7.74	1.00 J	364
		4/19/2021	88.1	50,600	7.65	2.9	366
		10/8/2021	85.4	51,400	7.57	7.0	356
		4/26/2022	88.6	51,600	7.53	8.5	350
		10/18/2022	95.2	46,000	7.61	22.7	332
		4/4/2023	119	51,700	7.62	70.8	394
		10/3/2023	231	60,300	0.16 J	86.0	352
Compliance	B-11B	12/9/2015	1,140	64,100	8.06	134	494
		4/13/2016	1,360	65,400	8.14	148	512
		7/19/2016	1,210	59,000	7.77	165	520
		10/20/2016	1,460	59,100	7.91	178	496
		1/12/2017	1,540	63,900	8.18	182	488
		4/17/2017	1,760	67,400	7.83	181	502
		6/8/2017	1,880	68,200	8.07	191	516
		8/1/2017	1,800	61,400	7.77	179	498
		10/19/2017	1,500	52,400	7.77	175	510
		4/2/2018	2,020	59,000	8.42	200	550
		10/9/2018	3,620	66,300	7.74	197	602
		11/12/2018	--	--	8.05	--	594
		4/22/2019	6,830	83,300	7.91	303	742
		10/14/2019	4,630	91,400	7.92	339	728
		4/13/2020	5,380	115,000	7.89	378	872
		10/12/2020	3,350	91,200	7.80	388	906
		4/19/2021	4,440	93,400	8.07	379 M0	910
		10/8/2021	2,480	100,000	7.81	466	884
		4/26/2022	2,590	97,100	7.63	513	1000
		10/18/2022	3,010	75,100	7.74	429	920
		4/4/2023	4,740	84,400	7.68	436	980
		10/3/2023	5,040	80,600	7.84	403	918

Table 2. Historical Analytical Results for Parameters with SSIs
Nelson Dewey Generating Station - Cassville, Wisconsin / SCS Engineers Project #25224071.00

Well Group	Well	Collection Date	Boron ($\mu\text{g/L}$)	Calcium ($\mu\text{g/L}$)	Field pH (Std. Units)	Sulfate (mg/L)	Total Dissolved Solids (mg/L)
Compliance	B-11R	12/9/2015	4,170	126,000	7.07	75.4	616
		4/13/2016	3,410	141,000	6.78	18.4	682
		7/19/2016	3,530	130,000	6.69	115	698
		10/20/2016	4,120	128,000	6.77	118	660
		1/12/2017	3,530	126,000	6.98	108	616
		4/17/2017	3,520	123,000	7.11	108	620
		6/7/2017	3,420	128,000	6.80	98.2	630
		8/1/2017	2,040	139,000	6.70	126	738
		10/19/2017	3,120	117,000	7.22	97.7	586
		4/2/2018	3,180	124,000	7.14	88.1	638
		10/9/2018	576	49,900	6.55	15.1	266
		4/22/2019	1,360	82,400	6.82	34.6	406
		10/14/2019	1,440	66,000	6.83	40.7	310
		4/13/2020	2,140	117,000	6.80	41.9	570
		10/12/2020	2,870	120,000	6.83	22.8	600
		4/19/2021	3,010	115,000	7.11	61.2	578
		10/8/2021	2,940	119,000	6.86	61.8	576
		4/26/2022	2,330	114,000	7.01	58.1	560
		10/18/2022	3,090	116,000	6.76	65.3	572
		4/4/2023	3,110	105,000	6.81	57.0	554
		10/3/2023	3,120	90,600	6.80	58	456
	B-31A	12/9/2015	59.0	48,400	7.65	26.2	274
		4/13/2016	79.2	51,900	7.63	22.6	302
		7/19/2016	67.2	48,900	7.25	24.2	280
		10/20/2016	63.7	45,800	7.54	27.2	292
		1/12/2017	76.4	46,600	7.82	29.8	284
		4/17/2017	69.9	46,900	7.83	31.0	318
		6/8/2017	58.5	49,400	7.74	31.2	296
		8/1/2017	56.3	46,000	7.56	26.6	284
		10/19/2017	63.9	49,600	7.92	26.1	290
		4/2/2018	74.8	49,300	8.00	27.4	282
		10/9/2018	71.8	46,600	7.48	24.8	278
		4/22/2019	86.2	48,200	7.61	21.6	284
		10/14/2019	98.5	52,200	7.69	22.3	272
		4/13/2020	132	50,900	7.71	16.6	298
		10/13/2020	127	47,700	7.78	16.8	300
		4/19/2021	172	52,100	7.90	15.8	330
		10/8/2021	178	53,500	7.44	14.9	294
		4/26/2022	198	55,300	7.82	15.4	316
		10/18/2022	213	45,300	7.63	23.0	310
		4/4/2023	193	46,100	7.59	15.9	324
		10/2/2023	191	48,300	7.67	20.0	274
	B-31R	12/9/2015	851	77,400	6.79	28.8	374
		4/13/2016	838	84,900	6.76	34.1	404
		7/19/2016	641	76,100	6.44	38.5	406
		10/20/2016	1,020	84,200	6.53	49.7	452
		1/12/2017	749	73,900	6.80	34.9	380
		4/17/2017	929	85,600	6.80	43.0	416
		6/8/2017	895	90,700	6.67	41.1	426
		8/1/2017	1,550	93,400	6.56	55.6	432
		10/19/2017	645	75,700	7.19	19.2	358
		4/2/2018	540	72,900	6.76	22.0	374
		10/9/2018	1,430	125,000	6.41	186	668
		11/12/2018	--	--	6.59	162	596
		4/22/2019	906	105,000	6.62	121	516
		10/14/2019	915	110,000	6.72	146	480
		4/13/2020	730	93,800	6.79	89.4	464
		10/12/2020	702	95,700	6.89	49.4	462
		4/19/2021	621	91,400	6.91	45.3	454
		10/8/2021	353	79,000	6.63	24.9	372
		4/25/2022	454	81,100	6.77	60.0	428
		10/18/2022	327	78,500	6.83	29.6	386
		4/4/2023	589	88,300	6.62	50.0	440
		10/2/2023	519	114,000	6.82	103	536

Table 2. Historical Analytical Results for Parameters with SSIs
Nelson Dewey Generating Station - Cassville, Wisconsin / SCS Engineers Project #25224071.00

Well Group	Well	Collection Date	Boron ($\mu\text{g/L}$)	Calcium ($\mu\text{g/L}$)	Field pH (Std. Units)	Sulfate (mg/L)	Total Dissolved Solids (mg/L)
Compliance	B-7R	12/9/2015	110	31,700	6.74	17.0 J	198
		4/13/2016	115	42,300	6.80	2.50 J	218
		7/18/2016	164	44,400	6.29	2.40 J	220
		10/19/2016	154	56,600	6.55	<5.00	288
		1/12/2017	159	56,700	7.43	<5.00	240
		4/17/2017	129	61,400	6.60	<5.00	278
		6/7/2017	110	51,600	6.65	<5.00	240
		8/1/2017	129	50,400	6.28	3.70	220
		10/19/2017	159	56,200	6.88	<5.00 D3	242
		4/2/2018	121	49,200	6.57	<5.00 D3	220
		10/9/2018	73.0	38,500	6.23	3.20	186
		4/22/2019	93.5	59,400	6.63	<5.00 D3	254
		10/14/2019	139	57,700	6.62	<5.00 D3	208
		4/13/2020	96.0	58,700	6.60	7.50 J, D3	306
		10/13/2020	145	41,900	6.35	<2.20	208
		4/20/2021	104	56,100	6.54	<2.2 D3	248
		10/8/2021 ⁽¹⁾	--	--	--	--	--
		4/26/2022	98.1	59,200	6.43	3.7 J, D3	318
		10/18/2022 ⁽²⁾	--	--	--	--	--
		4/3/2023	120	48,800	6.18	<2.2 D3	224
		10/3/2023	144	41,000 P6	3.60	4.5	184

Abbreviations:

$\mu\text{g/L}$ = micrograms per liter or parts per billion (ppb)

mg/L = milligrams per liter or parts per million (ppm)

Std. Units = Standard Units

Flags:

J = Estimated concentration at or above the LOD and below the LOQ.

D3 = Sample was diluted due to the presence of high levels of non-target analytes or other matrix interference.

M0 = Matrix spike recovery and/or matrix spike duplicate recovery was outside laboratory control limits.

P6 = Matrix spike recovery was outside laboratory control limits due to a parent sample concentration notably higher than the spike level.

-- = Not applicable.

Notes:

(1) B-7R could not be sampled on 10/8/2021 or during an attempted resampling event on 10/28/2021 due to low water levels.

(2) B-7R could not be sampled on 10/18/2022 due to low water levels.

Created by: RM
Last revision by: RM
Checked by: AJR

Date: 9/19/2023
Date: 2/23/2024
Date: 3/18/2024

Table 3. Water Level Summary

Notes

-- = not measured

*The PVC casing at B-35A was cut down on June 28, 2018 to allow the protective cover to close. Groundwater elevations prior to 6/28/18 are calculated using the old top of casing (TOC) elevation of 621.20 ft amsl. Groundwater elevations after 6/28/18 are calculated using the new TOC elevation (621.09 ft amsl).

** The PVC casing at B-21R was extended in 2018 following well rehabilitation. The well was resurveyed on April 22, 2019. The old top of casing elevation was 621.03 ft. The new TOC elevation is 623.31 ft.

¹ One pond staff gauge was installed on April 22, 2019. The base of the gauge (0 reading) is at 615.056 ft amsl. Two additional gauges were installed on March 24, 2020. These gauge bases are at 609' and 612' amsl.

^ASG-12 reestablished in 2022 following barge slip construction work. Previous elevation (applies to measurements before October 2022) was 616.60. New elevation (top of metal pipe) is 622.34'.

#B-21R was found knocked over during the April 2023 sampling event. A replacement well installation plan is in progress.

Created by: MDB Date: 4/1/2013
Last revision by: BS Date: 10/13/2023
Checked by: RM Date: 10/17/2023

Table 4. Analytical Results - State Monitoring Program
Nelson Dewey Generating Station
Cassville, Wisconsin / SCS Engineers Project #25224071.00

WELL ID	SAMPLE MONTH	BORON, DISSOLVED (UG/L)	SULFATE, DISSOLVED (MG/L)	PH, FIELD (STANDARD UNITS)
B-7R	2016-Apr	110	7.40	6.80
	2016-Oct	147	<20.0	6.55
	2017-Apr	127	<5.00	6.60
	2017-Oct	159	<5.00	6.61
	2018-Apr	115	<5.00 D3	6.57
	2018-Oct	89.8	3.40	6.23
	2019-Apr	95.7	<5.00 D3	6.63
	2019-Oct	140	<5.00 D3	6.62
	2020-Apr	90.8	5.20 J, D3	6.60
	2020-Oct	145	<2.20 D3	6.35
	2021-Apr	121	<2.20 D3	6.54
	2021-Oct	--	--	--
	2022-Apr	93.1	5.0 J, D3	6.43
	2022-Oct	--	--	--
	2023-Apr	120	2.3 J, D3	6.18
	2023-Oct	151	4.3	6.30
B-8R	2016-Apr	2,250	30.0	6.64
	2016-Oct	2,130	47.0	6.38
	2017-Apr	1,970	30.5	6.83
	2017-Oct	2,490	32.5	6.87
	2018-Apr	1,700	28.7	7.02
	2018-Oct	1,500	30.6	6.18
	2019-Apr	1,560	39.8	6.65
	2019-Oct	1,110	23.6	6.85
	2020-Apr	1,340	20.9	6.61
	2020-Oct	1,600	63.9	6.60
	2021-Apr	1,310	25.0	6.54
	2021-Oct	1,730	42.3	6.48
	2022-Apr	1,320	23.8	6.52
	2022-Oct	1,690	41.4	6.45
	2023-Apr	1,290	20.0	6.43
	2023-Oct	1,360	28.7	6.88
B-11A	2016-Apr	110	3.80 J	7.75
	2016-Oct	111	2.80 J	7.47
	2017-Apr	106	<1.00	7.38
	2017-Oct	97.7	8.30	7.91
	2018-Apr	89.4	12.70	8.04
	2018-Oct	142	5.30	7.43
	2019-Apr	94.0	1.90 J	7.62
	2019-Oct	82.3	<1.00	7.66
	2020-Apr	83.3	1.50 J	7.75
	2020-Oct	94.3	1.0 J	7.74
	2021-Apr	92.9	3.5	7.65
	2021-Oct	97.6	7.3	7.49
	2022-Apr	87.0	9.1	7.53
	2022-Oct	98.4	24.2	7.61
	2023-Apr	119	72.0	7.62
	2023-Oct	240	88.5	7.66

Table 4, Page 1 of 4

I:\25224071.00\Deliverables\2023 October ASD NED\Tables\Table 4 - Analytical Results - State Monitoring NED.xlsx

Table 4. Analytical Results - State Monitoring Program
Nelson Dewey Generating Station
Cassville, Wisconsin / SCS Engineers Project #25224071.00

WELL ID	SAMPLE MONTH	BORON, DISSOLVED (UG/L)	SULFATE, DISSOLVED (MG/L)	PH, FIELD (STANDARD UNITS)
B-11B	2016-Apr	1,240	153	8.14
	2016-Oct	1,410	181	7.91
	2017-Apr	1,720	186	7.83
	2017-Oct	1,900	169	7.80
	2018-Apr	2,020	195	8.42
	2018-Oct	3,910	195	7.74
	2019-Apr	6,670	289	7.91
	2019-Oct	4,860	335	7.92
	2020-Apr	5,080	362	7.89
	2020-Oct	3,190	422	7.80
	2021-Apr	4,590	389	8.07
	2021-Oct	2,480	468	7.72
	2022-Apr	2,690	494	7.63
	2022-Oct	3,190	446	7.74
	2023-Apr	4,320	459	7.68
	2023-Oct	4,940	409	7.84
B-11R	2016-Apr	3,290	93.9	6.98
	2016-Oct	4,070	115	6.77
	2017-Apr	3,710	111	7.11
	2017-Oct	3,400	94.0	6.75
	2018-Apr	2,790	78.6	7.14
	2018-Oct	635	15.6	6.55
	2019-Apr	1,310	34.5	6.82
	2019-Oct	1,500	39.2	6.83
	2020-Apr	2,250	39.8	6.80
	2020-Oct	2,690	23.0	6.83
	2021-Apr	2,890	59.9	7.11
	2021-Oct	3,050	61.6	6.86
	2022-Apr	2,330	58.1	7.01
	2022-Oct	3,250	59.9	6.76
	2023-Apr	3,010	62.7	6.81
	2023-Oct	3,020	58.4	6.80
B-26	2016-Apr	37.0	40.1	7.43
	2016-Oct	48.7	34.4	7.19
	2017-Apr	37.3	32.3	7.54
	2017-Oct	44.5	25.0	7.35
	2018-Apr	46.8	19.2	7.64
	2018-Oct	55.2	24.9	7.20
	2019-Apr	41.8	26.4	7.10
	2019-Oct	50.8	37.0	7.24
	2020-Apr	49.2	29.1	7.27
	2020-Oct	61.4	37.1	7.34
	2021-Apr	67.1	35.5	7.27
	2021-Oct	56.0	43.0	7.18
	2022-Apr	50.3	33.5	7.19
	2022-Oct	51.5	46.1	7.15
	2023-Apr	48.3	34.4	7.05
	2023-Oct	40.8	43.7	7.47

Table 4, Page 2 of 4

I:\25224071.00\Deliverables\2023 October ASD NED\Tables\Table 4 - Analytical Results - State Monitoring NED.xlsx

Table 4. Analytical Results - State Monitoring Program
Nelson Dewey Generating Station
Cassville, Wisconsin / SCS Engineers Project #25224071.00

WELL ID	SAMPLE MONTH	BORON, DISSOLVED (UG/L)	SULFATE, DISSOLVED (MG/L)	PH, FIELD (STANDARD UNITS)
B-26A	2016-Apr	33.1	40.1	7.06
	2016-Oct	30.5	39.9	7.26
	2017-Apr	52.6	42.3	7.96
	2017-Oct	28.4	38.4	7.44
	2018-Apr	27.6	37.0	7.47
	2018-Oct	18.4	33.3	7.38
	2019-Apr	27.6	27.0	7.35
	2019-Oct	47.0	35.6	7.31
	2020-Apr	37.7	39.2 M0	7.38
	2020-Oct	33.5	44.7	7.51
	2021-Apr	42.7	45.5	7.26
	2021-Oct	36.4	49.7	7.45
	2022-Apr	29.8	53.2	7.39
	2022-Oct	26.3	47.1	7.48
	2023-Apr	31.0	47.0	7.15
	2023-Oct	36.9	50.9	7.54
B-31A	2016-Apr	69.4	22.8	7.63
	2016-Oct	81.0	27.9	7.54
	2017-Apr	80.3	30.8	7.83
	2017-Oct	61.5	26.2	7.60
	2018-Apr	69.3	28.1	8.00
	2018-Oct	103	26.2	7.48
	2019-Apr	86.0	21.6	7.61
	2019-Oct	112	22.5	7.69
	2020-Apr	121	17.7	7.71
	2020-Oct	146	16.8	7.78
	2021-Apr	168	17.1	7.90
	2021-Oct	188	15.0	7.58
	2022-Apr	179	15.3	7.82
	2022-Oct	202	22.8	7.63
	2023-Apr	196	16.1	7.59
	2023-Oct	195	21.3	7.67
B-31R	2016-Apr	759	34.3	6.76
	2016-Oct	956	48.5	6.53
	2017-Apr	910	42.9	6.80
	2017-Oct	618	23.2	6.78
	2018-Apr	520	23.3	6.76
	2018-Oct	1,530	179	6.41
	2019-Apr	892	114	6.62
	2019-Oct	1,000	145	6.72
	2020-Apr	765	97.6 M0	6.79
	2020-Oct	696	50.8	6.89
	2021-Apr	597	44.9	6.91
	2021-Oct	356	25.1	6.83
	2022-Apr	425	57.4	6.77
	2022-Oct	341	30.2	6.83
	2023-Apr	553	50.5	6.62
	2023-Oct	532	105	6.82

Table 4, Page 3 of 4

I:\25224071.00\Deliverables\2023 October ASD NED\Tables\Table 4 - Analytical Results - State Monitoring NED.xlsx

Table 4. Analytical Results - State Monitoring Program
Nelson Dewey Generating Station
Cassville, Wisconsin / SCS Engineers Project #25224071.00

WELL ID	SAMPLE MONTH	BORON, DISSOLVED (UG/L)	SULFATE, DISSOLVED (MG/L)	PH, FIELD (STANDARD UNITS)
B-35	2016-Apr	38.7	8.10	6.89
	2016-Oct	46.4	6.50	6.86
	2017-Apr	54.4	7.70	6.68
	2017-Oct	40.8	3.80	7.65
	2018-Apr	28.9	4.80 M0	7.01
	2018-Oct	40.0	3.60	6.58
	2019-Apr	33.6	4.90	7.26
	2019-Oct	41.0	5.60	7.07
	2020-Apr	27.0	4.20	6.87
	2020-Oct	28.1	5.60	6.85
	2021-Apr	23.8	5.90	6.89
	2021-Oct	--	--	--
	2022-Apr	22.7	7.7	6.95
	2022-Oct	--	--	--
	2023-Apr	20.6	4.5	6.74
	2023-Oct	--	--	--
B-35A	2016-Apr	21.7	26.2	6.96
	2016-Oct	23.4	27.4	7.17
	2017-Apr	29.9	25.4	7.27
	2017-Oct	51.4	4.00	7.44
	2018-Apr	28.9	23.1	7.45
	2018-Oct	59.8	6.00 J, D3	6.95
	2019-Apr	30.3	16.7	7.30
	2019-Oct	33.7	18.9	7.30
	2020-Apr	32.1	20.2	7.29
	2020-Oct	70.7	17.8	7.39
	2021-Apr	46.8	18.9	7.26
	2021-Oct	52.7	18.7	7.27
	2022-Apr	46.5	16.2	7.17
	2022-Oct	55.6	5.6	7.23
	2023-Apr	47.2	5.4	7.04
	2023-Oct	96.5	14.0	7.54
B-36	2021-Oct	24.7	2.80	7.34
	2022-Apr	27.2	3.2	7.23
	2022-Oct	28.3	3.1	6.71
	2023-Apr	25.1	3.1	6.88
	2023-Oct	26.8	3.4	6.66
B-36A	2021-Oct	20.7	17.6	7.43
	2022-Apr	29.5	13.7	7.26
	2022-Oct	33.1	16.7	7.18
	2023-Apr	35.7	8.1	7.28
	2023-Oct	27.9	22.8	6.80

Abbreviations:

J: Estimated concentration above the adjusted method detection limit and below the adjusted reporting

D3: Sample was diluted due to the presence of high levels of non-target analytes or other matrix

M0: Matrix spike recovery and/or matrix spike duplicate recovery was outside laboratory control limits.

Notes:

(1) B-7R and B-35 were dry during October 2021 and 2022 sampling events.


(2) B-37 and B-37A were abandoned 12/6/2022. B-36 and B-36A were installed prior to the October 2021 sampling event.

Created by: RM
Last revision by: RM
Checked by: AJR

Date: 9/19/2023
Date: 2/23/2024
Date: 3/18/2024

Figures

- 1 Site Location Map
- 2 Aerial View
- 3 Site Plan and Monitoring Well Locations
- 4 Water Table Flow Map – October 2023

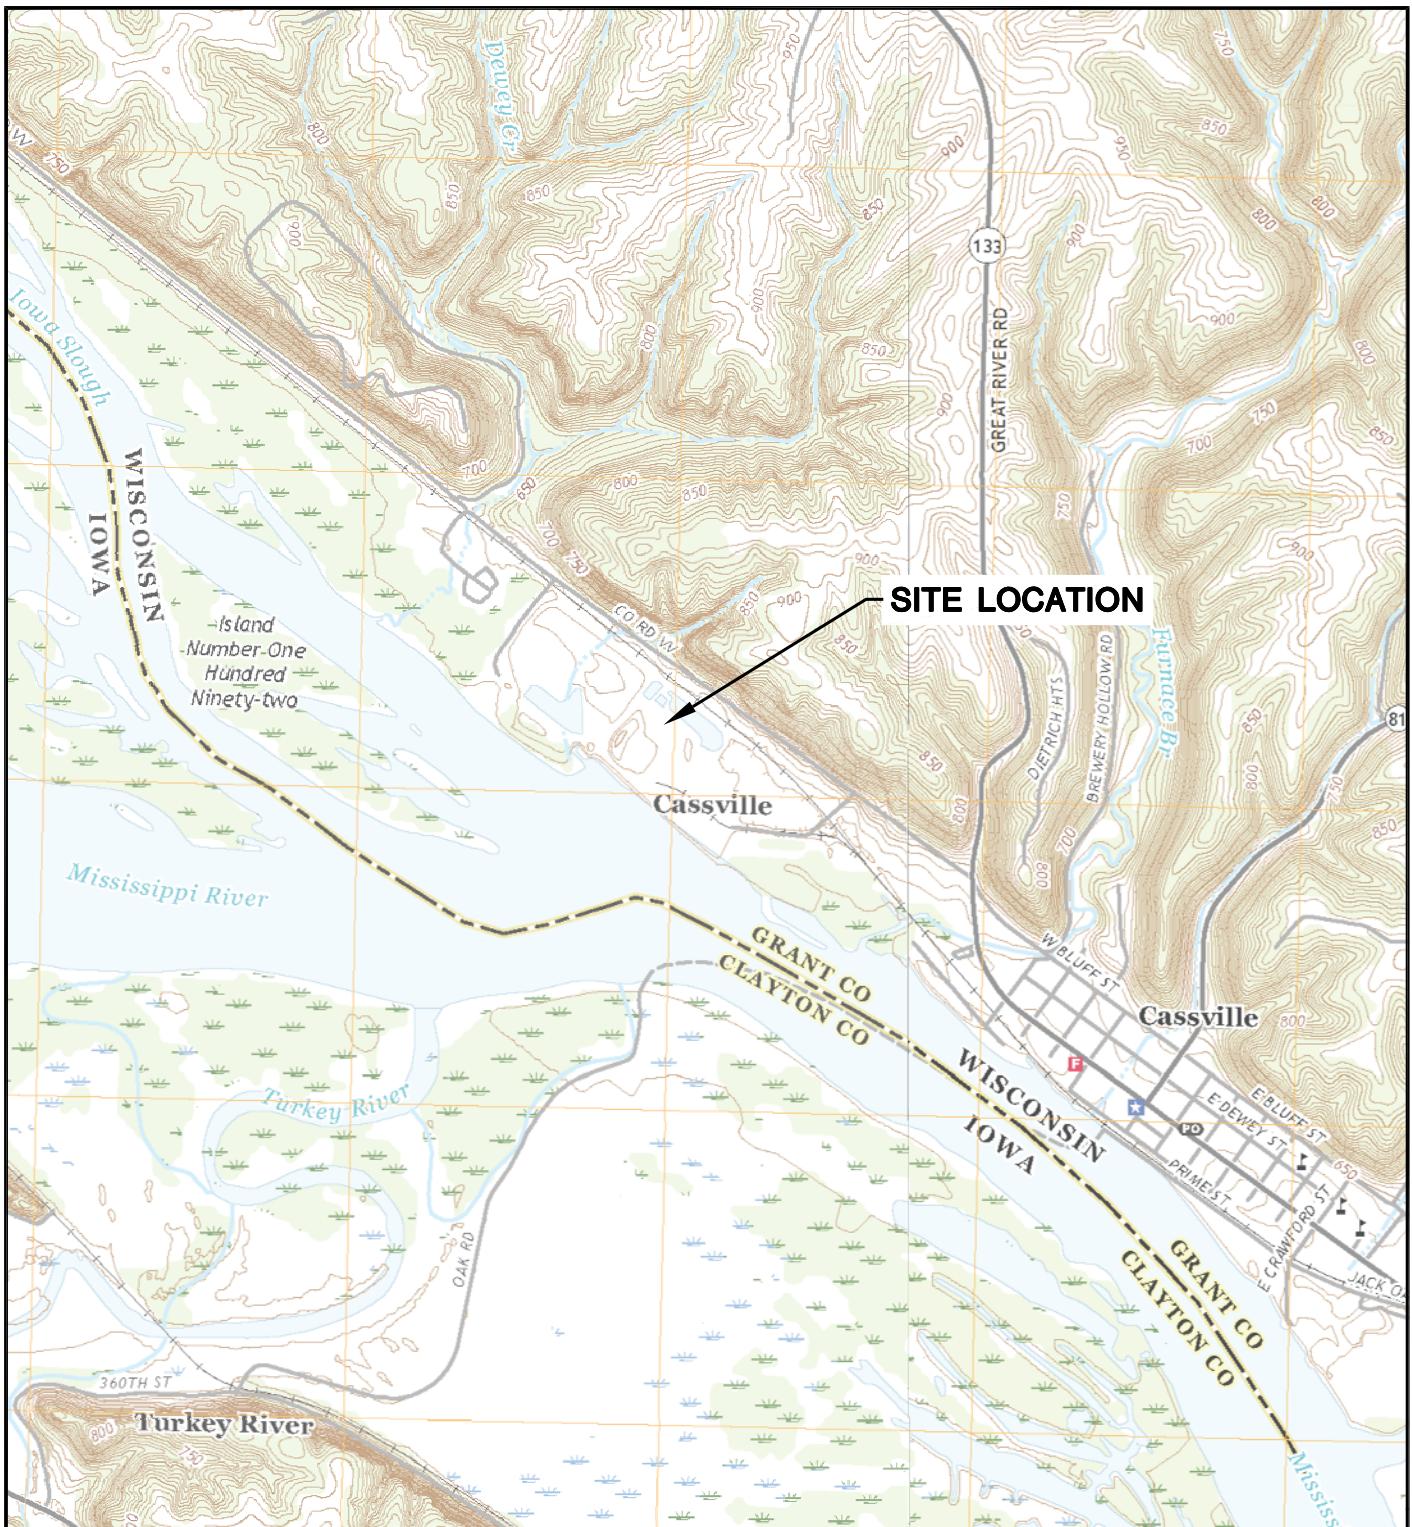

CASSVILLE AND TURKEY RIVER QUADRANGLES

WISCONSIN-IAWA


7.5 MINUTE SERIES (TOPOGRAPHIC)


2018


SCALE: 1" = 2,000'



CLIENT ALLIANT ENERGY 4902 N. BILTMORE LANE, #1000 MADISON, WI 53718	SITE NELSON DEWEY GENERATING STATION CASSVILLE, WISCONSIN	SITE LOCATION MAP	
PROJECT NO. 25220071.00	DRAWN BY: BSS	ENGINEER	FIGURE
DRAWN: 11/27/2019	CHECKED BY: MDB	SCS ENGINEERS 2830 DAIRY DRIVE MADISON, WI 53718-6751 PHONE: (608) 224-2830	
REVISED: 01/14/2020	APPROVED BY: TK 04/10/2020		1

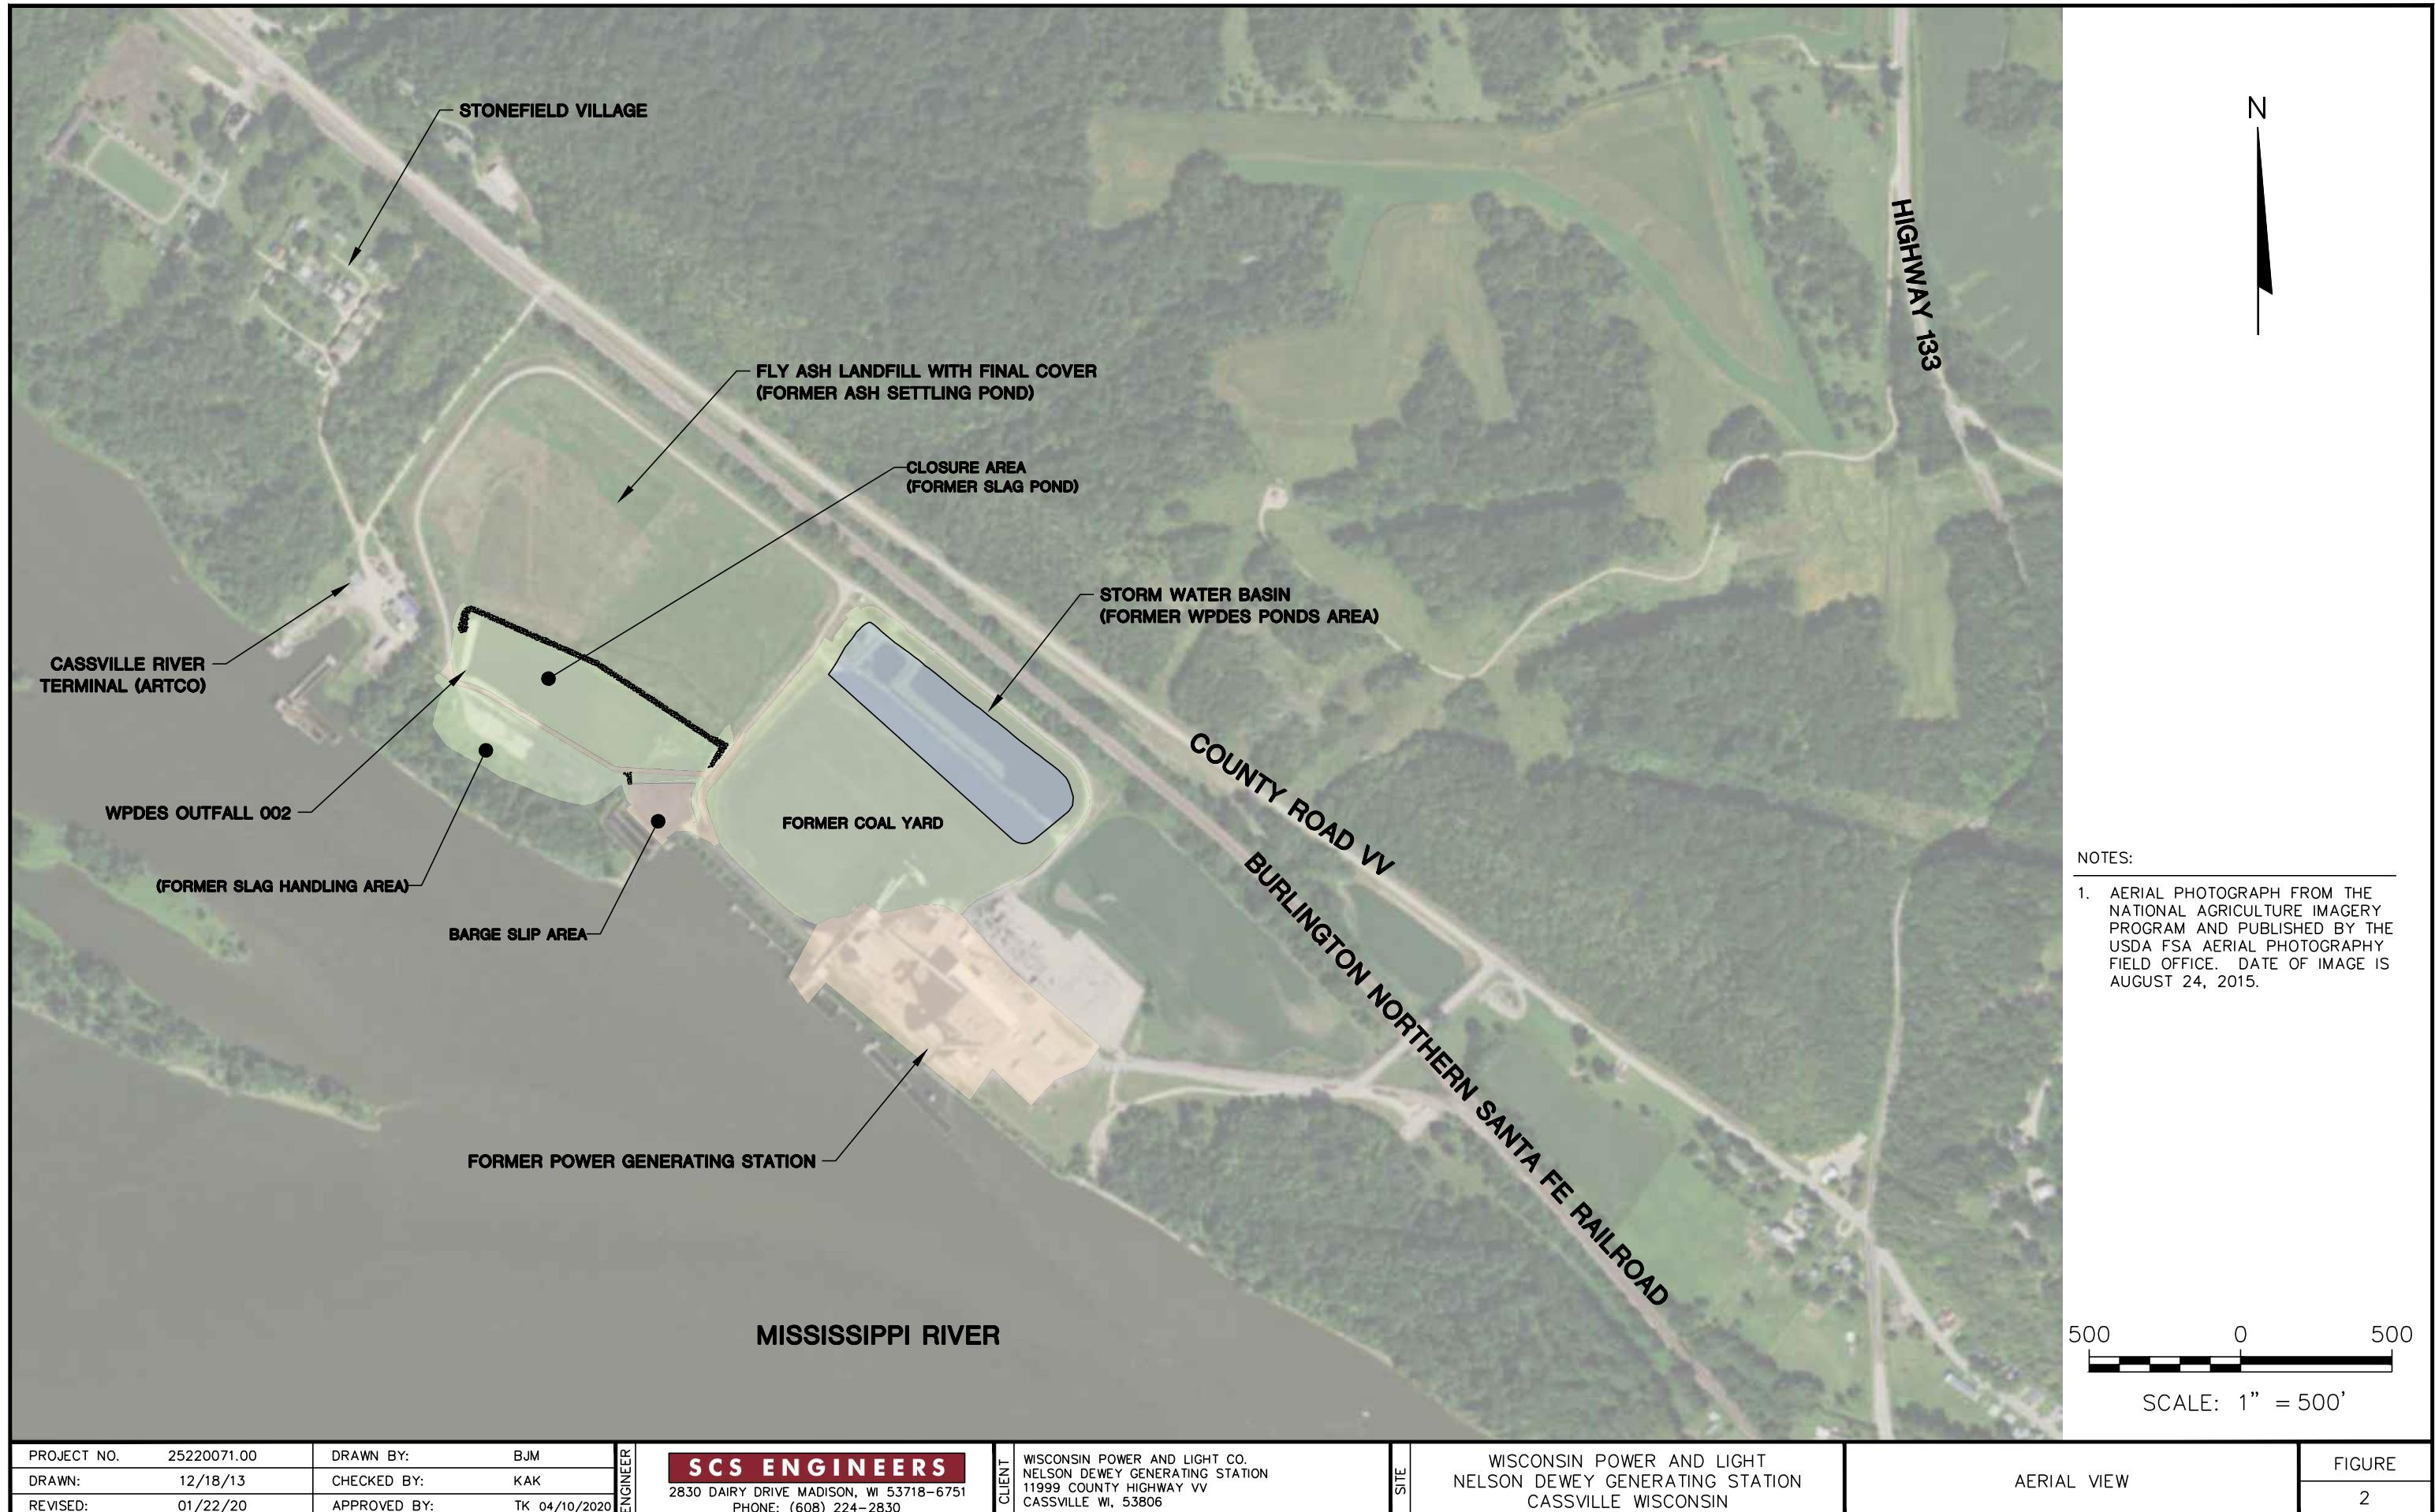

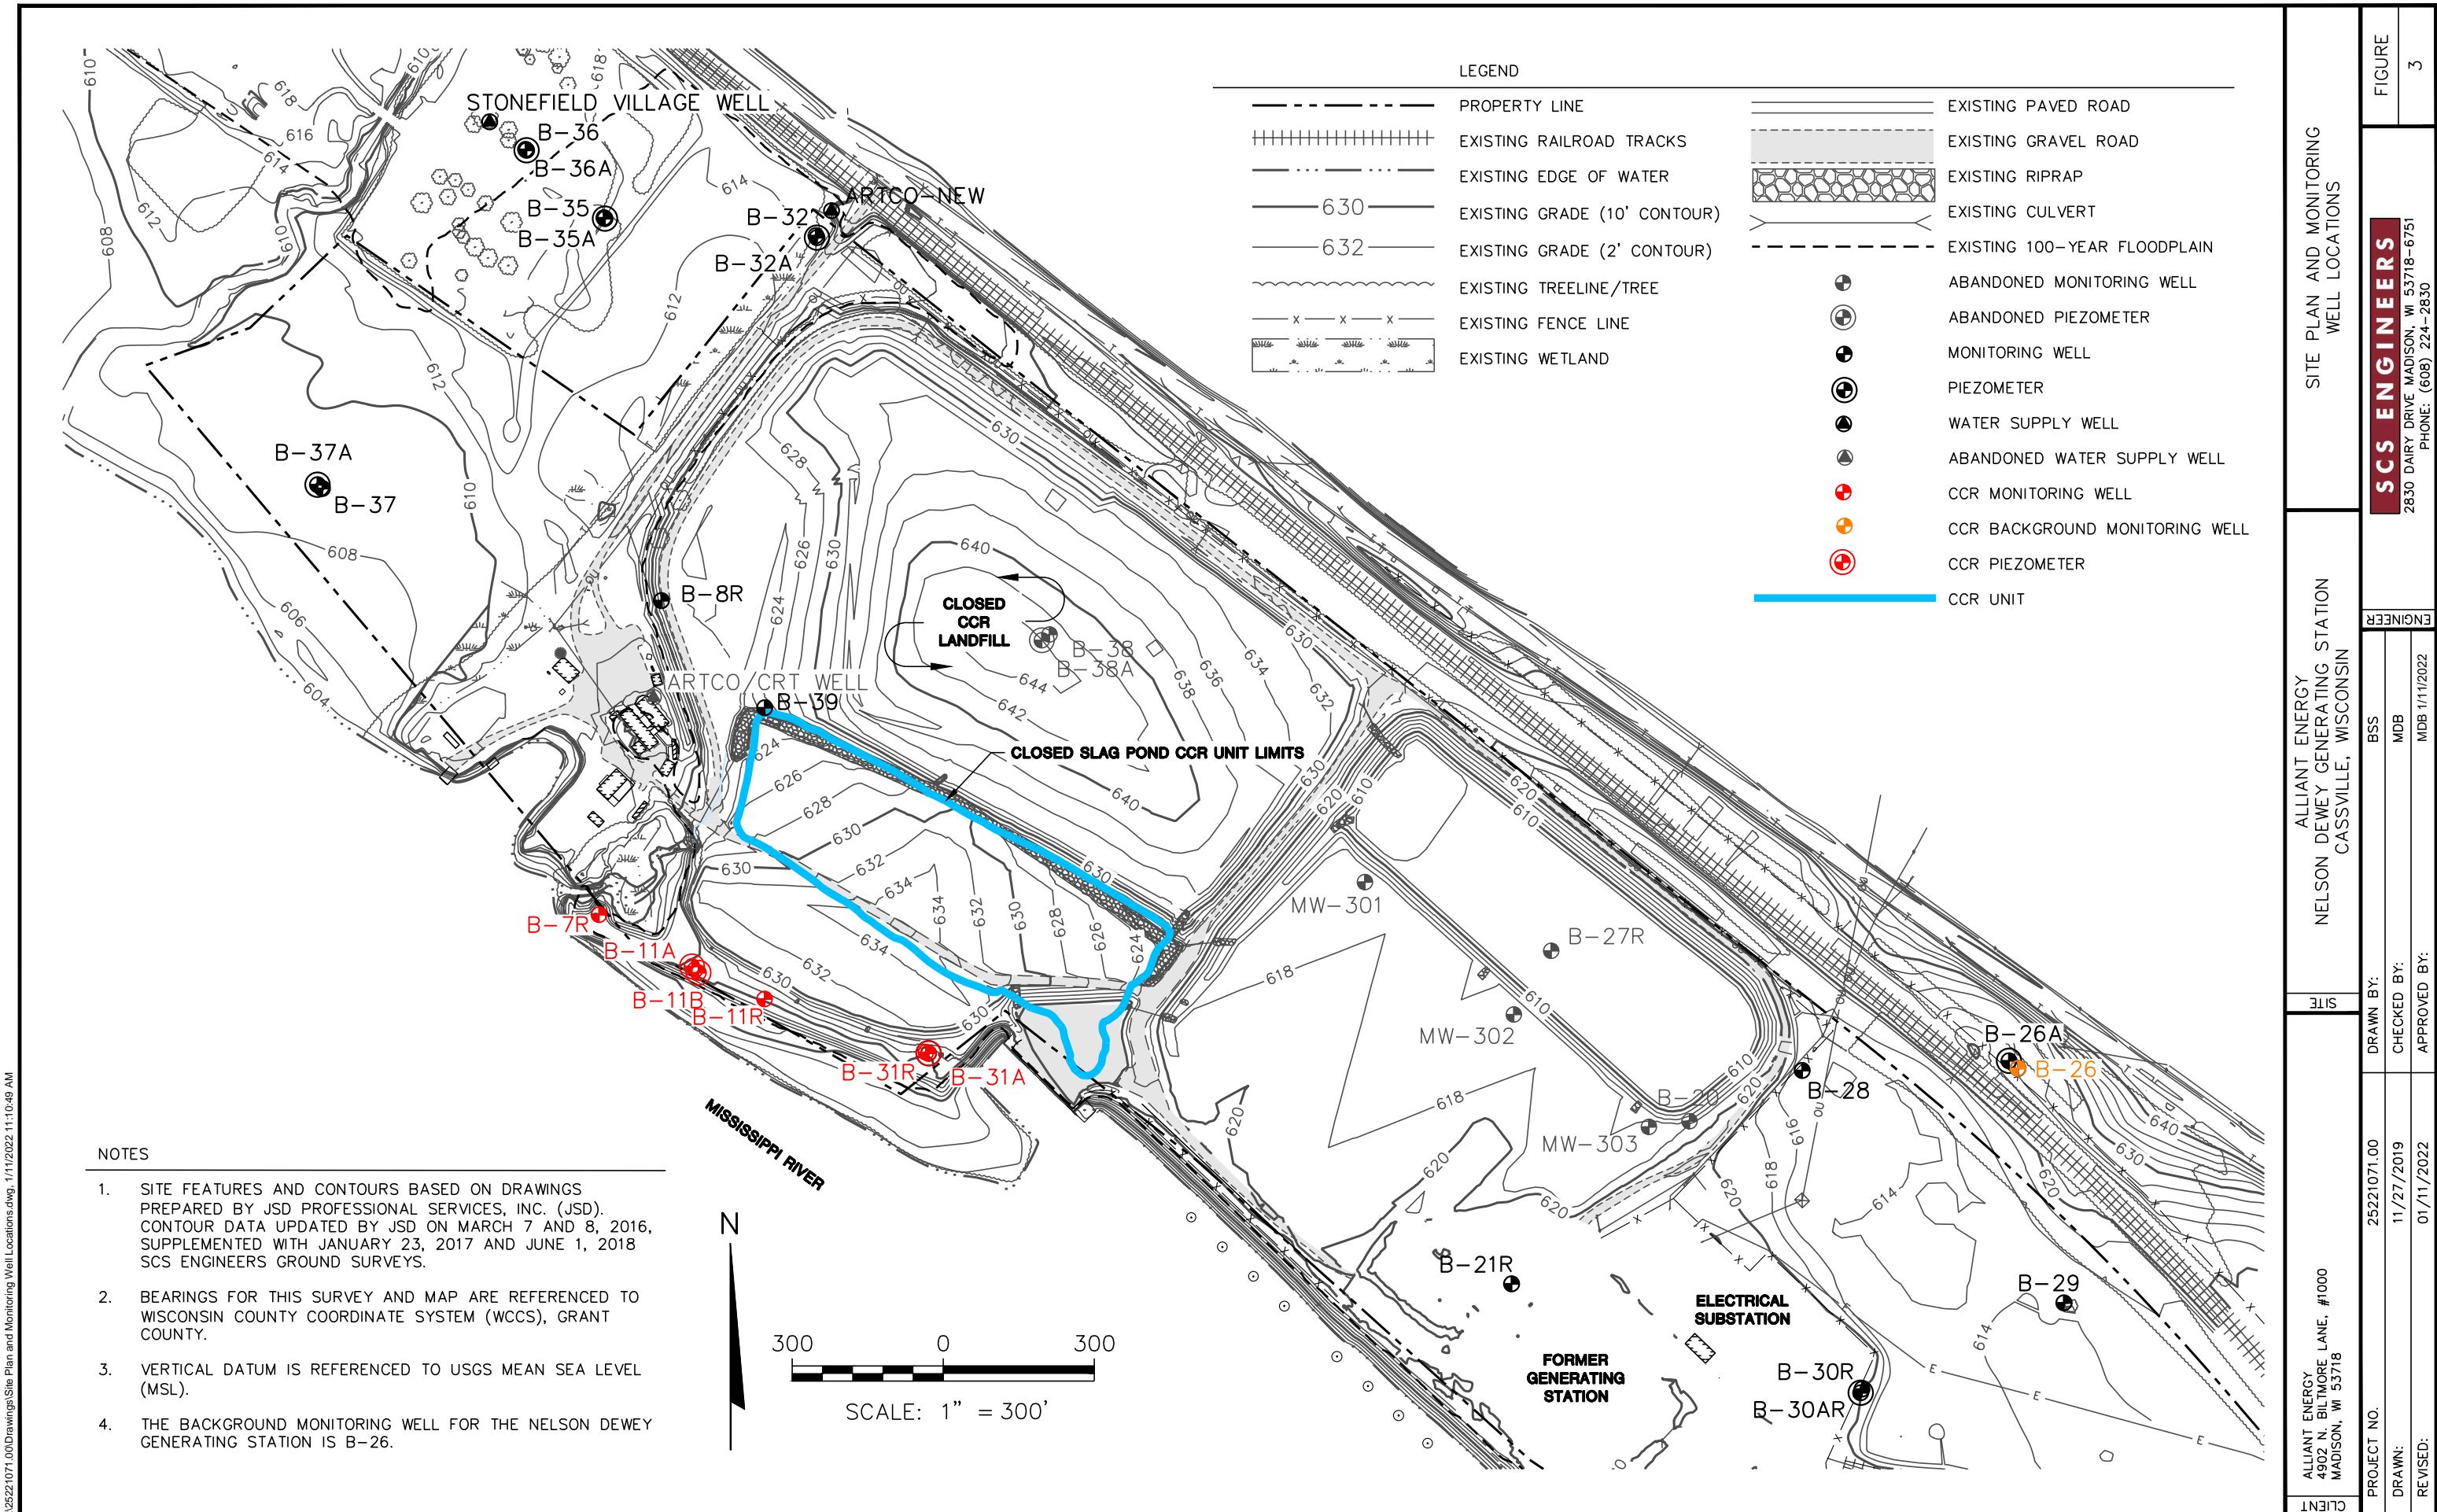

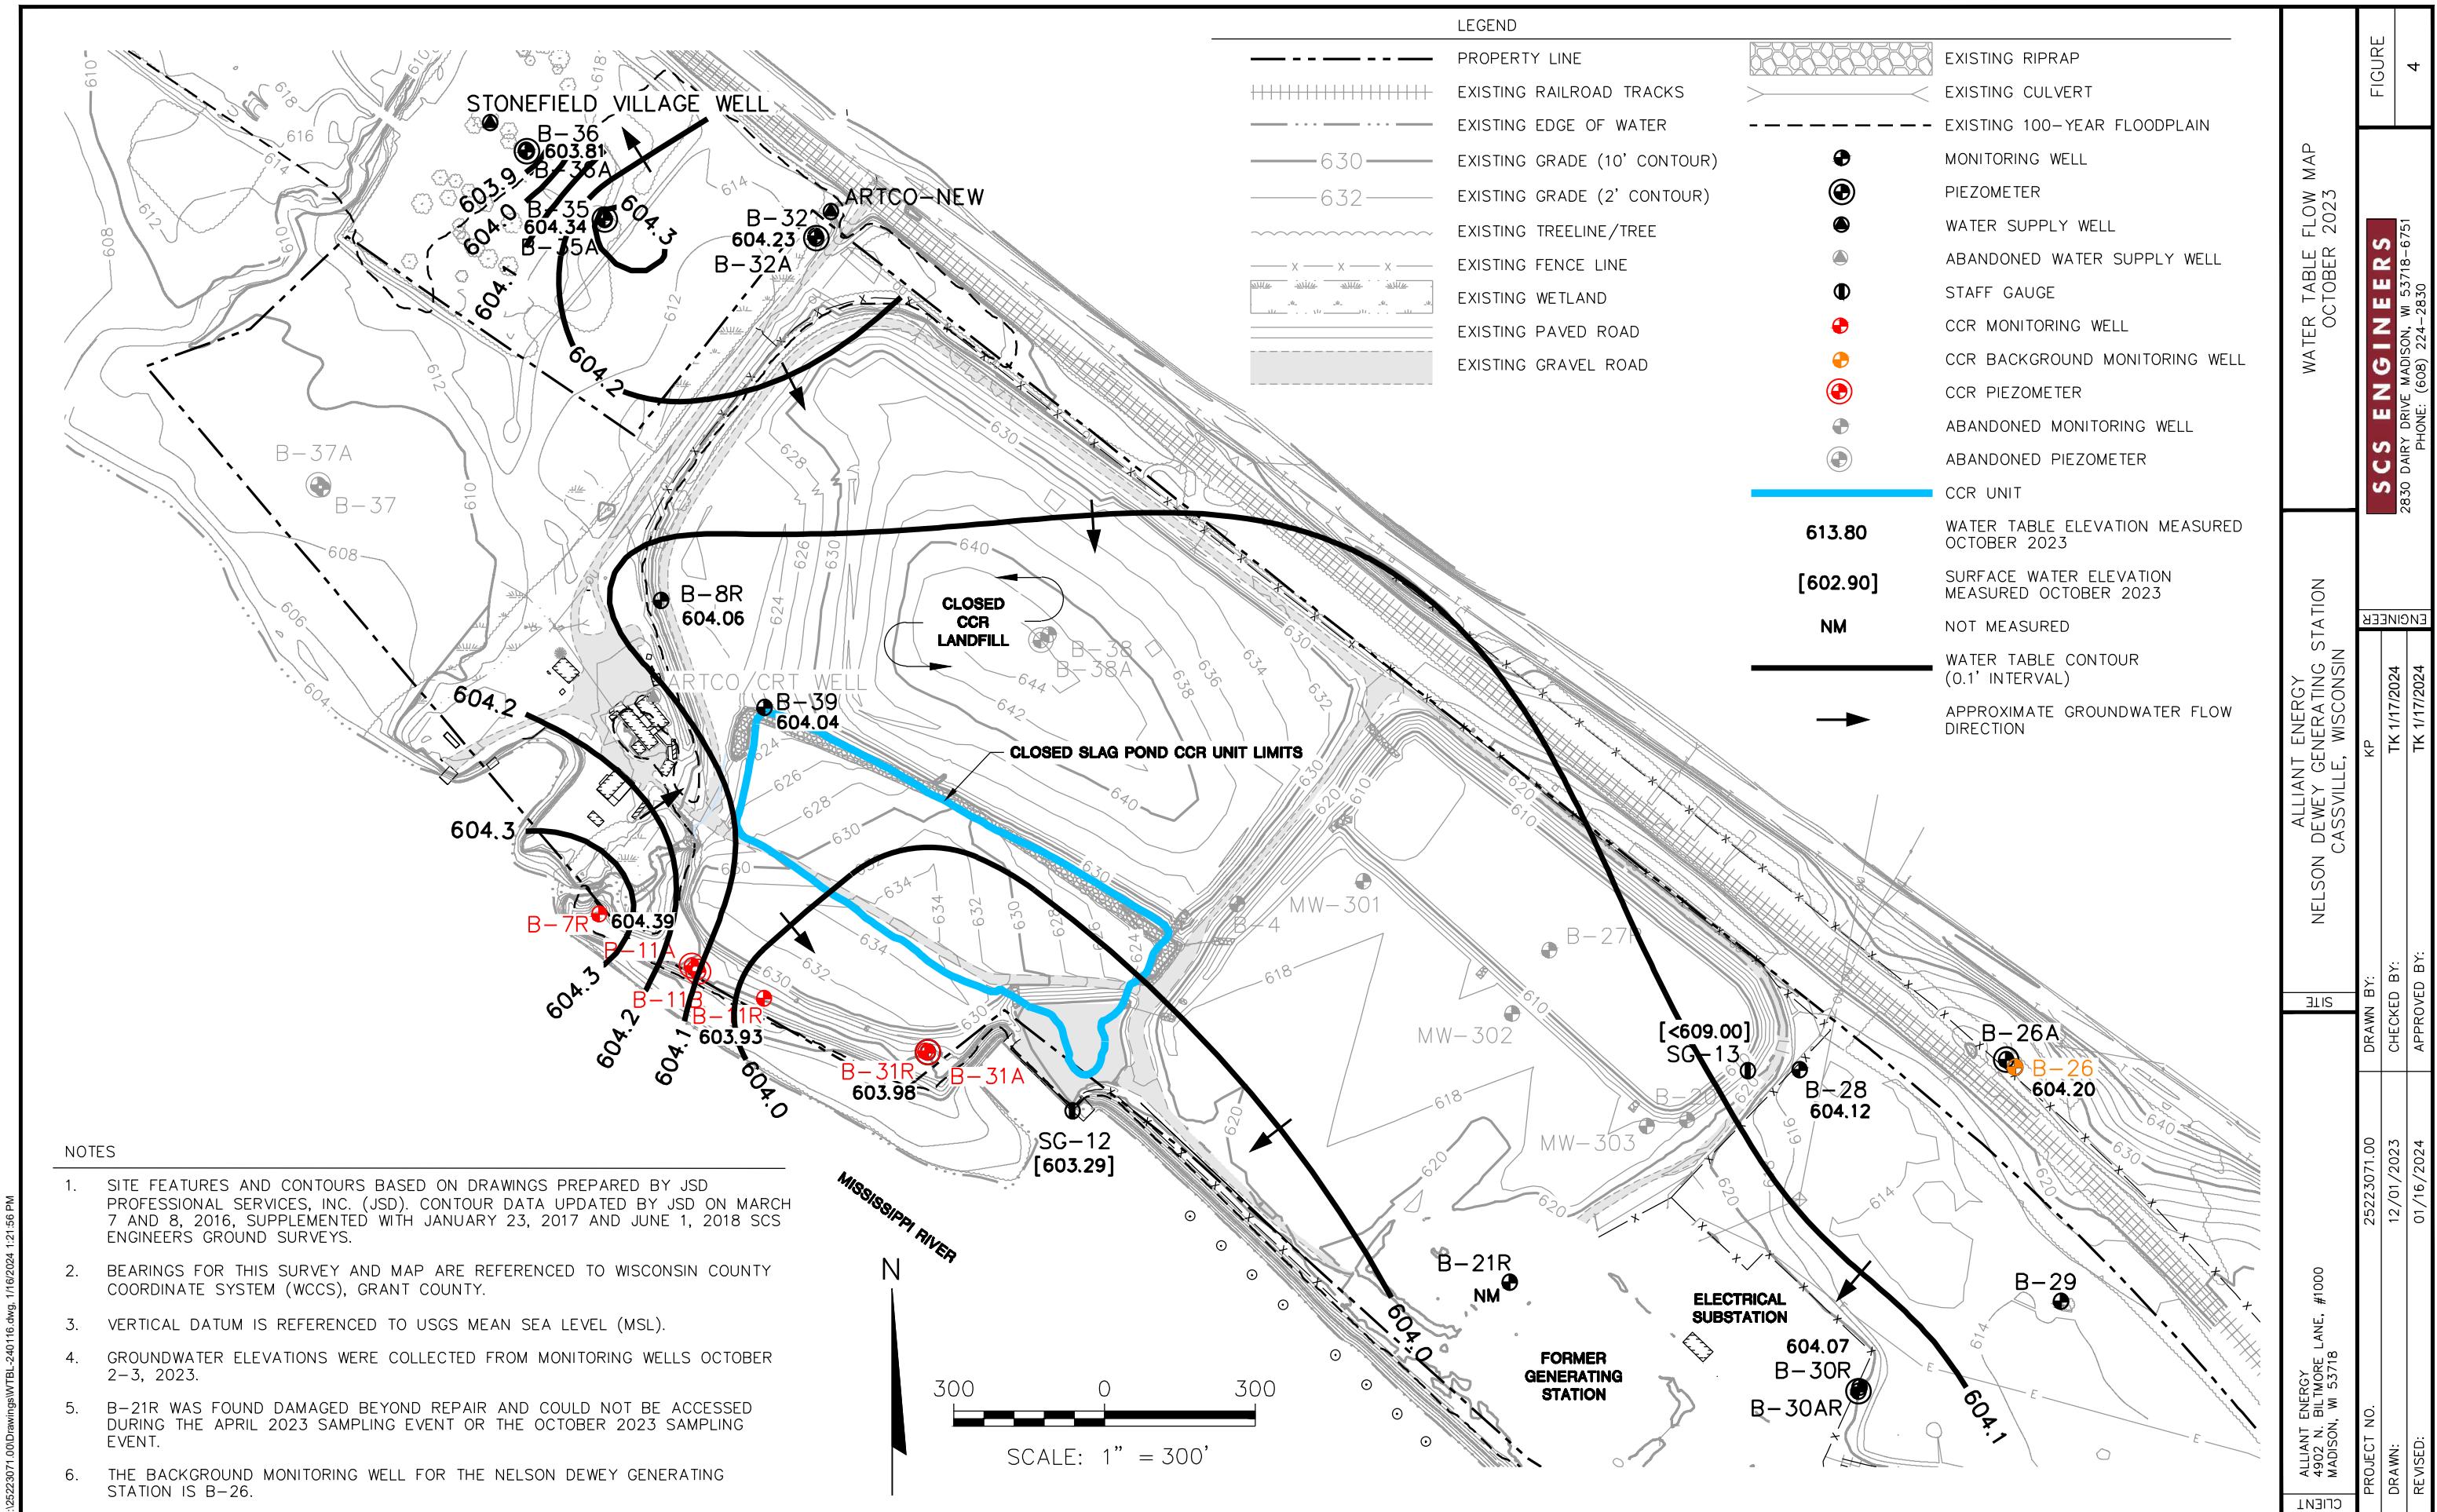


Appendix A

CCR Well Trend Plots

Sanitas™ v.10.0.16 Software licensed to SCS Engineers. UG
Hollow symbols indicate censored values.

Boron

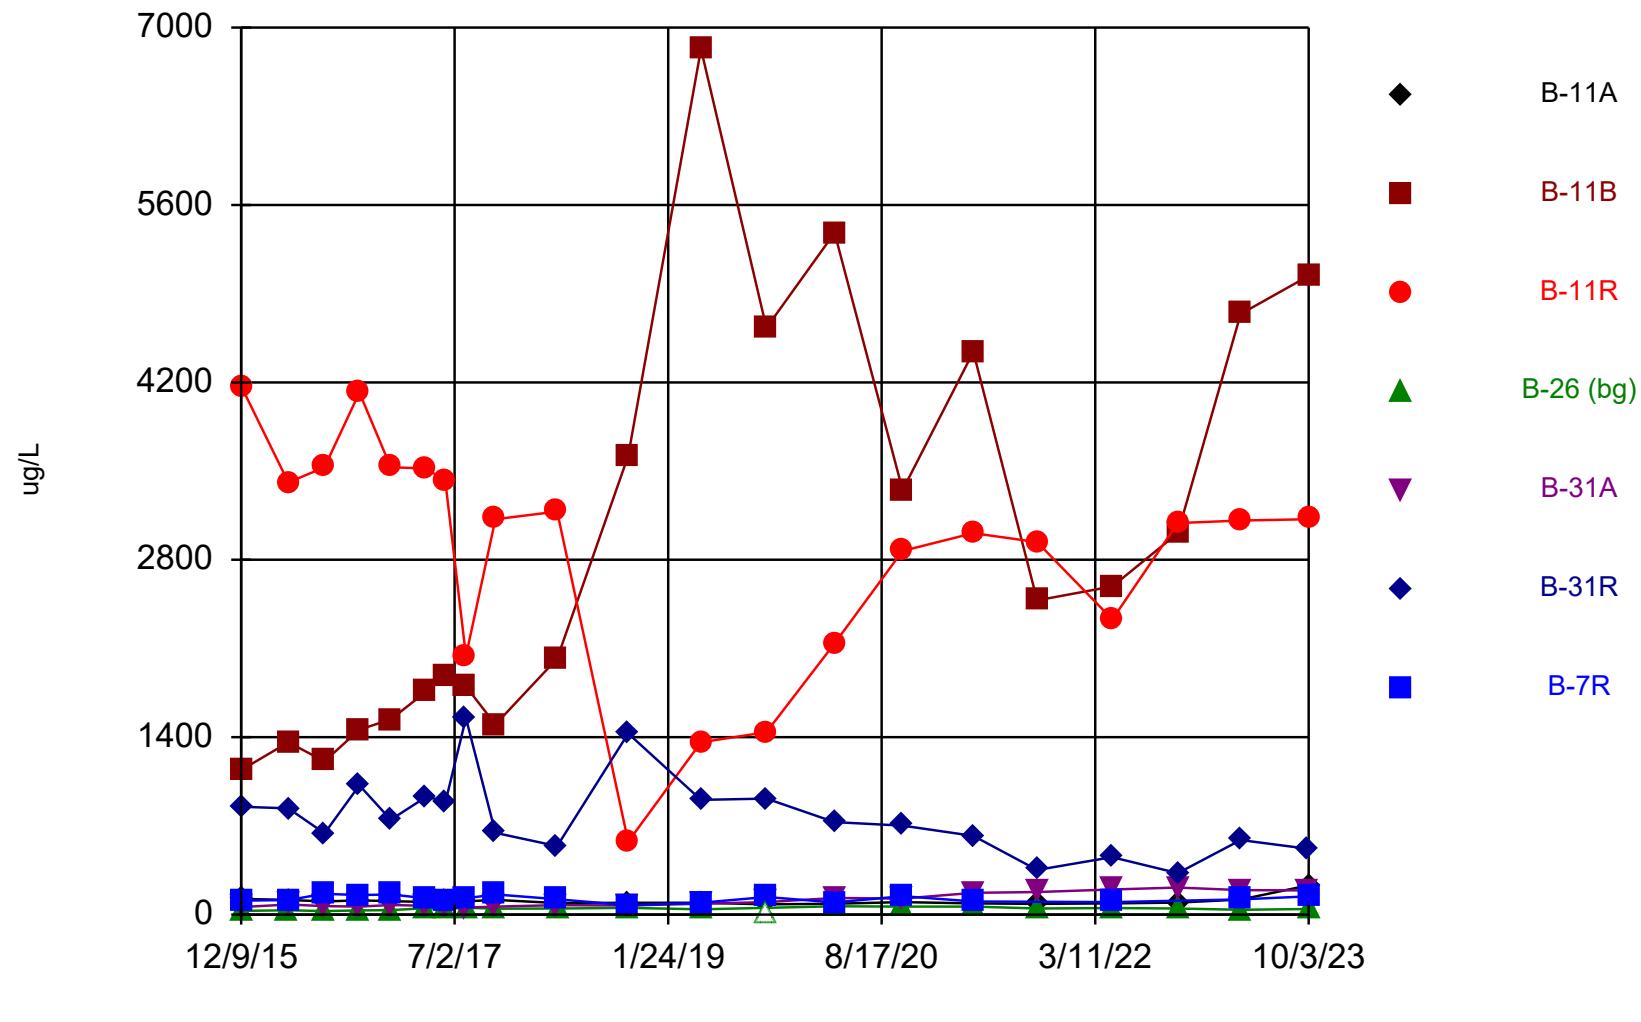

Time Series Analysis Run 3/12/2024 4:16 PM

Nelson Dewey Generating Station Client: SCS Engineers Data: NED - Chempoint- export-Dec2020

Time Series


Constituent: Boron (ug/L) Analysis Run 3/12/2024 4:16 PM

Nelson Dewey Generating Station Client: SCS Engineers Data: NED - Chempoint- export-Dec2020

	B-11A	B-11B	B-11R	B-26 (bg)	B-31A	B-31R	B-7R
12/9/2015	124	1140	4170	29.6	59	851	110
4/12/2016				33.7			
4/13/2016	116	1360	3410		79.2	838	115
7/18/2016							164
7/19/2016	104	1210	3530	28.6	67.2	641	
10/19/2016	112						154
10/20/2016		1460	4120	33	63.7	1020	
1/12/2017	106	1540	3530	35.2	76.4	749	159
4/17/2017	100	1760	3520	50.1	69.9	929	129
6/7/2017			3420	45.8			110
6/8/2017	102	1880			58.5	895	
8/1/2017	105	1800	2040		56.3	1550	129
8/2/2017				54.6			
10/19/2017	116	1500	3120	47.4	63.9	645	159
4/2/2018	91	2020	3180		74.8	540	121
4/3/2018				48			
10/8/2018				53.4			
10/9/2018	94.2	3620	576		71.8	1430	73
4/22/2019	93.9	6830	1360		86.2	906	93.5
4/23/2019				41.6			
10/14/2019	80.7	4630	1440		98.5	915	139
10/15/2019				<3 (UX)			
4/13/2020	86.3	5380	2140		132	730	96
4/14/2020				66.1			
10/12/2020	99.3	3350	2870		127	702	
10/13/2020				63.6			145
4/19/2021	88.1	4440	3010		172	621	
4/20/2021							104
4/21/2021				63.6			
10/7/2021	85.4	2480	2940		178	353	
10/8/2021				48.4			
4/25/2022				52.5		454	
4/26/2022	88.6	2590	2330		198		98.1
10/18/2022	95.2	3010	3090	48.8	213	327	
4/3/2023							120
4/4/2023	119	4740	3110		193	589	
4/5/2023				38.6			
10/2/2023					191	519	
10/3/2023	231	5040	3120	44.8			144

Sanitas™ v.10.0.16 Software licensed to SCS Engineers. UG
Hollow symbols indicate censored values.

Calcium

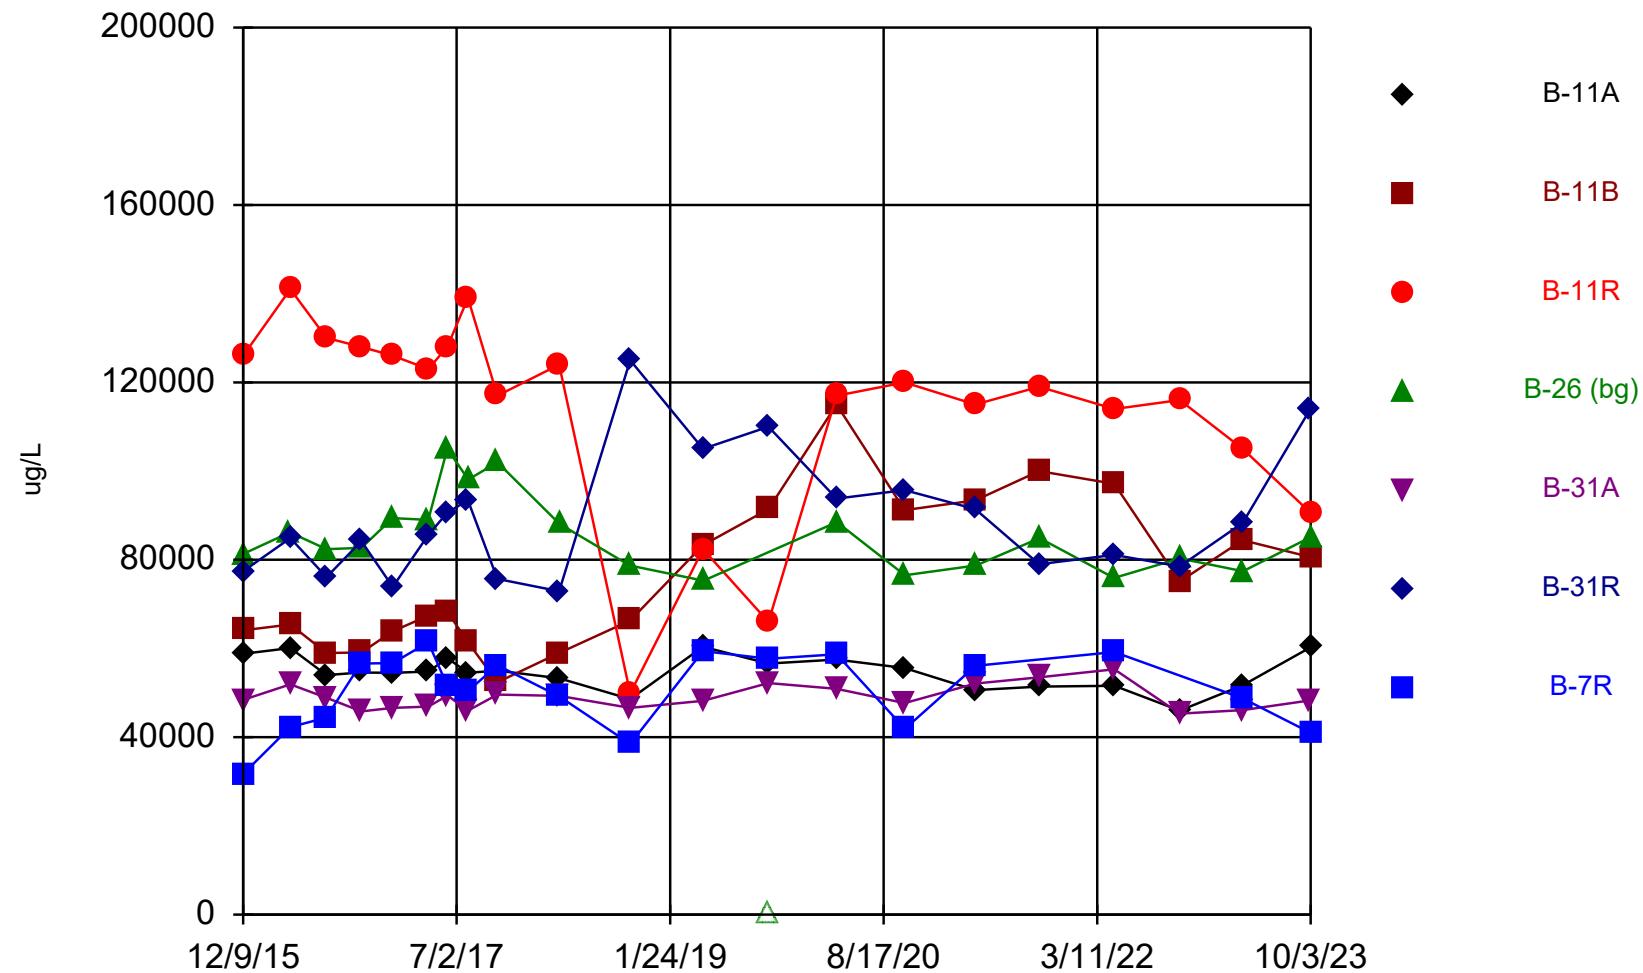

Time Series Analysis Run 3/12/2024 4:16 PM

Nelson Dewey Generating Station Client: SCS Engineers Data: NED - Chempoint- export-Dec2020


Time Series

Constituent: Calcium (ug/L) Analysis Run 3/12/2024 4:16 PM

Nelson Dewey Generating Station Client: SCS Engineers Data: NED - Chempoint- export-Dec2020

	B-11A	B-11B	B-11R	B-26 (bg)	B-31A	B-31R	B-7R
12/9/2015	58800	64100	126000	81300	48400	77400	31700
4/12/2016				86200			
4/13/2016	60100	65400	141000		51900	84900	42300
7/18/2016							44400
7/19/2016	54000	59000	130000	82400	48900	76100	
10/19/2016	54600						56600
10/20/2016		59100	128000	82700	45800	84200	
1/12/2017	54500	63900	126000	89400	46600	73900	56700
4/17/2017	54800	67400	123000	89000	46900	85600	61400
6/7/2017			128000	105000			51600
6/8/2017	57800	68200			49400	90700	
8/1/2017	54500	61400	139000		46000	93400	50400
8/2/2017				98100			
10/19/2017	55000	52400	117000	102000	49600	75700	56200
4/2/2018	53300	59000	124000		49300	72900	49200
4/3/2018				88100			
10/8/2018				78700			
10/9/2018	48600	66300	49900		46600	125000	38500
4/22/2019	60400	83300	82400		48200	105000	59400
4/23/2019				75300			
10/14/2019	56600	91400	66000		52200	110000	57700
10/15/2019				<76.2 (UX)			
4/13/2020	57500	115000	117000		50900	93800	58700
4/14/2020				88500			
10/12/2020	55600	91200	120000		47700	95700	
10/13/2020				76500			41900
4/19/2021	50600	93400	115000		52100	91400	
4/20/2021				78700			56100
4/21/2021							
10/7/2021	51400	100000	119000		53500	79000	
10/8/2021				84900			
4/25/2022				75900		81100	
4/26/2022	51600	97100	114000		55300		59200
10/18/2022	46000	75100	116000	80300	45300	78500	
4/3/2023							48800
4/4/2023	51700	84400	105000		46100	88300	
4/5/2023				77400			
10/2/2023					48300	114000	
10/3/2023	60300	80600	90600	85100			41000

Chloride

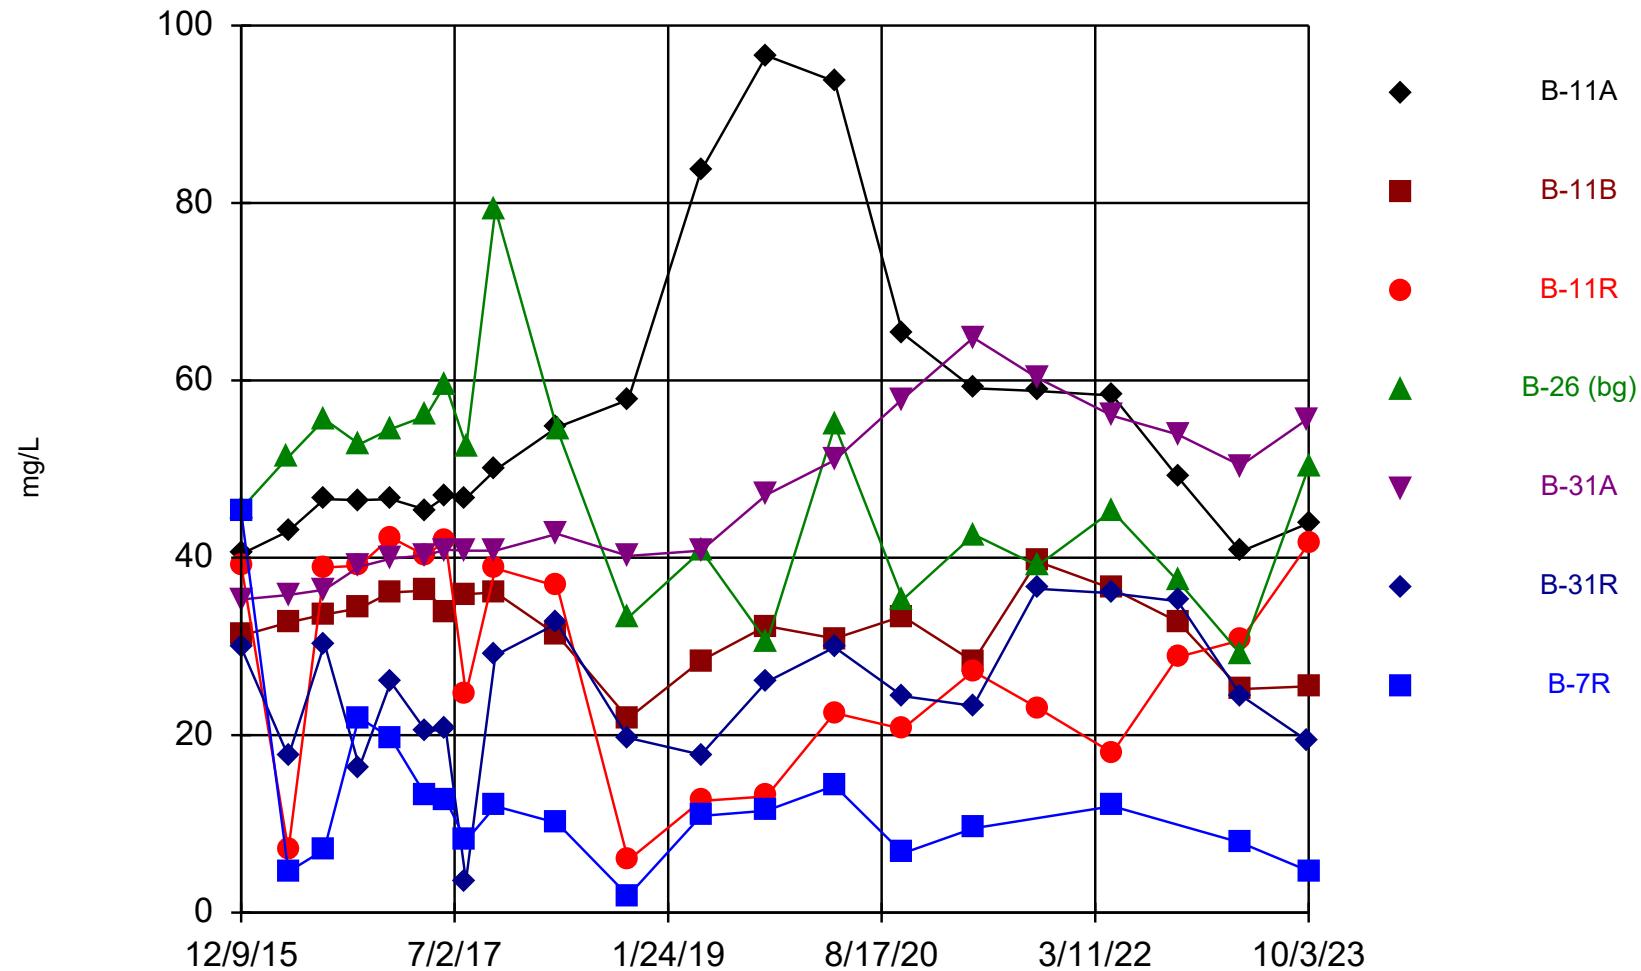

Time Series Analysis Run 3/12/2024 4:16 PM

Nelson Dewey Generating Station Client: SCS Engineers Data: NED - Chempoint- export-Dec2020


Time Series

Constituent: Chloride (mg/L) Analysis Run 3/12/2024 4:16 PM

Nelson Dewey Generating Station Client: SCS Engineers Data: NED - Chempoint- export-Dec2020

	B-11A	B-11B	B-11R	B-26 (bg)	B-31A	B-31R	B-7R
12/9/2015	40.4	31.2	39.2	45.5	35.3	29.9	45.2
4/12/2016				51.3			
4/13/2016	43	32.7	7		35.8	17.6	4.6
7/18/2016							7.1
7/19/2016	46.6	33.6	38.9	55.6	36.4	30.3	
10/19/2016	46.5						22
10/20/2016		34.3	39.1	52.8	39	16.4	
1/12/2017	46.6	36.1	42.3	54.5	39.9	26	19.7
4/17/2017	45.4	36.3	40.2	56	40.3	20.4	13.1
6/7/2017			42	59.6			12.8
6/8/2017	46.9	33.9			40.9	20.7	
8/1/2017	46.7	35.9	24.7		40.8	3.6	8.1
8/2/2017				52.6			
10/19/2017	49.9	36.1	38.8	79.3	40.8	29	12
4/2/2018	54.7	31.3	36.8		42.7	32.6	10.1
4/3/2018				54.4			
10/8/2018				33.2			
10/9/2018	57.8	21.9	5.9		40.2	19.7	1.9 (J)
4/22/2019	83.6	28.4	12.6		40.8	17.8	10.9
4/23/2019				40.8			
10/14/2019	96.6	32.3	13.1		47.1	26	11.5
10/15/2019				30.5			
4/13/2020	93.7	30.9	22.5		51	29.9	14.3
4/14/2020				54.9			
10/12/2020	65.3	33.4	20.7		57.9	24.4	
10/13/2020				35.3			6.7 (J)
4/19/2021	59.1	28.3	27.2		64.8	23.3	
4/20/2021							9.5 (J)
4/21/2021				42.6			
10/7/2021	58.8	39.6	23.1		60.3	36.5	
10/8/2021				39.1			
4/25/2022				45.3		36	
4/26/2022	58.3	36.5	18		56		12
10/18/2022	49.1	32.8	28.8	37.4	53.9	35.1	
4/3/2023							7.9 (J)
4/4/2023	40.7	25.2	30.7		50.4	24.5	
4/5/2023				29.1			
10/2/2023					55.7	19.3	
10/3/2023	43.9	25.5	41.6	50.2			4.7

Field pH

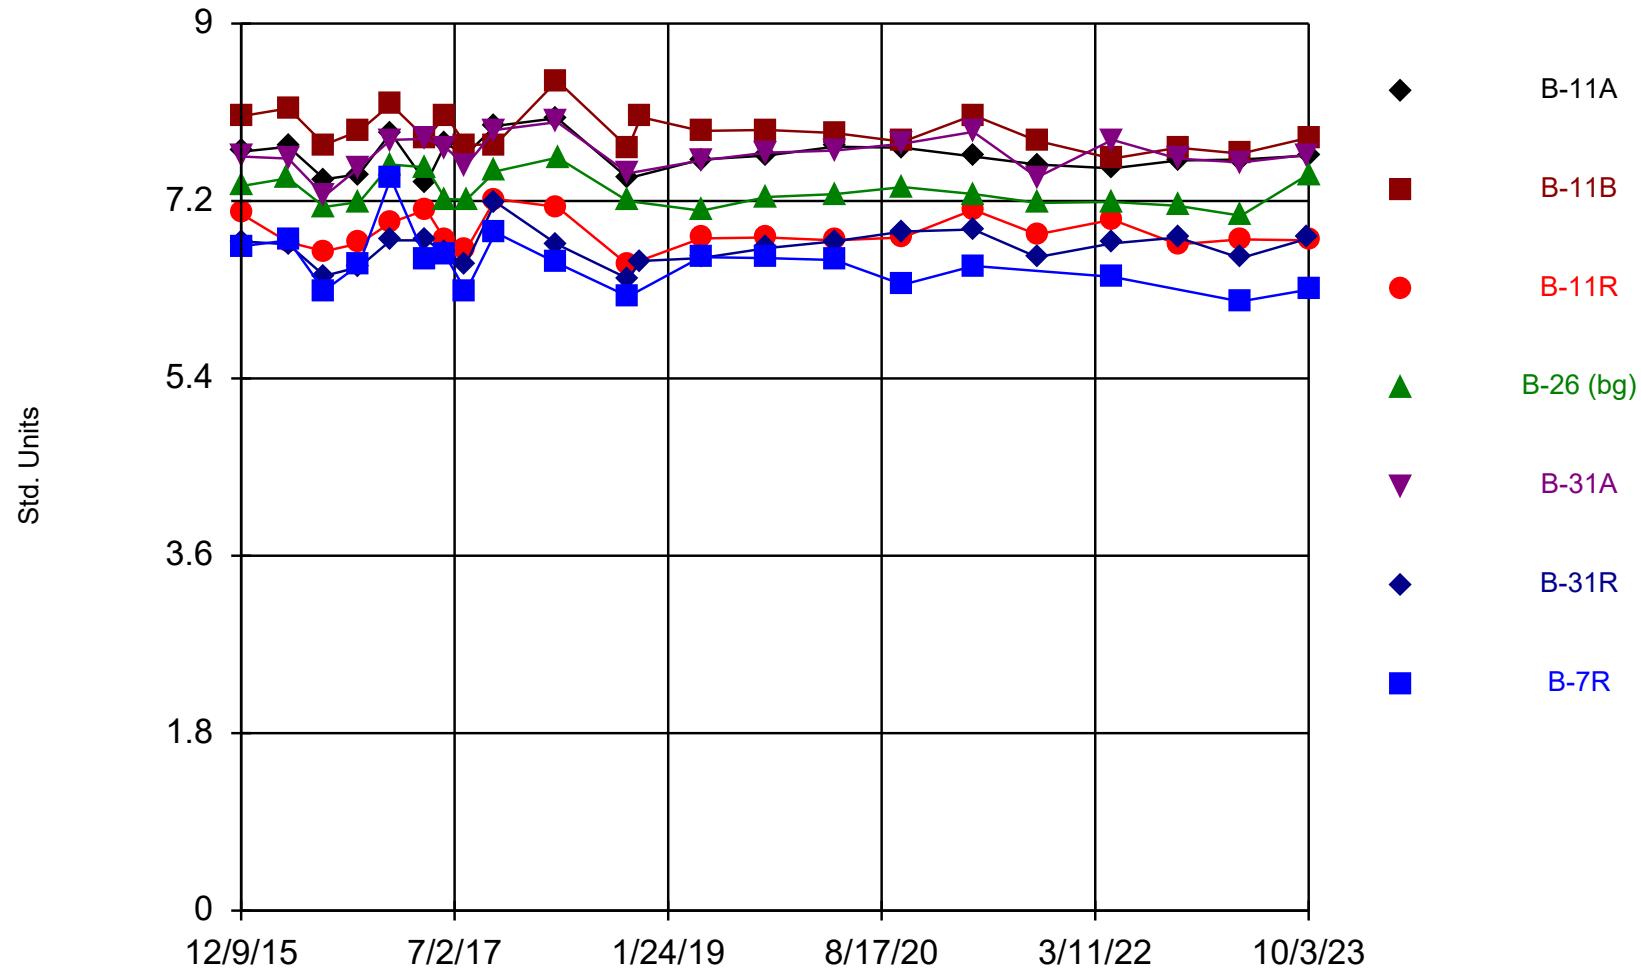

Time Series Analysis Run 3/12/2024 4:16 PM

Nelson Dewey Generating Station Client: SCS Engineers Data: NED - Chempoint- export-Dec2020

Time Series


Constituent: Field pH (Std. Units) Analysis Run 3/12/2024 4:16 PM

Nelson Dewey Generating Station Client: SCS Engineers Data: NED - Chempoint- export-Dec2020

	B-11A	B-11B	B-11R	B-26 (bg)	B-31A	B-31R	B-7R
12/9/2015	7.7	8.06	7.07	7.35	7.65	6.79	6.74
4/12/2016				7.43			
4/13/2016	7.75	8.14	6.78		7.63	6.76	6.8
7/18/2016							6.29
7/19/2016	7.42	7.77	6.69	7.14	7.25	6.44	
10/19/2016	7.47						6.55
10/20/2016		7.91	6.77	7.19	7.54	6.53	
1/12/2017	7.89	8.18	6.98	7.57	7.82	6.8	7.43
4/17/2017	7.38	7.83	7.11	7.54	7.83	6.8	6.6
6/7/2017			6.8	7.22			6.65
6/8/2017	7.78	8.07			7.74	6.67	
8/1/2017	7.67	7.77	6.7		7.56	6.56	6.28
8/2/2017				7.21			
10/19/2017	7.96	7.77	7.22	7.5	7.92	7.19	6.88
4/2/2018	8.04	8.42	7.14		8	6.76	6.57
4/3/2018				7.64			
10/8/2018				7.2			
10/9/2018	7.43	7.74	6.55		7.48	6.41	6.23
11/12/2018		8.05				6.59	
4/22/2019	7.62	7.91	6.82		7.61	6.62	6.63
4/23/2019				7.1			
10/14/2019	7.66	7.92	6.83		7.69	6.72	6.62
10/15/2019				7.24			
4/13/2020	7.75	7.89	6.8		7.71	6.79	6.6
4/14/2020				7.27			
10/12/2020	7.74	7.8	6.83		7.78	6.89	
10/13/2020				7.34			6.35
4/19/2021	7.65	8.07	7.11		7.9	6.91	
4/20/2021							6.54
4/21/2021				7.27			
10/7/2021	7.57	7.81	6.86		7.44	6.63	
10/8/2021				7.18			
4/25/2022				7.19		6.77	
4/26/2022	7.53	7.63	7.01		7.82		6.43
10/18/2022	7.61	7.74	6.76	7.15	7.63	6.83	
4/3/2023							6.18
4/4/2023	7.62	7.68	6.81		7.59	6.62	
4/5/2023				7.05			
10/2/2023					7.67	6.82	
10/3/2023	7.66	7.84	6.8	7.47			6.3

Sanitas™ v.10.0.16 Software licensed to SCS Engineers. UG
Hollow symbols indicate censored values.

Fluoride

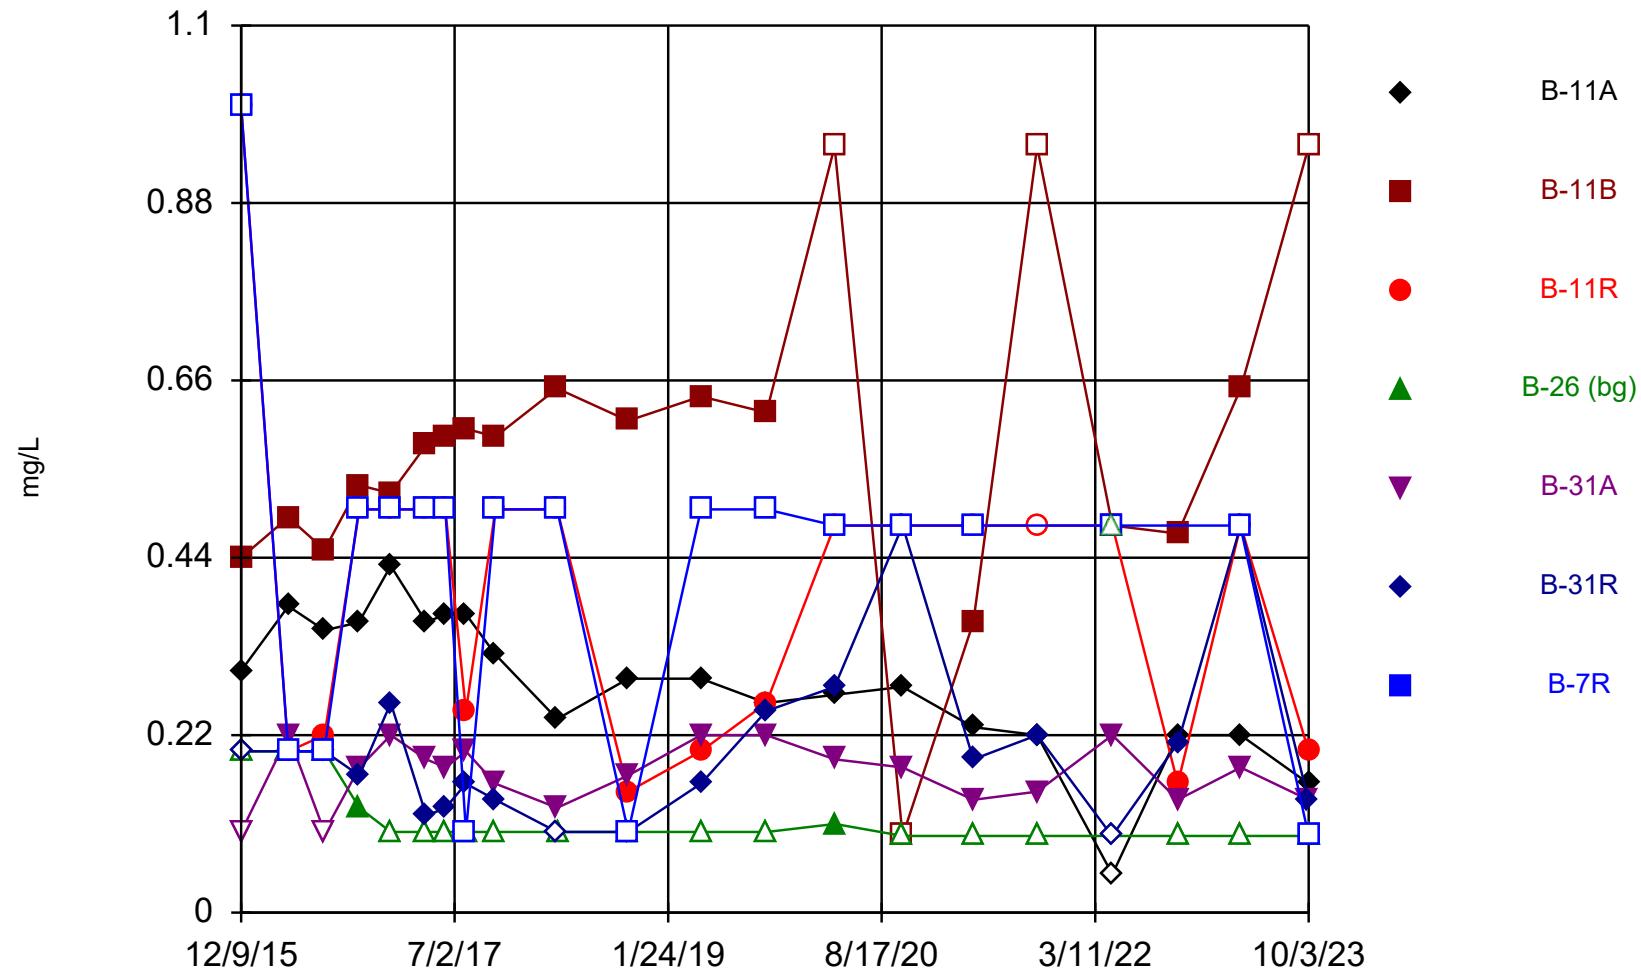

Time Series Analysis Run 3/12/2024 4:16 PM

Nelson Dewey Generating Station Client: SCS Engineers Data: NED - Chempoint- export-Dec2020

Time Series


Constituent: Fluoride (mg/L) Analysis Run 3/12/2024 4:16 PM

Nelson Dewey Generating Station Client: SCS Engineers Data: NED - Chempoint- export-Dec2020

	B-11A	B-11B	B-11R	B-26 (bg)	B-31A	B-31R	B-7R
12/9/2015	0.3 (J)	0.44	<1 (U)	<0.2 (U)	<0.2 (U)	<0.2 (U)	<1 (U)
4/12/2016				<0.2 (U)			
4/13/2016	0.38 (J)	0.49	<0.2 (U)		0.22 (J)	<0.2 (U)	<0.2 (U)
7/18/2016							<0.2 (U)
7/19/2016	0.35 (J)	0.45	0.22 (J)	<0.2 (U)	<0.2 (U)	<0.2 (U)	
10/19/2016	0.36						<0.5 (U)
10/20/2016		0.53	<0.5 (U)	0.13 (J)	0.18 (J)	0.17 (J)	
1/12/2017	0.43	0.52	<0.5 (U)	<0.1 (U)	0.22 (J)	0.26 (J)	<0.5 (U)
4/17/2017	0.36	0.58	<0.5 (U)	<0.1 (U)	0.19 (J)	0.12 (J)	<0.5 (U)
6/7/2017			<0.5 (U)	<0.1 (U)			<0.5 (U)
6/8/2017	0.37	0.59			0.18 (J)	0.13 (J)	
8/1/2017	0.37	0.6	0.25 (J)		0.2 (J)	0.16 (J)	<0.1 (U)
8/2/2017				<0.1 (U)			
10/19/2017	0.32	0.59	<0.5 (U)	<0.1 (U)	0.16 (J)	0.14 (J)	<0.5 (U)
4/2/2018	0.24 (J)	0.65	<0.5 (U)		0.13 (J)	<0.1 (U)	<0.5 (U)
4/3/2018				<0.1 (U)			
10/8/2018				<0.1 (U)			
10/9/2018	0.29 (J)	0.61	0.15 (J)		0.17 (J)	<0.1 (U)	<0.1 (U)
4/22/2019	0.29 (J)	0.64	0.2 (J)		0.22 (J)	0.16 (J)	<0.5 (U)
4/23/2019				<0.1 (U)			
10/14/2019	0.26 (J)	0.62	0.26 (J)		0.22 (J)	0.25 (J)	<0.5 (U)
10/15/2019				<0.1 (U)			
4/13/2020	0.27 (J)	<0.95 (U)	<0.48 (U)		0.19 (J)	0.28 (J)	<0.48 (U)
4/14/2020				0.11 (J)			
10/12/2020	0.28 (J)	<0.095 (U)	<0.48 (U)		0.18 (J)	<0.48 (U)	
10/13/2020				<0.095 (U)			<0.48 (U)
4/19/2021	0.23 (J)	0.36	<0.48		0.14 (J)	0.19 (J)	
4/20/2021							<0.48
4/21/2021				<0.095 (U)			
10/7/2021	0.22 (J)	<0.95 (U)	<0.48 (U)		0.15 (J)	0.22 (J)	
10/8/2021				<0.095 (U)			
4/25/2022				<0.48 (UX)		<0.095 (U)	
4/26/2022	<0.095 (U)	<0.48 (U)	<0.48 (U)		0.22 (J)		<0.48 (U)
10/18/2022	0.22 (J)	0.47	0.16 (J)	<0.095 (U)	0.14 (J)	0.21 (J)	
4/3/2023							<0.48 (U)
4/4/2023	0.22 (J)	0.65 (J)	<0.48 (U)		0.18 (J)	<0.48 (U)	
4/5/2023				<0.095 (U)			
10/2/2023					0.14 (J)	0.14 (J)	
10/3/2023	0.16 (J)	<0.95 (U)	0.2 (J)	<0.095 (U)			<0.095 (U)

Sanitas™ v.10.0.16 Software licensed to SCS Engineers. UG
Hollow symbols indicate censored values.

Sulfate

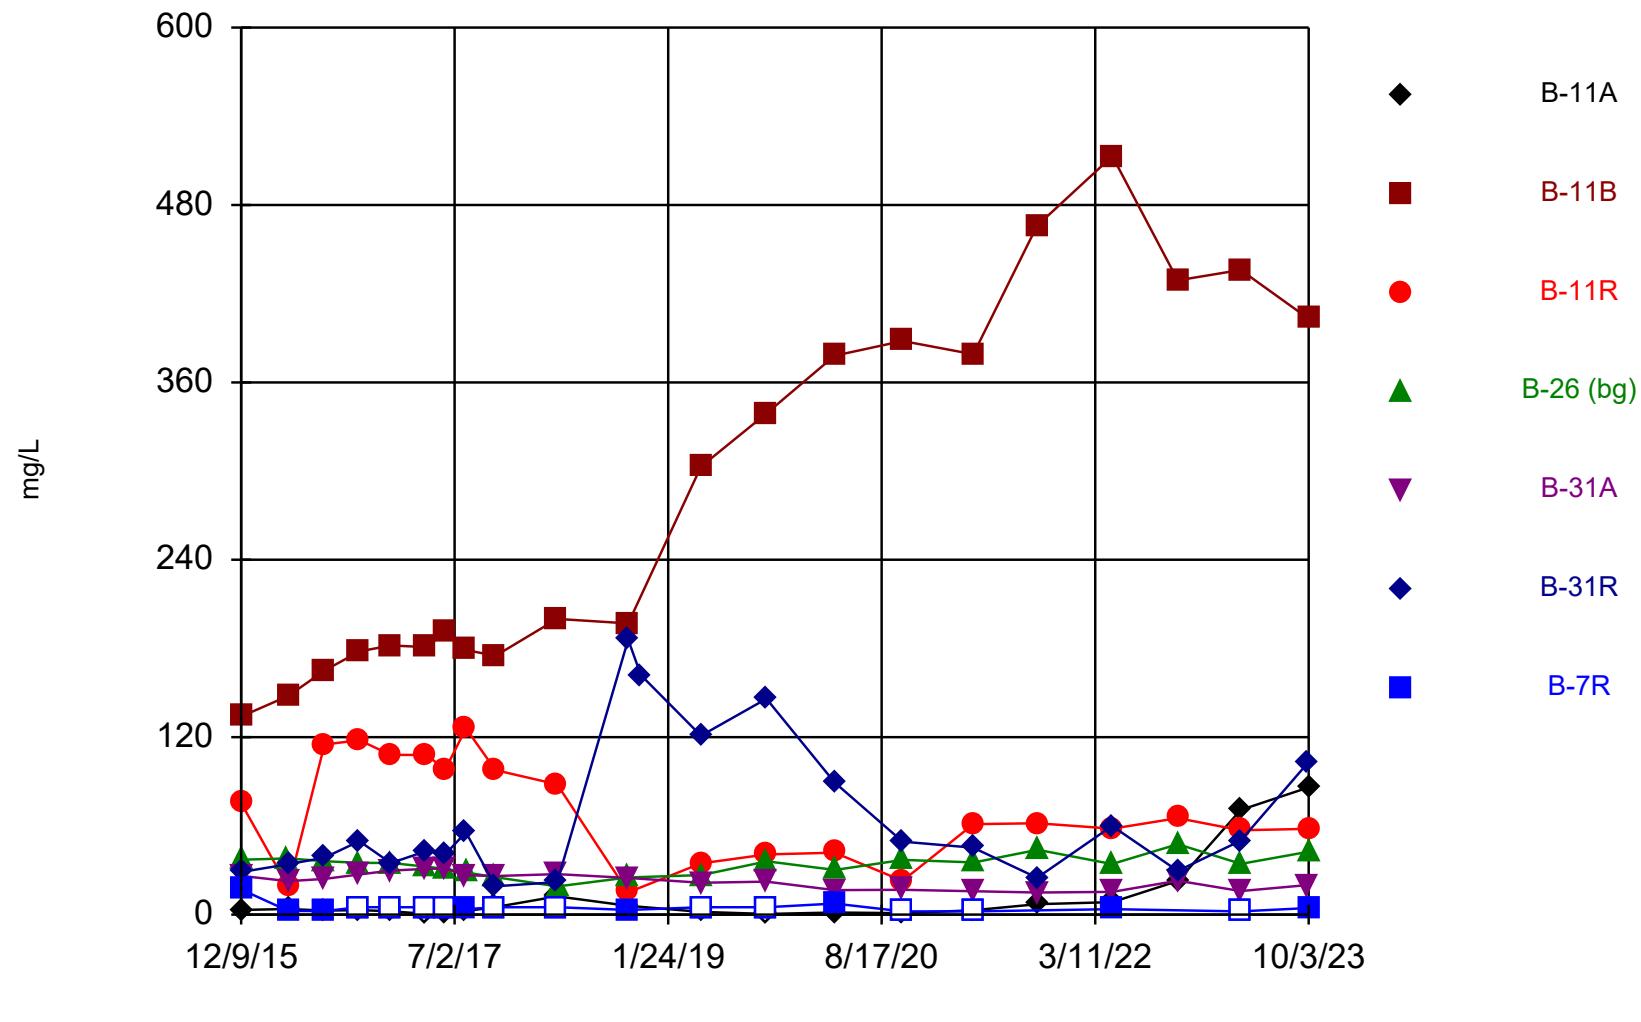

Time Series Analysis Run 3/12/2024 4:16 PM


Nelson Dewey Generating Station Client: SCS Engineers Data: NED - Chempoint- export-Dec2020

Time Series

Constituent: Sulfate (mg/L) Analysis Run 3/12/2024 4:16 PM

Nelson Dewey Generating Station Client: SCS Engineers Data: NED - Chempoint- export-Dec2020

	B-11A	B-11B	B-11R	B-26 (bg)	B-31A	B-31R	B-7R
12/9/2015	3.2 (J)	134	75.4	37.1	26.2	28.8	17 (J)
4/12/2016				38			
4/13/2016	3.8 (J)	148	18.4		22.6	34.1	2.5 (J)
7/18/2016							2.4 (J)
7/19/2016	2.7 (J)	165	115	36.2	24.2	38.5	
10/19/2016	3 (J)						<5 (U)
10/20/2016		178	118	35	27.2	49.7	
1/12/2017	2.3 (J)	182	108	35	29.8	34.9	<5 (U)
4/17/2017	<1 (U)	181	108	32.4	31	43	<5 (U)
6/7/2017			98.2	31			<5 (U)
6/8/2017	1.4 (J)	191			31.2	41.1	
8/1/2017	2.4 (J)	179	126		26.6	55.6	3.7
8/2/2017				28.5			
10/19/2017	5.1	175	97.7	25.3	26.1	19.2	<5 (U)
4/2/2018	12.3	200	88.1		27.4	22	<5 (U)
4/3/2018				19.1			
10/8/2018				25.1			
10/9/2018	6	197	15.1		24.8	186	3.2
11/12/2018						162	
4/22/2019	1.9 (J)	303	34.6		21.6	121	<5 (U)
4/23/2019				26.7			
10/14/2019	<1 (U)	339	40.7		22.3	146	<5 (U)
10/15/2019				36			
4/13/2020	1.4 (J)	378	41.9		16.6	89.4	7.5 (J)
4/14/2020				30.2			
10/12/2020	1 (J)	388	22.8		16.8	49.4	
10/13/2020				37			<2.2 (U)
4/19/2021	2.9	379	61.2		15.8	45.3	
4/20/2021				35.3			<2.2
4/21/2021							
10/7/2021	7	466	61.8		14.9	24.9	
10/8/2021				43.8			
4/25/2022				34.2		60	
4/26/2022	8.5	513	58.1		15.4		3.7 (J)
10/18/2022	22.7	429	65.3	47.6	23	29.6	
4/3/2023							<2.2 (U)
4/4/2023	70.8	436	57		15.9	50	
4/5/2023				34.3			
10/2/2023					20	103	
10/3/2023	86	403	58	42.5			4.5

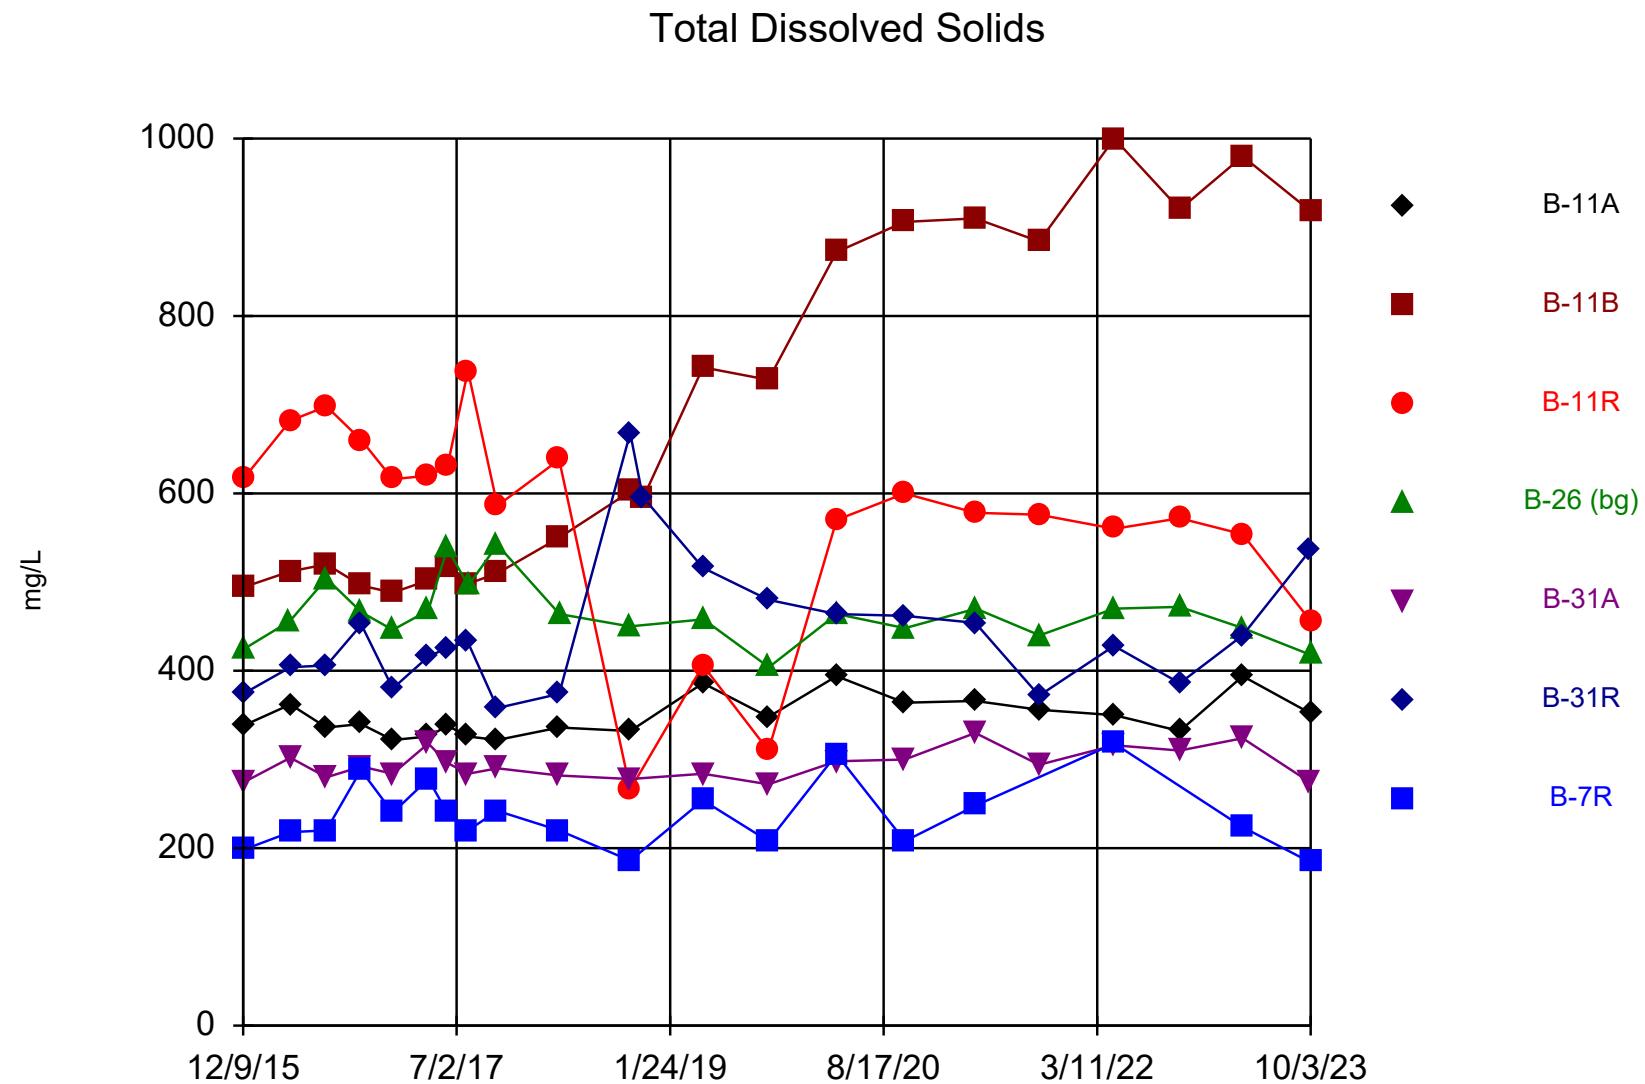

Time Series Analysis Run 3/12/2024 4:16 PM

Nelson Dewey Generating Station Client: SCS Engineers Data: NED - Chempoint- export-Dec2020

Time Series


Constituent: Total Dissolved Solids (mg/L) Analysis Run 3/12/2024 4:16 PM

Nelson Dewey Generating Station Client: SCS Engineers Data: NED - Chempoint- export-Dec2020

	B-11A	B-11B	B-11R	B-26 (bg)	B-31A	B-31R	B-7R
12/9/2015	338	494	616	424	274	374	198
4/12/2016				456			
4/13/2016	362	512	682		302	404	218
7/18/2016							220
7/19/2016	336	520	698	504	280	406	
10/19/2016	340						288
10/20/2016		496	660	466	292	452	
1/12/2017	322	488	616	446	284	380	240
4/17/2017	326	502	620	468	318	416	278
6/7/2017			630	538			240
6/8/2017	338	516			296	426	
8/1/2017	326	498	738		284	432	220
8/2/2017				496			
10/19/2017	322	510	586	542	290	358	242
4/2/2018	336	550	638		282	374	220
4/3/2018				464			
10/8/2018				450			
10/9/2018	332	602	266		278	668	186
11/12/2018		594				596	
4/22/2019	386	742	406		284	516	254
4/23/2019				458			
10/14/2019	348	728	310		272	480	208
10/15/2019				404			
4/13/2020	394	872	570		298	464	306
4/14/2020				464			
10/12/2020	364	906	600		300	462	
10/13/2020				448			208
4/19/2021	366	910	578		330	454	
4/20/2021							248
4/21/2021				470			
10/7/2021	356	884	576		294	372	
10/8/2021				440			
4/25/2022				470		428	
4/26/2022	350	1000	560		316		318
10/18/2022	332	920	572	472	310	386	
4/3/2023							224
4/4/2023	394	980	554		324	440	
4/5/2023				448			
10/2/2023					274	536	
10/3/2023	352	918	456	418			184

Appendix B

1994 RMT Environmental Contamination Assessment Information

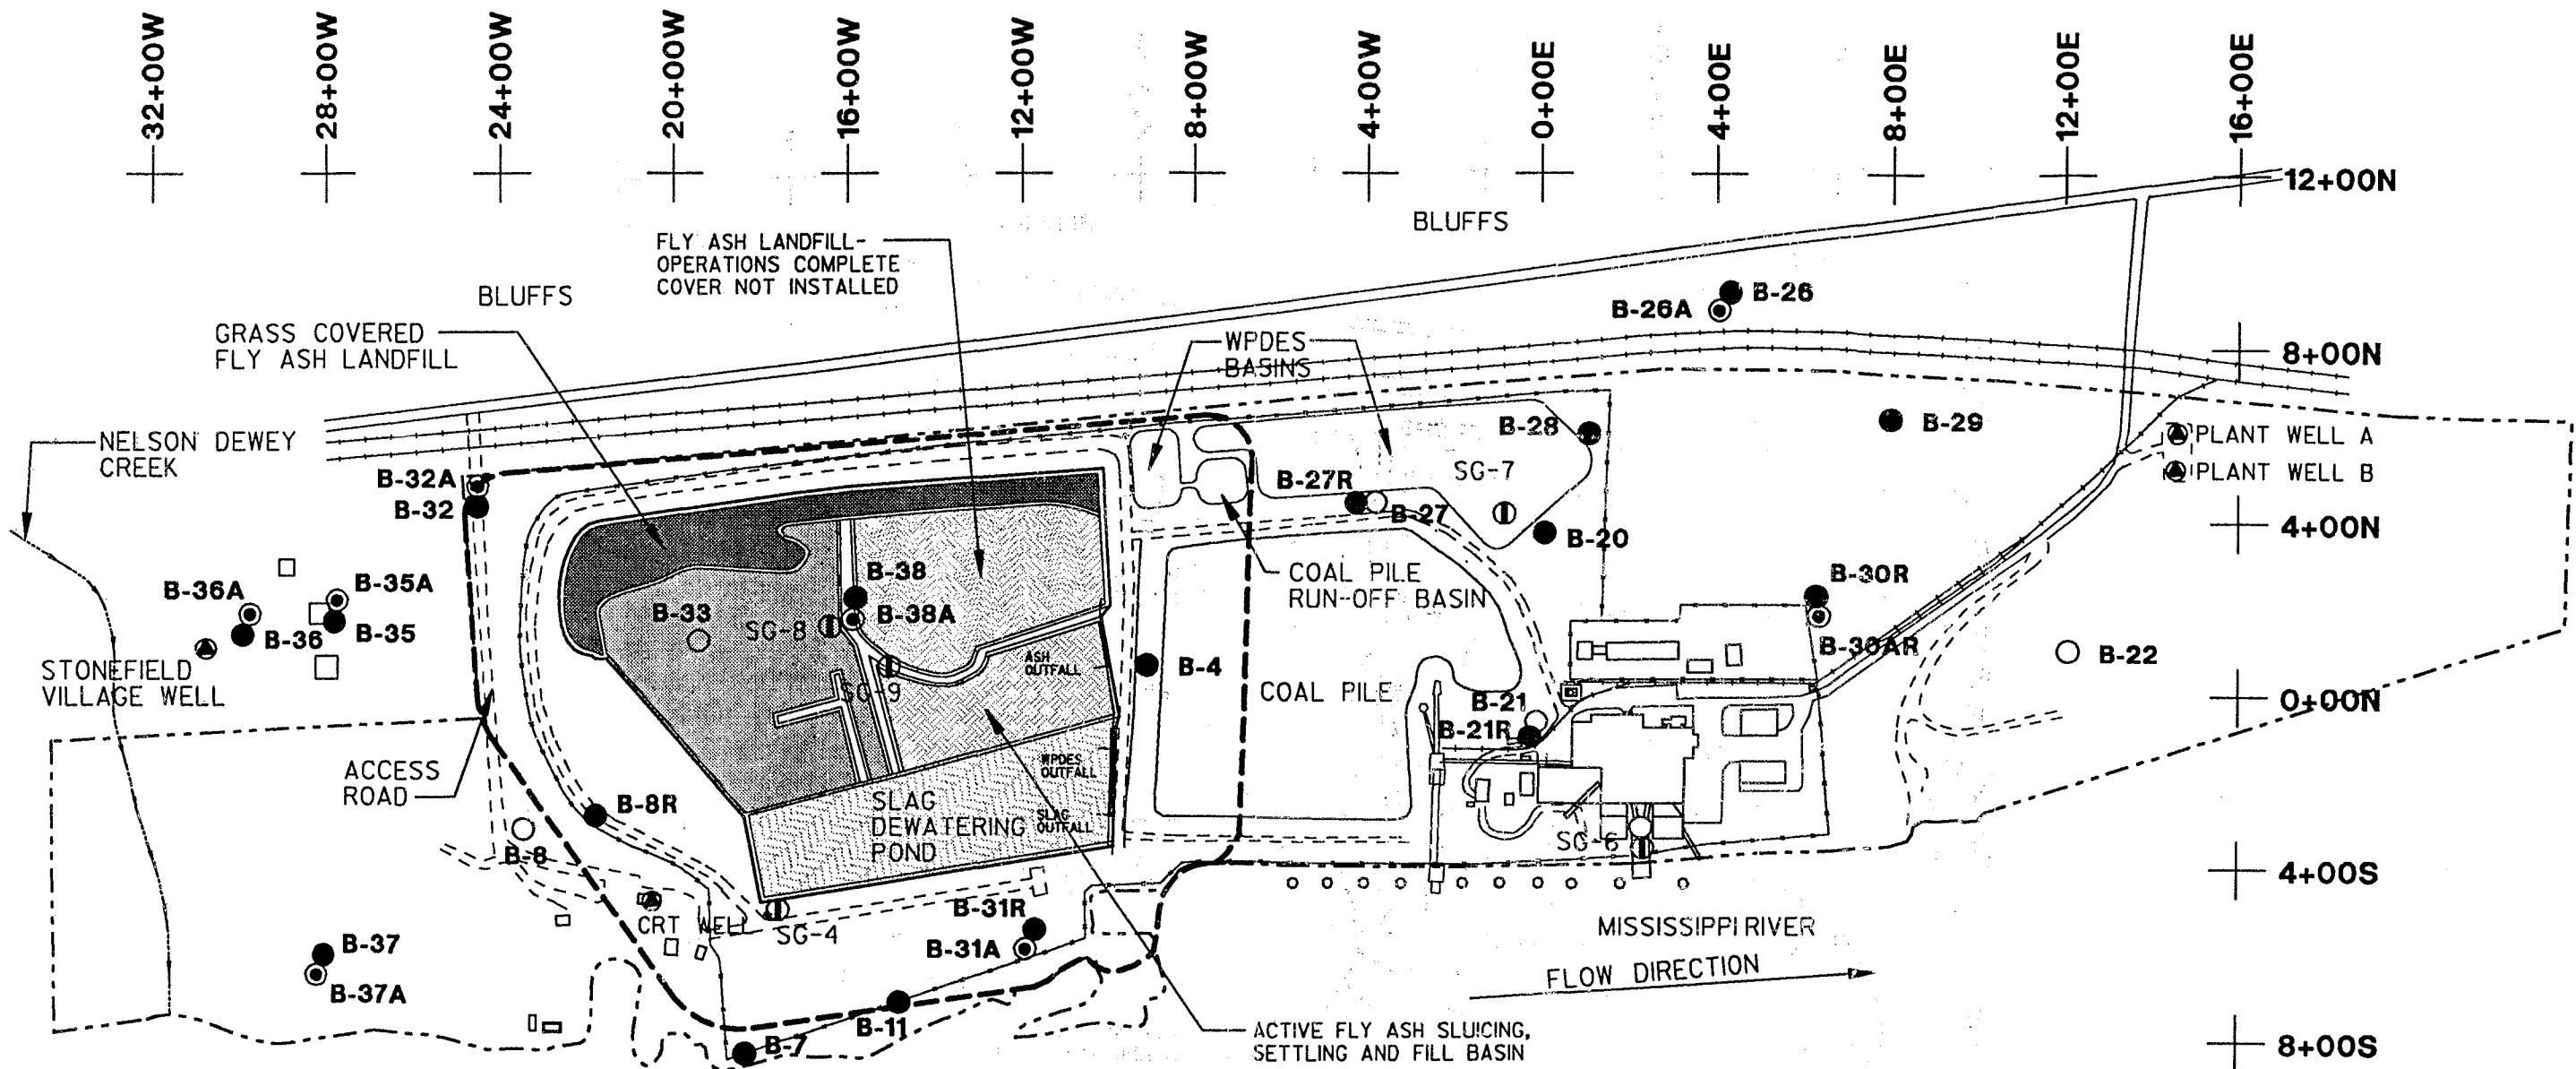


LEGEND



- B-28 WATER TABLE OBSERVATION WELL
- ◎ B-28A PIEZOMETER
- B-33 ABANDONED WELL
- CRT WELL WATER SUPPLY WELL
- ① SG-4 STAFF GAUGE
- APPROXIMATE LIMITS OF LICENSED LANDFILL
- - - RAILROAD TRACK
- - - ROAD
- - - PROPERTY LINE
- - - DESIGN MANAGEMENT ZONE
- + 8+00S LOCAL GRID
- BUILDINGS
- PILINGS

NOTES

1. BASE MAP WELLHEAD LOCATIONS SURVEYED BY SCHMITT ENGINEERING IN OCTOBER 1993.
2. OTHER SITE INFORMATION PROVIDED BY WP&L.

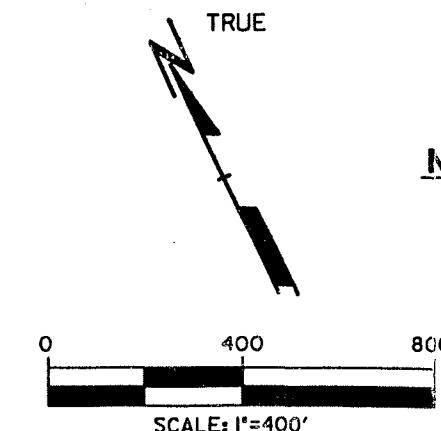

WISCONSIN POWER & LIGHT
NELSON DEWEY GENERATING STATION
EXISTING CONDITIONS
OCTOBER 1993

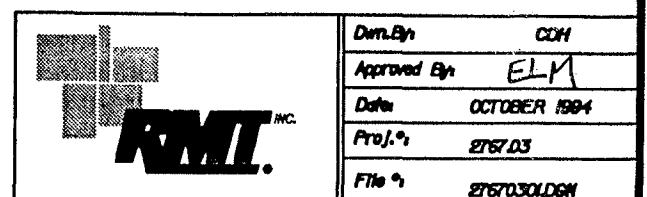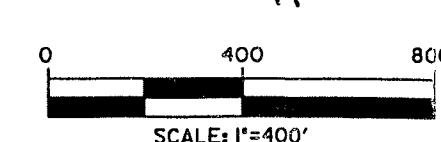

OCT 31 1994

FIGURE 4

TABLE 5
SUMMARY OF LEACHING TEST RESULTS

	Fly Ash		Slag
Year	1983	1990 to 1992	1987 to 1992
Coal Type	Eastern (and Western)	Western (and Eastern)	Western (and Eastern) *
Water/Solid Ratio	2:1	4:1	4:1
Extraction Time	24 hours	48 hours	48 hours
Number of Samples	1	3	6
Arsenic (mg/L)	< 0.001	0.05 to 2.02	< 0.002 to 0.081
Selenium (mg/L)	NA	0.42 to 160	< 0.002 to 0.045
Boron (mg/L)	420	4.63 to 37.34	< 0.010 to 1.05
Iron (mg/L)	NA	NA	< 0.02 to 0.98
Sulfate (mg/L)	13,070	2,000 to 16,700	2.0 to < 5.0
pH (SU)	6.6	10.3 to 12.5	5.6 to 9.9

NOTES:

1. 1983 fly ash leaching data from RMT (1984); remaining leaching data provided by WP&L.
2. NA = Not Analyzed.

PROJECT NUMBER: 1831.28
BEGINNING DATE: 01-JUN-93
ENDING DATE: 07-SEP-93

TABLE 6
SLAG AND ASH BASIN CHEMISTRY

PARAMETER	UNITS	FLY ASH BASIN	SLAG BASIN
		07-SEP-93	07-SEP-93
PARAMETER	UNITS	3302-011	3302-010
COLOR, FIELD		CLEAR	CLEAR
CONDUCTANCE, SPECIFIC	UMHOS/CM	5190	400
ODOR, FIELD		NONE	NONE
PH, FIELD	SU	8.1	7.4
TEMPERATURE	DEG C	17	18
TURBIDITY, FIELD		SLIGHT	SLIGHT
ALKALINITY AS CACO ₃	MG/L	230	160
HARDNESS AS CACO ₃	MG/L	930	200
SOLIDS, TOTAL DISSOLVED	MG/L	410	300
SULFATE	MG/L	3300	50
ARSENIC, TOTAL	UG/L	60	8.0
BARIUM, TOTAL	UG/L	270	150
BORON, TOTAL	UG/L	2300	210
CADMIUM, TOTAL	UG/L	5.4	< 0.30
CHROMIUM, TOTAL	UG/L	11	< 10
IRON, TOTAL	UG/L	1600	2000
LEAD, TOTAL	UG/L	< 3.0	< 3.0
MERCURY, TOTAL	UG/L	< 0.20	< 0.20
SELENIUM, TOTAL	UG/L	36	I 2.1 L
SILVER, TOTAL	UG/L	< 1.0	< 1.0

PROJECT NUMBER: 1831.28
 BEGINNING DATE: 01-JUN-93
 ENDING DATE: 29-OCT-93

TABLE 8
 GROUNDWATER CHEMISTRY

PARAMETER	UNITS	B-04 01-JUN-93	B-04 07-SEP-93	B-07 ND 01-JUN-93	B-07 ND 07-SEP-93	B-08 01-JUN-93	B-08R 07-SEP-93
		1670-015	3293-010	1670-020	3302-004	1670-001	3293-009
COLOR, FIELD		CLEAR	CLEAR	CLEAR	CLEAR	CLEAR	CLEAR
CONDUCTANCE, SPECIFIC	UMHOS/CM	1160	1240	460	550	670	1160
DEPTH TO WATER	FEET	9.90	12.75	12.83	16.12	5.68	20.13
ODOR, FIELD		NONE	NONE	NONE	NONE	NONE	NONE
PH, FIELD	SU	7.3	7.5	7.0	6.9	7.1	6.8
TEMPERATURE	DEG C	15	10	14	12	15	7
TURBIDITY, FIELD		NONE	SLIGHT	NONE	SLIGHT	NONE	MODERATE
WATER ELEVATION	FEET	610.68	607.83	610.97	607.68	610.51	
ALKALINITY AS CACO ₃	MG/L	72	92	160	190	220	440
CHLORIDE	MG/L	18	23	17	15	9.4	2.8
COD	MG/L						
FLUORIDE	MG/L	0.58	5.5	0.26	0.32	< 0.10	0.12
HARDNESS AS CACO ₃	MG/L	220	120	210	250	370	620
NITROGEN, NITRATE + NITRITE	MG/L	0.15	0.33	< 0.050	< 0.050	< 0.050	4.2
SOLIDS, TOTAL DISSOLVED	MG/L	900	940	300	360	460	770
SULFATE	MG/L	500	560	74	100	180	180
ARSENIC, DISSOLVED	UG/L	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0
BARIUM, DISSOLVED	UG/L	68	< 50	61	73	63	50
BORON, DISSOLVED	UG/L	1900	4200	230	< 200	2200	9400
CADMIUM, DISSOLVED	UG/L	< 0.30	< 0.30	< 0.30	< 0.30	< 0.30	0.38
CHROMIUM, DISSOLVED	UG/L	< 10	< 10	< 10	< 10	< 10	< 10
COPPER, DISSOLVED	UG/L	< 20	< 20	< 20	< 20	< 20	< 20
IRON, DISSOLVED	UG/L	720	890	2800	4100	< 100	< 100
LEAD, DISSOLVED	UG/L	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0
MANGANESE, DISSOLVED	UG/L	1200	720	970	1500	17	3400
MERCURY, DISSOLVED	UG/L	< 0.20	< 0.20	< 0.20	< 0.20	< 0.20	< 0.20
SELENIUM, DISSOLVED	UG/L	6.9	3.2	< 1.0	< 1.0	< 1.0	34
SILVER, DISSOLVED	UG/L	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
ZINC, DISSOLVED	UG/L	1000	100	22	< 20	220	< 20

PROJECT NUMBER: 1831.28
 BEGINNING DATE: 01-JUN-93
 ENDING DATE: 29-OCT-93

TABLE 8
 GROUNDWATER CHEMISTRY

PARAMETER	UNITS	B-11	B-11	B-20	B-26	B-26	B-26A
		07-SEP-93	29-OCT-93	07-SEP-93	01-JUN-93	07-SEP-93	01-JUN-93
COLOR, FIELD		X0001	3485-001	X0002	1670-022	3302-005	1670-023
CONDUCTANCE, SPECIFIC	UMHOS/CM	1500		310	610	670	660
DEPTH TO WATER	FEET	15.91		10.81	16.22	18.85	16.20
ODOR, FIELD				NONE	NONE	NONE	
PH, FIELD	SU			7.1	7.2	7.0	
TEMPERATURE	DEG C	13	13	14	14	11	15
TURBIDITY, FIELD				NONE	SLIGHT	NONE	
WATER ELEVATION	FEET			610.18	607.55	610.19	
ALKALINITY AS CACO ₃	MG/L		470		320	300	340
CHLORIDE	MG/L				21	43	33
COD	MG/L						
FLUORIDE	MG/L			< 0.10	0.15	< 0.10	
HARDNESS AS CACO ₃	MG/L		810		390	410	400
NITROGEN, NITRATE + NITRITE	MG/L				2.6	4.9	2.0
SOLIDS, TOTAL DISSOLVED	MG/L		520		440	450	450
SULFATE	MG/L		360		34	34	33
ARSENIC, DISSOLVED	UG/L		8.4	< 3.0	< 3.0	< 3.0	< 3.0
BARIUM, DISSOLVED	UG/L		100		62	68	96
BORON, DISSOLVED	UG/L		5100	< 200	< 200	< 200	< 200
CADMIUM, DISSOLVED	UG/L		< 0.30	< 0.30	< 0.30	< 0.30	< 0.30
CHROMIUM, DISSOLVED	UG/L		< 10	< 10	< 10	< 10	< 10
COPPER, DISSOLVED	UG/L			< 20	< 20	< 20	< 20
IRON, DISSOLVED	UG/L		55000	< 100	< 100	< 100	< 100
LEAD, DISSOLVED	UG/L		< 3.0	< 3.0	< 3.0	< 3.0	< 3.0
MANGANESE, DISSOLVED	UG/L			< 5.0	< 5.0	< 5.0	< 5.0
MERCURY, DISSOLVED	UG/L		< 0.20	< 0.20	< 0.20	< 0.20	< 0.20
SELENIUM, DISSOLVED	UG/L		< 1.0	LNP	< 1.0	L	< 1.0
SILVER, DISSOLVED	UG/L		< 10		< 1.0	< 1.0	< 1.0
ZINC, DISSOLVED	UG/L				< 20	< 20	< 20

PROJECT NUMBER: 1831.28
 BEGINNING DATE: 01-JUN-93
 ENDING DATE: 29-OCT-93

TABLE 8
 GROUNDWATER CHEMISTRY

PARAMETER	UNITS	B-26A 07-SEP-93	B-27R 07-SEP-93	B-28 01-JUN-93	B-28 07-SEP-93	B-29 07-SEP-93	B-30AR 01-JUN-93
		3302-006	X0003	1670-014	3302-003	X0004	1670-013
COLOR, FIELD		CLEAR		CLEAR	CLEAR		CLEAR
CONDUCTANCE, SPECIFIC	UMHOS/CM	440	370	190	230	360	220
DEPTH TO WATER	FEET	18.84	14.67	6.40	9.08	9.57	12.33
ODOR, FIELD		NONE		NONE	NONE		NONE
PH, FIELD	SU	7.2		6.1	6.0		7.2
TEMPERATURE	DEG C	11	14	17	15	15	17
TURBIDITY, FIELD		NONE		SLIGHT	MODERATE		NONE
WATER ELEVATION	FEET	607.55		610.46	607.74	607.26	610.11
ALKALINITY AS CACO ₃	MG/L	340		26	54		200
CHLORIDE	MG/L	25		4.6	11		13
COD	MG/L						7.3
FLUORIDE	MG/L	0.15		< 0.10	< 0.10		0.10
HARDNESS AS CACO ₃	MG/L	410		82	110		220
NITROGEN, NITRATE + NITRITE	MG/L	1.8		2.7	0.60		< 0.050
SOLIDS, TOTAL DISSOLVED	MG/L	440		140	160		280
SULFATE	MG/L	38		45	42		27
ARSENIC, DISSOLVED	UG/L	< 3.0		< 3.0	< 3.0		< 3.0
BARIUM, DISSOLVED	UG/L	86		< 50	52		< 50
BORON, DISSOLVED	UG/L	< 200		< 200	< 200		< 200
CADMIUM, DISSOLVED	UG/L	< 0.30		< 0.30	< 0.30		< 0.30
CHROMIUM, DISSOLVED	UG/L	< 10		< 10	< 10		< 10
COPPER, DISSOLVED	UG/L	< 20		< 20	< 20		< 20
IRON, DISSOLVED	UG/L	< 100		210	< 100		< 100
LEAD, DISSOLVED	UG/L	< 3.0		< 3.0	< 3.0		< 3.0
MANGANESE, DISSOLVED	UG/L	< 5.0		8.6	< 5.0		< 5.0
MERCURY, DISSOLVED	UG/L	< 0.20		< 0.20	< 0.20		< 0.20
SELENIUM, DISSOLVED	UG/L	< 1.0	LN	< 1.0	L	< 1.0	L
SILVER, DISSOLVED	UG/L	< 1.0		< 1.0	< 1.0		< 1.0
ZINC, DISSOLVED	UG/L	< 20		< 20	< 20		< 20

PROJECT NUMBER: 1831.28
 BEGINNING DATE: 01-JUN-93
 ENDING DATE: 29-OCT-93

TABLE 8
 GROUNDWATER CHEMISTRY

PARAMETER	UNITS	B-30AR 07-SEP-93	B-30R 01-JUN-93	B-30R 07-SEP-93	B-31A 01-JUN-93	B-31A 07-SEP-93	B-31R 01-JUN-93
		3302-002	1670-012	3302-001	1670-019	3293-011	1670-018
COLOR, FIELD		CLEAR	CLEAR	CLEAR	CLEAR	CLEAR	CLEAR
CONDUCTANCE, SPECIFIC	UMHOS/CM	410	420	360	700	800	640
DEPTH TO WATER	FEET	15.37	12.25	15.17	12.21	15.93	11.56
ODOR, FIELD		NONE	NONE	NONE	NONE	NONE	NONE
PH, FIELD	SU	7.3	7.0	6.8	6.9	7.3	6.8
TEMPERATURE	DEG C	12	16	14	17	14	17
TURBIDITY, FIELD		NONE	MODERATE	MODERATE	NONE	SLIGHT	SLIGHT
WATER ELEVATION	FEET	607.07	610.10	607.18	610.46	606.74	610.85
ALKALINITY AS CACO ₃	MG/L	190	160	140	170	160	240
CHLORIDE	MG/L	14	13	6.6	16	17	11
COD	MG/L		9.7				
FLUORIDE	MG/L	0.16	< 0.10	< 0.10	0.39	0.43	< 0.10
HARDNESS AS CACO ₃	MG/L	230	210	210	120	160	330
NITROGEN, NITRATE + NITRITE	MG/L	< 0.050	8.5	8.8	< 0.050	< 0.050	< 0.050
SOLIDS, TOTAL DISSOLVED	MG/L	280	280	230	510	570	510
SULFATE	MG/L	25	25	26	250	250	150
ARSENIC, DISSOLVED	UG/L	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0
BARIUM, DISSOLVED	UG/L	< 50	< 50	< 50	54	66	110
BORON, DISSOLVED	UG/L	< 200	< 200	< 200	2900	2100	2900
CADMIUM, DISSOLVED	UG/L	< 0.30	< 0.30	< 0.30	< 0.30	< 0.30	2.7
CHROMIUM, DISSOLVED	UG/L	< 10	< 10	< 10	< 10	< 10	< 10
COPPER, DISSOLVED	UG/L	< 20	< 20	< 20	< 20	< 20	110
IRON, DISSOLVED	UG/L	< 100	< 100	< 100	210	300	450
LEAD, DISSOLVED	UG/L	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0
MANGANESE, DISSOLVED	UG/L	< 5.0	< 5.0	< 5.0	4600	6000	440
MERCURY, DISSOLVED	UG/L	< 0.20	< 0.20	< 0.20	< 0.20	< 0.20	< 0.20
SELENIUM, DISSOLVED	UG/L	< 1.0	L	3.2	< 1.0	L	1.2
SILVER, DISSOLVED	UG/L	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
ZINC, DISSOLVED	UG/L	< 20	< 20	< 20	< 20	< 20	27

PROJECT NUMBER: 1831.28
 BEGINNING DATE: 01-JUN-93
 ENDING DATE: 29-OCT-93

TABLE 8
 GROUNDWATER CHEMISTRY

PARAMETER	UNITS	B-31R 07-SEP-93	B-32 01-JUN-93	B-32 07-SEP-93	B-32A 01-JUN-93	B-32A 07-SEP-93	B-35 01-JUN-93
		3293-012	1670-002	3293-016	1670-003	3293-017	1670-004
COLOR, FIELD		CLEAR	CLEAR	CLEAR	CLEAR	CLEAR	L YLW/BN
CONDUCTANCE, SPECIFIC	UMHOS/CM	480	300	330	610	1320	1070
DEPTH TO WATER	FEET	14.44	3.37	6.22	3.59	6.46	10.10
ODOR, FIELD		NONE	NONE	NONE	NONE	NONE	NONE
PH, FIELD	SU	7.0	6.3	5.6	7.0	6.8	6.3
TEMPERATURE	DEG C	15	13	14	13	14	12
TURBIDITY, FIELD		MODERATE	SLIGHT	MODERATE	NONE	SLIGHT	SLIGHT
WATER ELEVATION	FEET	607.97	610.80	607.95	610.81	607.94	610.66
ALKALINITY AS CACO ₃	MG/L	190	140	140	330	320	190
CHLORIDE	MG/L	11	6.7	6.9	7.0	7.6	110
COD	MG/L						
FLUORIDE	MG/L	0.18	< 0.10	0.12	0.12	0.19	< 0.10
HARDNESS AS CACO ₃	MG/L	240	160	180	350	390	260
NITROGEN, NITRATE + NITRITE	MG/L	< 0.050	0.68	1.2	1.1	1.3	36
SOLIDS, TOTAL DISSOLVED	MG/L	340	200	240	380	420	800
SULFATE	MG/L	71	11	16	29	30	35
ARSENIC, DISSOLVED	UG/L	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	7.4
BARIUM, DISSOLVED	UG/L	81	100	120	98	91	100
BORON, DISSOLVED	UG/L	1100	< 200	< 200	< 200	< 200	210
CADMIUM, DISSOLVED	UG/L	1.1	< 0.30	0.38	< 0.30	0.35	< 0.30
CHROMIUM, DISSOLVED	UG/L	< 10	< 10	< 10	< 10	< 10	< 10
COPPER, DISSOLVED	UG/L	< 20	< 20	< 20	< 20	< 20	21
IRON, DISSOLVED	UG/L	210	< 100	< 100	< 100	< 100	< 100
LEAD, DISSOLVED	UG/L	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0
MANGANESE, DISSOLVED	UG/L	360	< 5.0	280	6.9	33	< 5.0
MERCURY, DISSOLVED	UG/L	< 0.20	< 0.20	< 0.20	< 0.20	< 0.20	< 0.20
SELENIUM, DISSOLVED	UG/L	< 1.0	L	< 1.0	L	< 1.0	L
SILVER, DISSOLVED	UG/L	< 1.0		< 1.0		< 1.0	< 1.0
ZINC, DISSOLVED	UG/L	< 20	< 20	< 20	< 20	< 20	< 20

PROJECT NUMBER: 1831.28
 BEGINNING DATE: 01-JUN-93
 ENDING DATE: 29-OCT-93

TABLE 8
 GROUNDWATER CHEMISTRY

PARAMETER	UNITS	B-35 07-SEP-93 3293-002	B-35A 01-JUN-93 1670-005	B-35A 07-SEP-93 3293-003	B-36 01-JUN-93 1670-007	B-36 07-SEP-93 3293-004	B-36A 01-JUN-93 1670-006
COLOR, FIELD		YELLOW	CLEAR	CLEAR	CLEAR	CLEAR	CLEAR
CONDUCTANCE, SPECIFIC	UMHOS/CM	1050	620	680	430	500	620
DEPTH TO WATER	FEET	13.13	10.55	13.57	10.86	13.97	11.11
ODOR, FIELD		NONE	NONE	NONE	NONE	NONE	NONE
PH, FIELD	SU	6.8	7.0	7.1	6.3	7.0	7.1
TEMPERATURE	DEG C	14	13	12	12	13	13
TURBIDITY, FIELD		SLIGHT	NONE	NONE	SLIGHT	MODERATE	NONE
WATER ELEVATION	FEET	607.63	610.63	607.61	610.60	607.49	610.35
ALKALINITY AS CACO ₃	MG/L	210	330	320	230	210	330
CHLORIDE	MG/L	80	26	24	4.4	25	12
COD	MG/L						
FLUORIDE	MG/L	0.19	< 0.10	0.13	< 0.10	0.14	< 0.10
HARDNESS AS CACO ₃	MG/L	290	380	400	240	280	350
NITROGEN, NITRATE + NITRITE	MG/L	39	1.7	2.0	< 0.050	1.4	0.83
SOLIDS, TOTAL DISSOLVED	MG/L	770	480	460	280	350	400
SULFATE	MG/L	43	33	37	15	18	36
ARSENIC, DISSOLVED	UG/L	3.6	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0
BARIUM, DISSOLVED	UG/L	120	< 50	54	110	120	68
BORON, DISSOLVED	UG/L	220	< 200	< 200	< 200	< 200	< 200
CADMIUM, DISSOLVED	UG/L	< 0.30	< 0.30	< 0.30	< 0.30	< 0.30	< 0.30
CHROMIUM, DISSOLVED	UG/L	< 10	< 10	< 10	< 10	< 10	< 10
COPPER, DISSOLVED	UG/L	24	< 20	< 20	< 20	< 20	< 20
IRON, DISSOLVED	UG/L	< 100	< 100	< 100	< 100	< 100	< 100
LEAD, DISSOLVED	UG/L	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0
MANGANESE, DISSOLVED	UG/L	< 5.0	< 5.0	< 5.0	< 5.0	55	< 5.0
MERCURY, DISSOLVED	UG/L	< 0.20	< 0.20	< 0.20	< 0.20	< 0.20	< 0.20
SELENIUM, DISSOLVED	UG/L	< 1.0	L	< 1.0	L	1.0	L
SILVER, DISSOLVED	UG/L	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
ZINC, DISSOLVED	UG/L	< 20	< 20	< 20	< 20	< 20	< 20

PROJECT NUMBER: 1831.28
 BEGINNING DATE: 01-JUN-93
 ENDING DATE: 29-OCT-93

TABLE 8
 GROUNDWATER CHEMISTRY

PARAMETER	UNITS	B-36A 07-SEP-93 3293-005	B-37 07-SEP-93 3302-007	B-37A 07-SEP-93 3302-008	B-38 01-JUN-93 1670-016	B-38 07-SEP-93 3293-006	B-38A 01-JUN-93 1670-017
COLOR, FIELD		CLEAR	CLEAR	CLEAR	CLEAR	CLEAR	CLEAR
CONDUCTANCE, SPECIFIC	UMHOS/CM	620	510	770	3630	2830	2760
DEPTH TO WATER	FEET	14.18	8.13	8.14	18.53	20.19	24.87
ODOR, FIELD		NONE	NONE	NONE	NONE	NONE	NONE
PH, FIELD	SU	7.1	7.3	7.3	8.3	9.9	7.7
TEMPERATURE	DEG C	11	13	11	20	20	15
TURBIDITY, FIELD		NONE	SLIGHT	NONE	NONE	SLIGHT	NONE
WATER ELEVATION	FEET	607.51	606.69	606.69	617.29	615.63	610.96
ALKALINITY AS CACO ₃	MG/L	330	200	190	100	420	80
CHLORIDE	MG/L	13	6.8	11	26	24	23
COD	MG/L						
FLUORIDE	MG/L	0.14	< 0.10	< 0.10	1.8	2.6	1.1
HARDNESS AS CACO ₃	MG/L	390	290	410	620	21	500
NITROGEN, NITRATE + NITRITE	MG/L	0.85	1.2	< 0.050	1.7	0.29	1.6
SOLIDS, TOTAL DISSOLVED	MG/L	420	380	590	3000	2200	2300
SULFATE	MG/L	36	100	240	2600	1200	2000
ARSENIC, DISSOLVED	UG/L	< 3.0	< 3.0	< 3.0	180	90	38
BARIUM, DISSOLVED	UG/L	68	< 50	< 50	110	< 50	58
BORON, DISSOLVED	UG/L	< 200	3100	7400	2500	2600	2200
CADMIUM, DISSOLVED	UG/L	< 0.30	< 0.30	< 0.30	< 0.30	< 0.30	< 0.30
CHROMIUM, DISSOLVED	UG/L	< 10	< 10	< 10	68	< 10	52
COPPER, DISSOLVED	UG/L	< 20	< 20	< 20	< 20	< 20	< 20
IRON, DISSOLVED	UG/L	< 100	< 100	< 100	< 100	< 100	< 100
LEAD, DISSOLVED	UG/L	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0
MANGANESE, DISSOLVED	UG/L	< 5.0	< 5.0	55	< 5.0	< 5.0	< 5.0
MERCURY, DISSOLVED	UG/L	< 0.20	< 0.20	< 0.20	< 0.20	< 0.20	< 0.20
SELENIUM, DISSOLVED	UG/L	< 1.0	L	< 1.0	L	57	320
SILVER, DISSOLVED	UG/L	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
ZINC, DISSOLVED	UG/L	< 20	< 20	< 20	< 20	< 20	< 20

PROJECT NUMBER: 1831.28
BEGINNING DATE: 01-JUN-93
ENDING DATE: 29-OCT-93

TABLE 8
GROUNDWATER CHEMISTRY

B-38A
07-SEP-93

PARAMETER UNITS 3293-007

COLOR, FIELD		CLEAR
CONDUCTANCE, SPECIFIC	UMHOS/CM	3280
DEPTH TO WATER	FEET	27.59
ODOR, FIELD		NONE
PH, FIELD	SU	9.0
TEMPERATURE	DEG C	16
TURBIDITY, FIELD		NONE
WATER ELEVATION	FEET	608.24
ALKALINITY AS CACO ₃	MG/L	90
CHLORIDE	MG/L	21
COD	MG/L	
FLUORIDE	MG/L	3.4
HARDNESS AS CACO ₃	MG/L	390
NITROGEN, NITRATE + NITRITE	MG/L	0.59
SOLIDS, TOTAL DISSOLVED	MG/L	2600
SULFATE	MG/L	1800
ARSENIC, DISSOLVED	UG/L	51
BARIUM, DISSOLVED	UG/L	54
BORON, DISSOLVED	UG/L	3300
CADMUM, DISSOLVED	UG/L	< 0.30
CHROMIUM, DISSOLVED	UG/L	11
COPPER, DISSOLVED	UG/L	< 20
IRON, DISSOLVED	UG/L	< 100
LEAD, DISSOLVED	UG/L	< 3.0
MANGANESE, DISSOLVED	UG/L	< 5.0
MERCURY, DISSOLVED	UG/L	< 0.20
SELENIUM, DISSOLVED	UG/L	57
SILVER, DISSOLVED	UG/L	< 1.0
ZINC, DISSOLVED	UG/L	< 20

Appendix C

2016 Low-Hazard Waste Exemption Leaching Test Results – Slag and Ash

Sediment and Soil Analytical Results - Water Leach Test Results
WPL Nelson Dewey

Sample	Date	Depth (feet)	Material Type	Lab Notes	Boron (ug/L)	Chloride (mg/L)	Sulfate (mg/L)	TDS (mg/L)
WPDES POND								
SED-1	8/3/2016	0-1.3	Fly Ash	--	240	4.3	4.4	54
SED-2	8/3/2016	0-1.0	Fly Ash	--	200	4.3	11.5	60
QC-3 (SED-2)	8/3/2016	0-1	Fly Ash	--	240	3.5 J	6.1	52
SED-3	7/20/2016	0-4.5	Slag	--	130	2.7 J	5	28
	7/20/2016	4.5-5.5	SP	--	<50	2.5 J	<2.0	14 J
SED-4	7/19/2016	0-4.8	ML	--	510	10.5 J	11.9 J	86
	7/19/2016	4.8-5.5		--	74 J	NA	NA	NA
GP-19	8/4/2016	8-12	SM	--	62 J	2.4 J	2 J	16 J
SLAG POND								
SED-5	7/20/2016	0-1.6	ML-OL	--	54 J	3.2 J	33.3	90
SED-6	7/20/2016	0-1.0	ML	--	60 J	3.7 J	59.1	130
SED-7	8/4/2016	0-3.0	Fly Ash	--	88 J	4	10.5	76
SED-8	8/4/2016	1.0-1.5	Fly Ash	--	82 J	3.7 J	12.1	74
COAL YARD								
TP-CY-1	7/19/2016	0-0.5	Coal	--	140	<20.0	<20.0	32
	7/19/2016	3.0-3.5	SM	--	100 J	2.8 J	<2.0	20
TP-CY-3	7/20/2016	1.9-2.1	GM	--	<50	3.9 J	2.8 J	50
	7/20/2016	4.8-5.5	SM	--	NA	NA	NA	NA
TP-CY-4	7/19/2016	0-2.8	Coal	--	190	<20.0	<20.0	38
	7/19/2016	2.8-3.2	GP & SM	--	<50	<10.0	<10.0	34
	7/19/2016	3.6-4.8	Slag	--	<50	<20.0	<20.0	10 J
	7/19/2016	4.8-5.0		--	NA	NA	NA	NA
TP-CY-6	7/19/2016	0-0.5	Coal	--	190	<20.0	<20.0	54
	7/19/2016	0.7-1.0	SP	--	<50	2.5 J	2.3 J	30
TP-CY-10	7/19/2016	0-0.5	Coal	--	120	2.4 J	11.6	48
	7/19/2016	1.0-2.0	SM	--	<50	2.2 J	2.3 J	28
TP-CY-12	7/20/2016	0-0.3	Coal	--	160	<20.0	<20.0	44
	7/20/2016	0.3-2.0	SP	--	<50	2.2 J	2.2 J	24
	7/20/2016	2.0-2.7	SP	--	<50	2.3 J	27.5	50
QC-1 (TP-CY-12)	7/20/2016	0.3-2.0	SP	--	<50	2.6 J	2.5 J	24
SLAG HANDLING AREA								
GP-5	8/3/2016	12.5-15	Fly Ash	--	100	<2.0	3.0 J	22
	8/3/2016	18-24	ML & SM	--	99 J	3.3 J	<2.0	24
GP-7	8/3/2016	7.5-18	Slag	--	<50	2.2 J	<2.0	<8.7
QC-2 (GP-7)	8/3/2016	7.5-18	Slag	--	<50	2.2 J	<2.0	10 J
GP-14	8/4/2016	12.5-15	Fly Ash	--	120	<2.0	13.4	96
SLAG SAMPLES¹								
Slag 01 ²	6/3/2013	--	Slag	--	NA	NA	NA	NA
Slag 01	12/23/2013	--	Slag	--	12.5 AB	0.277 B	0.218	NA
NED Slag Composite 2014	7/1/2014	--	Slag	--	11.7 AB ^{*^}	< 0.142	0.457 B	98 H
Slag Sample	4/14/2015	--	Slag	--	< 1020 A	0.751	0.427	NA

Sediment and Soil Analytical Results - Water Leach Test Results
WPL Nelson Dewey

Sample	Date	Depth (feet)	Material Type	Lab Notes	Boron (ug/L)	Chloride (mg/L)	Sulfate (mg/L)	TDS (mg/L)
FLY ASH SAMPLES¹								
NED Flyash Composite ²	2/14/2014	--	Fly Ash	--	NA	NA	6,530 B	NA
Week of 062815 ²	7/3/2015	--	Fly Ash	--	NA	NA	6,260	NA
Week of 010916	1/4/2016	--	Fly Ash	--	NA	NA	NA	NA
NR 140 Preventative Action Limits (PALs)					200	125	125	NE
NR 140 Enforcement Standards (ESs)					1000	250	250	NE
40 CFR Part 141.62 Maximum Contaminant Levels (MCL)					NE	NE	NE	NE
NR 538 Table 1A Standards					190	125	125	NE
NR 538 Table 2A Standards					1900	1,250	1,250	NE

Abbreviations:

mg/L = micrograms per liter	NE = No Standard Established	NA = Not Analyzed	GM = Silty Gravel
ML = Silt	ML-CL = Silty Clay	SM = Silty Sand	GP = Poorly Graded Gravel
ML-OL = Silty Organic Clay	SP = Poorly Graded Sand	ML-OL = Silty Organic Clay	TDS = Total Dissolved Solids

Notes:

1. Slag and Fly Ash samples were collected by the plant as part of permit requirements.
 2. Sample was analyzed using the SPLP Leach Method rather than the ASTM Water Leach Method for tested parameters except for Sulfate.
- NR 140 ESs - Wisconsin Administrative Code (WAC), Chapter NR 140.10 Table 1 - Public Health Groundwater Quality Standards from July 2015 and WAC, Chapter NR 140.12 Table 2 - Public Welfare Groundwater Quality Standards from July 2015.
- NR 140 PALs - WAC, Chapter NR 140.10 Table 1 - Public Health Groundwater Quality Standards from July 2015 and WAC, Chapter NR 140.12 Table 2 - Public Welfare Groundwater Quality Standards from July 2015.

Laboratory Notes/Qualifiers:

J = Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.
A = Result is less than the RL but greater than or equal to the MDL and the concentration is an approximate value.
B = Compound was found in the blank and sample.
F1 = MS and/or MSD Recovery is outside acceptance limits.
H = Sample was prepped or analyzed beyond the specified holding time.
^ = ICV, CCV, ICB, CCB, ISA, ISB, CRA, DLCK or MRL standard: Instrument related QC is outside acceptance limits.
* = LCS or LCSD is outside acceptance limits.

Created by: RJG Date: 3/14/2016
Last revision by: RJG Date: 10/24/2016
Checked by: BSS Date: 10/24/2016

Original table prepared for Slag Pond Closure Low Hazard Waste Exemption Request (SCS Project #25216054.00).

Reformatted for the Alternative Source Demonstration to include only the parameters with SSIs that were included in the leach testing by NDK, 9/14/2020; SCC 10/1/2021.

I:\25223071.00\Deliverables\April 2023 ASD NED\Appendix C 2016 Leachate Results Slag and Ash\[Table 4. Sediment_Soil_Water Leach Results-Updated.xlsx]Leach Test - SSI Parameters

Table 4a. Sediment and Soil Analytical Results - Water Leach Test Metals
WPL Nelson Dewey / SCS Engineers Project #25216054.00

Abbreviations:
 µg/L = micrograms per liter or parts per billion (ppb)
 ML = Silt

NA = Not Analyzed
 ML-CL = Silty Clay

NE = No Standard Established
 SM = Silty Sand

GM = Silty Gravel
 SP = Poorly Graded Sand
 GP = Poorly Graded Gravel

Notes:
 1. Slag and Fly Ash samples were collected by the plant as part of permit requirements.

2. Sample was analyzed using the SPC-A Method rather than the ASTM Water Leach Method for tested parameters except for Sulfate.
 NR 140 ES+ - WAC, Chapter NR 140.10 Table 1 - Public Health Groundwater Quality Standards from July 2015 and WAC, Chapter NR 140.12 Table 2 - Public Welfare Groundwater Quality Standards from July 2015.
 NR 140 - WAC, Chapter NR 140.10 Table 1 - Public Health Groundwater Quality Standards from July 2015 and WAC, Chapter NR 140.12 Table 2 - Public Welfare Groundwater Quality Standards from July 2015.

Bold+underlined values meet or exceed NR 140 enforcement standards.

Italic+underlined values meet or exceed NR 140 preventive action limits.

Shaded values exceed NR 538 Table 1A Standards.

Red text exceeds NR 538 Table 2A Standards.

Laboratory Notes/Qualifiers:

J = Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

A = Result is less than the RL but greater than or equal to the MDL and the concentration is an approximate value.

B = Compound was found in the blank and sample.

F1 = MS end/or MSD Recovery is outside acceptance limits.

^ = ICV, CCV, ICB, ISA, ISB, CRA, DLCK or MRL standard: Instrument related QC is outside acceptance limits.

* = LCS or LCSD is outside acceptance limits.

Created by: RIG Date: 3/14/2016
 Last revision by: RIG Date: 10/24/2016
 Checked by: BS5 Date: 10/24/2016

I:\25223071.00\Deliverables\April 2023 ASD NED\Appendix C 2016 Leachate Results Slag and Ash\{Table 4. Sediment_Soil_Water Leach Results-Updated.xlsx\}4a. Leach Test - Metals

Table 4b. Sediment and Soil Analytical Results - Water Leach Test Additional Parameters
WPL Nelson Dewey / SCS Engineers Project #25216054.00
 (Results are in mg/L, except where noted otherwise)

Sample	Date	Depth (feet)	Material Type	Lab Notes	Chloride	Fluoride	Nitrite+ Nitrate	Total Kjeldahl Nitrogen	Sulfate	TDS
WPDES POND										
SED-1	8/3/2016	0-1.3	Fly Ash	--	4.3	<1.0	<0.095	0.69 J	4.4	54
SED-2	8/3/2016	0-1.0	Fly Ash	--	4.3	<1.0	<0.095	0.75	11.5	60
QC-3 (SED-2)	8/3/2016	0-1	Fly Ash	--	3.5 J	<1.0	<0.095	0.59 J	6.1	52
SED-3	7/20/2016	0-4.5	Slag	--	2.7 J	<1.0	<0.095	0.22 J	5	28
	7/20/2016	4.5-5.5	SP	--	2.5 J	<0.20	<0.095	0.22 J	<2.0	14 J
SED-4	7/19/2016	0-4.8	ML	--	10.5 J	<10.0	<0.095	1.4	11.9 J	86
GP-19	8/4/2016	8-12	SM	--	2.4 J	<1.0	<0.095	0.23 J	2 J	16 J
SLAG POND										
SED-5	7/20/2016	0-1.6	ML-OL	--	3.2 J	<1.0	<0.095	<0.22	33.3	90
SED-6	7/20/2016	0-1.0	ML	--	3.7 J	0.36 J	1.0	<0.22	59.1	130
SED-7	8/4/2016	0-3.0	Fly Ash	--	4	<1.0	<0.095	1.1	10.5	76
SED-8	8/4/2016	1.0-1.5	Fly Ash	--	3.7 J	<1.0	<0.095	1.1	12.1	74
COAL YARD										
TP-CY-1	7/19/2016	0-0.5	Coal	--	<20.0	<2.0	<0.095	0.26 J	<20.0	32
	7/19/2016	3.0-3.5	SM	--	2.8 J	<1.0	<0.095	0.28 J	<2.0	20
TP-CY-3	7/20/2016	1.9-2.1	GM	--	3.9 J	<0.20	<0.095	<0.22	2.8 J	50
TP-CY-4	7/19/2016	0-2.8	Coal	--	<20.0	<2.0	<0.095	0.81	<20.0	38
	7/19/2016	2.8-3.2	GP & SM	--	<10.0	<1.0	<0.095	<0.22	<10.0	34
	7/19/2016	3.6-4.8	Slag	--	<20.0	<2.0	<0.095	<0.22	<20.0	10 J
TP-CY-6	7/19/2016	0-0.5	Coal	--	<20.0	<2.0	<0.095	0.23 J	<20.0	54
	7/19/2016	0.7-1.0	SP	--	2.5 J	<0.20	<0.095	<0.22	2.3 J	30
TP-CY-10	7/19/2016	0-0.5	Coal	--	2.4 J	<1.0	<0.095	<0.22	11.6	48
	7/19/2016	1.0-2.0	SM	--	2.2 J	<1.0	<0.095	<0.22	2.3 J	28
TP-CY-12	7/20/2016	0-0.3	Coal	--	<20.0	<2.0	<0.095	0.26 J	<20.0	44
	7/20/2016	0.3-2.0	SP	--	2.2 J	<0.20	<0.095	<0.22	2.2 J	24
	7/20/2016	2.0-2.7	SP	--	2.3 J	<0.20	<0.095	<0.22	27.5	50
QC-1 (TP-CY-12)	7/20/2016	0.3-2.0	SP	--	2.6 J	<0.20	<0.095	<0.22	2.5 J	24
SLAG HANDLING AREA										
GP-5	8/3/2016	12.5-15	Fly Ash	--	<2.0	<1.0	0.11 J	<0.22	3.0 J	22
	8/3/2016	18-24	ML & SM	--	3.3 J	<1.0	<0.095	0.48 J	<2.0	24
GP-7	8/3/2016	7.5-18	Slag	--	2.2 J	<1.0	<0.095	0.22 J	<2.0	<8.7
QC-2 (GP-7)	8/3/2016	7.5-18	Slag	--	2.2 J	<1.0	<0.095	0.24 J	<2.0	10 J
GP-14	8/4/2016	12.5-15	Fly Ash	--	<2.0	<1.0	0.1 J	<0.22	13.4	96
SLAG SAMPLES¹										
Slag 01 ²	6/3/2013	--	Slag	--	NA	NA	NA	NA	NA	NA
Slag 01	12/23/2013	--	Slag	--	0.277 B	NA	0.923	NA	0.218	NA
NED Slag Composite 2014	7/1/2014	--	Slag	--	< 0.142	NA	< 0.045	NA	0.457 B	98 H
Slag Sample	4/14/2015	--	Slag	--	0.751	NA	< 0.045	NA	0.427	NA
FLY ASH SAMPLES¹										
NED Flyash Composite ²	2/14/2014	--	Fly Ash	--	NA	NA	NA	NA	6,530 B	NA
Week of 062815 ²	7/3/2015	--	Fly Ash	--	NA	NA	NA	NA	6,260	NA
Week of 010916	1/4/2016	--	Fly Ash	--	NA	NA	NA	NA	NA	NA
NR 140 Preventative Action Limits (PALs)					125	0.8	2	NE	125	NE
NR 140 Enforcement Standards (ESs)					250	4	10	NE	250	NE
40 CFR Part 141.62 Maximum Contaminant Levels (MCL)					NE	4	10	NE	NE	NE
NR 538 Table 1A Standards					125	0.8	2	NE	125	NE
NR 538 Table 2A Standards					1,250	8	20	NE	1,250	NE

Table 4b. Sediment and Soil Analytical Results - Water Leach Test Additional Parameters
WPL Nelson Dewey / SCS Engineers Project #25216054.00

Abbreviations:

mg/L = micrograms per liter
 ML = Silt

NE = No Standard Established
 ML-CL = Silty Clay

NA = Not Analyzed
 SM = Silty Sand

TDS = Total Dissolved Solids
 SP = Poorly Graded Sand

GM = Silty Gravel
 GP = Poorly Graded Gravel

Notes:

1. Slag and Fly Ash samples were collected by the plant as part of permit requirements.
 2. Sample was analyzed using the SPLP Leach Method rather than the ASTM Water Leach Method for tested parameters except for Sulfate.
- NR 140 ESs - Wisconsin Administrative Code (WAC), Chapter NR 140.10 Table 1 - Public Health Groundwater Quality Standards from July 2015 and WAC, Chapter NR 140.12 Table 2 - Public Welfare Groundwater Quality Standards from July 2015.
- NR 140 PALs - WAC, Chapter NR 140.10 Table 1 - Public Health Groundwater Quality Standards from July 2015 and WAC, Chapter NR 140.12 Table 2 - Public Welfare Groundwater Quality Standards from July 2015.

Bold+underlined values meet or exceed NR 140 enforcement standards.

Italic+underlined values meet or exceed NR 140 preventive action limits.

Shaded values exceed NR 538 Table 1A Standards.

Red text exceeds NR 538 Table 2A Standards.

Laboratory Notes/Qualifiers:

- J = Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.
 A = Result is less than the RL but greater than or equal to the MDL and the concentration is an approximate value.
 B = Compound was found in the blank and sample.
 F1 = MS and/or MSD Recovery is outside acceptance limits.
 H = Sample was prepped or analyzed beyond the specified holding time.
 ^ = ICV, CCV, ICB, CCB, ISA, ISB, CRI, CRA, DLCK or MRL standard: Instrument related QC is outside acceptance limits.
 * = LCS or LCSD is outside acceptance limits.

Created by:	<u>RJG</u>	Date: <u>3/14/2016</u>
Last revision by:	<u>RJG</u>	Date: <u>10/24/2016</u>
Checked by:	<u>BSS</u>	Date: <u>10/24/2016</u>

I:\25223071.00\Deliverables\April 2023 ASD NED\Appendix C 2016 Leachate Results Slag and Ash\[Table 4. Sediment_Soil_Water Leach Results-Updated.xlsx]4b. Leach Test - Parameters

Table 4c. Sediment and Soil Analytical Results - Water Leach Test Radiochemistry**WPL Nelson Dewey / SCS Engineers Project #25216054.00**

(Results are in pCi/L)

Sample	Date	Depth (feet)	Lab Notes	Radium-226	Radium-228	Total Radium
WPDES POND						
SED-4	7/19/2016	0-4.8	--	0.0858 ± 0.481 (0.922)	0.355 ± 0.483 (1.00)	0.441 ± 0.964 (1.92)
SLAG POND						
SED-6	7/20/2016	0-1.0	--	0.206 ± 0.905 (1.45)	2.97 ± 1.30 (2.14)	3.18 ± 2.21 (3.59)
COAL YARD						
TP-CY-10	7/19/2016	0-0.5	--	1.23 ± 0.996 (0.556)	0.915 ± 0.497 (0.891)	2.145 ± 1.493 (1.45)
SLAG HANDLING AREA						
GP-5	8/3/2016	12.5-15	--	0.0829 ± 0.586 (0.996)	0.447 ± 0.474 (0.981)	0.53 ± 1.06 (1.98)
GP-7	8/3/2016	7.5-18	--	-0.085 ± 0.683 (1.19)	0.446 ± 0.418 (0.843)	0.446 ± 1.1 (2.03)
NR 140 Preventive Action Limits (PALs)				NE	NE	NE
NR 140 Enforcement Standards (ESs)				NE	NE	NE
CFR 40 141.66 Maximum Contaminant Levels (MCL)				NE	NE	5
NR 538 Table 1A Standards				NE	NE	NE
NR 538 Table 2A Standards				NE	NE	NE

Abbreviations:pCi/L = picocuries per liter
ML-CL = Silty ClayNA = Not Analyzed
SM = Silty SandNE = No Standard Established
SP = Poorly Graded Sand

GM = Silty Gravel

ML = Silt

Notes:

NR 140 ESs - Wisconsin Administrative Code (WAC), Chapter NR 140.10 Table 1 - Public Health Groundwater Quality Standards from July 2015 and WAC, Chapter NR 140.12 Table 2 - Public Welfare Groundwater Quality Standards from July 2015.

NR 140 PALs - WAC, Chapter NR 140.10 Table 1 - Public Health Groundwater Quality Standards from July 2015 and WAC, Chapter NR 140.12 Table 2 - Public Welfare Groundwater Quality Standards from July 2015.

Bold+underlined values meet or exceed NR 140 enforcement standards.*Italic+underlined* values meet or exceed NR 140 preventive action limits.

Shaded values exceed NR 538 Table 1A Standards.

Red text exceeds NR 538 Table 2A Standards.

Created by: RJG Date: 3/14/2016
 Last revision by: RJG Date: 10/24/2016
 Checked by: BSS Date: 10/24/2016

I:\25223071.00\Deliverables\April 2023 ASD NED\Appendix C 2016 Leachate Results Slag and Ash\[Table 4. Sediment_Soil_Water Leach Results-Updated.xlsx]4c. Leach Test - Radium

E2 Alternative Source Demonstration, April 2024 Detection Monitoring

Alternative Source Demonstration

April 2024 Detection Monitoring

Slag Pond
Nelson Dewey Generating Station
Cassville, Wisconsin

Prepared for:



SCS ENGINEERS

25224071.00 | November 12, 2024

2830 Dairy Drive
Madison, WI 53718-6751
608-224-2830

Table of Contents

Section	Page
PE Certification.....	iii
1.0 Introduction.....	1
1.1 §257.94(e)(2) Alternative Source Demonstration Requirements	1
1.2 Site Information and Map	1
1.3 Statistically Significant Increases Identified.....	2
1.4 Overview of Alternative Source Demonstration Approach.....	2
2.0 Background.....	3
2.1 Geologic and Hydrogeologic Setting.....	3
2.1.1 Regional Information.....	3
2.1.2 Site Information	3
2.2 Coal Combustion Residuals Rule Monitoring System.....	4
2.3 Other Monitoring Wells.....	4
3.0 Methodology and Analysis Review.....	4
3.1 Sampling and Field Analysis Review	4
3.2 Laboratory Analysis Review	4
3.3 Statistical Evaluation Review.....	5
3.4 Summary of Methodology and Analysis Review Findings	5
4.0 Alternative Sources.....	5
4.1 Potential Causes of Statistically Significant Increases	6
4.1.1 Natural Variation	6
4.1.2 Man-Made Alternative Sources	6
4.2 Lines of Evidence	6
4.2.1 Previous CCR Pond and Landfill Study.....	7
4.2.2 Slag Pond Closure Sampling Results	8
4.2.3 State Program Groundwater Monitoring Results	8
4.2.4 Grant County Fluoride Data	9
5.0 Alternative Source Demonstration Conclusions	9
6.0 Site Groundwater Monitoring Recommendations.....	9
7.0 References.....	9

Tables

- | | |
|----------|--|
| Table 1. | Groundwater Analytical Results Summary – April 2024 |
| Table 2. | Historical Analytical Results for Parameters with SSIs |
| Table 3. | Water Level Summary |
| Table 4. | Analytical Results – State Monitoring Program |

Figures

- Figure 1. Site Location Map
- Figure 2. Aerial View
- Figure 3. Site Plan and Monitoring Well Locations
- Figure 4. Water Table Flow Map – April 2024

Appendices

- Appendix A CCR Well Trend Plots
- Appendix B 1994 RMT Environmental Contamination Assessment Information
- Appendix C 2016 Low-Hazard Waste Exemption Leaching Test Results – Slag and Ash
- Appendix D Grant County Fluoride Data

I:\25224071.00\Deliverables\2024 April ASD NED\241112_NED_Apr24 ASD_Final.docx

PE CERTIFICATION

 11/8/2024	<p>I, Sherren Clark, hereby certify that the information in this alternative source demonstration is accurate and meets the requirements of 40 CFR 257.94(e)(2). This certification is based on my review of the groundwater data and related site information available for the Nelson Dewey Generating Station Slag Pond facility. I am a duly licensed Professional Engineer under the laws of the State of Wisconsin.</p> <p> 11/8/2024 (signature) (date)</p> <p>Sherren Clark (printed or typed name)</p> <p>License number <u>E-29863</u></p> <p>My license renewal date is July 31, 2026.</p> <p>Pages or sheets covered by this seal:</p> <p>Alternative Source Demonstration, April 2024 Detection Monitoring – Slag Pond Nelson Dewey Generating Station, Cassville (Entire Document)</p>
--	--

[This page left blank intentionally]

1.0 INTRODUCTION

This Alternative Source Demonstration (ASD) was prepared to support compliance with the groundwater monitoring requirements of the “Coal Combustion Residuals (CCR) Final Rule” published by the U.S. Environmental Protection Agency (U.S. EPA) in the *Hazardous and Solid Waste Management System; Disposal of Coal Combustion Residuals from Electric Utilities; Final Rule*, dated April 17, 2015 (U.S. EPA, 2015), and subsequent amendments. Specifically, this report was prepared to fulfill the requirements of 40 CFR 257.94(e)(2). The applicable sections of the Rule are provided below in *italics*.

1.1 §257.94(E)(2) ALTERNATIVE SOURCE DEMONSTRATION REQUIREMENTS

The owner and operator may demonstrate that a source other than the CCR Unit caused the statistically significant increase over background levels for a constituent or that the statistically significant increase resulted from error in sampling, analysis, statistical evaluation, or natural variation in groundwater quality. The owner or operator must complete the written demonstration within 90 days of detecting a statistically significant increase over background levels.

An ASD is completed when there are exceedances of one or more benchmarks established within the groundwater monitoring program to determine if any other sources are likely causes of the identified exceedance(s) of established benchmark(s) at the site. This ASD was performed in response to results indicating a statistically significant increase (SSI) over background levels during detection monitoring under the CCR Rule.

This ASD report evaluates the SSIs observed in the statistical evaluation of the April 2024 detection monitoring event at the Nelson Dewey Generating Station (NED). The first ASD prepared for this facility evaluated the SSIs observed in the statistical evaluation of the October 2017 detection monitoring event (SCS Engineers [SCS], 2018). The October 2017 ASD and subsequent semiannual updates have included several lines of evidence demonstrating that SSIs reported for Appendix III parameters in the downgradient monitoring wells were likely due to man-made sources other than the slag pond CCR Unit and/or naturally occurring constituents in the alluvial aquifer. The conclusions of this ASD are consistent with previous ASDs.

1.2 SITE INFORMATION AND MAP

The NED site is located along the east bank of the Mississippi River, north of the Village of Cassville, in Grant County, Wisconsin (**Figure 1**). The facility includes a decommissioned coal-fired generating plant, a CCR landfill that was closed in 2001, a closed Slag Pond, and a closed wastewater treatment pond. The layout of the site on an aerial photograph base is shown on **Figure 2**. The closed landfill at the NED facility was permitted under Wisconsin Department of Natural Resources (DNR) License #02525.

The existing CCR Unit evaluated for this ASD is:

- Slag Pond (existing surface impoundment – closed January 2018)

A map showing the CCR Unit and all background (or upgradient) and downgradient monitoring wells with identification numbers for the CCR groundwater monitoring program and the state monitoring program is provided on **Figure 3**.

Operations at the facility began in the late 1950s, and a CCR impoundment that included what is now the Slag Pond closure area was commissioned at that time. The CCR landfill was initially licensed in 1976 and received fly ash from NED until it was closed in phases between 1996 and 2001. The CCR landfill was initially operated as a fly ash sluice basin, then transitioned to dry ash placement prior to closure. The wastewater ponds, now closed, were constructed in 1976 for the purpose of settling CCR from the NED process wastewater streams and sediment from storm water runoff prior to discharge. Both NED generating units were retired on December 31, 2015, and have since been decommissioned. The generating station was demolished in 2017. Closure of the slag pond was completed in January 2018.

1.3 STATISTICALLY SIGNIFICANT INCREASES IDENTIFIED

The statistical evaluation was completed in accordance with 40 CFR 257.93(f)(3) using a prediction interval procedure, in which an interval for each constituent is established from the distribution of the background data, and the level of each constituent in each compliance well is compared to the upper prediction limit (UPL). The initial evaluation was based on an interwell comparison. The UPLs were calculated based on a 1-of-2 resampling approach. The UPLs and the analytical results for the April 2024 monitoring event are summarized in the attached **Table 1**.

The initial evaluation indicated that the April 2024 monitoring event results represent an SSI over background for the following parameters and wells:

- Boron: B-7R, B-11A, B-11B, B-11R, B-31A, B-31R
- Calcium: B-11B
- Fluoride: B-11B
- Field pH: B-11A, B-31A
- Sulfate: B-11A, B-11B, B-11R, B-31R
- Total Dissolved Solids (TDS): B-11B, B-11R

The SSIs are generally consistent with SSIs identified in previous detection monitoring results.

1.4 OVERVIEW OF ALTERNATIVE SOURCE DEMONSTRATION APPROACH

This ASD report includes:

- Background information (**Section 2.0**).
- Evaluation of potential that SSIs are due to methodology or analysis (**Section 3.0**).
- Evaluation of potential that SSIs are due to natural sources or man-made sources other than the CCR Units (**Section 4.0**).
- ASD conclusions (**Section 5.0**).
- Monitoring recommendations (**Section 6.0**).

Historical monitoring results from background and compliance sampling for the CCR Rule constituents with SSIs are provided in **Table 2**. The laboratory report for the April 2024 event will be included in the 2024 Annual Groundwater Monitoring and Corrective Action Report to be completed in January 2025. Complete laboratory reports for the background monitoring events and previous detection monitoring events were included in the previous annual groundwater monitoring and corrective action reports.

2.0 BACKGROUND

To provide context for the ASD evaluation, the following background information is provided in this section of the report, prior to the ASD evaluation sections:

- Geologic and hydrogeologic setting
- CCR Rule monitoring system
- Other monitoring wells

A more detailed discussion of the background information for the site is provided in the ASD for the October 2017 event (SCS, 2018).

2.1 GEOLOGIC AND HYDROGEOLOGIC SETTING

2.1.1 Regional Information

The uppermost geologic formation beneath the NED site is the surficial alluvial aquifer. The alluvial aquifer consists of Mississippi River valley sand and gravel deposits, and is the uppermost aquifer as defined in section 257.53 of the CCR Rule. This deposit is prevalent along the edges of the entire Mississippi River valley in southwestern Wisconsin.

The alluvial aquifer is underlain by dolomitic bedrock of the Prairie du Chien Group. The dolomite bedrock is also an aquifer and is likely hydraulically connected to the alluvial aquifer above.

Regionally, groundwater flow is generally to the southwest and discharges to the Mississippi River.

Additional details on the regional geology were provided in the October 2017 ASD (SCS, 2018).

2.1.2 Site Information

The thickness of the alluvium in the immediate vicinity of the site is over 125 feet, as evidenced by local water supply well logs (SCS, 2018). These logs are also evidence that the alluvial aquifer yields useable quantities of groundwater for supply wells in the area. Soil boring logs for monitoring wells installed at the site also generally indicate sand and gravel soils within the monitored depths.

The groundwater flow direction in the vicinity of the plant is generally southwest toward the Mississippi River, except when influenced by high river levels as discussed below. Historically, infiltration at the former Slag Pond, former fly ash basin, and the former Wisconsin Pollutant Discharge Elimination System (WPDES) ponds caused groundwater mounding to be present around these features; however, these ponds have now all been closed and are no longer sources of infiltration.

While site water level measurements typically indicate that groundwater flow is to the southwest, discharging to the Mississippi River, the local flow directions are influenced by changes in the river level. During periods of high river water levels, the flow temporarily reverses, and the river discharges to the shallow sand and gravel aquifer. The groundwater flow direction during the April 2024 detection monitoring event was generally to the northeast, away from the Mississippi River (**Figure 4**). The groundwater elevations are provided in **Table 3**.

2.2 COAL COMBUSTION RESIDUALS RULE MONITORING SYSTEM

The groundwater monitoring system established in accordance with the CCR Rule consists of one upgradient (background) monitoring well and six downgradient monitoring wells. The background well is B-26. The downgradient wells include B-7R, B-11A, B-11B, B-11R, B-31A, and B-31R. The CCR Rule wells are installed within the surficial alluvium aquifer. Well depths range from approximately 23 to 114 feet, measured from the top of the well casing.

2.3 OTHER MONITORING WELLS

There are several additional groundwater monitoring wells at the NED facility that are part of the monitoring system developed for the state monitoring program. All of the wells included in the CCR monitoring well network were already in use for the state monitoring program. The well locations are shown on **Figure 3**. The state program monitoring wells and two private wells are used to monitor groundwater conditions at the site under DNR License Number 2525, which includes the closed CCR landfill and the closed Slag Pond. Monitoring wells for the state monitoring program are installed in the surficial sand and gravel aquifer, which is the uppermost aquifer as defined under 40 CFR 257.53.

3.0 METHODOLOGY AND ANALYSIS REVIEW

To evaluate the potential that an SSI is due to a source other than the regulated CCR Unit, SCS used a two-step evaluation process. First, the sample collection, field and laboratory analysis, and statistical evaluation were reviewed to identify any potential error or analysis that led to an exceedance of the benchmark. Second, potential alternative sources, including natural variation and man-made sources other than the CCR Unit, were evaluated. This section of the report provides the findings of the methodology and analysis review. **Section 4.0** of the report addresses the potential alternative sources.

3.1 SAMPLING AND FIELD ANALYSIS REVIEW

Field notes and sampling results were reviewed to determine if a sampling error may have caused or contributed to the observed SSIs. Potential field sampling errors or issues could include mislabeling of samples, improper sample handling, missed holding times, cross contamination during sampling, or other field error. Field blank sample results were also reviewed for any indication of potential contamination from sampling equipment or containers. Based on the review of the field notes and results, SCS did not identify any indication that the SSIs were due to a sampling error.

SCS did not identify any issues with the field sampling or field analysis based on review of the data and field notes.

3.2 LABORATORY ANALYSIS REVIEW

The laboratory reports for the April 2024 detection monitoring events were reviewed to evaluate whether any laboratory analysis error or issue may have caused or contributed to the observed SSIs. The laboratory report review included reviewing the laboratory quality control flags and narrative, verifying that correct methods were used and desired detection limits were achieved, and checking the field and laboratory blank sample results. Laboratory reports for the background monitoring events were reviewed for the October 2017 ASD. Laboratory reports for subsequent detection monitoring events were reviewed as part of the ASD preparation for each event.

Based on the review of the laboratory reports, SCS did not identify any indication that any SSI was due to a laboratory analysis error. There were no laboratory quality control flags or issues identified

in the laboratory reports that affect the usability of the data for detection monitoring; however, some results were flagged by the laboratory as follows:

- Sampling results for monitoring well B-7R included D3 flags for fluoride, chloride, and sulfate. The D3 flags indicate the sample was diluted prior to analysis due to the presence of high levels of non-target analytes or other matrix interference. The detection limits for the B-7R chloride, fluoride, and sulfate results were elevated due to the dilutions but were similar to previously reported detection limits for the same well.
- Sampling results for monitoring well B-7R also included M0 and R1 flags for fluoride. The M0 flag indicates the matrix spike (MS) recovery and/or matrix spike duplicate (MSD) recovery was outside laboratory control limits. The R1 flag indicates the relative percent difference (RPD) between the MS and MSD was outside control limits. The MS recovery was only slightly outside the control limits and fluoride results for all wells were consistent with historical results; therefore, the fluoride results are considered to be usable.

Based on this review of the laboratory flags, the laboratory results were accepted as usable data.

Time series plots for the parameters with SSIs were also reviewed for any anomalous results that might indicate a possible sampling or laboratory error (e.g., dilution error or incorrect sample labeling). The time series plots are provided in **Appendix A**. None of the time series plots included anomalous results that appeared to indicate a sampling or laboratory error.

3.3 STATISTICAL EVALUATION REVIEW

The review of the statistical results and methods included a quality control check of the following:

- Input analytical data vs. laboratory analytical reports
- Statistical method and process for each SSI

Based on the review of the statistical evaluation, SCS did not identify any errors or issues in the statistical evaluation that caused or contributed to the determination of interwell SSIs at the downgradient monitoring wells.

3.4 SUMMARY OF METHODOLOGY AND ANALYSIS REVIEW FINDINGS

In summary, there were no changes to the SSI determinations for the April 2024 detection monitoring events based on the methodology and analysis review. No errors or issues causing or contributing to the reported SSIs were identified.

4.0 ALTERNATIVE SOURCES

This section of the report discusses the potential alternative sources for the SSI constituents at the downgradient wells, identifies the most likely alternative source(s), and presents the lines of evidence indicating that an alternative source is the most likely cause of the observed SSIs.

4.1 POTENTIAL CAUSES OF STATISTICALLY SIGNIFICANT INCREASES

4.1.1 Natural Variation

The statistical analysis was completed using an interwell approach, comparing the April 2024 detection monitoring results to the UPLs calculated based on sampling of the background well (B-26). If concentrations of a constituent that is naturally present in the aquifer vary spatially, then the potential exists that the downgradient concentrations may be higher than upgradient concentrations due to natural variation.

Although natural variation is present in the shallow aquifer, it does not appear likely that natural variation is the primary source causing the boron, field pH, sulfate, and TDS SSIs. These parameters were detected at higher concentrations than would likely be present naturally.

Natural variation may have caused or contributed to the SSI for calcium at B-11B. As discussed in **Section 2.1.1**, the alluvial aquifer is underlain by dolomitic bedrock of the Prairie du Chien Group. The dolomite aquifer is also present in the bluffs northeast of the site, and groundwater from the dolomite likely discharges to the alluvial aquifer. Calcium is a typical constituent of groundwater in dolomite aquifers. The calcium concentrations in upgradient well B-26 have exceeded those in at least three of the downgradient wells, suggesting that natural variability may contribute to the calcium concentrations observed in the downgradient monitoring wells.

Based on fluoride data for wells in Grant County, natural variation may also have caused or contributed to the SSI for fluoride at B-11B.

4.1.2 Man-Made Alternative Sources

Man-made alternative sources that could potentially contribute to the boron, calcium, field pH, sulfate, and TDS SSIs could include the closed CCR landfill, the coal storage area, or other plant operations. Based on the groundwater flow directions and on previous investigations at the site, the closed landfill appears to be the most likely man-made cause of the SSIs for the downgradient wells B-7R, B-11A, B-11B, B-11R, B-31A, and B-31R.

4.2 LINES OF EVIDENCE

The lines of evidence indicating that the SSIs for boron, calcium, field pH, fluoride, sulfate, and TDS in one or more compliance wells relative to the background well are more likely due to the closed landfill and prior fly ash sluicing than to the Slag Pond include:

1. A previous Environmental Contamination Assessment completed for the ash disposal facility indicated that the fly ash sluicing and landfill were the primary source of the groundwater impacts in the area, based on multiple lines of evidence.
2. Sampling performed in preparation for the Slag Pond closure indicated that the slag and the Slag Pond sediment had little potential to cause the SSIs for boron, sulfate, and TDS.
3. Past and current groundwater monitoring performed under the state monitoring program show that groundwater quality has improved since the 1990s in response to termination of fly ash sluicing and closure and capping of the ash landfill. Recent concentration increases at some wells in the state monitoring program appear to be attributable to the closed CCR landfill source and to changes in groundwater flow at the site in response to closure of the Slag Pond.

The lines of evidence indicating that natural variation may also have caused or contributed to the fluoride SSIs include:

1. Although fluoride was detected at a lower concentration in background well B-26, publicly available data from the DNR's Groundwater Retrieval Network (GRN) database indicate it is commonly detected in Grant County.

The data supporting these lines of evidence are discussed below. Most of these lines of evidence and the supporting data were discussed in detail in the ASD for the October 2017 detection monitoring event (SCS, 2018), with the exception of the TDS SSI concentrations. For lines of evidence included in previous ASDs, the discussion focuses on any updated information collected since the previous ASD, with references to the previous ASD for additional details.

4.2.1 Previous CCR Pond and Landfill Study

A previous investigation titled *Environmental Contamination Assessment: Nelson Dewey Generating Station Ash Disposal Facility*, completed by RMT in 1994, found that groundwater impacts were associated with disposal of fly ash in the now-closed CCR landfill located immediately north of the Slag Pond (**Figure 3**). The purpose of the 1994 Environmental Contamination Assessment (ECA) was to investigate the impacts to groundwater at the NED landfill. The ECA was used to evaluate the feasibility of possible remedial alternatives. The remedial alternative that was ultimately selected was to convert the plant to dry fly ash handling.

The primary lines of evidence from the 1994 report that support the current ASD for boron, calcium, field pH, fluoride, sulfate, and TDS include:

- Water leaching tests for ash and slag indicated that boron and sulfate concentrations in the slag leachate were orders of magnitude lower than in the fly ash leachate (**Appendix B, Table 5**). Higher pH values were also reported for leach samples of Western coal fly ash in 1990 to 1992 than for the slag samples.
- Surface water samples from the then active fly ash sluice pond and the Slag Pond indicated that boron and sulfate concentrations in the Slag Pond were one or more orders of magnitude lower than in the ash sluice pond. The surface water pH measurement was also higher in the ash sluice pond. The surface water boron and sulfate concentrations in the Slag Pond were higher than leach test results, which was attributed to infiltration of ash sluice pond water through the berm between the ponds into the Slag Pond (**Appendix B, Table 6**).
- Groundwater sampling at monitoring wells B-38 and B-38A (now abandoned), which were installed through and screened below the ash disposal area (now closed landfill), indicated that groundwater affected by ash sluicing was characterized by high pH and elevated concentrations of boron, fluoride, sulfate, and TDS (**Appendix B, Site Map**, and **Table 8**).

Although calcium was not included in the historical state groundwater monitoring program or evaluated in the 1994 report, hardness was monitored and provides an indication of relative calcium concentrations. Surface water samples from the then active ash sluice pond and the Slag Pond indicated that hardness in the Slag Pond was lower than in the ash sluice pond (**Appendix B, Table 6**). These results suggest that if the calcium SSI is not solely due to natural variation, then the closed CCR landfill is the most likely man-made source of calcium.

The results of the 1994 ECA were reported to DNR in November 1994. The ECA investigation was then used for a feasibility study to determine appropriate ash disposal operation on site. Following the ECA, the plant converted to a dry ash handling system. Dry ash was placed in the CCR landfill through the 1990s, and the landfill was capped and closed in phases in 1996 through 2001. After that time, fly ash was not disposed of at the facility.

4.2.2 Slag Pond Closure Sampling Results

Results of leaching test analysis performed for slag, ash, soil, and sediment were submitted as part of a Low Hazard Exemption Request to the DNR in March 2017 (SCS, 2017). The Exemption Request was submitted as part of the Closure Plan for the site and requested DNR approval to consolidate materials from decommissioning activities in the Slag Pond and Slag Handling Area, which would then be capped with a composite final cover system. The sediment and soil samples were collected to characterize the materials that would remain on site under the Closure Plan. Leaching tests were performed using ASTM water leach test methods. The leaching test analytical results for parameters with SSIs that were included in the leaching test program (boron, fluoride, sulfate, and TDS) are summarized in **Appendix C**.

The sampling results in the Exemption Request indicated that the materials to be consolidated and capped were not likely to cause groundwater standard exceedances for boron, fluoride, sulfate, or TDS. The leach test results for slag, Slag Pond sediment, and soil in the Slag Handling Area were below the state groundwater standards for boron, fluoride, and sulfate. The parameter TDS does not currently have a state standard but the leach test results for slag, Slag Pond sediment, and soil in the Slag Handling Area were all below the calculated TDS UPL for the site (**Table 1** and **Appendix C**). The boron, sulfate, and TDS results were also below the concentrations in the downgradient CCR wells with SSIs, and well below the historical results for former well B-38, which was located within the CCR landfill area, upgradient from the Slag Pond (**Appendix B, Table 8**). Fluoride was only detected in one of the leaching test samples, at an estimated concentration below the concentration reported for downgradient well B-11B and below the historical results for former well B-38.

The Low Hazard Exemption was granted by the DNR based on the sampling results and other information presented.

4.2.3 State Program Groundwater Monitoring Results

Past and current groundwater monitoring performed under the state monitoring program show that groundwater quality has improved substantially since the 1990s in response to termination of fly ash sluicing, and closure and capping of the ash landfill (SCS, 2018). The long-term trends show that concentrations of boron and sulfate in groundwater have decreased or stabilized since termination of fly ash sluicing and closure of the landfill, in some cases by an order of magnitude or more. Graphs showing historical boron and sulfate trends in state monitoring wells were included in the Biennial Groundwater Monitoring Report for 2022-2023 dated January 31, 2024 (SCS Engineers, 2024). The results suggest that current pH levels and boron, sulfate, and TDS concentrations likely represent residual contamination from historical ash disposal in the CCR landfill area. Increases in boron, sulfate, and TDS concentrations at B-11B beginning in 2018 appear to be attributable to the closed CCR landfill and to changes in groundwater flow at the site related to a decrease in the volume of water discharged to the Slag Pond and subsequent closure of the Slag Pond. Concentrations of boron in samples from B-11B increased to a peak in April 2019 and have been lower since that event. Sulfate concentrations in samples from B-11B peaked in April 2022 and have been lower since that event. A summary of state analytical groundwater results is provided in **Table 4**.

4.2.4 Grant County Fluoride Data

Natural variation may have caused or contributed to the SSI for fluoride at B-11B. Although fluoride was detected at a lower concentration in background well B-26, publicly available data from the DNR's GRN database indicates it is commonly detected in Grant County. Out of a total of 431 fluoride analysis results in the GRN database for water supply wells in Grant County, as of December 2019, 89 percent had fluoride detected. The average concentration of fluoride in Grant County well samples with fluoride detections was 0.38 milligrams per liter (mg/L). The fluoride concentration reported for B-11B for April 2024, 0.43 mg/L, is in the range of concentrations in the GRN database for Grant County. The Grant County fluoride data are included in **Appendix D**. As discussed above, there is also a potential that fluoride concentrations in B-11B are associated with impacts from the closed CCR landfill.

5.0 ALTERNATIVE SOURCE DEMONSTRATION CONCLUSIONS

The lines of evidence discussed above regarding the SSIs reported for boron, calcium, field pH, fluoride, sulfate, and TDS results in downgradient monitoring wells demonstrate that the SSIs are likely primarily due to sources other than the closed Slag Pond. The SSIs for boron, calcium, field pH, fluoride, sulfate, and TDS appear to be due to historical ash disposal in the closed CCR landfill, which is not subject to the requirements of 40 CFR 257.50-107. The landfill is regulated by the DNR under the solid waste program (License 02525). Natural variation in groundwater quality in the aquifer may also contribute to the SSIs for calcium and fluoride.

6.0 SITE GROUNDWATER MONITORING RECOMMENDATIONS

In accordance with section 257.94(e)(2) of the CCR Rule, the NED Slag Pond site may continue with detection monitoring based on this ASD. The ASD report will be included in the 2024 Annual Report due January 31, 2025.

7.0 REFERENCES

RMT, 1994, Environmental Contamination Assessment: Nelson Dewey Generating Station Ash Disposal Facility, November 1994.

SCS Engineers, 2017, Low Hazard Exemption Request, Nelson Dewey Generating Station, Cassville, WI, March 2017.

SCS Engineers, 2018, 2017 Alternative Source Demonstration, October 2017 Monitoring Event, Nelson Dewey Generating Station, April 2018.

SCS Engineers, 2024, Biennial Groundwater Monitoring Report for 2022-2023, Wisconsin Power and Light Company – Nelson Dewey Ash Disposal Facility, Cassville, WI, January 31, 2024.

U.S. Environmental Protection Agency (U.S. EPA), 2015, Hazardous and Solid Waste Management System; Disposal of Coal Combustion Residuals from Electric Utilities; Final Rule, April 2015.

[This page left blank intentionally.]

Tables

- 1 Groundwater Analytical Results Summary – April 2024
- 2 Historical Analytical Results for Parameters with SSIs
- 3 Water Level Summary
- 4 Analytical Results – State Monitoring Program

Table 1. Groundwater Analytical Results Summary
Nelson Dewey Slag Pond, Cassville, WI / SCS Engineers Project #25224071.00

		Background Well	Compliance Wells					
Parameter Name	UPL	B-26	B-7R	B-11A	B-11B	B-11R	B-31A	B-31R
Groundwater Elevation, ft amsl		4/24/2024	4/23/2023	4/24/2024	4/23/2024	4/24/2024	4/23/2024	4/23/2024
Appendix III		606.51	606.66	606.86	606.66	606.72	606.63	606.61
Boron, ug/L	70.5	44.8	134	715	5,630	2640	187	659
Calcium, ug/L	104,000	79,600	52,300	63,900	171,000	96,700	46,000	89,300
Chloride, mg/L	72.7	43.5	8.2 J,D3	35.1	25.1	35.8	51.0	35.4
Fluoride, mg/L	0.2	0.16 J	<0.48 D3,M0, R1	0.23 J	0.43	0.27 J	0.15 J	0.31 J
Field pH, Std. Units	7.64	7.23	6.33	7.82	7.36	6.89	7.74	6.73
Sulfate, mg/L	47.1	29.8	<2.2 D3	155	435	64.8	19	113
Total Dissolved Solids, mg/L	536	448	232	478	1,010	536	306	506

7.81

Blue shaded cell indicates the compliance well result exceeds the UPL (background) and the Limit of Quantitation (LOQ).

Abbreviations:

UPL = Upper Prediction Limit

SSI = Statistically Significant Increase

ug/L = micrograms per liter

mg/L = milligrams per liter

LOD = Limit of Detection

LOQ = Limit of Quantitation

Lab Notes:

J = Estimated concentration at or above the LOD and below the LOQ.

D3 = Sample was diluted due to the presence of high levels of non-target analytes or other matrix interference.

M0 = Matrix spike recovery and/or matrix spike duplicate recovery was outside laboratory control limits.

R1 = RPD value was outside control limits.

Notes:

1. An individual result above the UPL may not constitute an SSI above background. See the accompanying letter text for identification of statistically significant results.

2. Interwell UPLs calculated based on results from background well B-26. UPLs are based on a 1-of-2 retesting approach.

3. Interwell UPLs updated July 2023 based on background well results from December 2015 through April 2023.

Created by:	NDK	Date:	12/6/2022
Last revision by:	RM	Date:	5/28/2024
Checked by:	JM	Date:	5/31/2024
Proj Mgr QA/QC/Scientist:	TK	Date:	7/29/2024

Table 2. Historical Analytical Results for Parameters with SSIs
Nelson Dewey Generating Station - Cassville, Wisconsin / SCS Engineers Project #25224071.00

Well Group	Well	Collection Date	Boron ($\mu\text{g/L}$)	Calcium ($\mu\text{g/L}$)	Field pH (Std. Units)	Fluoride (mg/L)	Sulfate (mg/L)	Total Dissolved Solids (mg/L)
Background	B-26	12/9/2015	29.6	81,300	7.35	<0.20	37.1	424
		4/12/2016	33.7	86,200	7.43	<0.20	38.0	456
		7/19/2016	28.6	82,400	7.14	<0.20	36.2	504
		10/20/2016	33.0	82,700	7.19	0.13 J	35.0	466
		1/12/2017	35.2	89,400	7.57	<0.10	35.0	446
		4/17/2017	50.1	89,000	7.54	<0.10	32.4	468
		6/7/2017	45.8	105,000	7.22	<0.10	31.0	538
		8/2/2017	54.6	98,100	7.21	<0.10	28.5	496
		10/19/2017	47.4	102,000	7.50	<0.10	25.3	542
		4/2/2018	48.0	88,100	7.64	<0.10	19.1	464
		10/8/2018	53.4	78,700	7.20	<0.10	25.1	450
		4/22/2019	41.6	75,300	7.10	<0.10	26.7	458
		10/15/2019	<3.00	<76.2	7.24	<0.10	36.0	404
		4/14/2020	66.1	88,500	7.27	0.11 J	30.2	464
		10/13/2020	63.6	76,500	7.34	<0.095 M0	37.0	448
		4/21/2021	63.6	78,700	7.27	<0.095	35.3	470
		10/8/2021	48.4	84,900	7.18	<0.095	43.8	440
		4/25/2022	52.5	75,900	7.19	<0.48 D3, M0	34.2	470
		10/18/2022	48.8	80,300	7.15	<0.095	47.6	472
		4/5/2023	38.6	77,400	7.05	<0.095	34.3	448
		10/3/2023	44.8	85,100	7.47	<0.095	42.5	418
		4/24/2024	44.8	79,600	7.23	0.16 J	29.8	448
Compliance	B-11A	12/9/2015	124	58,800	7.70	0.30 J	3.20 J	338
		4/13/2016	116	60,100	7.75	0.38 J	3.80 J	362
		7/19/2016	104	54,000	7.42	0.35 J	2.70 J	336
		10/19/2016	112	54,600	7.47	0.36	3.00 J	340
		1/12/2017	106	54,500	7.89	0.43	2.30 J	322
		4/17/2017	100	54,800	7.38	0.36	<1.00	326
		6/8/2017	102	57,800	7.78	0.37	1.40 J	338
		8/1/2017	105	54,500	7.67	0.37	2.40 J	326
		10/19/2017	116	55,000	7.96	0.32	5.10	322
		4/2/2018	91.0	53,300	8.04	0.24 J, M0	12.3 M0	336
		10/9/2018	94.2	48,600	7.43	0.29 J	6.00	332
		4/22/2019	93.9	60,400	7.62	0.29 J	1.90 J	386
		10/14/2019	80.7	56,600	7.66	0.26 J	<1.00	348
		4/13/2020	86.3	57,500	7.75	0.27 J	1.40 J	394
		10/12/2020	99.3	55,600	7.74	0.28 J	1.00 J	364
		4/19/2021	88.1	50,600	7.65	0.23 J	2.9	366
		10/8/2021	85.4	51,400	7.57	0.22 J	7.0	356
		4/26/2022	88.6	51,600	7.53	<0.095	8.5	350
		10/18/2022	95.2	46,000	7.61	0.22 J	22.7	332
		4/4/2023	119	51,700	7.62	0.22 J	70.8	394
		10/3/2023	231	60,300	7.66	0.16 J	86.0	352
		4/24/2024	715	63,900	7.82	0.23 J	155	478
B-11B	B-11B	12/9/2015	1,140	64,100	8.06	0.44	134	494
		4/13/2016	1,360	65,400	8.14	0.49	148	512
		7/19/2016	1,210	59,000	7.77	0.45	165	520
		10/20/2016	1,460	59,100	7.91	0.53	178	496
		1/12/2017	1,540	63,900	8.18	0.52	182	488
		4/17/2017	1,760	67,400	7.83	0.58	181	502
		6/8/2017	1,880	68,200	8.07	0.59	191	516
		8/1/2017	1,800	61,400	7.77	0.60	179	498
		10/19/2017	1,500	52,400	7.77	0.59	175	510
		4/2/2018	2,020	59,000	8.42	0.65	200	550
		10/9/2018	3,620	66,300	7.74	0.61	197	602
		11/12/2018	--	--	8.05	--	--	594
		4/22/2019	6,830	83,300	7.91	0.64	303	742
		10/14/2019	4,630	91,400	7.92	0.62	339	728
		4/13/2020	5,380	115,000	7.89	<0.95	378	872
		10/12/2020	3,350	91,200	7.80	<0.095	388	906
		4/19/2021	4,440	93,400	8.07	0.36	379 M0	910
		10/8/2021	2,480	100,000	7.81	<0.95 D3	466	884
		4/26/2022	2,590	97,100	7.63	<0.48	513	1000
		10/18/2022	3,010	75,100	7.74	0.47	429	920
		4/4/2023	4,740	84,400	7.68	0.65 J	436	980
		10/3/2023	5,040	80,600	7.84	<0.95 D3	403	918
		4/23/2024	5,630	171,000	7.36	0.43	435	1,010

Table 2. Historical Analytical Results for Parameters with SSIs
Nelson Dewey Generating Station - Cassville, Wisconsin / SCS Engineers Project #25224071.00

Well Group	Well	Collection Date	Boron ($\mu\text{g/L}$)	Calcium ($\mu\text{g/L}$)	Field pH (Std. Units)	Fluoride (mg/L)	Sulfate (mg/L)	Total Dissolved Solids (mg/L)
Compliance	B-11R	12/9/2015	4,170	126,000	7.07	<10	75.4	616
		4/13/2016	3,410	141,000	6.78	<0.20	18.4	682
		7/19/2016	3,530	130,000	6.69	0.22 J	115	698
		10/20/2016	4,120	128,000	6.77	<0.50	118	660
		1/12/2017	3,530	126,000	6.98	<0.50	108	616
		4/17/2017	3,520	123,000	7.11	<0.50	108	620
		6/7/2017	3,420	128,000	6.80	<0.50	98.2	630
		8/1/2017	2,040	139,000	6.70	0.25 J	126	738
		10/19/2017	3,120	117,000	7.22	<0.50 D3	97.7	586
		4/2/2018	3,180	124,000	7.14	<0.50 D3, M0	88.1	638
		10/9/2018	576	49,900	6.55	0.15 J	15.1	266
		4/22/2019	1,360	82,400	6.82	0.20 J	34.6	406
		10/14/2019	1,440	66,000	6.83	0.26 J	40.7	310
		4/13/2020	2,140	117,000	6.80	<0.48	41.9	570
		10/12/2020	2,870	120,000	6.83	<0.48 D3	22.8	600
		4/19/2021	3,010	115,000	7.11	<0.48 D3	61.2	578
		10/8/2021	2,940	119,000	6.86	<0.48 D3	61.8	576
		4/26/2022	2,330	114,000	7.01	<0.48 D3	58.1	560
		10/18/2022	3,090	116,000	6.76	0.16 J	65.3	572
		4/4/2023	3,110	105,000	6.81	<0.48 D3	57.0	554
		10/3/2023	3,120	90,600	6.80	0.20 J	58.0	456
		4/24/2024	2,640	96,700	6.89	0.27 J	64.8	536
Compliance	B-31A	12/9/2015	59.0	48,400	7.65	<0.20	26.2	274
		4/13/2016	79.2	51,900	7.63	0.22 J	22.6	302
		7/19/2016	67.2	48,900	7.25	<0.20	24.2	280
		10/20/2016	63.7	45,800	7.54	0.18 J	27.2	292
		1/12/2017	76.4	46,600	7.82	0.22 J	29.8	284
		4/17/2017	69.9	46,900	7.83	0.19 J	31.0	318
		6/8/2017	58.5	49,400	7.74	0.18 J	31.2	296
		8/1/2017	56.3	46,000	7.56	0.20 J	26.6	284
		10/19/2017	63.9	49,600	7.92	0.16 J	26.1	290
		4/2/2018	74.8	49,300	8.00	0.13 J	27.4	282
		10/9/2018	71.8	46,600	7.48	0.17 J	24.8	278
		4/22/2019	86.2	48,200	7.61	0.22 J	21.6	284
		10/14/2019	98.5	52,200	7.69	0.22 J	22.3	272
		4/13/2020	132	50,900	7.71	0.19 J	16.6	298
		10/13/2020	127	47,700	7.78	0.18 J	16.8	300
		4/19/2021	172	52,100	7.90	0.14 J	15.8	330
		10/8/2021	178	53,500	7.44	0.15 J	14.9	294
		4/26/2022	198	55,300	7.82	0.22 J	15.4	316
		10/18/2022	213	45,300	7.63	0.14 J	23.0	310
		4/4/2023	193	46,100	7.59	0.18 J	15.9	324
		10/2/2023	191	48,300	7.67	0.14 J	20.0	274
		4/23/2024	187	46,000	7.74	0.15 J	19.0	306
Compliance	B-31R	12/9/2015	851	77,400	6.79	<0.20	28.8	374
		4/13/2016	838	84,900	6.76	<0.20	34.1	404
		7/19/2016	641	76,100	6.44	<0.20	38.5	406
		10/20/2016	1,020	84,200	6.53	0.17 J	49.7	452
		1/12/2017	749	73,900	6.80	0.26 J	34.9	380
		4/17/2017	929	85,600	6.80	0.12 J	43.0	416
		6/8/2017	895	90,700	6.67	0.13 J	41.1	426
		8/1/2017	1,550	93,400	6.56	0.16 J	55.6	432
		10/19/2017	645	75,700	7.19	0.14 J	19.2	358
		4/2/2018	540	72,900	6.76	<0.10	22.0	374
		10/9/2018	1,430	125,000	6.41	<0.10	186	668
		11/12/2018	--	--	6.59	--	162	596
		4/22/2019	906	105,000	6.62	0.16 J	121	516
		10/14/2019	915	110,000	6.72	0.25 J	146	480
		4/13/2020	730	93,800	6.79	0.28 J	89.4	464
		10/12/2020	702	95,700	6.89	<0.48 D3, M0	49.4	462
		4/19/2021	621	91,400	6.91	0.19 J	45.3	454
		10/8/2021	353	79,000	6.63	0.22 J	24.9	372
		4/25/2022	454	81,100	6.77	<0.095	60.0	428
		10/18/2022	327	78,500	6.83	0.21 J	29.6	386
		4/4/2023	589	88,300	6.62	<0.48 D3	50.0	440
		10/2/2023	519	114,000	6.82	0.14 J	103	536
		4/23/2024	659	89,300	6.73	0.31 J	113	506

Table 2. Historical Analytical Results for Parameters with SSIs
Nelson Dewey Generating Station - Cassville, Wisconsin / SCS Engineers Project #25224071.00

Well Group	Well	Collection Date	Boron (µg/L)	Calcium (µg/L)	Field pH (Std. Units)	Fluoride (mg/L)	Sulfate (mg/L)	Total Dissolved Solids (mg/L)
Compliance	B-7R	12/9/2015	110	31,700	6.74	<1.0	17.0 J	198
		4/13/2016	115	42,300	6.80	<0.20	2.50 J	218
		7/18/2016	164	44,400	6.29	<0.20	2.40 J	220
		10/19/2016	154	56,600	6.55	<0.50	<5.00	288
		1/12/2017	159	56,700	7.43	<0.50	<5.00	240
		4/17/2017	129	61,400	6.60	<0.50	<5.00	278
		6/7/2017	110	51,600	6.65	<0.50	<5.00	240
		8/1/2017	129	50,400	6.28	<0.10	3.70	220
		10/19/2017	159	56,200	6.88	<0.50 D3	<5.00 D3	242
		4/2/2018	121	49,200	6.57	<0.50 D3	<5.00 D3	220
		10/9/2018	73.0	38,500	6.23	<0.10	3.20	186
		4/22/2019	93.5	59,400	6.63	<0.50 D3	<5.00 D3	254
		10/14/2019	139	57,700	6.62	<0.50 D3	<5.00 D3	208
		4/13/2020	96.0	58,700	6.60	<0.48 D3	7.50 J, D3	306
		10/13/2020	145	41,900	6.35	<0.48 D3	<2.20	208
		4/20/2021	104	56,100	6.54	<0.48 D3	<2.2 D3	248
		10/8/2021 ⁽¹⁾	--	--	--	--	--	--
		4/26/2022	98.1	59,200	6.43	<0.48 D3	3.7 J, D3	318
		10/18/2022 ⁽²⁾	--	--	--	--	--	--
		4/3/2023	120	48,800	6.18	<0.48 D3	<2.2 D3	224
		10/3/2023	144	41,000 P6	3.60	<0.095 M0	4.5	184
		4/23/2024	134	52,300	6.33	<0.48 D3, M0, R1	<2.2 D3	232

Abbreviations:

µg/L = micrograms per liter or parts per billion (ppb)

-- = Not applicable.

mg/L = milligrams per liter or parts per million (ppm)

Std. Units = Standard Units

Flags:

J = Estimated concentration at or above the LOD and below the LOQ.

D3 = Sample was diluted due to the presence of high levels of non-target analytes or other matrix interference.

M0 = Matrix spike recovery and/or matrix spike duplicate recovery was outside laboratory control limits.

P6 = Matrix spike recovery was outside laboratory control limits due to a parent sample concentration notably higher than the spike level.

R1 = Relative Percent Difference (RPD) value was outside control limits

Notes:

(1) B-7R could not be sampled on 10/8/2021 or during an attempted resampling event on 10/28/2021 due to low water levels.

(2) B-7R could not be sampled on 10/18/2022 due to low water levels.

Created by: RM
 Last revision by: RM
 Checked by: JSN

Date: 9/19/2023
 Date: 9/5/2024
 Date: 9/16/2024

Table 3. Water Level Summary
Nelson Dewey Closed Ash Disposal Facility / SCS Engineers Project #25224071.00

Well Number	Ground Water Elevation in feet above mean sea level (amsl)																						Barge Gauge (SG-12)^\wedge	Pond Gauge (SG-13)			
	B-7R	B-8R	B-11R	B-11A	B-11B	B-21R	B-26	B-26A	B-28	B-30R	B-31R	B-31A	B-32	B-32A	B-35	B-35A	B-36	B-36A	B-37	B-37A	B-39	B-40	MW-301	MW-302	MW-303		
Top of Casing Elevation (feet amsl)	623.35	627.51	622.62	622.12	621.89	623.31	626.40	626.40	616.81	621.81	622.4	622.42	622.69	614.18	614.4	620.78	621.09	621.11	621.33	614.85	614.85	626.48	623.84	619.09	619.21	618.49	622.34
Screen Length (ft)	10	10	10	5	5	10	10	5	10	5	10	5	10	5	10	5	9	4.5	10	5	10	10	10	10	10		
Total Depth (ft from top of casing)	23.05	27.25	24.15	52.00	113.90	22.78	31.67	45.78	16.70	22.20	46.90	22.82	35.52	14.79	52.00	16.60	47.00		19.95	48.20	26.90	27.00	21.11	21.27	20.15		
Top of Well Screen Elevation (ft)	610.30	610.26	608.47	575.12	512.99	610.53	604.73	585.62	610.11	609.61	580.50	609.60	592.17	609.39	567.40	614.18	579.20	609.60	575.50	604.90	571.65	609.58	606.84	607.98	607.94	608.34	
Measurement Date																											
October 5-6, 2011	604.94	606.29	604.57	604.36	604.43	604.52	604.55	604.61	604.37	605.21	608.37	604.42	604.88	604.82	604.87	604.81	--	--	604.37	604.39	--	--	--	--	--	--	
April 25-26, 2012	606.58	606.30	606.07	606.30	606.28	--	605.89	605.91	--	--	608.65	606.31	604.33	--	606.29	#REF!	--	--	606.16	606.17	606.17	--	--	--	--	--	
October 17, 2012	604.39	604.16	604.10	603.98	604.08	604.12	604.14	604.31	603.97	603.98	607.32	604.07	604.33	604.35	--	#REF!	--	--	603.93	603.93	603.93	--	--	--	--	--	
April 2, 2013	607.04	608.01	606.15	607.20	607.17	606.30	605.60	605.64	605.90	605.91	607.13	607.13	606.11	606.14	606.13	606.25	--	--	606.99	607.02	--	--	--	--	--	--	
October 16-17, 2013	604.51	605.89	604.17	603.90	603.87	604.11	604.31	604.32	604.08	604.06	604.87	604.00	604.53	604.56	604.46	604.44	--	--	604.05	604.04	--	--	--	--	--	--	
April 10, 2014	607.42	608.97	607.45	607.28	607.26	--	607.22	607.23	--	--	607.37	607.28	--	--	607.46	607.39	--	--	607.25	607.26	--	--	--	--	--	--	
October 14-15, 2014	605.67	606.82	605.17	604.90	604.91	614.92	605.00	605.01	605.13	604.92	604.92	606.36	605.54	605.41	605.45	605.36	605.33	--	--	604.94	604.99	--	--	--	--	--	--
April 16, 2015	607.26	608.50	607.11	607.15	607.05	--	606.40	606.41	--	--	607.37	607.09	--	--	606.73	606.78	--	--	606.99	606.88	--	--	--	--	--	--	
October 1-2, 2015	605.14	604.66	604.53	604.42	604.38	604.36	604.43	604.50	604.54	604.34	604.32	605.13	604.38	604.76	604.76	604.75	--	--	604.30	604.39	--	--	--	--	--	--	
December 8, 2015	606.69	--	606.71	606.30	606.26	--	606.80	--	--	--	607.40	606.39	--	--	--	--	--	--	--	607.54	--	--	--	--	--	--	
April 12, 2016	609.32	609.36	609.32	608.71	608.68	--	609.81	609.72	--	--	609.34	609.01	--	--	609.73	609.65	--	--	608.79	608.79	610.23	--	--	--	--	--	
July 18-19, 2016	606.54	--	606.14	606.76	606.74	--	606.09	--	--	--	606.55	606.73	--	--	--	--	--	--	--	606.28	--	--	--	--	--	--	
October 19-20, 2016	608.59	608.46	608.35	608.21	608.19	608.37	608.84	608.76	608.63	608.45	608.46	608.51	608.20	608.69	608.73	608.78	608.74	--	--	608.20	608.18	609.09	--	--	--	--	
January 11-12, 2017	608.02	--	607.96	607.83	607.78	--	608.56	--	--	--	607.90	607.84	--	--	--	--	--	--	--	608.92	--	--	--	--	--	--	
April 17, 2017	609.08	608.82	608.34	609.05	608.99	NM	608.59	608.54	609.94	608.57	608.64	607.20	608.98	608.96	608.98	609.00	609.02	--	--	609.02	610.23	--	--	--	--	--	--
June 8, 2017	610.74	--	610.42	609.81	610.08	--	611.25	--	--	--	609.63	610.50	--	--	--	--	--	--	--	611.53	--	--	--	--	--	--	--
August 1-2, 2017	607.02	--	606.73	605.57	605.50	--	607.39	--	--	--	606.84	605.69	--	--	--	--	--	--	--	608.71	--	--	--	--	--	--	--
October 9-10, 2017	606.93	606.51	606.25	607.01	606.94	--	606.22	606.13	606.33	606.44	606.45	606.68	606.93	606.57	606.61	606.65	606.71	--	--	--	--	--	--	--	--	--	
October 19, 2017	609.60	--	609.42	609.58	609.65	--	608.84	--	--	--	609.47	609.43	--	--	--	--	--	--	--	609.40	609.40	608.55	--	--	--	--	
November 17, 2017	--	--	--	--	--	606.35	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	
December 19, 2017	--	--	--	--	--	604.81	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	
February 7, 2018	605.37	--	605.33	604.96	604.92	--	--	--	616.81	--	--	605.31	605.01	--	--	--	--	--	--	606.19	--	605.08	605.05	605.00	--	--	
March 16, 2018	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	604.64	604.6	604.56	--	--		
April 203, 2018 **	604.82	606.61	606.27	606.63	606.55	606.52	606.49	606.37	606.39	606.46	606.43	604.44	606.46	606.58	606.66	606.68	606.70	--	606.77	606.83	606.19	--	--	--	--	--	

Table 4. Analytical Results - State Monitoring Program
Nelson Dewey Generating Station
Cassville, Wisconsin / SCS Engineers Project #25224071.00

WELL ID	SAMPLE MONTH	BORON, DISSOLVED (UG/L)	FLUORIDE, DISSOLVED (MG/L)	SULFATE, DISSOLVED (MG/L)	PH, FIELD (STANDARD UNITS)
B-7R	2016-Apr	110	<0.20	7.40	6.80
	2016-Oct	147	<2.00	<20.0	6.55
	2017-Apr	127	<0.50	<5.00	6.60
	2017-Oct	159	<0.50	<5.00	6.61
	2018-Apr	115	<0.50 D3	<5.00 D3	6.57
	2018-Oct	89.8	<0.10	3.40	6.23
	2019-Apr	95.7	<0.50 D3	<5.00 D3	6.63
	2019-Oct	140	<0.50 D3, M0	<5.00 D3	6.62
	2020-Apr	90.8	<0.48 D3	5.20 J, D3	6.60
	2020-Oct	145	<0.48	<2.20 D3	6.35
	2021-Apr	121	<0.48 D3	<2.20 D3	6.54
	2021-Oct	--	--	--	--
	2022-Apr	93.1	<0.48 D3, M0	5.0 J, D3	6.43
	2022-Oct	--	--	--	--
	2023-Apr	120	<0.48 D3	2.3 J, D3	6.18
	2023-Oct	151	<0.095	4.3	6.30
	2024-Apr	133	<0.48 D3	<2.2 D3	6.33
B-8R	2016-Apr	2,250	0.26 J	30.0	6.64
	2016-Oct	2,130	0.21 J	47.0	6.38
	2017-Apr	1,970	0.16 J	30.5	6.83
	2017-Oct	2,490	0.30 J	32.5	6.87
	2018-Apr	1,700	0.14 J	28.7	7.02
	2018-Oct	1,500	0.25 J	30.6	6.18
	2019-Apr	1,560	0.24 J	39.8	6.65
	2019-Oct	1,110	0.49	23.6	6.85
	2020-Apr	1,340	0.27 J	20.9	6.61
	2020-Oct	1,600	0.36	63.9	6.60
	2021-Apr	1,310	0.28 J	25.0	6.54
	2021-Oct	1,730	0.19 J	42.3	6.48
	2022-Apr	1,320	0.24 J	23.8	6.52
	2022-Oct	1,690	0.15 J	41.4	6.45
	2023-Apr	1,290	0.19 J	20.0	6.43
	2023-Oct	1,360	0.43	28.7	6.88
	2024-Apr	1,280	0.22 J	17.9	6.71
B-11A	2016-Apr	110	0.37 J	3.80 J	7.75
	2016-Oct	111	0.28 J	2.80 J	7.47
	2017-Apr	106	0.35	<1.00	7.38
	2017-Oct	97.7	0.34	8.30	7.91
	2018-Apr	89.4	0.30 J	12.70	8.04
	2018-Oct	142	0.16 J	5.30	7.43
	2019-Apr	94.0	0.29 J	1.90 J	7.62
	2019-Oct	82.3	0.27 J	<1.00	7.66
	2020-Apr	83.3	0.17 J	1.50 J	7.75
	2020-Oct	94.3	0.30 J	1.0 J	7.74
	2021-Apr	92.9	0.23 J	3.5	7.65
	2021-Oct	97.6	0.24 J	7.3	7.49
	2022-Apr	87.0	0.23 J	9.1	7.53
	2022-Oct	98.4	0.25 J	24.2	7.61
	2023-Apr	119	0.21 J	72.0	7.62
	2023-Oct	240	0.23 J	88.5	7.66
	2024-Apr	697	0.16 J	153	7.82

Table 4. Analytical Results - State Monitoring Program
Nelson Dewey Generating Station
Cassville, Wisconsin / SCS Engineers Project #25224071.00

WELL ID	SAMPLE MONTH	BORON, DISSOLVED (UG/L)	FLUORIDE, DISSOLVED (MG/L)	SULFATE, DISSOLVED (MG/L)	PH, FIELD (STANDARD UNITS)
B-11B	2016-Apr	1,240	0.53	153	8.14
	2016-Oct	1,410	0.54	181	7.91
	2017-Apr	1,720	0.56	186	7.83
	2017-Oct	1,900	0.65	169	7.80
	2018-Apr	2,020	0.68	195	8.42
	2018-Oct	3,910	0.41	195	7.74
	2019-Apr	6,670	0.60	289	7.91
	2019-Oct	4,860	0.64	335	7.92
	2020-Apr	5,080	<0.095	362	7.89
	2020-Oct	3,190	<0.095	422	7.80
	2021-Apr	4,590	<0.095	389	8.07
	2021-Oct	2,480	0.49	468	7.72
	2022-Apr	2,690	0.44	494	7.63
	2022-Oct	3,190	<1.9 D3	446	7.74
	2023-Apr	4,320	0.57	459	7.68
	2023-Oct	4,940	0.57	409	7.84
	2024-Apr	5,860	<0.95 D3	449	7.36
B-11R	2016-Apr	3,290	<1.00	93.9	6.98
	2016-Oct	4,070	<0.50	115	6.77
	2017-Apr	3,710	<0.50	111	7.11
	2017-Oct	3,400	<0.50	94.0	6.75
	2018-Apr	2,790	<0.50 D3	78.6	7.14
	2018-Oct	635	0.14 J	15.6	6.55
	2019-Apr	1,310	0.19 J	34.5	6.82
	2019-Oct	1,500	0.28 J	39.2	6.83
	2020-Apr	2,250	<0.48 D3	39.8	6.80
	2020-Oct	2,690	<0.48	23.0	6.83
	2021-Apr	2,890	<0.48 D3	59.9	7.11
	2021-Oct	3,050	<0.48 D3	61.6	6.86
	2022-Apr	2,330	<0.48 D3	58.1	7.01
	2022-Oct	3,250	0.19 J	59.9	6.76
	2023-Apr	3,010	0.20 J	62.7	6.81
	2023-Oct	3,020	0.23 J	58.4	6.80
	2024-Apr	2,960	0.19 J	66.2	6.89
B-26	2016-Apr	37.0	<0.20	40.1	7.43
	2016-Oct	48.7	0.12 J	34.4	7.19
	2017-Apr	37.3	<0.10	32.3	7.54
	2017-Oct	44.5	<0.10	25.0	7.35
	2018-Apr	46.8	<0.10	19.2	7.64
	2018-Oct	55.2	<0.10	24.9	7.20
	2019-Apr	41.8	<0.10	26.4	7.10
	2019-Oct	50.8	0.11 J	37.0	7.24
	2020-Apr	49.2	<0.095	29.1	7.27
	2020-Oct	61.4	<0.095	37.1	7.34
	2021-Apr	67.1	<0.095	35.5	7.27
	2021-Oct	56.0	<0.095	43.0	7.18
	2022-Apr	50.3	0.098 J	33.5	7.19
	2022-Oct	51.5	<0.095	46.1	7.15
	2023-Apr	48.3	<0.095	34.4	7.05
	2023-Oct	40.8	<0.095	43.7	7.47
	2024-Apr	45.2	<0.095	29.9	7.23

Table 4. Analytical Results - State Monitoring Program
Nelson Dewey Generating Station
Cassville, Wisconsin / SCS Engineers Project #25224071.00

WELL ID	SAMPLE MONTH	BORON, DISSOLVED (UG/L)	FLUORIDE, DISSOLVED (MG/L)	SULFATE, DISSOLVED (MG/L)	PH, FIELD (STANDARD UNITS)
B-26A	2016-Apr	33.1	<0.20	40.1	7.06
	2016-Oct	30.5	0.14 J	39.9	7.26
	2017-Apr	52.6	0.47	42.3	7.96
	2017-Oct	28.4	<0.10	38.4	7.44
	2018-Apr	27.6	<0.10	37.0	7.47
	2018-Oct	18.4	<0.10	33.3	7.38
	2019-Apr	27.6	0.11 J	27.0	7.35
	2019-Oct	47.0	0.14 J	35.6	7.31
	2020-Apr	37.7	<0.095	39.2 M0	7.38
	2020-Oct	33.5	<0.095	44.7	7.51
	2021-Apr	42.7	<0.095	45.5	7.26
	2021-Oct	36.4	<0.095	49.7	7.45
	2022-Apr	29.8	0.11 J	53.2	7.39
	2022-Oct	26.3	<0.095	47.1	7.48
	2023-Apr	31.0	<0.095	47.0	7.15
	2023-Oct	36.9	<0.095	50.9	7.54
	2024-Apr	29.7	<0.48 D3	42.8	7.60
B-31A	2016-Apr	69.4	0.22 J	22.8	7.63
	2016-Oct	81.0	0.18 J	27.9	7.54
	2017-Apr	80.3	0.19 J	30.8	7.83
	2017-Oct	61.5	0.21 J	26.2	7.60
	2018-Apr	69.3	0.17 J	28.1	8.00
	2018-Oct	103	0.14 J	26.2	7.48
	2019-Apr	86.0	0.22 J	21.6	7.61
	2019-Oct	112	0.23 J	22.5	7.69
	2020-Apr	121	0.15 J	17.7	7.71
	2020-Oct	146	0.18 J	16.8	7.78
	2021-Apr	168	0.14 J	17.1	7.90
	2021-Oct	188	0.17 J	15.0	7.58
	2022-Apr	179	0.18 J	15.3	7.82
	2022-Oct	202	0.14 J	22.8	7.63
	2023-Apr	196	0.17 J	16.1	7.59
	2023-Oct	195	0.18 J	21.3	7.67
	2024-Apr	182	0.17 J	19.1	7.74
B-31R	2016-Apr	759	<0.20	34.3	6.76
	2016-Oct	956	0.16 J	48.5	6.53
	2017-Apr	910	0.12 J	42.9	6.80
	2017-Oct	618	0.20 J	23.2	6.78
	2018-Apr	520	0.11 J	23.3	6.76
	2018-Oct	1,530	<1.00 D3	179	6.41
	2019-Apr	892	0.17 J, D3	114	6.62
	2019-Oct	1,000	0.26 J	145	6.72
	2020-Apr	765	0.28 J, M0	97.6 M0	6.79
	2020-Oct	696	0.28 J	50.8	6.89
	2021-Apr	597	0.19 J	44.9	6.91
	2021-Oct	356	<0.48	25.1	6.83
	2022-Apr	425	0.24 J	57.4	6.77
	2022-Oct	341	0.22 J	30.2	6.83
	2023-Apr	553	<0.48 D3, M0	50.5	6.62
	2023-Oct	532	0.20 J	105	6.82
	2024-Apr	691	0.26 J, M0	118	6.73

Table 4. Analytical Results - State Monitoring Program
Nelson Dewey Generating Station
Cassville, Wisconsin / SCS Engineers Project #25224071.00

WELL ID	SAMPLE MONTH	BORON, DISSOLVED (UG/L)	FLUORIDE, DISSOLVED (MG/L)	SULFATE, DISSOLVED (MG/L)	PH, FIELD (STANDARD UNITS)
B-35	2016-Apr	38.7	<0.20	8.10	6.89
	2016-Oct	46.4	0.10 J	6.50	6.86
	2017-Apr	54.4	0.15 J	7.70	6.68
	2017-Oct	40.8	0.18 J	3.80	7.65
	2018-Apr	28.9	<0.10 M0	4.80 M0	7.01
	2018-Oct	40.0	0.13 J	3.60	6.58
	2019-Apr	33.6	<0.10	4.90	7.26
	2019-Oct	41.0	0.12 J	5.60	7.07
	2020-Apr	27.0	<0.095	4.20	6.87
	2020-Oct	28.1	0.097 J	5.60	6.85
	2021-Apr	23.8	0.12 J	5.90	6.89
	2021-Oct	--	--	--	--
	2022-Apr	22.7	<0.095	7.7	6.95
	2022-Oct	--	--	--	--
	2023-Apr	20.6	<0.095	4.5	6.74
	2023-Oct	--	--	--	--
	2024-Apr	26.8	<0.095	11.8	6.92
B-35A	2016-Apr	21.7	<0.20	26.2	6.96
	2016-Oct	23.4	0.16 J	27.4	7.17
	2017-Apr	29.9	<0.10	25.4	7.27
	2017-Oct	51.4	0.26 J	4.00	7.44
	2018-Apr	28.9	<0.10 M0	23.1	7.45
	2018-Oct	59.8	<0.50 D3	6.00 J, D3	6.95
	2019-Apr	30.3	0.12 J	16.7	7.30
	2019-Oct	33.7	0.13 J	18.9	7.30
	2020-Apr	32.1	0.12 J	20.2	7.29
	2020-Oct	70.7	<0.095	17.8	7.39
	2021-Apr	46.8	<0.095	18.9	7.26
	2021-Oct	52.7	<0.095	18.7	7.27
	2022-Apr	46.5	0.11 J	16.2	7.17
	2022-Oct	55.6	<0.095	5.6	7.23
	2023-Apr	47.2	<0.095	5.4	7.04
	2023-Oct	96.5	<0.095	14.0	7.54
	2024-Apr	93	0.099 J	19.7	7.60
B-36	2021-Oct	24.7	0.13 J	2.80	7.34
	2022-Apr	27.2	0.14 J	3.2	7.23
	2022-Oct	28.3	0.15 J	3.1	6.71
	2023-Apr	25.1	0.12 J	3.1	6.88
	2023-Oct	26.8	<0.095	3.4	6.66
	2024-Apr	25.1	0.10 J	3.5	6.87
B-36A	2021-Oct	20.7	<0.095	17.6	7.43
	2022-Apr	29.5	0.13 J	13.7	7.26
	2022-Oct	33.1	<0.095	16.7	7.18
	2023-Apr	35.7	0.12 J	8.1	7.28
	2023-Oct	27.9	<0.095	22.8	6.80
	2024-Apr	24.4	0.13 J	25.6	7.32

Abbreviations:

J: Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

D3: Sample was diluted due to the presence of high levels of non-target analytes or other matrix interference.

M0: Matrix spike recovery and/or matrix spike duplicate recovery was outside laboratory control limits.

Notes:

(1) B-7R and B-35 were dry during October 2021 and 2022 sampling events.


(2) B-37 and B-37A were abandoned 12/6/2022. B-36 and B-36A were installed prior to the October 2021 sampling event.

Created by: RM
Last revision by: RM
Checked by: JSN

Date: 9/19/2023
Date: 9/5/2024
Date: 9/16/2024

Figures

- 1 Site Location Map
- 2 Aerial View
- 3 Site Plan and Monitoring Well Locations
- 4 Water Table Flow Map – April 2024

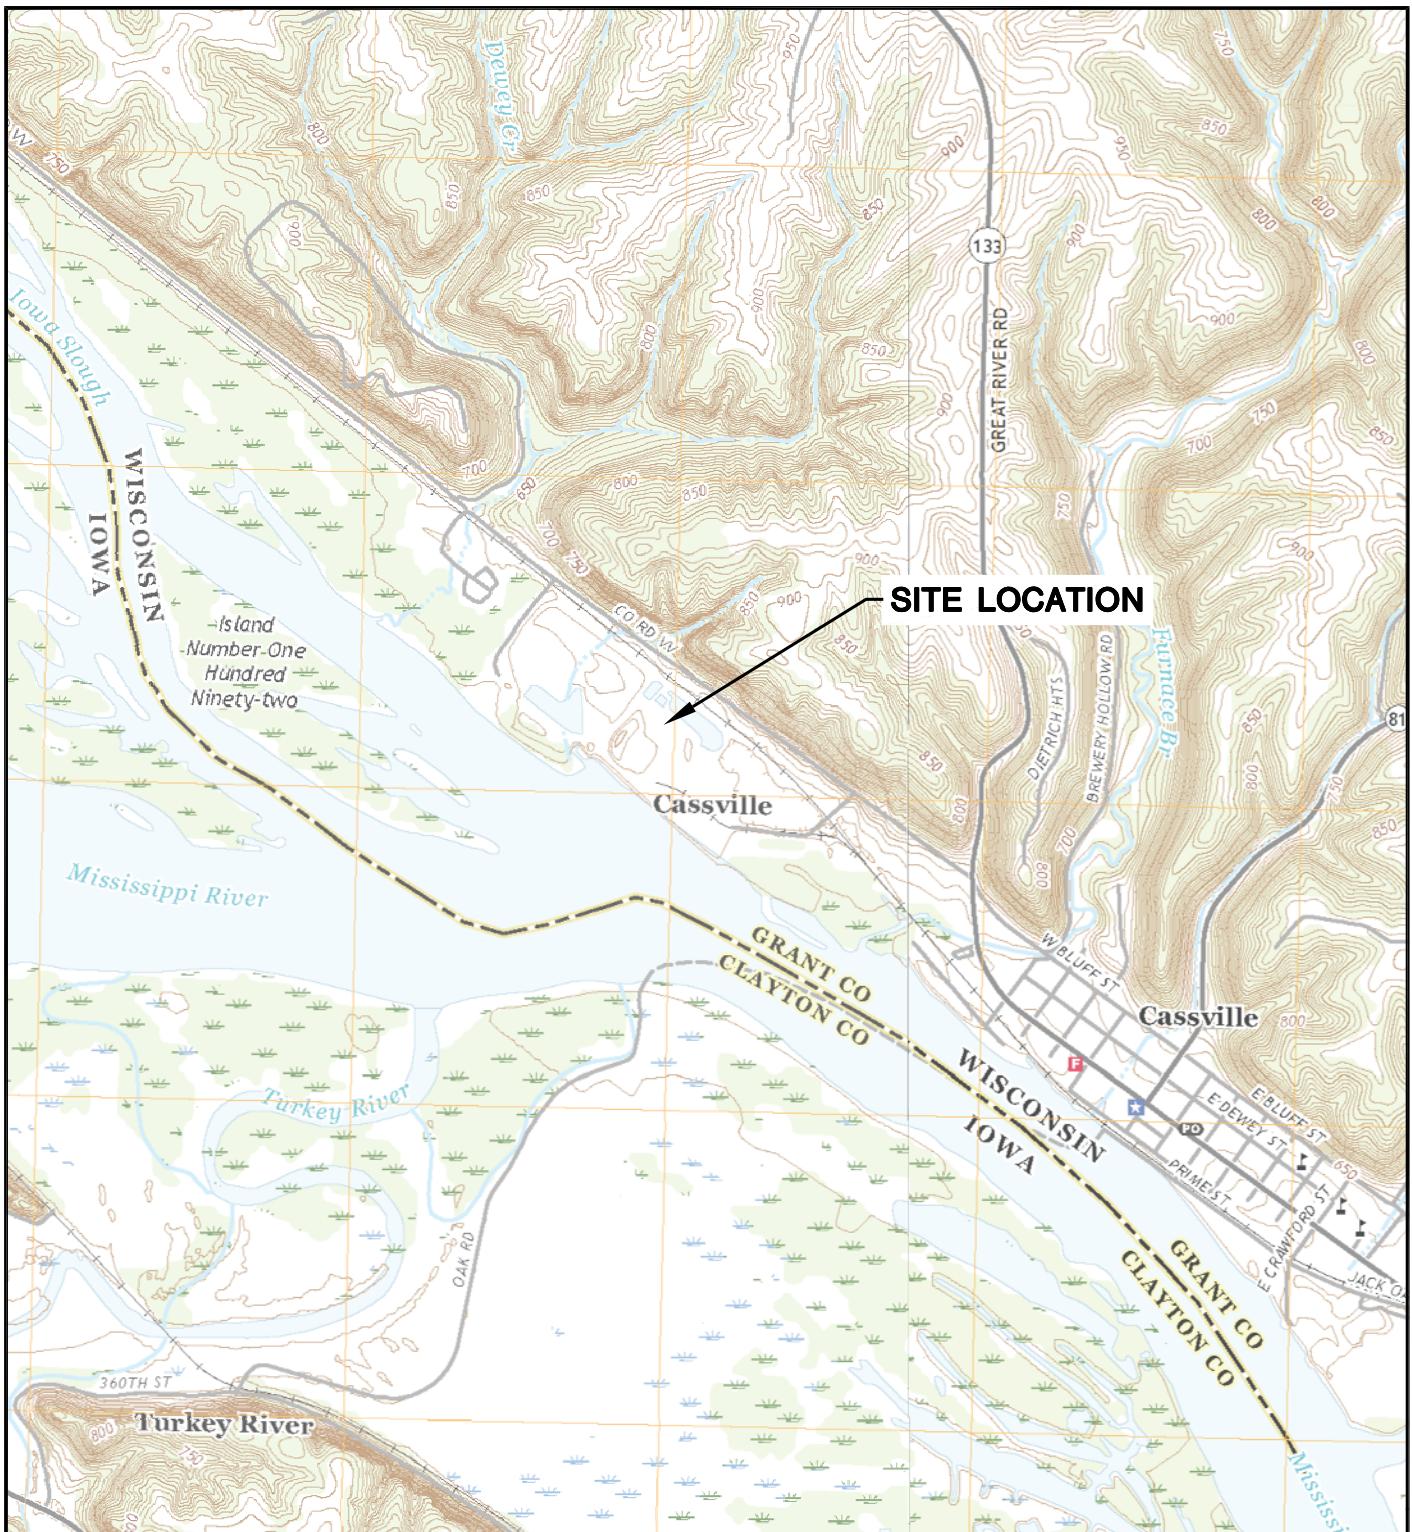

CASSVILLE AND TURKEY RIVER QUADRANGLES

WISCONSIN-IAWA


7.5 MINUTE SERIES (TOPOGRAPHIC)

2018

SCALE: 1" = 2,000'



CLIENT ALLIANT ENERGY 4902 N. BILTMORE LANE, #1000 MADISON, WI 53718	SITE NELSON DEWEY GENERATING STATION CASSVILLE, WISCONSIN	SITE LOCATION MAP	
PROJECT NO. 25220071.00	DRAWN BY: BSS	ENGINEER	FIGURE
DRAWN: 11/27/2019	CHECKED BY: MDB	SCS ENGINEERS 2830 DAIRY DRIVE MADISON, WI 53718-6751 PHONE: (608) 224-2830	
REVISED: 01/14/2020	APPROVED BY: TK 04/10/2020		1

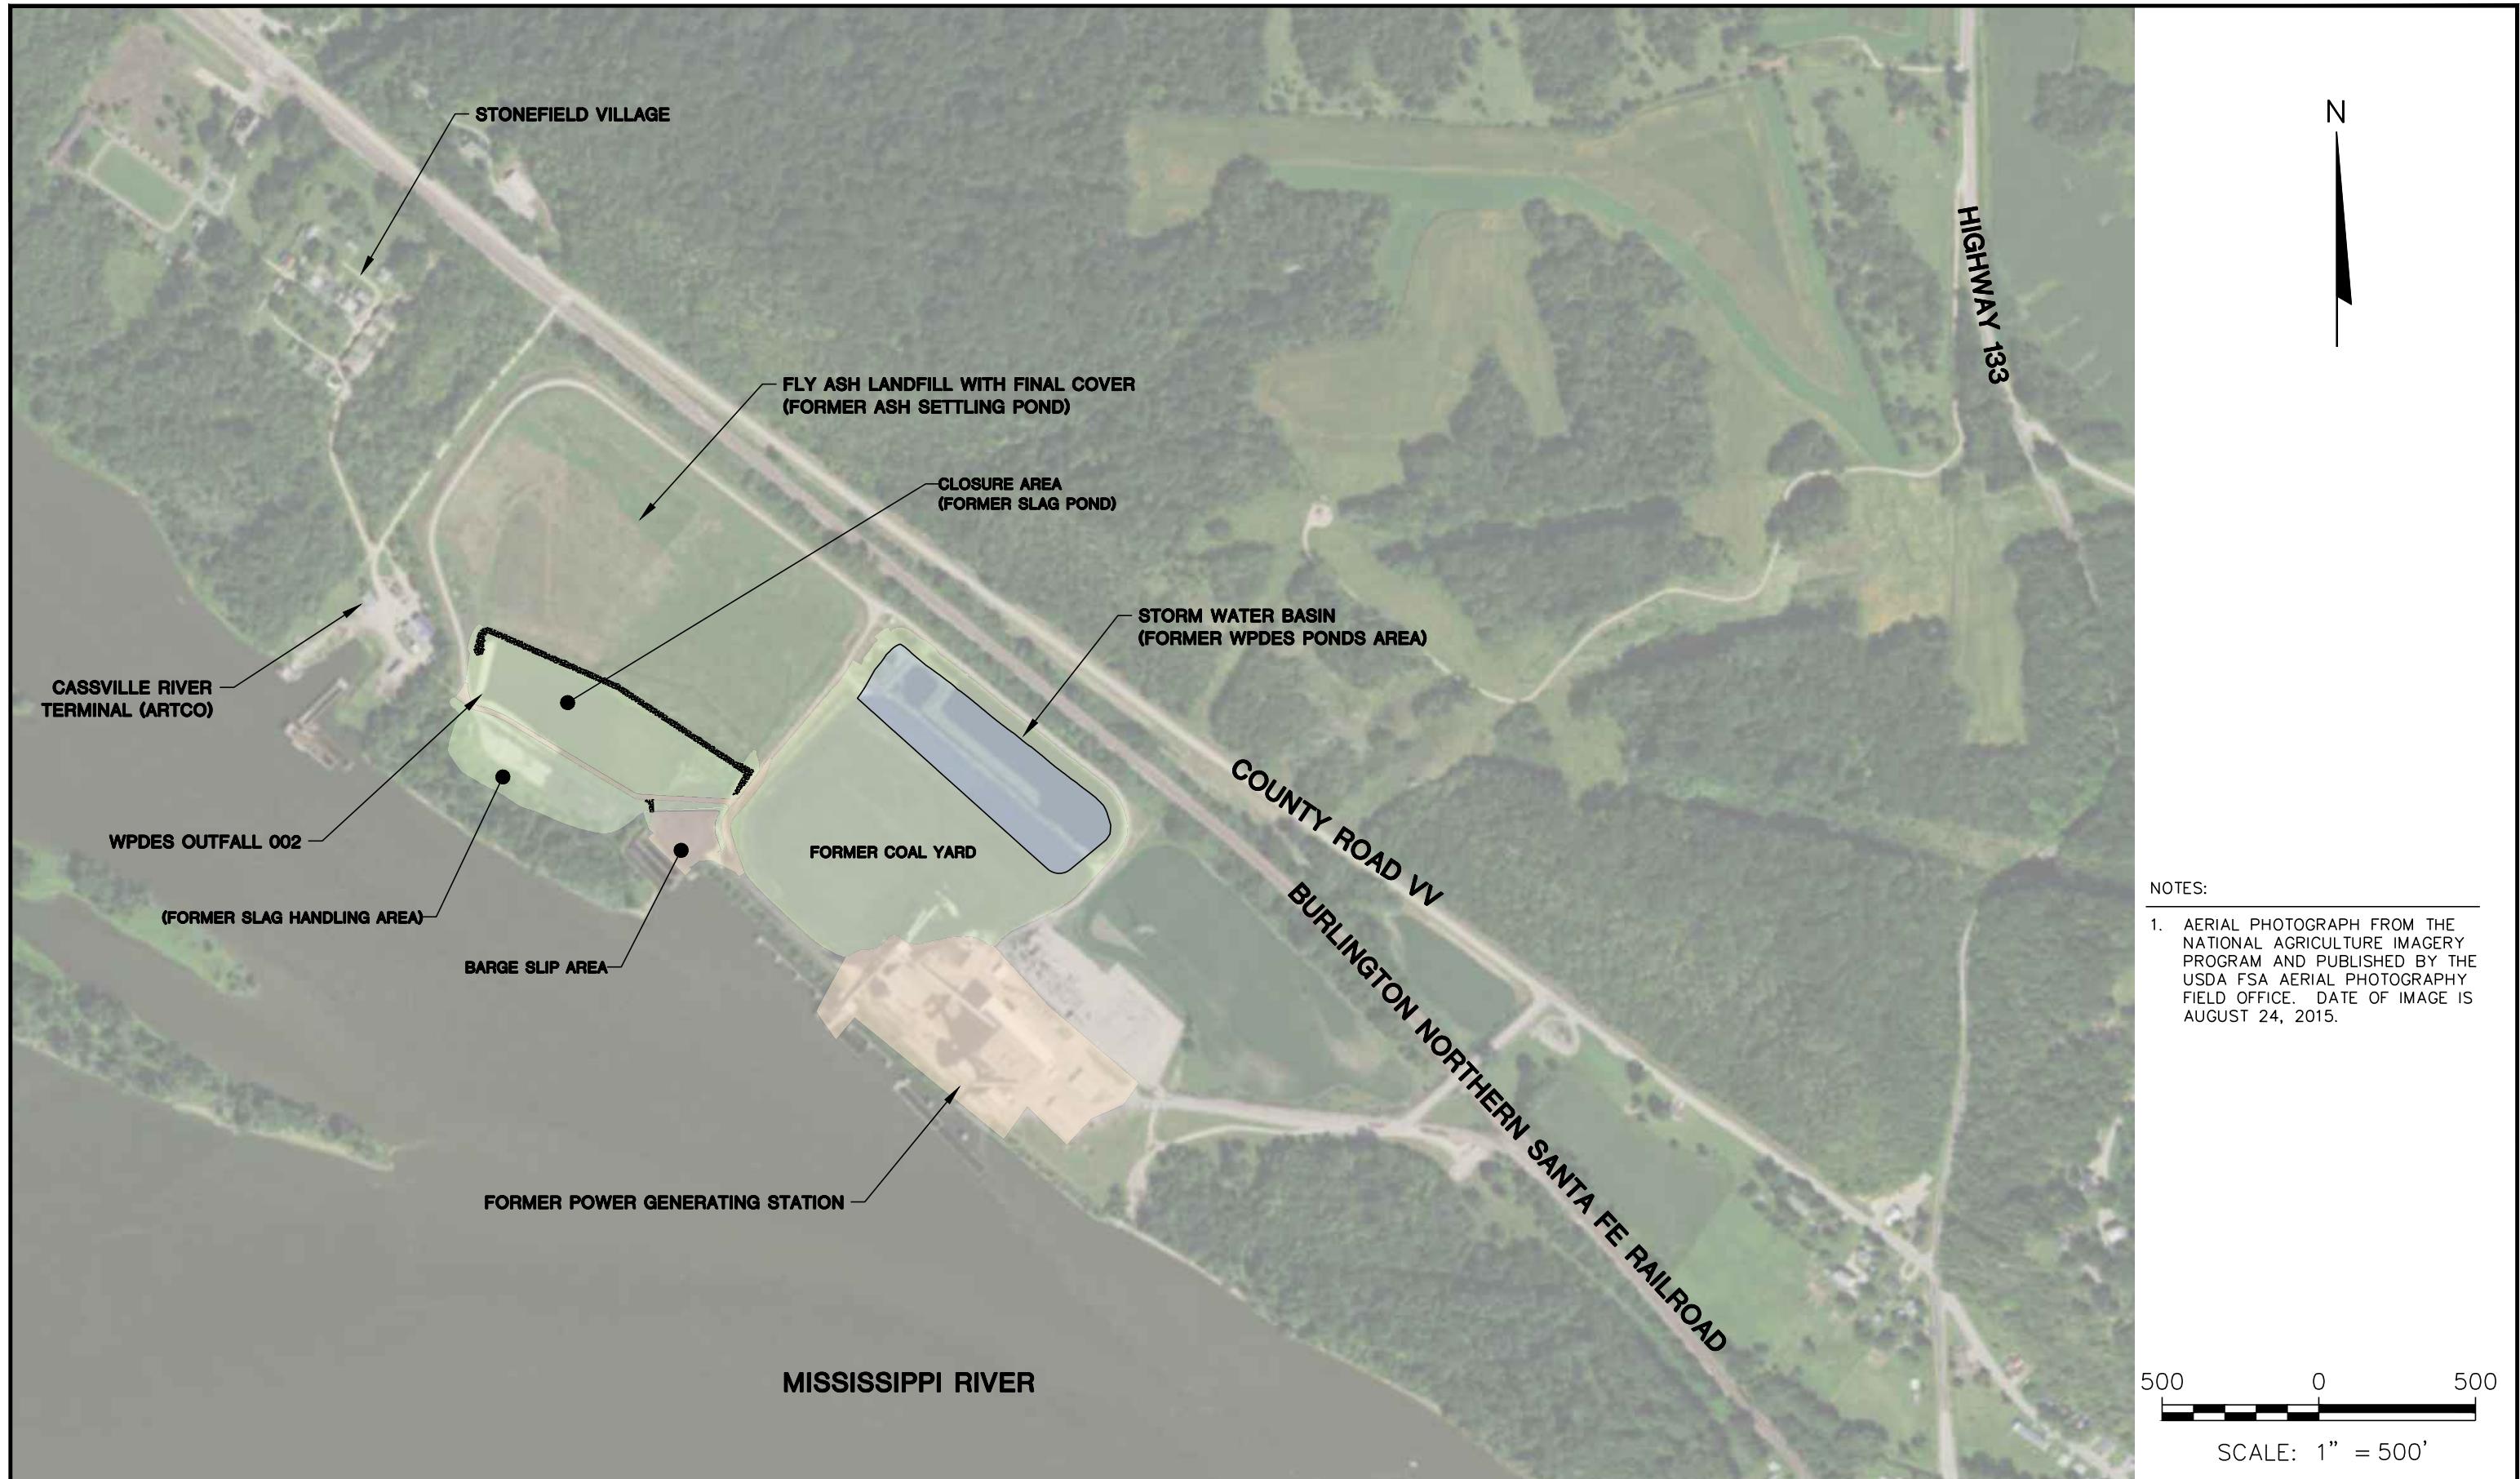

PROJECT NO.	25220071.00	DRAWN BY:	BJM
DRAWN:	12/18/13	CHECKED BY:	KAK
REVISED:	01/22/20	APPROVED BY:	TK 04/10/2020

SCS ENGINEERS
2830 DAIRY DRIVE MADISON, WI 53718-6751
PHONE: (608) 224-2830


CLIENT
WISCONSIN POWER AND LIGHT CO.
NELSON DEWEY GENERATING STATION
11999 COUNTY HIGHWAY VV
CASSVILLE WI, 53806


SITE

WISCONSIN POWER AND LIGHT
NELSON DEWEY GENERATING STATION
CASSVILLE WISCONSIN

AERIAL VIEW

FIGURE
2

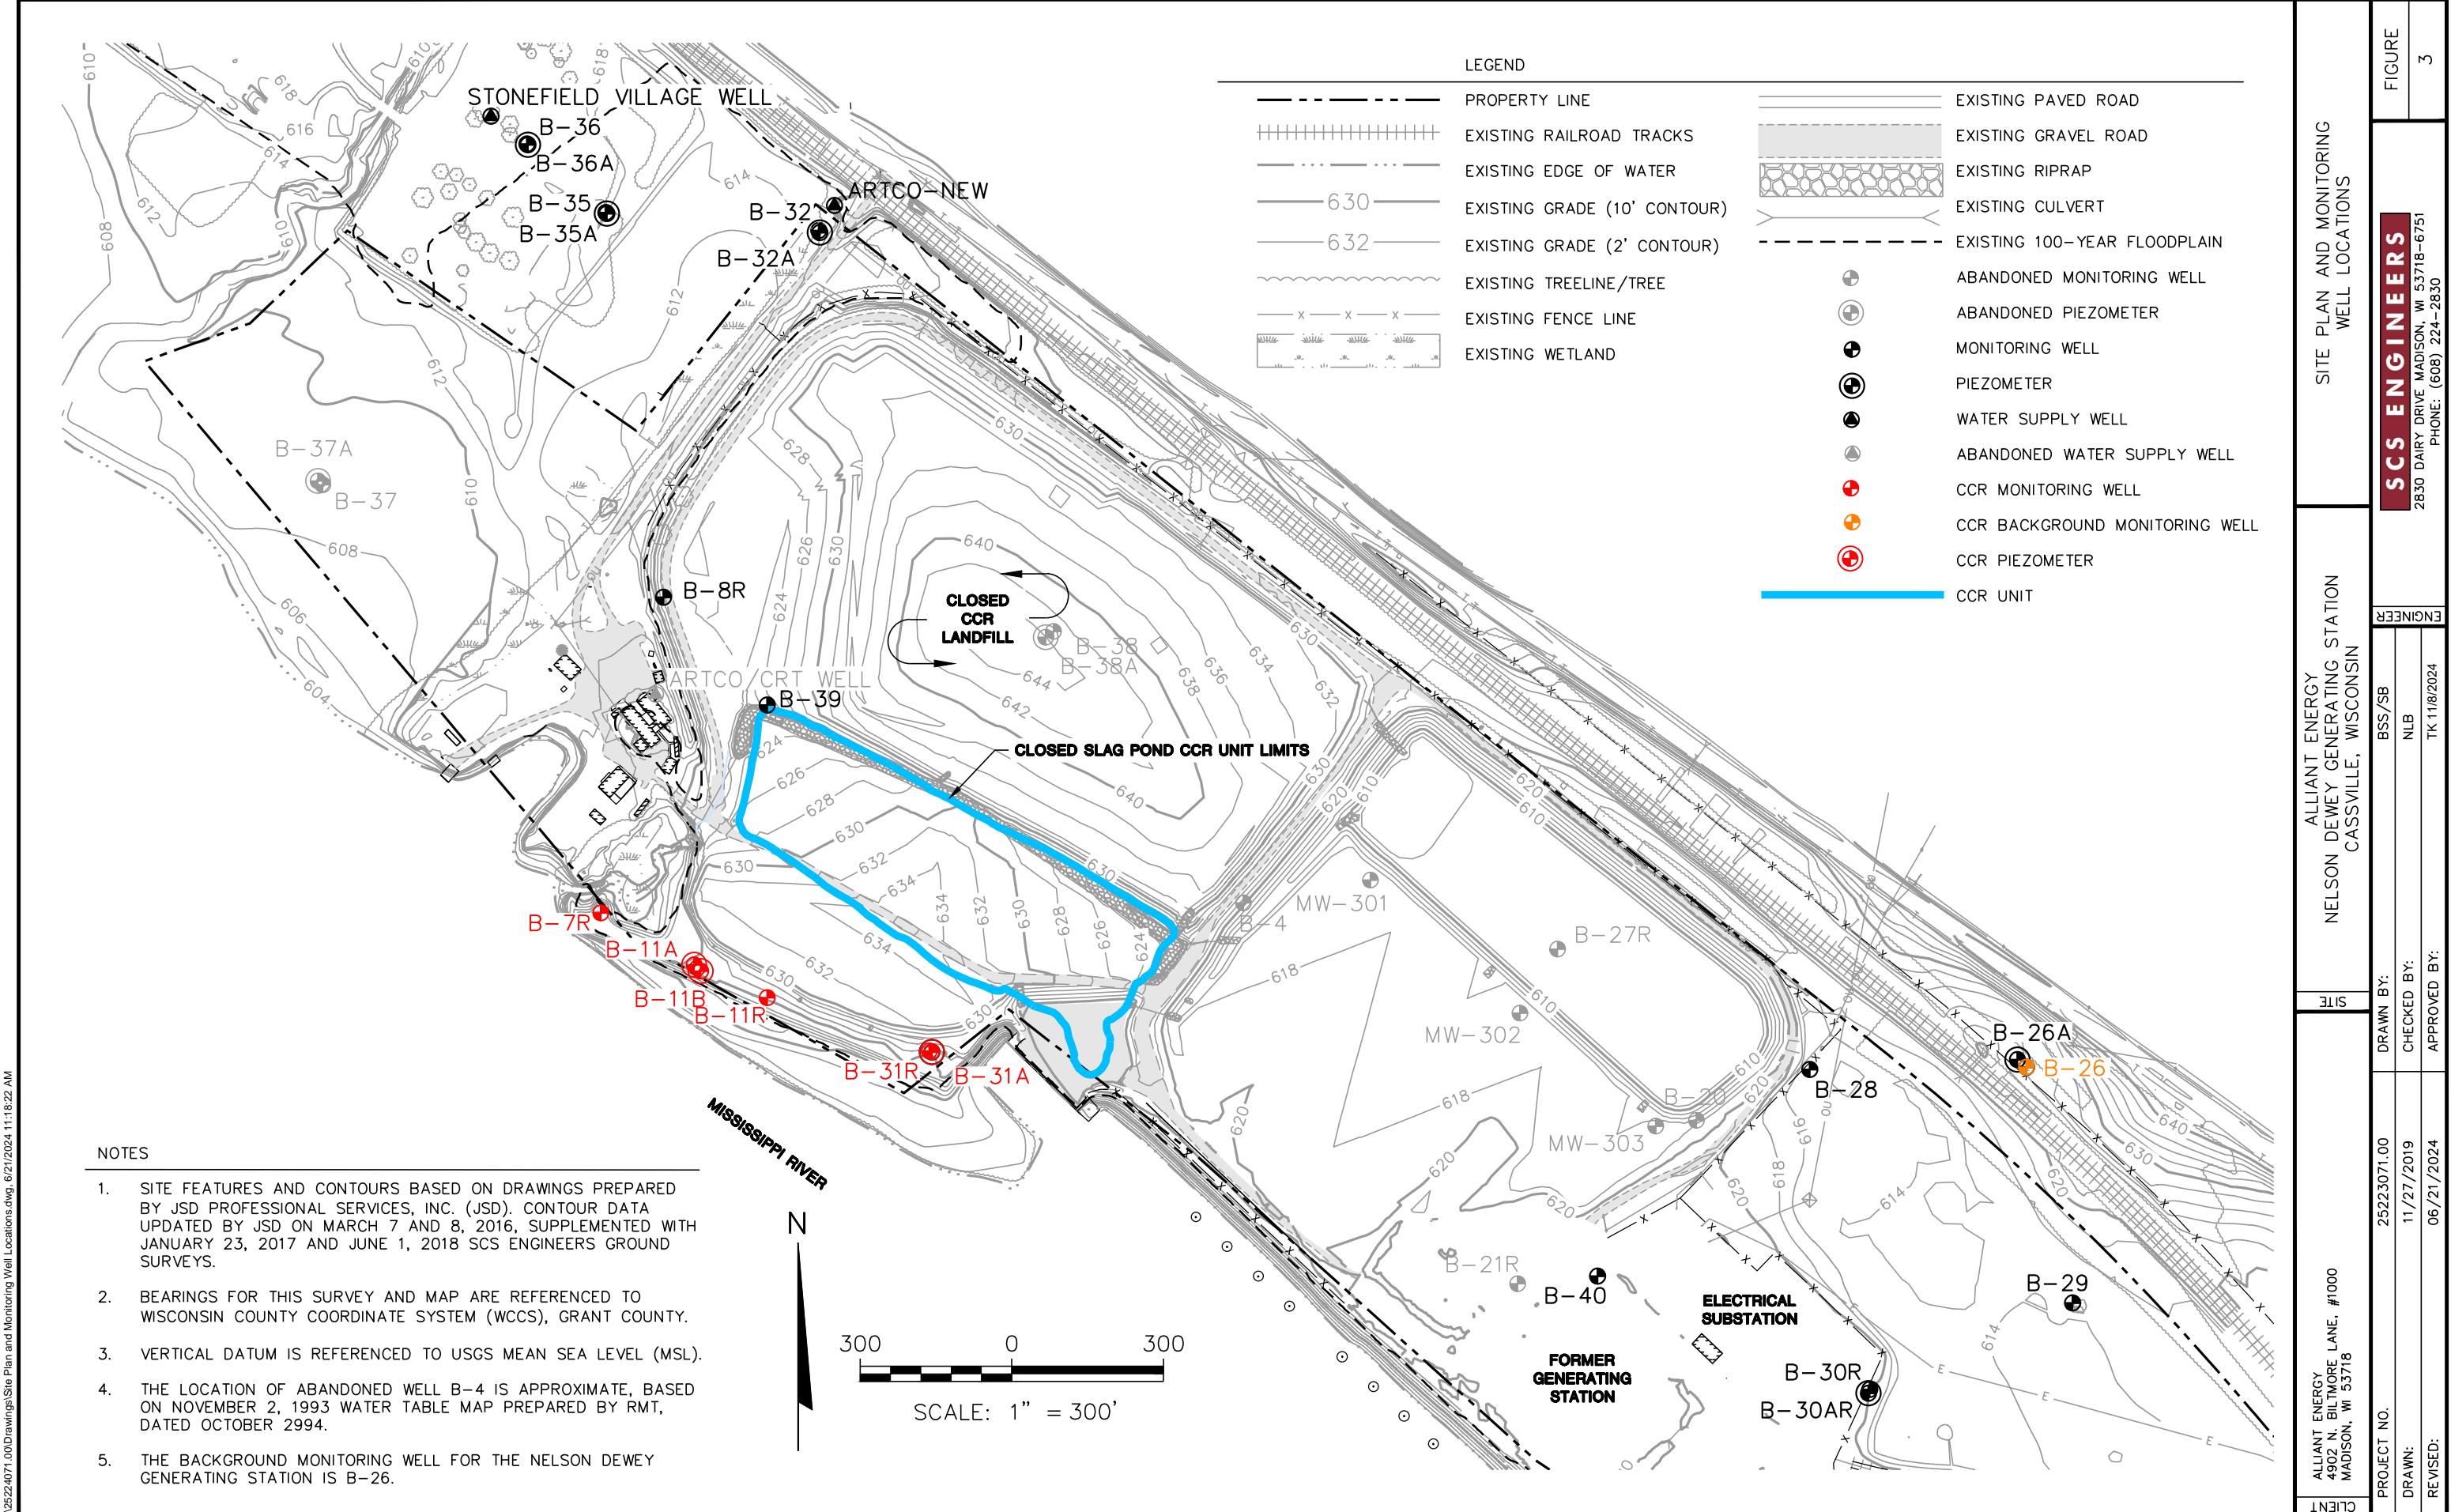

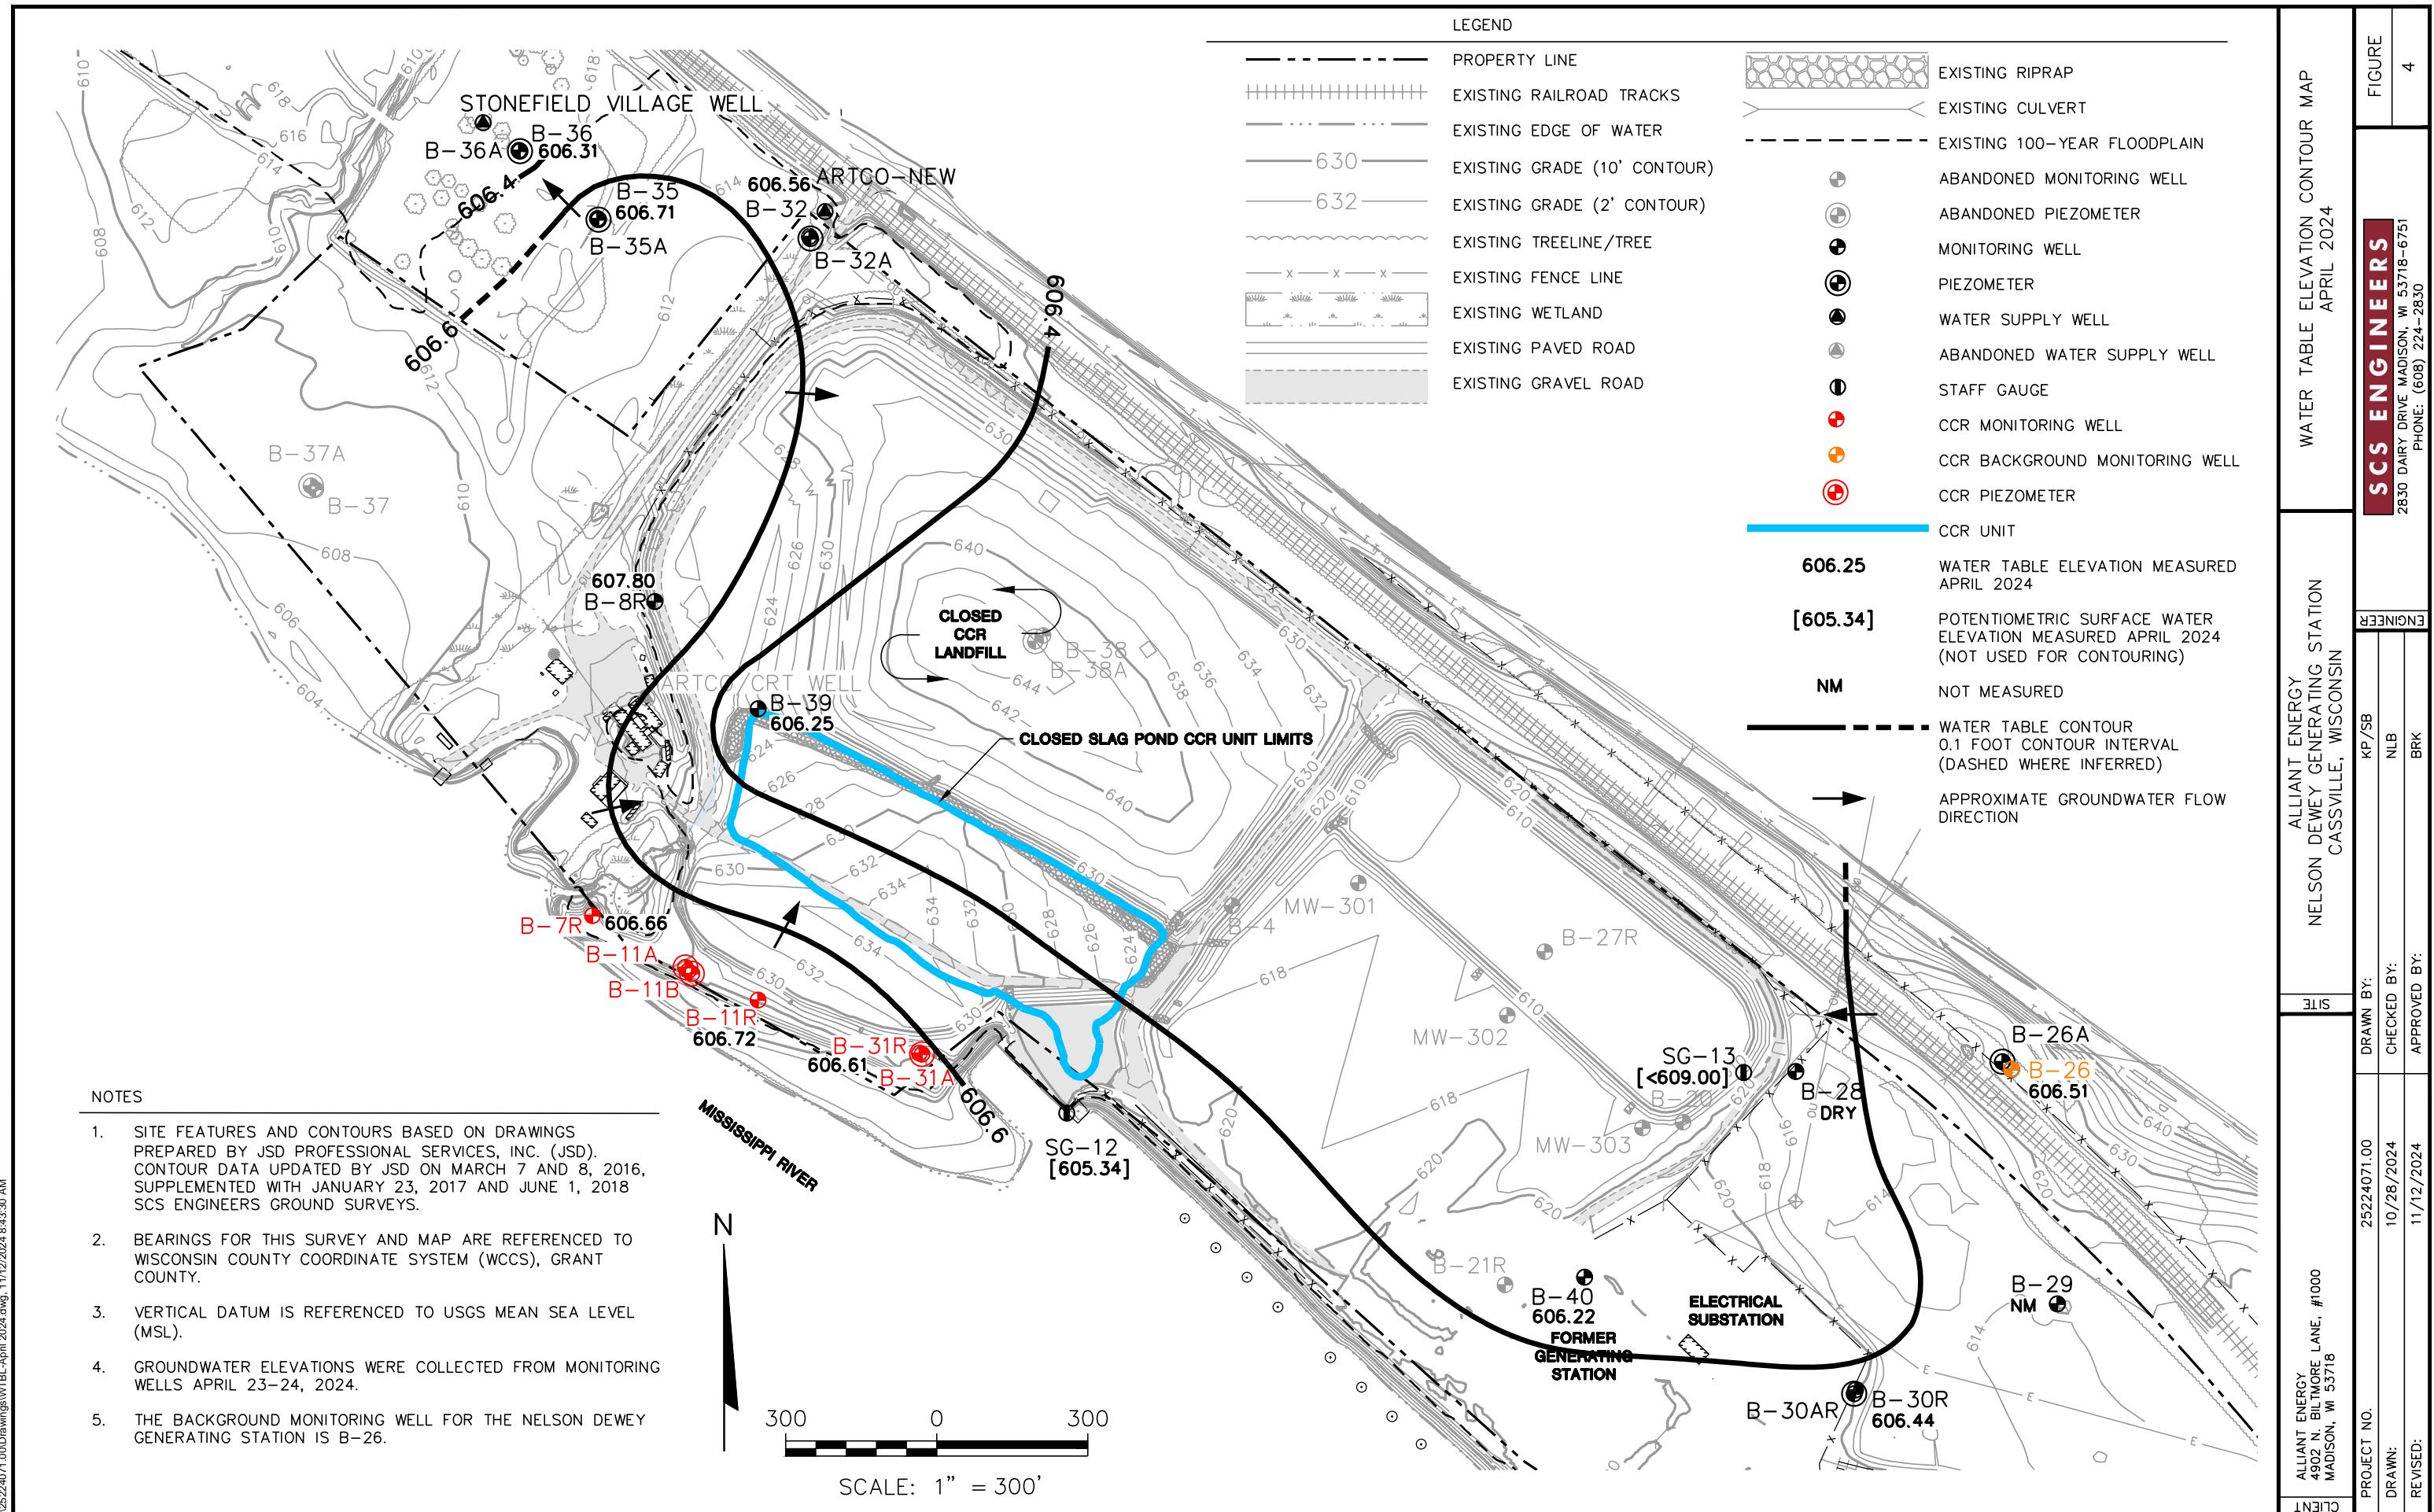


Appendix A

CCR Well Trend Plots

Sanitas™ v.10.0.22 Software licensed to SCS Engineers. UG
Hollow symbols indicate censored values.

Boron

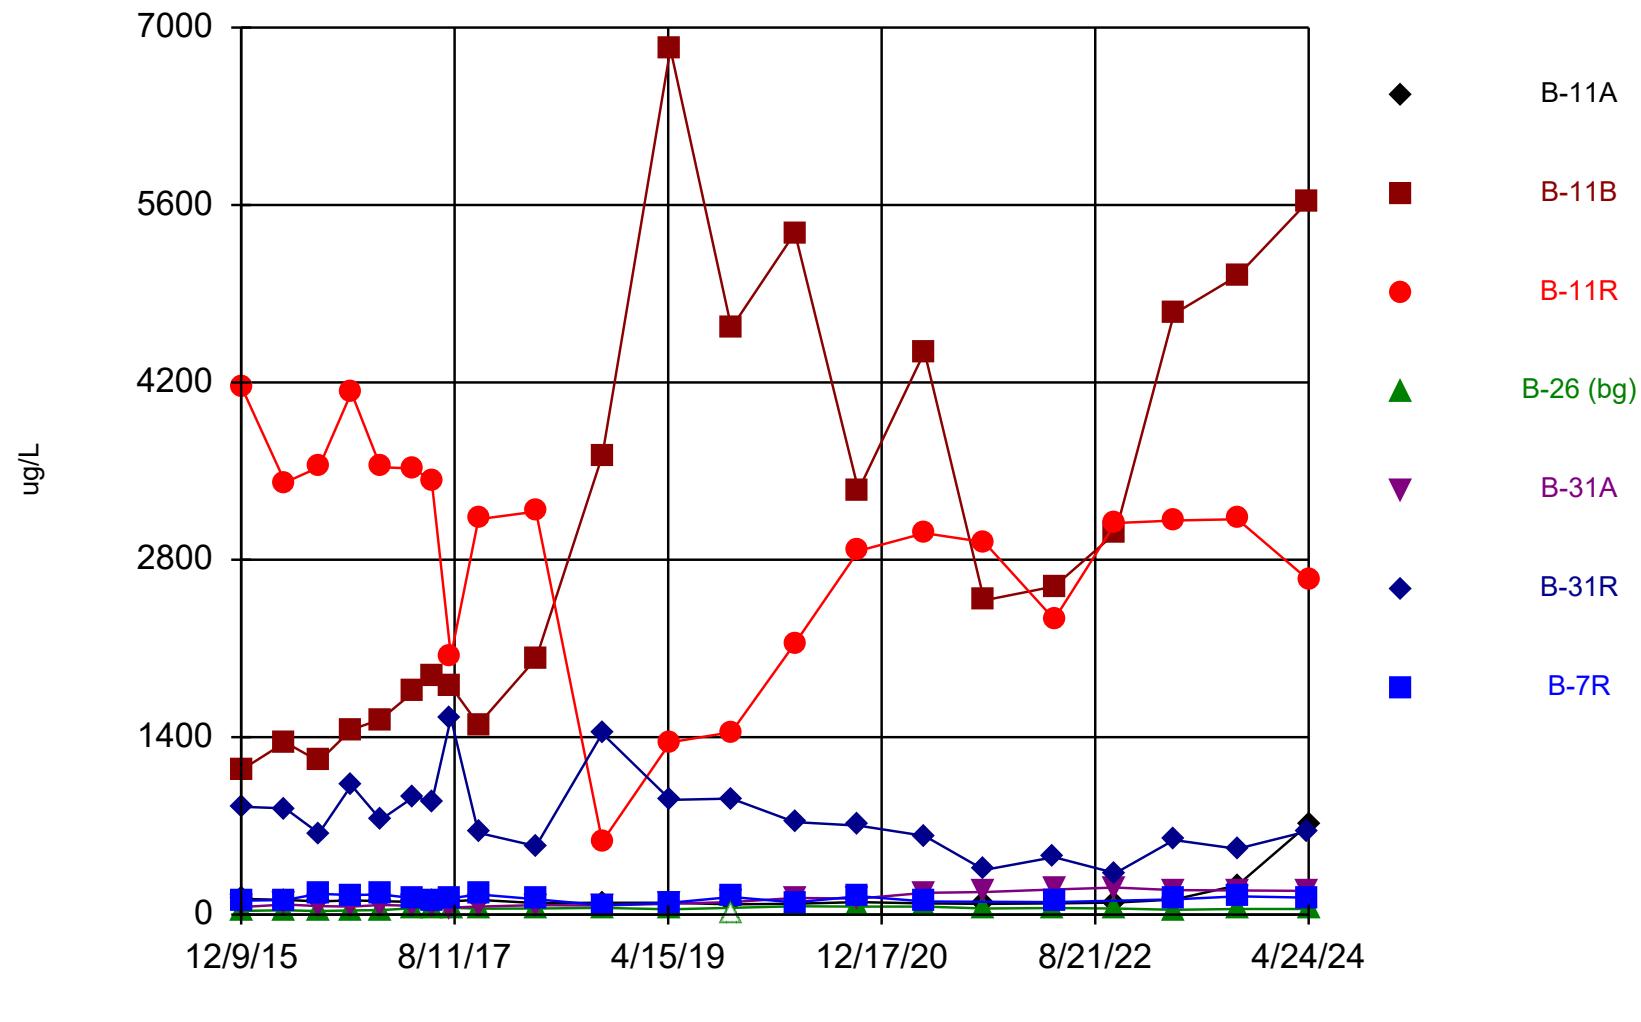

Time Series Analysis Run 9/5/2024 9:02 AM

Nelson Dewey Generating Station Client: SCS Engineers Data: NED - Chempoint- export-Dec2020

Time Series


Constituent: Boron (ug/L) Analysis Run 9/5/2024 9:12 AM

Nelson Dewey Generating Station Client: SCS Engineers Data: NED - Chempoint- export-Dec2020

	B-11A	B-11B	B-11R	B-26 (bg)	B-31A	B-31R	B-7R
12/9/2015	124	1140	4170	29.6	59	851	110
4/12/2016				33.7			
4/13/2016	116	1360	3410		79.2	838	115
7/18/2016							164
7/19/2016	104	1210	3530	28.6	67.2	641	
10/19/2016	112						154
10/20/2016		1460	4120	33	63.7	1020	
1/12/2017	106	1540	3530	35.2	76.4	749	159
4/17/2017	100	1760	3520	50.1	69.9	929	129
6/7/2017			3420	45.8			110
6/8/2017	102	1880			58.5	895	
8/1/2017	105	1800	2040		56.3	1550	129
8/2/2017				54.6			
10/19/2017	116	1500	3120	47.4	63.9	645	159
4/2/2018	91	2020	3180		74.8	540	121
4/3/2018				48			
10/8/2018				53.4			
10/9/2018	94.2	3620	576		71.8	1430	73
4/22/2019	93.9	6830	1360		86.2	906	93.5
4/23/2019				41.6			
10/14/2019	80.7	4630	1440		98.5	915	139
10/15/2019				<3 (UX)			
4/13/2020	86.3	5380	2140		132	730	96
4/14/2020				66.1			
10/12/2020	99.3	3350	2870		127	702	
10/13/2020				63.6			145
4/19/2021	88.1	4440	3010		172	621	
4/20/2021							104
4/21/2021				63.6			
10/7/2021	85.4	2480	2940		178	353	
10/8/2021				48.4			
4/25/2022				52.5		454	
4/26/2022	88.6	2590	2330		198		98.1
10/18/2022	95.2	3010	3090	48.8	213	327	
4/3/2023							120
4/4/2023	119	4740	3110		193	589	
4/5/2023				38.6			
10/2/2023					191	519	
10/3/2023	231	5040	3120	44.8			144
4/23/2024		5630			187	659	134
4/24/2024	715		2640	44.8			

Sanitas™ v.10.0.22 Software licensed to SCS Engineers. UG
Hollow symbols indicate censored values.

Calcium

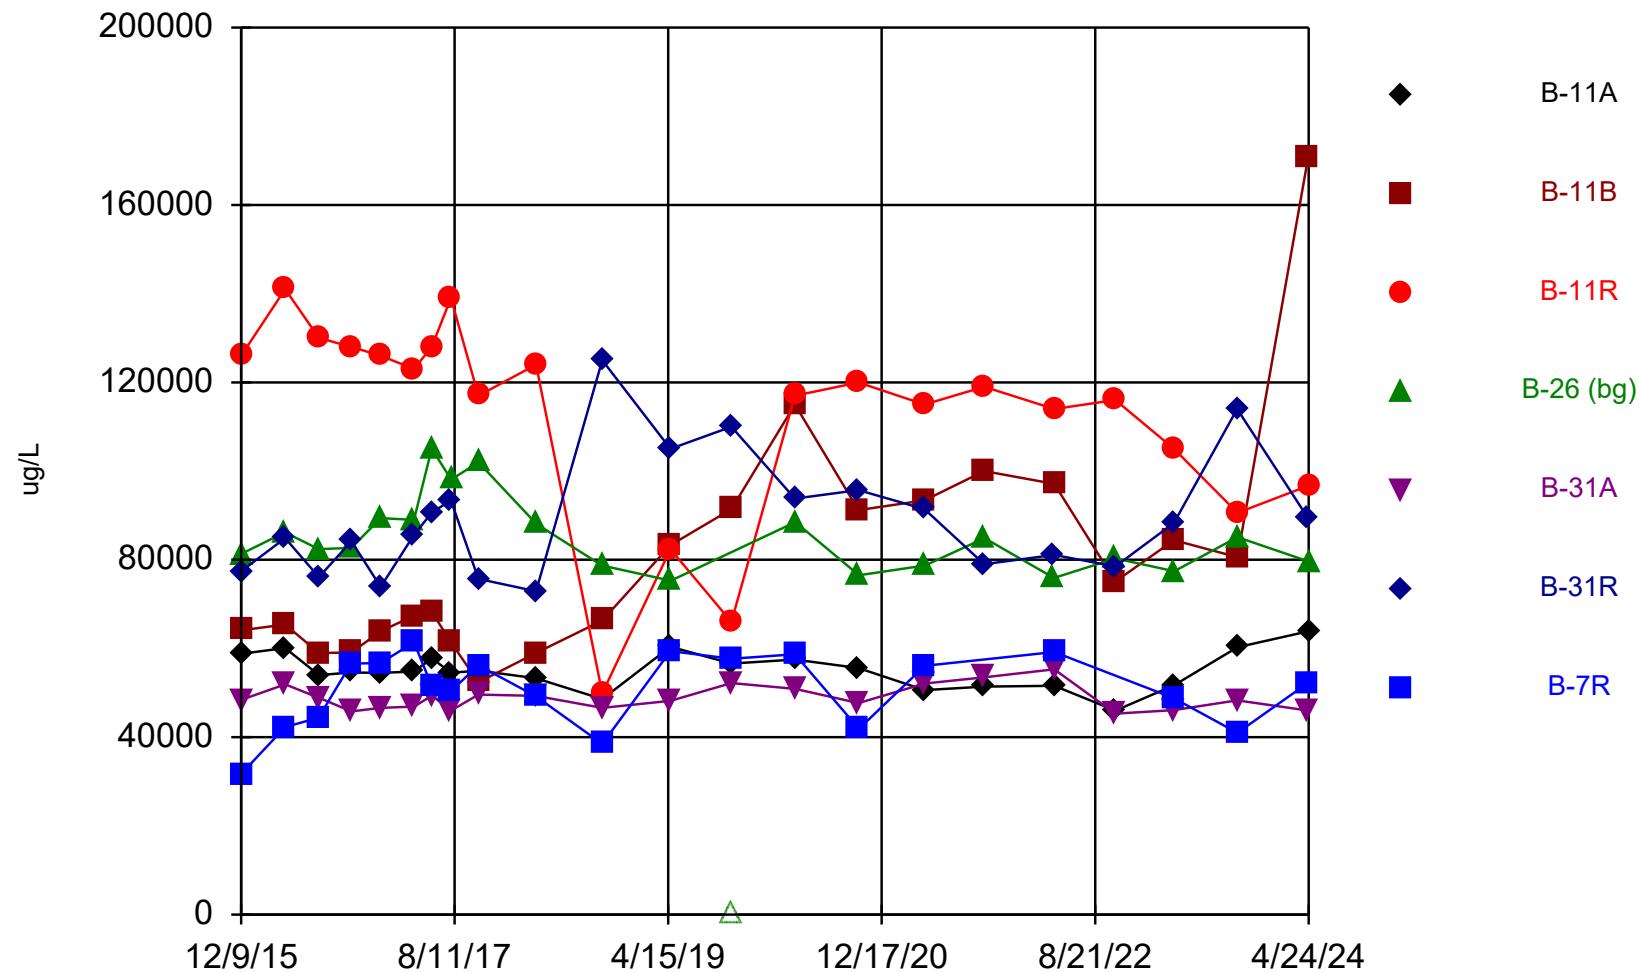

Time Series Analysis Run 9/5/2024 9:02 AM

Nelson Dewey Generating Station Client: SCS Engineers Data: NED - Chempoint- export-Dec2020


Time Series

Constituent: Calcium (ug/L) Analysis Run 9/5/2024 9:12 AM

Nelson Dewey Generating Station Client: SCS Engineers Data: NED - Chempoint- export-Dec2020

	B-11A	B-11B	B-11R	B-26 (bg)	B-31A	B-31R	B-7R
12/9/2015	58800	64100	126000	81300	48400	77400	31700
4/12/2016				86200			
4/13/2016	60100	65400	141000		51900	84900	42300
7/18/2016							44400
7/19/2016	54000	59000	130000	82400	48900	76100	
10/19/2016	54600						56600
10/20/2016		59100	128000	82700	45800	84200	
1/12/2017	54500	63900	126000	89400	46600	73900	56700
4/17/2017	54800	67400	123000	89000	46900	85600	61400
6/7/2017			128000	105000			51600
6/8/2017	57800	68200			49400	90700	
8/1/2017	54500	61400	139000		46000	93400	50400
8/2/2017				98100			
10/19/2017	55000	52400	117000	102000	49600	75700	56200
4/2/2018	53300	59000	124000		49300	72900	49200
4/3/2018				88100			
10/8/2018				78700			
10/9/2018	48600	66300	49900		46600	125000	38500
4/22/2019	60400	83300	82400		48200	105000	59400
4/23/2019				75300			
10/14/2019	56600	91400	66000		52200	110000	57700
10/15/2019				<76.2 (UX)			
4/13/2020	57500	115000	117000		50900	93800	58700
4/14/2020				88500			
10/12/2020	55600	91200	120000		47700	95700	
10/13/2020				76500			41900
4/19/2021	50600	93400	115000		52100	91400	
4/20/2021							56100
4/21/2021				78700			
10/7/2021	51400	100000	119000		53500	79000	
10/8/2021				84900			
4/25/2022				75900		81100	
4/26/2022	51600	97100	114000		55300		59200
10/18/2022	46000	75100	116000	80300	45300	78500	
4/3/2023							48800
4/4/2023	51700	84400	105000		46100	88300	
4/5/2023				77400			
10/2/2023					48300	114000	
10/3/2023	60300	80600	90600	85100			41000
4/23/2024			171000		46000	89300	52300
4/24/2024	63900		96700	79600			

Chloride

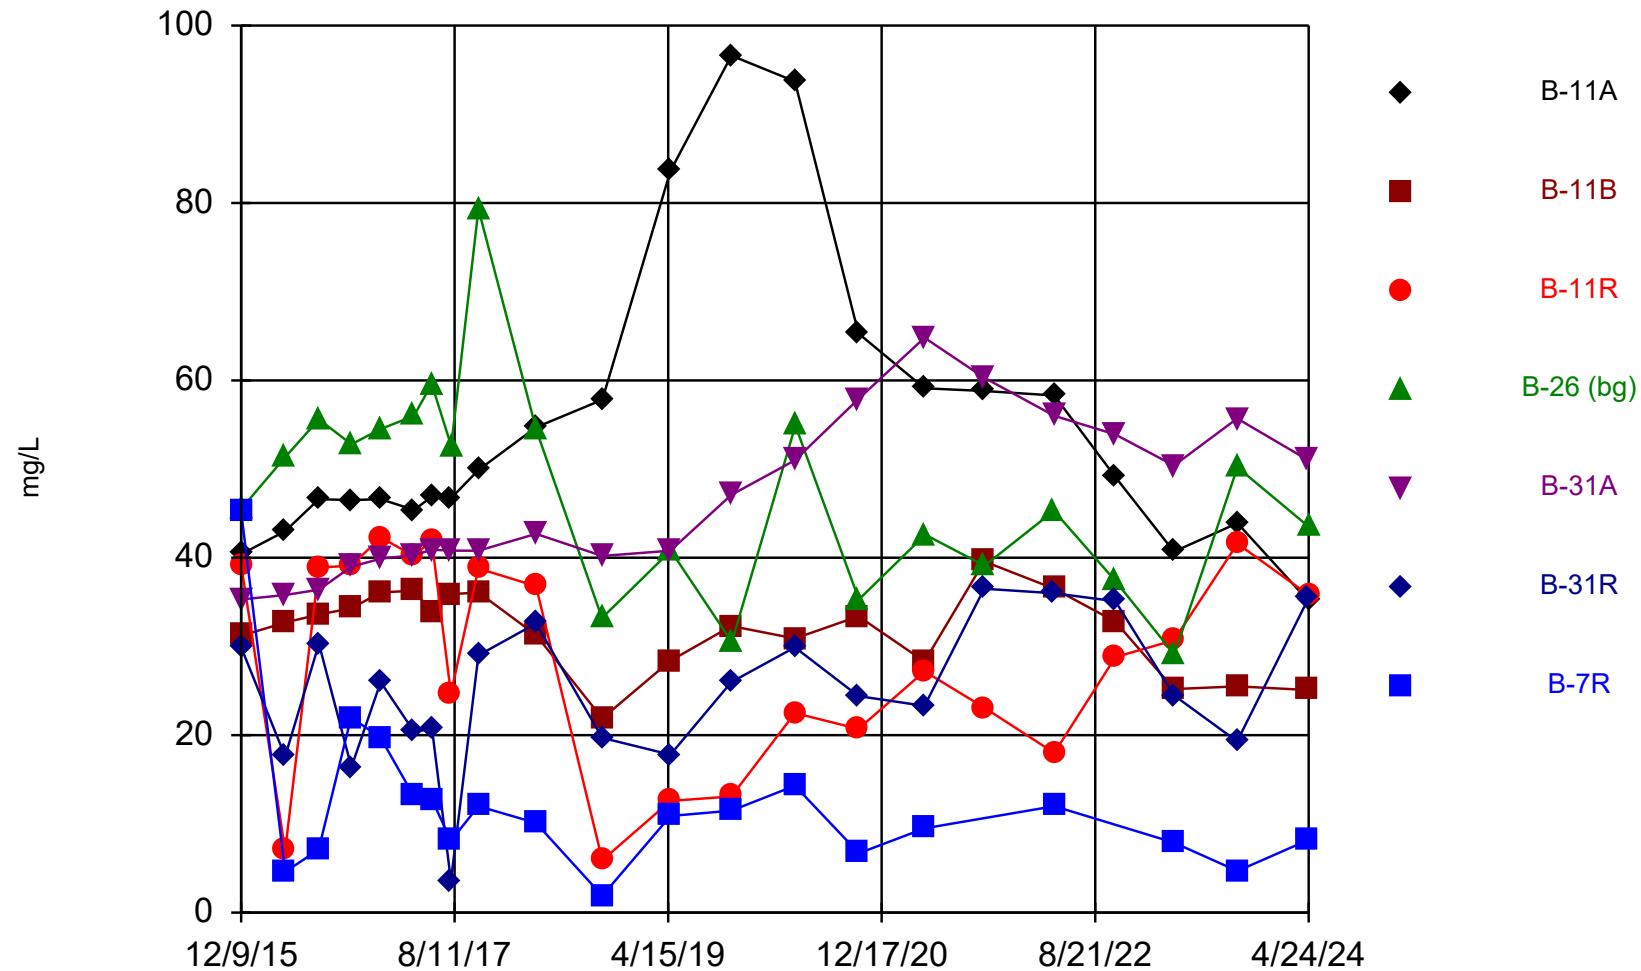

Time Series Analysis Run 9/5/2024 9:02 AM

Nelson Dewey Generating Station Client: SCS Engineers Data: NED - Chempoint- export-Dec2020


Time Series

Constituent: Chloride (mg/L) Analysis Run 9/5/2024 9:12 AM

Nelson Dewey Generating Station Client: SCS Engineers Data: NED - Chempoint- export-Dec2020

	B-11A	B-11B	B-11R	B-26 (bg)	B-31A	B-31R	B-7R
12/9/2015	40.4	31.2	39.2	45.5	35.3	29.9	45.2
4/12/2016				51.3			
4/13/2016	43	32.7	7		35.8	17.6	4.6
7/18/2016							7.1
7/19/2016	46.6	33.6	38.9	55.6	36.4	30.3	
10/19/2016	46.5		34.3	39.1	52.8	39	16.4
10/20/2016				54.5	39.9	26	19.7
1/12/2017	46.6	36.1	42.3				
4/17/2017	45.4	36.3	40.2	56	40.3	20.4	13.1
6/7/2017			42	59.6			12.8
6/8/2017	46.9	33.9			40.9	20.7	
8/1/2017	46.7	35.9	24.7		40.8	3.6	8.1
8/2/2017				52.6			
10/19/2017	49.9	36.1	38.8	79.3	40.8	29	12
4/2/2018	54.7	31.3	36.8		42.7	32.6	10.1
4/3/2018				54.4			
10/8/2018				33.2			
10/9/2018	57.8	21.9	5.9		40.2	19.7	1.9 (J)
4/22/2019	83.6	28.4	12.6		40.8	17.8	10.9
4/23/2019				40.8			
10/14/2019	96.6	32.3	13.1		47.1	26	11.5
10/15/2019				30.5			
4/13/2020	93.7	30.9	22.5		51	29.9	14.3
4/14/2020				54.9			
10/12/2020	65.3	33.4	20.7		57.9	24.4	
10/13/2020				35.3			6.7 (J)
4/19/2021	59.1	28.3	27.2		64.8	23.3	
4/20/2021							9.5 (J)
4/21/2021				42.6			
10/7/2021	58.8	39.6	23.1		60.3	36.5	
10/8/2021				39.1			
4/25/2022				45.3		36	
4/26/2022	58.3	36.5	18		56		12
10/18/2022	49.1	32.8	28.8	37.4	53.9	35.1	
4/3/2023							7.9 (J)
4/4/2023	40.7	25.2	30.7		50.4	24.5	
4/5/2023				29.1			
10/2/2023					55.7	19.3	
10/3/2023	43.9	25.5	41.6	50.2			4.7
4/23/2024		25.1			51	35.4	8.2 (J)
4/24/2024	35.1		35.8	43.5			

Field pH

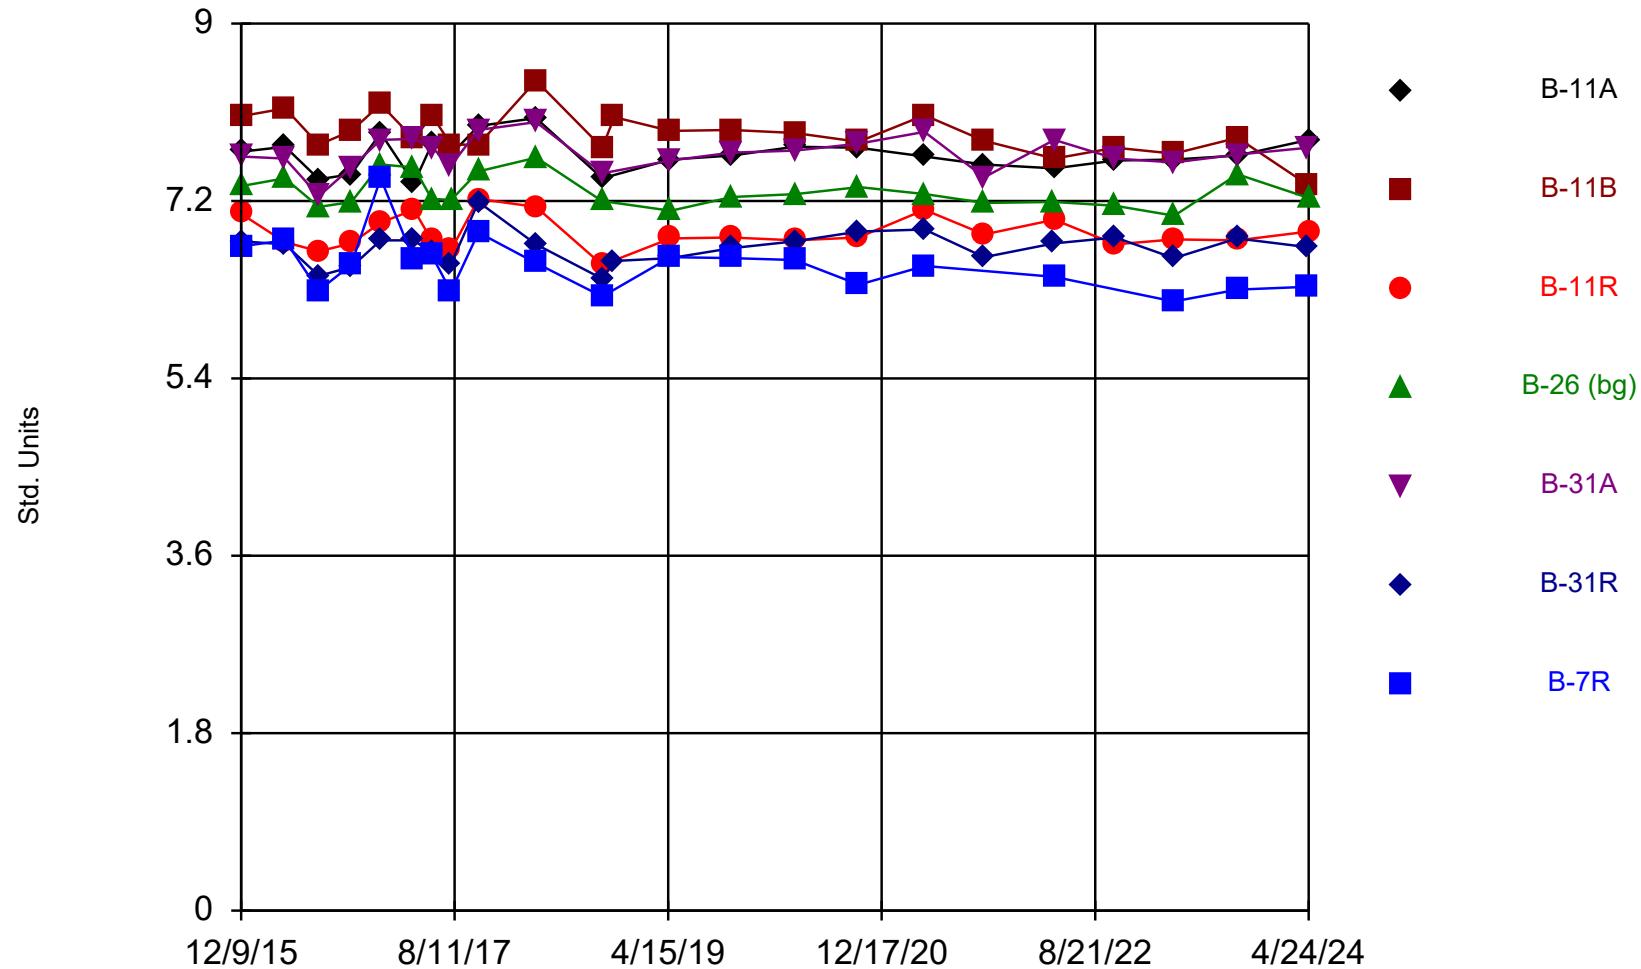

Time Series Analysis Run 9/5/2024 9:02 AM

Nelson Dewey Generating Station Client: SCS Engineers Data: NED - Chempoint- export-Dec2020

Time Series


Constituent: Field pH (Std. Units) Analysis Run 9/5/2024 9:12 AM

Nelson Dewey Generating Station Client: SCS Engineers Data: NED - Chempoint- export-Dec2020

	B-11A	B-11B	B-11R	B-26 (bg)	B-31A	B-31R	B-7R
12/9/2015	7.7	8.06	7.07	7.35	7.65	6.79	6.74
4/12/2016				7.43			
4/13/2016	7.75	8.14	6.78		7.63	6.76	6.8
7/18/2016							6.29
7/19/2016	7.42	7.77	6.69	7.14	7.25	6.44	
10/19/2016	7.47						6.55
10/20/2016		7.91	6.77	7.19	7.54	6.53	
1/12/2017	7.89	8.18	6.98	7.57	7.82	6.8	7.43
4/17/2017	7.38	7.83	7.11	7.54	7.83	6.8	6.6
6/7/2017			6.8	7.22			6.65
6/8/2017	7.78	8.07			7.74	6.67	
8/1/2017	7.67	7.77	6.7		7.56	6.56	6.28
8/2/2017				7.21			
10/19/2017	7.96	7.77	7.22	7.5	7.92	7.19	6.88
4/2/2018	8.04	8.42	7.14		8	6.76	6.57
4/3/2018				7.64			
10/8/2018				7.2			
10/9/2018	7.43	7.74	6.55		7.48	6.41	6.23
11/12/2018		8.05				6.59	
4/22/2019	7.62	7.91	6.82		7.61	6.62	6.63
4/23/2019				7.1			
10/14/2019	7.66	7.92	6.83		7.69	6.72	6.62
10/15/2019				7.24			
4/13/2020	7.75	7.89	6.8		7.71	6.79	6.6
4/14/2020				7.27			
10/12/2020	7.74	7.8	6.83		7.78	6.89	
10/13/2020				7.34			6.35
4/19/2021	7.65	8.07	7.11		7.9	6.91	
4/20/2021							6.54
4/21/2021				7.27			
10/7/2021	7.57	7.81	6.86		7.44	6.63	
10/8/2021				7.18			
4/25/2022				7.19		6.77	
4/26/2022	7.53	7.63	7.01		7.82		6.43
10/18/2022	7.61	7.74	6.76	7.15	7.63	6.83	
4/3/2023							6.18
4/4/2023	7.62	7.68	6.81		7.59	6.62	
4/5/2023				7.05			
10/2/2023					7.67	6.82	
10/3/2023	7.66	7.84	6.8	7.47			6.3
4/23/2024		7.36			7.74	6.73	6.33
4/24/2024	7.82		6.89	7.23			

Sanitas™ v.10.0.22 Software licensed to SCS Engineers. UG
Hollow symbols indicate censored values.

Fluoride

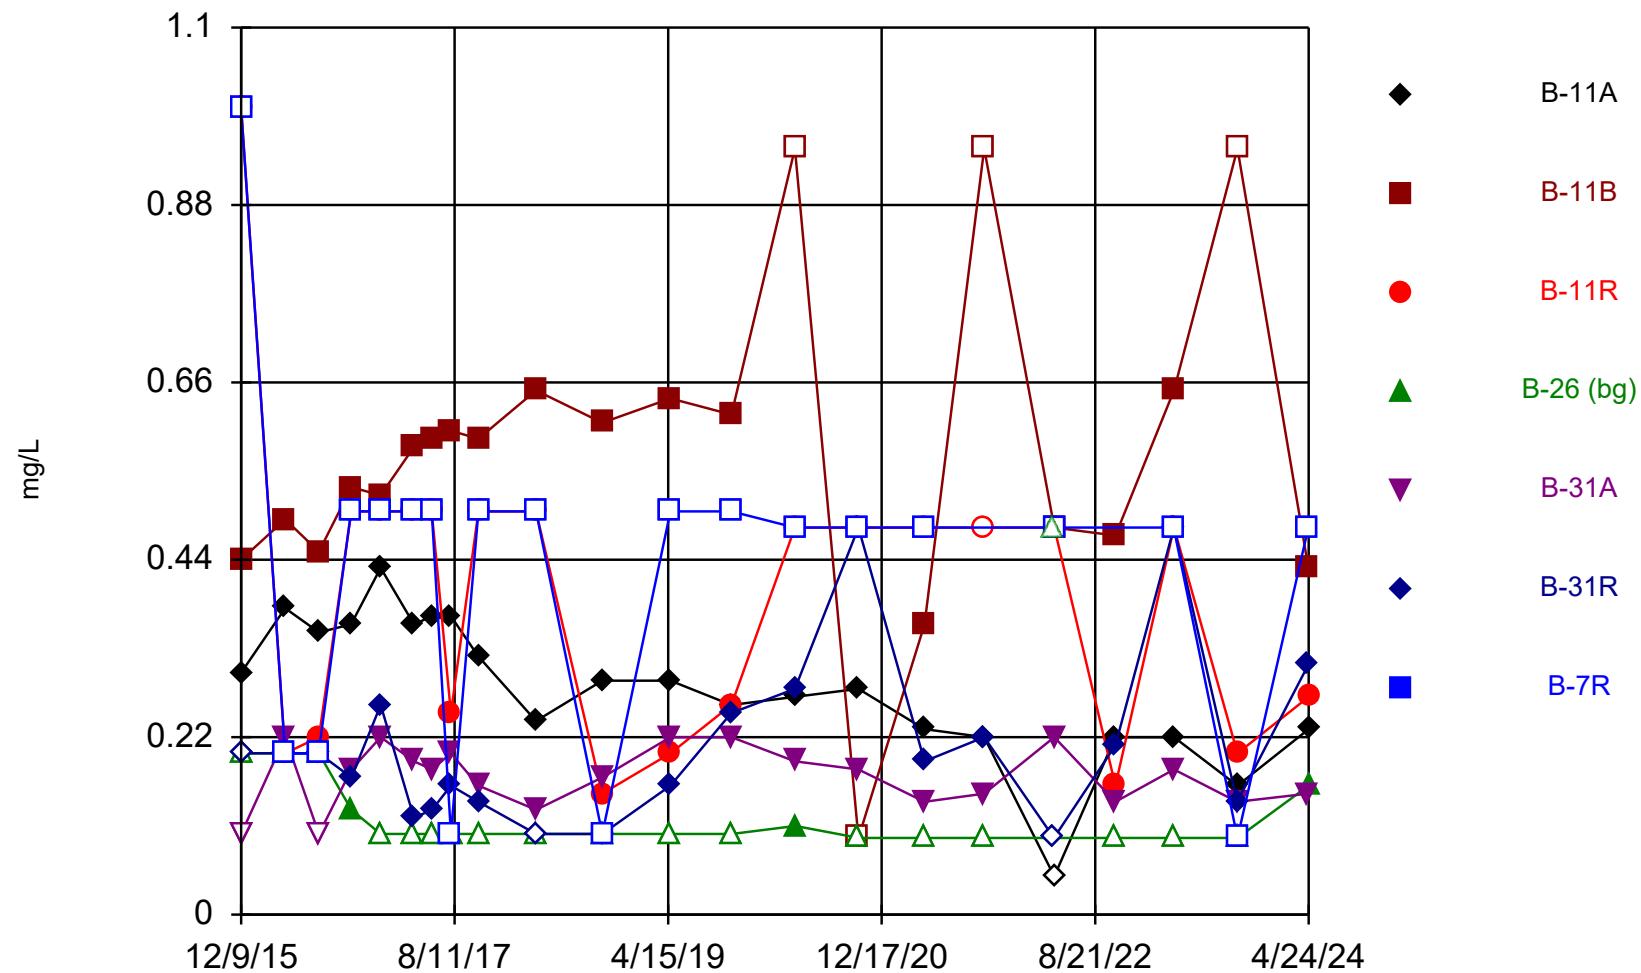

Time Series Analysis Run 9/5/2024 9:02 AM

Nelson Dewey Generating Station Client: SCS Engineers Data: NED - Chempoint- export-Dec2020

Time Series


Constituent: Fluoride (mg/L) Analysis Run 9/5/2024 9:12 AM

Nelson Dewey Generating Station Client: SCS Engineers Data: NED - Chempoint- export-Dec2020

	B-11A	B-11B	B-11R	B-26 (bg)	B-31A	B-31R	B-7R
12/9/2015	0.3 (J)	0.44	<1 (U)	<0.2 (U)	<0.2 (U)	<0.2 (U)	<1 (U)
4/12/2016				<0.2 (U)			
4/13/2016	0.38 (J)	0.49	<0.2 (U)		0.22 (J)	<0.2 (U)	<0.2 (U)
7/18/2016							<0.2 (U)
7/19/2016	0.35 (J)	0.45	0.22 (J)	<0.2 (U)	<0.2 (U)	<0.2 (U)	
10/19/2016	0.36						<0.5 (U)
10/20/2016		0.53	<0.5 (U)	0.13 (J)	0.18 (J)	0.17 (J)	
1/12/2017	0.43	0.52	<0.5 (U)	<0.1 (U)	0.22 (J)	0.26 (J)	<0.5 (U)
4/17/2017	0.36	0.58	<0.5 (U)	<0.1 (U)	0.19 (J)	0.12 (J)	<0.5 (U)
6/7/2017			<0.5 (U)	<0.1 (U)			<0.5 (U)
6/8/2017	0.37	0.59			0.18 (J)	0.13 (J)	
8/1/2017	0.37	0.6	0.25 (J)		0.2 (J)	0.16 (J)	<0.1 (U)
8/2/2017				<0.1 (U)			
10/19/2017	0.32	0.59	<0.5 (U)	<0.1 (U)	0.16 (J)	0.14 (J)	<0.5 (U)
4/2/2018	0.24 (J)	0.65	<0.5 (U)		0.13 (J)	<0.1 (U)	<0.5 (U)
4/3/2018				<0.1 (U)			
10/8/2018				<0.1 (U)			
10/9/2018	0.29 (J)	0.61	0.15 (J)		0.17 (J)	<0.1 (U)	<0.1 (U)
4/22/2019	0.29 (J)	0.64	0.2 (J)		0.22 (J)	0.16 (J)	<0.5 (U)
4/23/2019				<0.1 (U)			
10/14/2019	0.26 (J)	0.62	0.26 (J)		0.22 (J)	0.25 (J)	<0.5 (U)
10/15/2019				<0.1 (U)			
4/13/2020	0.27 (J)	<0.95 (U)	<0.48 (U)		0.19 (J)	0.28 (J)	<0.48 (U)
4/14/2020				0.11 (J)			
10/12/2020	0.28 (J)	<0.095 (U)	<0.48 (U)		0.18 (J)	<0.48 (U)	
10/13/2020				<0.095 (U)			<0.48 (U)
4/19/2021	0.23 (J)	0.36	<0.48		0.14 (J)	0.19 (J)	
4/20/2021							<0.48
4/21/2021				<0.095 (U)			
10/7/2021	0.22 (J)	<0.95 (U)	<0.48 (U)		0.15 (J)	0.22 (J)	
10/8/2021				<0.095 (U)			
4/25/2022				<0.48 (UX)		<0.095 (U)	
4/26/2022	<0.095 (U)	<0.48 (U)	<0.48 (U)		0.22 (J)		<0.48 (U)
10/18/2022	0.22 (J)	0.47	0.16 (J)	<0.095 (U)	0.14 (J)	0.21 (J)	
4/3/2023							<0.48 (U)
4/4/2023	0.22 (J)	0.65 (J)	<0.48 (U)		0.18 (J)	<0.48 (U)	
4/5/2023				<0.095 (U)			
10/2/2023					0.14 (J)	0.14 (J)	
10/3/2023	0.16 (J)	<0.95 (U)	0.2 (J)	<0.095 (U)			<0.095 (U)
4/23/2024		0.43			0.15 (J)	0.31 (J)	<0.48
4/24/2024	0.23 (J)		0.27 (J)	0.16 (J)			

Sanitas™ v.10.0.22 Software licensed to SCS Engineers. UG
Hollow symbols indicate censored values.

Sulfate

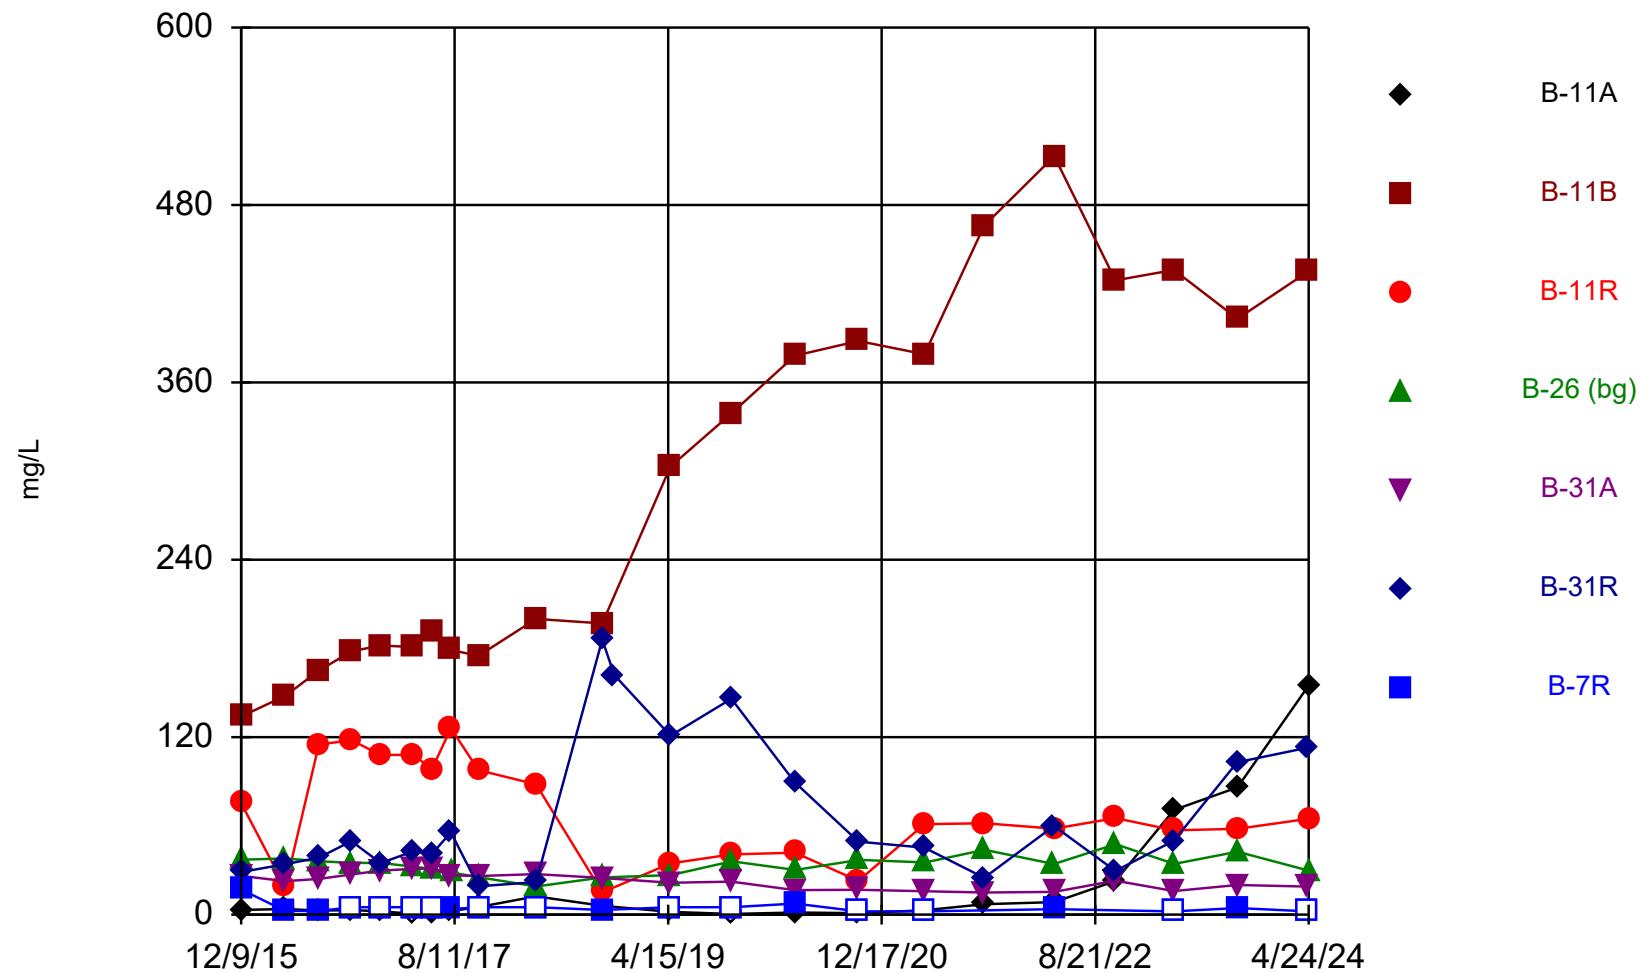

Time Series Analysis Run 9/5/2024 9:02 AM

Nelson Dewey Generating Station Client: SCS Engineers Data: NED - Chempoint- export-Dec2020


Time Series

Constituent: Sulfate (mg/L) Analysis Run 9/5/2024 9:12 AM

Nelson Dewey Generating Station Client: SCS Engineers Data: NED - Chempoint- export-Dec2020

	B-11A	B-11B	B-11R	B-26 (bg)	B-31A	B-31R	B-7R
12/9/2015	3.2 (J)	134	75.4	37.1	26.2	28.8	17 (J)
4/12/2016				38			
4/13/2016	3.8 (J)	148	18.4		22.6	34.1	2.5 (J)
7/18/2016							2.4 (J)
7/19/2016	2.7 (J)	165	115	36.2	24.2	38.5	
10/19/2016	3 (J)						<5 (U)
10/20/2016		178	118	35	27.2	49.7	
1/12/2017	2.3 (J)	182	108	35	29.8	34.9	<5 (U)
4/17/2017	<1 (U)	181	108	32.4	31	43	<5 (U)
6/7/2017			98.2	31			<5 (U)
6/8/2017	1.4 (J)	191			31.2	41.1	
8/1/2017	2.4 (J)	179	126		26.6	55.6	3.7
8/2/2017				28.5			
10/19/2017	5.1	175	97.7	25.3	26.1	19.2	<5 (U)
4/2/2018	12.3	200	88.1		27.4	22	<5 (U)
4/3/2018				19.1			
10/8/2018				25.1			
10/9/2018	6	197	15.1		24.8	186	3.2
11/12/2018						162	
4/22/2019	1.9 (J)	303	34.6		21.6	121	<5 (U)
4/23/2019				26.7			
10/14/2019	<1 (U)	339	40.7		22.3	146	<5 (U)
10/15/2019				36			
4/13/2020	1.4 (J)	378	41.9		16.6	89.4	7.5 (J)
4/14/2020				30.2			
10/12/2020	1 (J)	388	22.8		16.8	49.4	
10/13/2020				37			<2.2 (U)
4/19/2021	2.9	379	61.2		15.8	45.3	
4/20/2021				35.3			<2.2
4/21/2021							
10/7/2021	7	466	61.8		14.9	24.9	
10/8/2021				43.8			
4/25/2022				34.2		60	
4/26/2022	8.5	513	58.1		15.4		3.7 (J)
10/18/2022	22.7	429	65.3	47.6	23	29.6	
4/3/2023							<2.2 (U)
4/4/2023	70.8	436	57		15.9	50	
4/5/2023				34.3			
10/2/2023					20	103	
10/3/2023	86	403	58	42.5			4.5
4/23/2024		435			19	113	<2.2
4/24/2024	155		64.8	29.8			

Total Dissolved Solids

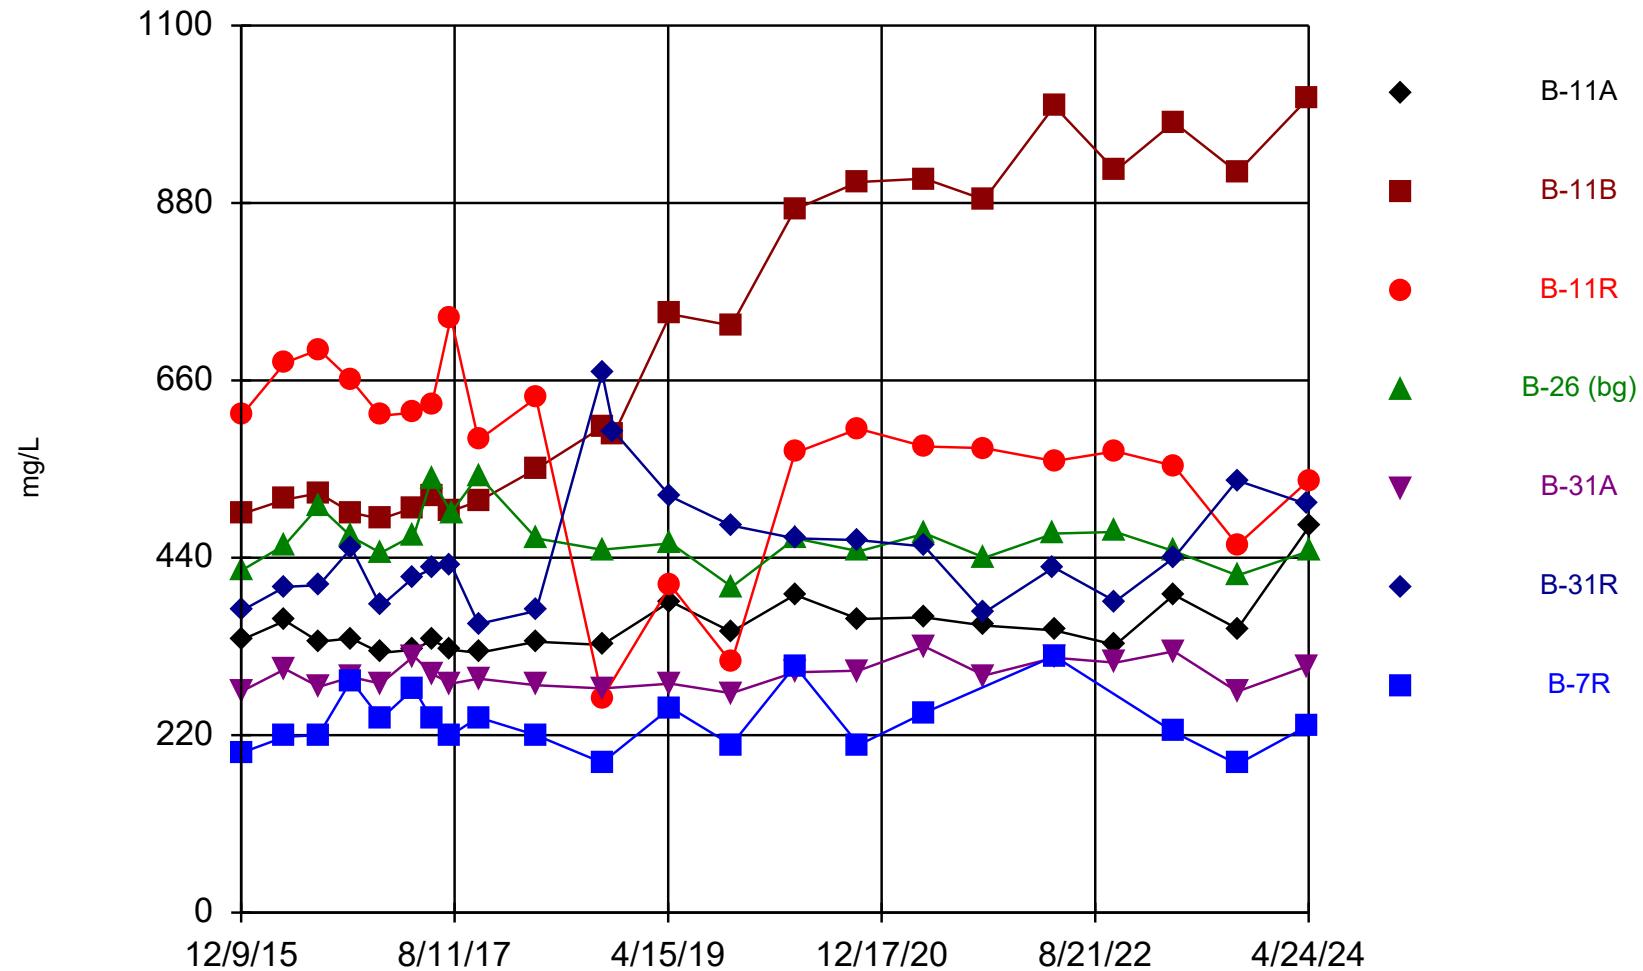

Time Series Analysis Run 9/5/2024 9:02 AM

Nelson Dewey Generating Station Client: SCS Engineers Data: NED - Chempoint- export-Dec2020

Time Series


Constituent: Total Dissolved Solids (mg/L) Analysis Run 9/5/2024 9:12 AM

Nelson Dewey Generating Station Client: SCS Engineers Data: NED - Chempoint- export-Dec2020

	B-11A	B-11B	B-11R	B-26 (bg)	B-31A	B-31R	B-7R
12/9/2015	338	494	616	424	274	374	198
4/12/2016				456			
4/13/2016	362	512	682		302	404	218
7/18/2016							220
7/19/2016	336	520	698	504	280	406	
10/19/2016	340						288
10/20/2016		496	660	466	292	452	
1/12/2017	322	488	616	446	284	380	240
4/17/2017	326	502	620	468	318	416	278
6/7/2017			630	538			240
6/8/2017	338	516			296	426	
8/1/2017	326	498	738		284	432	220
8/2/2017				496			
10/19/2017	322	510	586	542	290	358	242
4/2/2018	336	550	638		282	374	220
4/3/2018				464			
10/8/2018				450			
10/9/2018	332	602	266		278	668	186
11/12/2018		594				596	
4/22/2019	386	742	406		284	516	254
4/23/2019				458			
10/14/2019	348	728	310		272	480	208
10/15/2019				404			
4/13/2020	394	872	570		298	464	306
4/14/2020				464			
10/12/2020	364	906	600		300	462	
10/13/2020				448			208
4/19/2021	366	910	578		330	454	
4/20/2021							248
4/21/2021				470			
10/7/2021	356	884	576		294	372	
10/8/2021				440			
4/25/2022				470		428	
4/26/2022	350	1000	560		316		318
10/18/2022	332	920	572	472	310	386	
4/3/2023							224
4/4/2023	394	980	554		324	440	
4/5/2023				448			
10/2/2023					274	536	
10/3/2023	352	918	456	418			184
4/23/2024		1010			306	506	232
4/24/2024	478		536	448			

Appendix B

1994 RMT Environmental Contamination Assessment Information

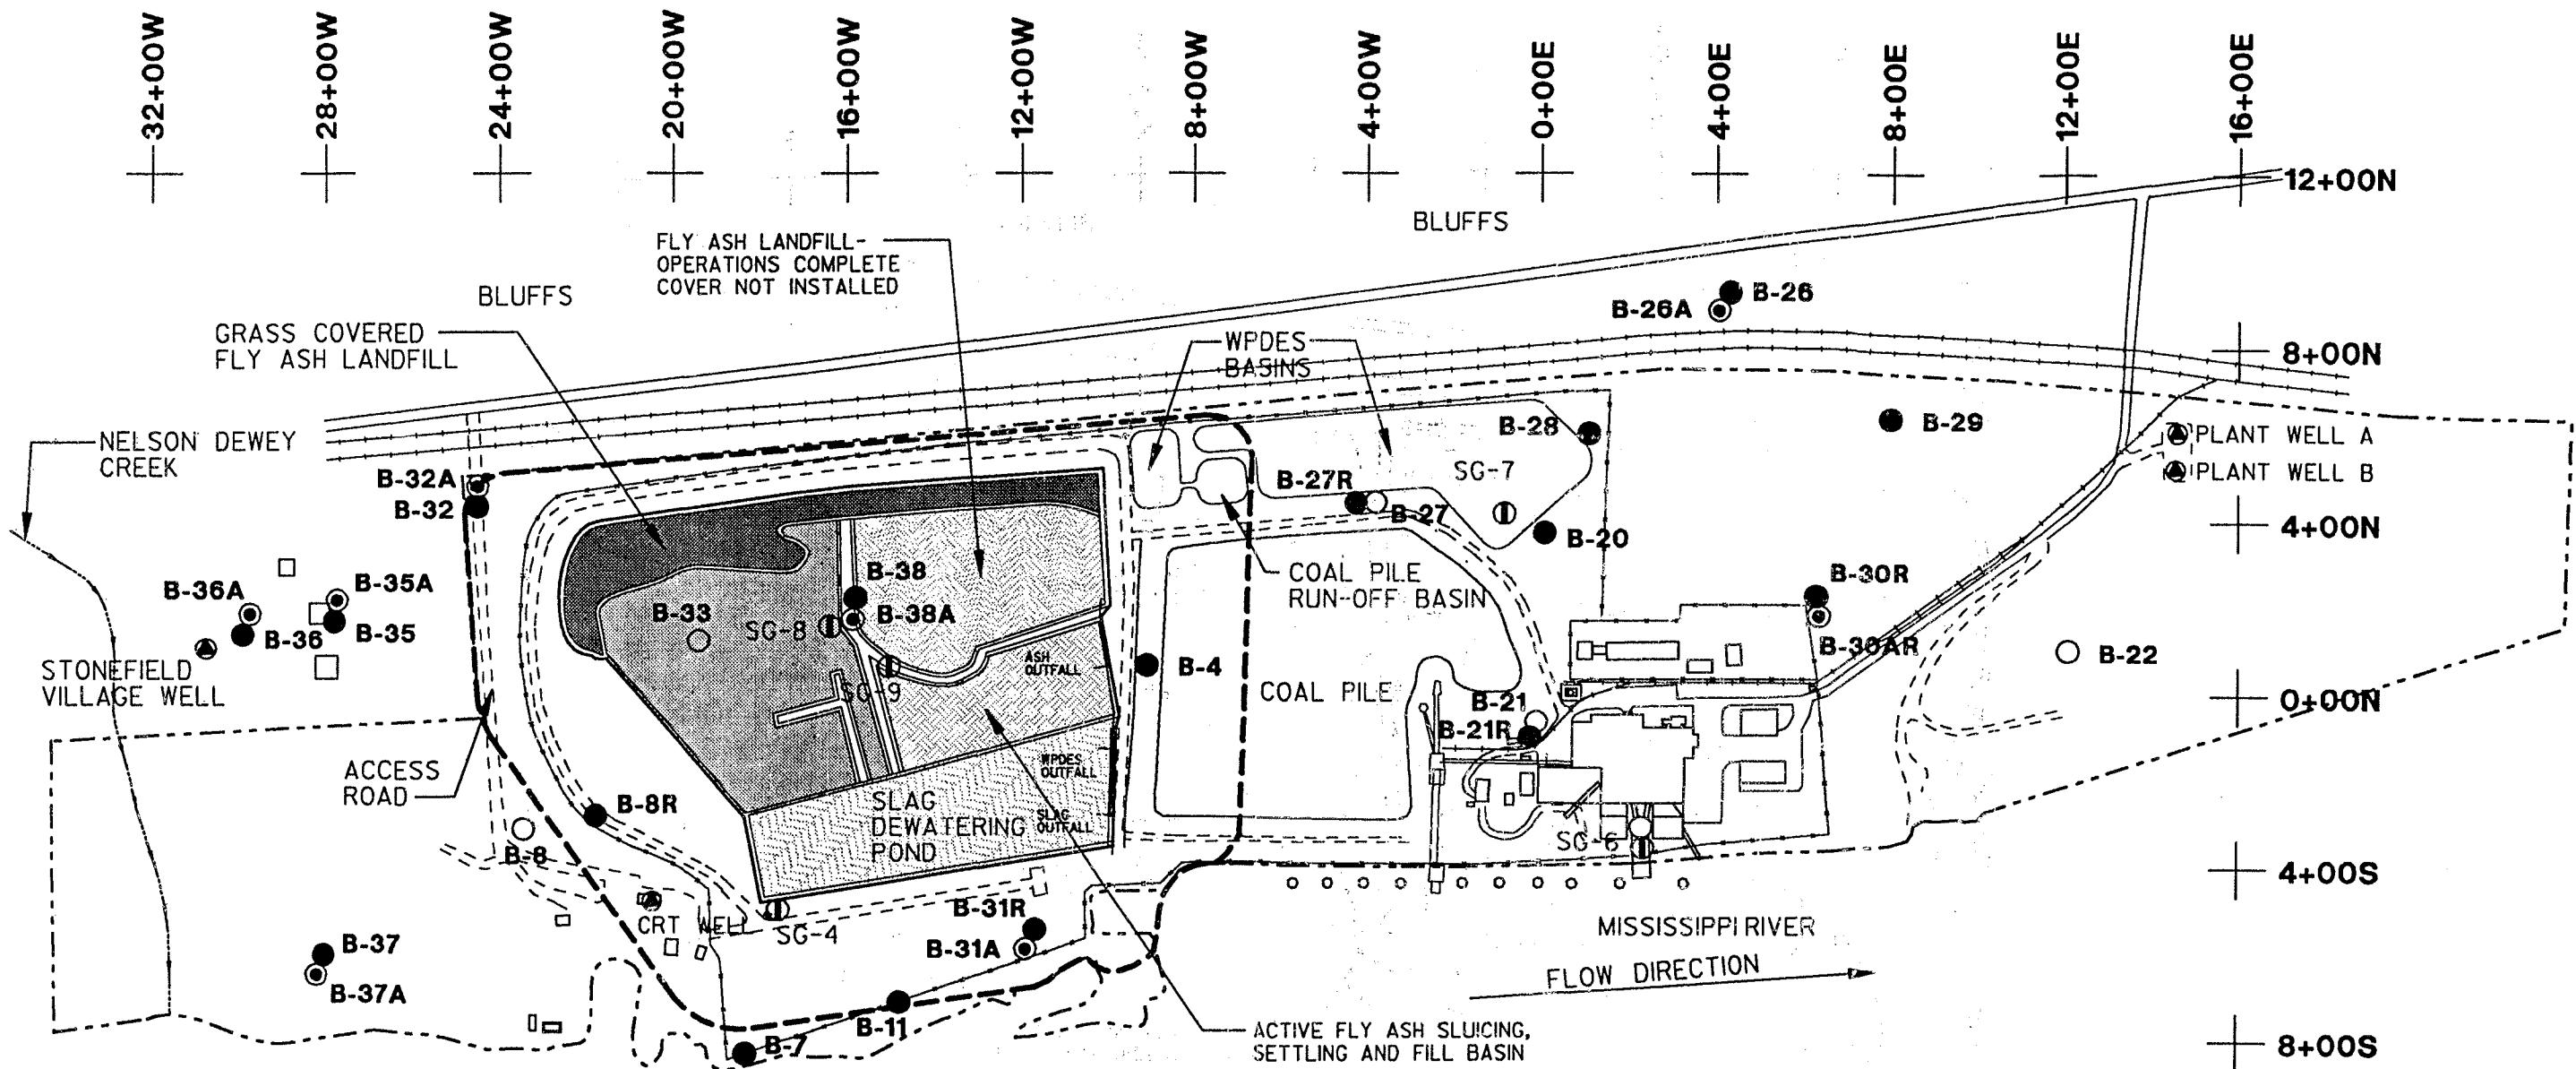


LEGEND

- B-28 WATER TABLE OBSERVATION WELL
- B-28A PIEZOMETER
- B-33 ABANDONED WELL
- CRT WELL WATER SUPPLY WELL
- ① SG-4 STAFF GAUGE
- APPROXIMATE LIMITS OF LICENSED LANDFILL
- - - RAILROAD TRACK
- - - ROAD
- - - PROPERTY LINE
- - - DESIGN MANAGEMENT ZONE
- + 8+00S LOCAL GRID
- BUILDINGS
- PILINGS

NOTES

- I. BASE MAP WELLHEAD LOCATIONS SURVEYED BY SCHMITT ENGINEERING IN OCTOBER 1993.
2. OTHER SITE INFORMATION PROVIDED BY WP&L.

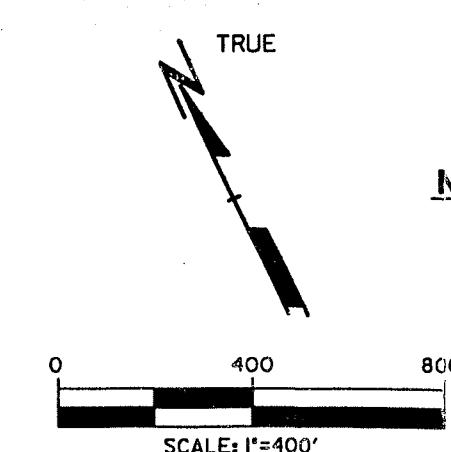

WISCONSIN POWER & LIGHT
NELSON DEWEY GENERATING STATION
EXISTING CONDITIONS
OCTOBER 1993

Drawn By	CDH
Approved By	ELM
Date	OCTOBER 1994
Proj. #	276703
File #	276703OLDGM

OCT 31 1994

FIGURE 4

TABLE 5
SUMMARY OF LEACHING TEST RESULTS

	Fly Ash		Slag
Year	1983	1990 to 1992	1987 to 1992
Coal Type	Eastern (and Western)	Western (and Eastern)	Western (and Eastern) *
Water/Solid Ratio	2:1	4:1	4:1
Extraction Time	24 hours	48 hours	48 hours
Number of Samples	1	3	6
Arsenic (mg/L)	< 0.001	0.05 to 2.02	< 0.002 to 0.081
Selenium (mg/L)	NA	0.42 to 160	< 0.002 to 0.045
Boron (mg/L)	420	4.63 to 37.34	< 0.010 to 1.05
Iron (mg/L)	NA	NA	< 0.02 to 0.98
Sulfate (mg/L)	13,070	2,000 to 16,700	2.0 to < 5.0
pH (SU)	6.6	10.3 to 12.5	5.6 to 9.9

NOTES:

1. 1983 fly ash leaching data from RMT (1984); remaining leaching data provided by WP&L.
2. NA = Not Analyzed.

PROJECT NUMBER: 1831.28
BEGINNING DATE: 01-JUN-93
ENDING DATE: 07-SEP-93

TABLE 6
SLAG AND ASH BASIN CHEMISTRY

PARAMETER	UNITS	FLY ASH BASIN	SLAG BASIN
		07-SEP-93	07-SEP-93
PARAMETER	UNITS	3302-011	3302-010
COLOR, FIELD		CLEAR	CLEAR
CONDUCTANCE, SPECIFIC	UMHOS/CM	5190	400
ODOR, FIELD		NONE	NONE
PH, FIELD	SU	8.1	7.4
TEMPERATURE	DEG C	17	18
TURBIDITY, FIELD		SLIGHT	SLIGHT
ALKALINITY AS CACO ₃	MG/L	230	160
HARDNESS AS CACO ₃	MG/L	930	200
SOLIDS, TOTAL DISSOLVED	MG/L	410	300
SULFATE	MG/L	3300	50
ARSENIC, TOTAL	UG/L	60	8.0
BARIUM, TOTAL	UG/L	270	150
BORON, TOTAL	UG/L	2300	210
CADMIUM, TOTAL	UG/L	5.4	< 0.30
CHROMIUM, TOTAL	UG/L	11	< 10
IRON, TOTAL	UG/L	1600	2000
LEAD, TOTAL	UG/L	< 3.0	< 3.0
MERCURY, TOTAL	UG/L	< 0.20	< 0.20
SELENIUM, TOTAL	UG/L	36	I 2.1 L
SILVER, TOTAL	UG/L	< 1.0	< 1.0

PROJECT NUMBER: 1831.28
 BEGINNING DATE: 01-JUN-93
 ENDING DATE: 29-OCT-93

TABLE 8
 GROUNDWATER CHEMISTRY

PARAMETER	UNITS	B-04 01-JUN-93	B-04 07-SEP-93	B-07 ND 01-JUN-93	B-07 ND 07-SEP-93	B-08 01-JUN-93	B-08R 07-SEP-93
		1670-015	3293-010	1670-020	3302-004	1670-001	3293-009
COLOR, FIELD		CLEAR	CLEAR	CLEAR	CLEAR	CLEAR	CLEAR
CONDUCTANCE, SPECIFIC	UMHOS/CM	1160	1240	460	550	670	1160
DEPTH TO WATER	FEET	9.90	12.75	12.83	16.12	5.68	20.13
ODOR, FIELD		NONE	NONE	NONE	NONE	NONE	NONE
PH, FIELD	SU	7.3	7.5	7.0	6.9	7.1	6.8
TEMPERATURE	DEG C	15	10	14	12	15	7
TURBIDITY, FIELD		NONE	SLIGHT	NONE	SLIGHT	NONE	MODERATE
WATER ELEVATION	FEET	610.68	607.83	610.97	607.68	610.51	
ALKALINITY AS CACO ₃	MG/L	72	92	160	190	220	440
CHLORIDE	MG/L	18	23	17	15	9.4	2.8
COD	MG/L						
FLUORIDE	MG/L	0.58	5.5	0.26	0.32	< 0.10	0.12
HARDNESS AS CACO ₃	MG/L	220	120	210	250	370	620
NITROGEN, NITRATE + NITRITE	MG/L	0.15	0.33	< 0.050	< 0.050	< 0.050	4.2
SOLIDS, TOTAL DISSOLVED	MG/L	900	940	300	360	460	770
SULFATE	MG/L	500	560	74	100	180	180
ARSENIC, DISSOLVED	UG/L	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0
BARIUM, DISSOLVED	UG/L	68	< 50	61	73	63	50
BORON, DISSOLVED	UG/L	1900	4200	230	< 200	2200	9400
CADMIUM, DISSOLVED	UG/L	< 0.30	< 0.30	< 0.30	< 0.30	< 0.30	0.38
CHROMIUM, DISSOLVED	UG/L	< 10	< 10	< 10	< 10	< 10	< 10
COPPER, DISSOLVED	UG/L	< 20	< 20	< 20	< 20	< 20	< 20
IRON, DISSOLVED	UG/L	720	890	2800	4100	< 100	< 100
LEAD, DISSOLVED	UG/L	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0
MANGANESE, DISSOLVED	UG/L	1200	720	970	1500	17	3400
MERCURY, DISSOLVED	UG/L	< 0.20	< 0.20	< 0.20	< 0.20	< 0.20	< 0.20
SELENIUM, DISSOLVED	UG/L	6.9	3.2	< 1.0	< 1.0	< 1.0	34
SILVER, DISSOLVED	UG/L	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
ZINC, DISSOLVED	UG/L	1000	100	22	< 20	220	< 20

PROJECT NUMBER: 1831.28
 BEGINNING DATE: 01-JUN-93
 ENDING DATE: 29-OCT-93

TABLE 8
 GROUNDWATER CHEMISTRY

PARAMETER	UNITS	B-11	B-11	B-20	B-26	B-26	B-26A
		07-SEP-93	29-OCT-93	07-SEP-93	01-JUN-93	07-SEP-93	01-JUN-93
COLOR, FIELD		X0001	3485-001	X0002	1670-022	3302-005	1670-023
CONDUCTANCE, SPECIFIC	UMHOS/CM	1500		310	610	670	660
DEPTH TO WATER	FEET	15.91		10.81	16.22	18.85	16.20
ODOR, FIELD				NONE	NONE	NONE	
PH, FIELD	SU			7.1	7.2	7.0	
TEMPERATURE	DEG C	13	13	14	14	11	15
TURBIDITY, FIELD				NONE	SLIGHT	NONE	
WATER ELEVATION	FEET			610.18	607.55	610.19	
ALKALINITY AS CACO ₃	MG/L		470		320	300	340
CHLORIDE	MG/L				21	43	33
COD	MG/L						
FLUORIDE	MG/L			< 0.10	0.15	< 0.10	
HARDNESS AS CACO ₃	MG/L		810		390	410	400
NITROGEN, NITRATE + NITRITE	MG/L				2.6	4.9	2.0
SOLIDS, TOTAL DISSOLVED	MG/L		520		440	450	450
SULFATE	MG/L		360		34	34	33
ARSENIC, DISSOLVED	UG/L		8.4	< 3.0	< 3.0	< 3.0	< 3.0
BARIUM, DISSOLVED	UG/L		100		62	68	96
BORON, DISSOLVED	UG/L		5100	< 200	< 200	< 200	< 200
CADMIUM, DISSOLVED	UG/L		< 0.30	< 0.30	< 0.30	< 0.30	< 0.30
CHROMIUM, DISSOLVED	UG/L		< 10	< 10	< 10	< 10	< 10
COPPER, DISSOLVED	UG/L			< 20	< 20	< 20	< 20
IRON, DISSOLVED	UG/L		55000	< 100	< 100	< 100	< 100
LEAD, DISSOLVED	UG/L		< 3.0	< 3.0	< 3.0	< 3.0	< 3.0
MANGANESE, DISSOLVED	UG/L			< 5.0	< 5.0	< 5.0	< 5.0
MERCURY, DISSOLVED	UG/L		< 0.20	< 0.20	< 0.20	< 0.20	< 0.20
SELENIUM, DISSOLVED	UG/L		< 1.0	LNP	< 1.0	L	< 1.0
SILVER, DISSOLVED	UG/L		< 10		< 1.0	< 1.0	< 1.0
ZINC, DISSOLVED	UG/L				< 20	< 20	< 20

PROJECT NUMBER: 1831.28
 BEGINNING DATE: 01-JUN-93
 ENDING DATE: 29-OCT-93

TABLE 8
 GROUNDWATER CHEMISTRY

PARAMETER	UNITS	B-26A 07-SEP-93	B-27R 07-SEP-93	B-28 01-JUN-93	B-28 07-SEP-93	B-29 07-SEP-93	B-30AR 01-JUN-93
		3302-006	X0003	1670-014	3302-003	X0004	1670-013
COLOR, FIELD		CLEAR		CLEAR	CLEAR		CLEAR
CONDUCTANCE, SPECIFIC	UMHOS/CM	440	370	190	230	360	220
DEPTH TO WATER	FEET	18.84	14.67	6.40	9.08	9.57	12.33
ODOR, FIELD		NONE		NONE	NONE		NONE
PH, FIELD	SU	7.2		6.1	6.0		7.2
TEMPERATURE	DEG C	11	14	17	15	15	17
TURBIDITY, FIELD		NONE		SLIGHT	MODERATE		NONE
WATER ELEVATION	FEET	607.55		610.46	607.74	607.26	610.11
ALKALINITY AS CACO ₃	MG/L	340		26	54		200
CHLORIDE	MG/L	25		4.6	11		13
COD	MG/L						7.3
FLUORIDE	MG/L	0.15		< 0.10	< 0.10		0.10
HARDNESS AS CACO ₃	MG/L	410		82	110		220
NITROGEN, NITRATE + NITRITE	MG/L	1.8		2.7	0.60		< 0.050
SOLIDS, TOTAL DISSOLVED	MG/L	440		140	160		280
SULFATE	MG/L	38		45	42		27
ARSENIC, DISSOLVED	UG/L	< 3.0		< 3.0	< 3.0		< 3.0
BARIUM, DISSOLVED	UG/L	86		< 50	52		< 50
BORON, DISSOLVED	UG/L	< 200		< 200	< 200		< 200
CADMIUM, DISSOLVED	UG/L	< 0.30		< 0.30	< 0.30		< 0.30
CHROMIUM, DISSOLVED	UG/L	< 10		< 10	< 10		< 10
COPPER, DISSOLVED	UG/L	< 20		< 20	< 20		< 20
IRON, DISSOLVED	UG/L	< 100		210	< 100		< 100
LEAD, DISSOLVED	UG/L	< 3.0		< 3.0	< 3.0		< 3.0
MANGANESE, DISSOLVED	UG/L	< 5.0		8.6	< 5.0		< 5.0
MERCURY, DISSOLVED	UG/L	< 0.20		< 0.20	< 0.20		< 0.20
SELENIUM, DISSOLVED	UG/L	< 1.0	LN	< 1.0	L	< 1.0	L
SILVER, DISSOLVED	UG/L	< 1.0		< 1.0	< 1.0		< 1.0
ZINC, DISSOLVED	UG/L	< 20		< 20	< 20		< 20

PROJECT NUMBER: 1831.28
 BEGINNING DATE: 01-JUN-93
 ENDING DATE: 29-OCT-93

TABLE 8
 GROUNDWATER CHEMISTRY

PARAMETER	UNITS	B-30AR 07-SEP-93	B-30R 01-JUN-93	B-30R 07-SEP-93	B-31A 01-JUN-93	B-31A 07-SEP-93	B-31R 01-JUN-93
		3302-002	1670-012	3302-001	1670-019	3293-011	1670-018
COLOR, FIELD		CLEAR	CLEAR	CLEAR	CLEAR	CLEAR	CLEAR
CONDUCTANCE, SPECIFIC	UMHOS/CM	410	420	360	700	800	640
DEPTH TO WATER	FEET	15.37	12.25	15.17	12.21	15.93	11.56
ODOR, FIELD		NONE	NONE	NONE	NONE	NONE	NONE
PH, FIELD	SU	7.3	7.0	6.8	6.9	7.3	6.8
TEMPERATURE	DEG C	12	16	14	17	14	17
TURBIDITY, FIELD		NONE	MODERATE	MODERATE	NONE	SLIGHT	SLIGHT
WATER ELEVATION	FEET	607.07	610.10	607.18	610.46	606.74	610.85
ALKALINITY AS CACO ₃	MG/L	190	160	140	170	160	240
CHLORIDE	MG/L	14	13	6.6	16	17	11
COD	MG/L		9.7				
FLUORIDE	MG/L	0.16	< 0.10	< 0.10	0.39	0.43	< 0.10
HARDNESS AS CACO ₃	MG/L	230	210	210	120	160	330
NITROGEN, NITRATE + NITRITE	MG/L	< 0.050	8.5	8.8	< 0.050	< 0.050	< 0.050
SOLIDS, TOTAL DISSOLVED	MG/L	280	280	230	510	570	510
SULFATE	MG/L	25	25	26	250	250	150
ARSENIC, DISSOLVED	UG/L	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0
BARIUM, DISSOLVED	UG/L	< 50	< 50	< 50	54	66	110
BORON, DISSOLVED	UG/L	< 200	< 200	< 200	2900	2100	2900
CADMIUM, DISSOLVED	UG/L	< 0.30	< 0.30	< 0.30	< 0.30	< 0.30	2.7
CHROMIUM, DISSOLVED	UG/L	< 10	< 10	< 10	< 10	< 10	< 10
COPPER, DISSOLVED	UG/L	< 20	< 20	< 20	< 20	< 20	110
IRON, DISSOLVED	UG/L	< 100	< 100	< 100	210	300	450
LEAD, DISSOLVED	UG/L	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0
MANGANESE, DISSOLVED	UG/L	< 5.0	< 5.0	< 5.0	4600	6000	440
MERCURY, DISSOLVED	UG/L	< 0.20	< 0.20	< 0.20	< 0.20	< 0.20	< 0.20
SELENIUM, DISSOLVED	UG/L	< 1.0	L	3.2	< 1.0	L	1.2
SILVER, DISSOLVED	UG/L	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
ZINC, DISSOLVED	UG/L	< 20	< 20	< 20	< 20	< 20	27

PROJECT NUMBER: 1831.28
 BEGINNING DATE: 01-JUN-93
 ENDING DATE: 29-OCT-93

TABLE 8
 GROUNDWATER CHEMISTRY

PARAMETER	UNITS	B-31R 07-SEP-93	B-32 01-JUN-93	B-32 07-SEP-93	B-32A 01-JUN-93	B-32A 07-SEP-93	B-35 01-JUN-93
		3293-012	1670-002	3293-016	1670-003	3293-017	1670-004
COLOR, FIELD		CLEAR	CLEAR	CLEAR	CLEAR	CLEAR	L YLW/BN
CONDUCTANCE, SPECIFIC	UMHOS/CM	480	300	330	610	1320	1070
DEPTH TO WATER	FEET	14.44	3.37	6.22	3.59	6.46	10.10
ODOR, FIELD		NONE	NONE	NONE	NONE	NONE	NONE
PH, FIELD	SU	7.0	6.3	5.6	7.0	6.8	6.3
TEMPERATURE	DEG C	15	13	14	13	14	12
TURBIDITY, FIELD		MODERATE	SLIGHT	MODERATE	NONE	SLIGHT	SLIGHT
WATER ELEVATION	FEET	607.97	610.80	607.95	610.81	607.94	610.66
ALKALINITY AS CACO ₃	MG/L	190	140	140	330	320	190
CHLORIDE	MG/L	11	6.7	6.9	7.0	7.6	110
COD	MG/L						
FLUORIDE	MG/L	0.18	< 0.10	0.12	0.12	0.19	< 0.10
HARDNESS AS CACO ₃	MG/L	240	160	180	350	390	260
NITROGEN, NITRATE + NITRITE	MG/L	< 0.050	0.68	1.2	1.1	1.3	36
SOLIDS, TOTAL DISSOLVED	MG/L	340	200	240	380	420	800
SULFATE	MG/L	71	11	16	29	30	35
ARSENIC, DISSOLVED	UG/L	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	7.4
BARIUM, DISSOLVED	UG/L	81	100	120	98	91	100
BORON, DISSOLVED	UG/L	1100	< 200	< 200	< 200	< 200	210
CADMIUM, DISSOLVED	UG/L	1.1	< 0.30	0.38	< 0.30	0.35	< 0.30
CHROMIUM, DISSOLVED	UG/L	< 10	< 10	< 10	< 10	< 10	< 10
COPPER, DISSOLVED	UG/L	< 20	< 20	< 20	< 20	< 20	21
IRON, DISSOLVED	UG/L	210	< 100	< 100	< 100	< 100	< 100
LEAD, DISSOLVED	UG/L	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0
MANGANESE, DISSOLVED	UG/L	360	< 5.0	280	6.9	33	< 5.0
MERCURY, DISSOLVED	UG/L	< 0.20	< 0.20	< 0.20	< 0.20	< 0.20	< 0.20
SELENIUM, DISSOLVED	UG/L	< 1.0	L	< 1.0	L	< 1.0	L
SILVER, DISSOLVED	UG/L	< 1.0		< 1.0		< 1.0	< 1.0
ZINC, DISSOLVED	UG/L	< 20	< 20	< 20	< 20	< 20	< 20

PROJECT NUMBER: 1831.28
 BEGINNING DATE: 01-JUN-93
 ENDING DATE: 29-OCT-93

TABLE 8
 GROUNDWATER CHEMISTRY

PARAMETER	UNITS	B-35 07-SEP-93 3293-002	B-35A 01-JUN-93 1670-005	B-35A 07-SEP-93 3293-003	B-36 01-JUN-93 1670-007	B-36 07-SEP-93 3293-004	B-36A 01-JUN-93 1670-006
COLOR, FIELD		YELLOW	CLEAR	CLEAR	CLEAR	CLEAR	CLEAR
CONDUCTANCE, SPECIFIC	UMHOS/CM	1050	620	680	430	500	620
DEPTH TO WATER	FEET	13.13	10.55	13.57	10.86	13.97	11.11
ODOR, FIELD		NONE	NONE	NONE	NONE	NONE	NONE
PH, FIELD	SU	6.8	7.0	7.1	6.3	7.0	7.1
TEMPERATURE	DEG C	14	13	12	12	13	13
TURBIDITY, FIELD		SLIGHT	NONE	NONE	SLIGHT	MODERATE	NONE
WATER ELEVATION	FEET	607.63	610.63	607.61	610.60	607.49	610.35
ALKALINITY AS CACO ₃	MG/L	210	330	320	230	210	330
CHLORIDE	MG/L	80	26	24	4.4	25	12
COD	MG/L						
FLUORIDE	MG/L	0.19	< 0.10	0.13	< 0.10	0.14	< 0.10
HARDNESS AS CACO ₃	MG/L	290	380	400	240	280	350
NITROGEN, NITRATE + NITRITE	MG/L	39	1.7	2.0	< 0.050	1.4	0.83
SOLIDS, TOTAL DISSOLVED	MG/L	770	480	460	280	350	400
SULFATE	MG/L	43	33	37	15	18	36
ARSENIC, DISSOLVED	UG/L	3.6	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0
BARIUM, DISSOLVED	UG/L	120	< 50	54	110	120	68
BORON, DISSOLVED	UG/L	220	< 200	< 200	< 200	< 200	< 200
CADMIUM, DISSOLVED	UG/L	< 0.30	< 0.30	< 0.30	< 0.30	< 0.30	< 0.30
CHROMIUM, DISSOLVED	UG/L	< 10	< 10	< 10	< 10	< 10	< 10
COPPER, DISSOLVED	UG/L	24	< 20	< 20	< 20	< 20	< 20
IRON, DISSOLVED	UG/L	< 100	< 100	< 100	< 100	< 100	< 100
LEAD, DISSOLVED	UG/L	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0
MANGANESE, DISSOLVED	UG/L	< 5.0	< 5.0	< 5.0	< 5.0	55	< 5.0
MERCURY, DISSOLVED	UG/L	< 0.20	< 0.20	< 0.20	< 0.20	< 0.20	< 0.20
SELENIUM, DISSOLVED	UG/L	< 1.0	L	< 1.0	L	1.0	L
SILVER, DISSOLVED	UG/L	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
ZINC, DISSOLVED	UG/L	< 20	< 20	< 20	< 20	< 20	< 20

PROJECT NUMBER: 1831.28
 BEGINNING DATE: 01-JUN-93
 ENDING DATE: 29-OCT-93

TABLE 8
 GROUNDWATER CHEMISTRY

PARAMETER	UNITS	B-36A 07-SEP-93 3293-005	B-37 07-SEP-93 3302-007	B-37A 07-SEP-93 3302-008	B-38 01-JUN-93 1670-016	B-38 07-SEP-93 3293-006	B-38A 01-JUN-93 1670-017
COLOR, FIELD		CLEAR	CLEAR	CLEAR	CLEAR	CLEAR	CLEAR
CONDUCTANCE, SPECIFIC	UMHOS/CM	620	510	770	3630	2830	2760
DEPTH TO WATER	FEET	14.18	8.13	8.14	18.53	20.19	24.87
ODOR, FIELD		NONE	NONE	NONE	NONE	NONE	NONE
PH, FIELD	SU	7.1	7.3	7.3	8.3	9.9	7.7
TEMPERATURE	DEG C	11	13	11	20	20	15
TURBIDITY, FIELD		NONE	SLIGHT	NONE	NONE	SLIGHT	NONE
WATER ELEVATION	FEET	607.51	606.69	606.69	617.29	615.63	610.96
ALKALINITY AS CACO ₃	MG/L	330	200	190	100	420	80
CHLORIDE	MG/L	13	6.8	11	26	24	23
COD	MG/L						
FLUORIDE	MG/L	0.14	< 0.10	< 0.10	1.8	2.6	1.1
HARDNESS AS CACO ₃	MG/L	390	290	410	620	21	500
NITROGEN, NITRATE + NITRITE	MG/L	0.85	1.2	< 0.050	1.7	0.29	1.6
SOLIDS, TOTAL DISSOLVED	MG/L	420	380	590	3000	2200	2300
SULFATE	MG/L	36	100	240	2600	1200	2000
ARSENIC, DISSOLVED	UG/L	< 3.0	< 3.0	< 3.0	180	90	38
BARIUM, DISSOLVED	UG/L	68	< 50	< 50	110	< 50	58
BORON, DISSOLVED	UG/L	< 200	3100	7400	2500	2600	2200
CADMIUM, DISSOLVED	UG/L	< 0.30	< 0.30	< 0.30	< 0.30	< 0.30	< 0.30
CHROMIUM, DISSOLVED	UG/L	< 10	< 10	< 10	68	< 10	52
COPPER, DISSOLVED	UG/L	< 20	< 20	< 20	< 20	< 20	< 20
IRON, DISSOLVED	UG/L	< 100	< 100	< 100	< 100	< 100	< 100
LEAD, DISSOLVED	UG/L	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0	< 3.0
MANGANESE, DISSOLVED	UG/L	< 5.0	< 5.0	55	< 5.0	< 5.0	< 5.0
MERCURY, DISSOLVED	UG/L	< 0.20	< 0.20	< 0.20	< 0.20	< 0.20	< 0.20
SELENIUM, DISSOLVED	UG/L	< 1.0	L	< 1.0	L	57	320
SILVER, DISSOLVED	UG/L	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0
ZINC, DISSOLVED	UG/L	< 20	< 20	< 20	< 20	< 20	< 20

PROJECT NUMBER: 1831.28
BEGINNING DATE: 01-JUN-93
ENDING DATE: 29-OCT-93

TABLE 8
GROUNDWATER CHEMISTRY

B-38A
07-SEP-93

PARAMETER UNITS 3293-007

COLOR, FIELD		CLEAR
CONDUCTANCE, SPECIFIC	UMHOS/CM	3280
DEPTH TO WATER	FEET	27.59
ODOR, FIELD		NONE
PH, FIELD	SU	9.0
TEMPERATURE	DEG C	16
TURBIDITY, FIELD		NONE
WATER ELEVATION	FEET	608.24
ALKALINITY AS CACO ₃	MG/L	90
CHLORIDE	MG/L	21
COD	MG/L	
FLUORIDE	MG/L	3.4
HARDNESS AS CACO ₃	MG/L	390
NITROGEN, NITRATE + NITRITE	MG/L	0.59
SOLIDS, TOTAL DISSOLVED	MG/L	2600
SULFATE	MG/L	1800
ARSENIC, DISSOLVED	UG/L	51
BARIUM, DISSOLVED	UG/L	54
BORON, DISSOLVED	UG/L	3300
CADMUM, DISSOLVED	UG/L	< 0.30
CHROMIUM, DISSOLVED	UG/L	11
COPPER, DISSOLVED	UG/L	< 20
IRON, DISSOLVED	UG/L	< 100
LEAD, DISSOLVED	UG/L	< 3.0
MANGANESE, DISSOLVED	UG/L	< 5.0
MERCURY, DISSOLVED	UG/L	< 0.20
SELENIUM, DISSOLVED	UG/L	57
SILVER, DISSOLVED	UG/L	< 1.0
ZINC, DISSOLVED	UG/L	< 20

Appendix C

2016 Low-Hazard Waste Exemption Leaching Test Results – Slag and Ash

Sediment and Soil Analytical Results - Water Leach Test Results
WPL Nelson Dewey

Sample	Date	Depth (feet)	Material Type	Lab Notes	Boron (ug/L)	Chloride (mg/L)	Sulfate (mg/L)	TDS (mg/L)
WPDES POND								
SED-1	8/3/2016	0-1.3	Fly Ash	--	240	4.3	4.4	54
SED-2	8/3/2016	0-1.0	Fly Ash	--	200	4.3	11.5	60
QC-3 (SED-2)	8/3/2016	0-1	Fly Ash	--	240	3.5 J	6.1	52
SED-3	7/20/2016	0-4.5	Slag	--	130	2.7 J	5	28
	7/20/2016	4.5-5.5	SP	--	<50	2.5 J	<2.0	14 J
SED-4	7/19/2016	0-4.8	ML	--	510	10.5 J	11.9 J	86
	7/19/2016	4.8-5.5		--	74 J	NA	NA	NA
GP-19	8/4/2016	8-12	SM	--	62 J	2.4 J	2 J	16 J
SLAG POND								
SED-5	7/20/2016	0-1.6	ML-OL	--	54 J	3.2 J	33.3	90
SED-6	7/20/2016	0-1.0	ML	--	60 J	3.7 J	59.1	130
SED-7	8/4/2016	0-3.0	Fly Ash	--	88 J	4	10.5	76
SED-8	8/4/2016	1.0-1.5	Fly Ash	--	82 J	3.7 J	12.1	74
COAL YARD								
TP-CY-1	7/19/2016	0-0.5	Coal	--	140	<20.0	<20.0	32
	7/19/2016	3.0-3.5	SM	--	100 J	2.8 J	<2.0	20
TP-CY-3	7/20/2016	1.9-2.1	GM	--	<50	3.9 J	2.8 J	50
	7/20/2016	4.8-5.5	SM	--	NA	NA	NA	NA
TP-CY-4	7/19/2016	0-2.8	Coal	--	190	<20.0	<20.0	38
	7/19/2016	2.8-3.2	GP & SM	--	<50	<10.0	<10.0	34
	7/19/2016	3.6-4.8	Slag	--	<50	<20.0	<20.0	10 J
	7/19/2016	4.8-5.0		--	NA	NA	NA	NA
TP-CY-6	7/19/2016	0-0.5	Coal	--	190	<20.0	<20.0	54
	7/19/2016	0.7-1.0	SP	--	<50	2.5 J	2.3 J	30
TP-CY-10	7/19/2016	0-0.5	Coal	--	120	2.4 J	11.6	48
	7/19/2016	1.0-2.0	SM	--	<50	2.2 J	2.3 J	28
TP-CY-12	7/20/2016	0-0.3	Coal	--	160	<20.0	<20.0	44
	7/20/2016	0.3-2.0	SP	--	<50	2.2 J	2.2 J	24
	7/20/2016	2.0-2.7	SP	--	<50	2.3 J	27.5	50
QC-1 (TP-CY-12)	7/20/2016	0.3-2.0	SP	--	<50	2.6 J	2.5 J	24
SLAG HANDLING AREA								
GP-5	8/3/2016	12.5-15	Fly Ash	--	100	<2.0	3.0 J	22
	8/3/2016	18-24	ML & SM	--	99 J	3.3 J	<2.0	24
GP-7	8/3/2016	7.5-18	Slag	--	<50	2.2 J	<2.0	<8.7
QC-2 (GP-7)	8/3/2016	7.5-18	Slag	--	<50	2.2 J	<2.0	10 J
GP-14	8/4/2016	12.5-15	Fly Ash	--	120	<2.0	13.4	96
SLAG SAMPLES¹								
Slag 01 ²	6/3/2013	--	Slag	--	NA	NA	NA	NA
Slag 01	12/23/2013	--	Slag	--	12.5 AB	0.277 B	0.218	NA
NED Slag Composite 2014	7/1/2014	--	Slag	--	11.7 AB ^{*^}	< 0.142	0.457 B	98 H
Slag Sample	4/14/2015	--	Slag	--	< 1020 A	0.751	0.427	NA

Sediment and Soil Analytical Results - Water Leach Test Results
WPL Nelson Dewey

Sample	Date	Depth (feet)	Material Type	Lab Notes	Boron (ug/L)	Chloride (mg/L)	Sulfate (mg/L)	TDS (mg/L)
FLY ASH SAMPLES¹								
NED Flyash Composite ²	2/14/2014	--	Fly Ash	--	NA	NA	6,530 B	NA
Week of 062815 ²	7/3/2015	--	Fly Ash	--	NA	NA	6,260	NA
Week of 010916	1/4/2016	--	Fly Ash	--	NA	NA	NA	NA
NR 140 Preventative Action Limits (PALs)					200	125	125	NE
NR 140 Enforcement Standards (ESs)					1000	250	250	NE
40 CFR Part 141.62 Maximum Contaminant Levels (MCL)					NE	NE	NE	NE
NR 538 Table 1A Standards					190	125	125	NE
NR 538 Table 2A Standards					1900	1,250	1,250	NE

Abbreviations:

mg/L = micrograms per liter	NE = No Standard Established	NA = Not Analyzed	GM = Silty Gravel
ML = Silt	ML-CL = Silty Clay	SM = Silty Sand	GP = Poorly Graded Gravel
ML-OL = Silty Organic Clay	SP = Poorly Graded Sand	ML-OL = Silty Organic Clay	TDS = Total Dissolved Solids

Notes:

1. Slag and Fly Ash samples were collected by the plant as part of permit requirements.
 2. Sample was analyzed using the SPLP Leach Method rather than the ASTM Water Leach Method for tested parameters except for Sulfate.
- NR 140 ESs - Wisconsin Administrative Code (WAC), Chapter NR 140.10 Table 1 - Public Health Groundwater Quality Standards from July 2015 and WAC, Chapter NR 140.12 Table 2 - Public Welfare Groundwater Quality Standards from July 2015.
- NR 140 PALs - WAC, Chapter NR 140.10 Table 1 - Public Health Groundwater Quality Standards from July 2015 and WAC, Chapter NR 140.12 Table 2 - Public Welfare Groundwater Quality Standards from July 2015.

Laboratory Notes/Qualifiers:

J = Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.
A = Result is less than the RL but greater than or equal to the MDL and the concentration is an approximate value.
B = Compound was found in the blank and sample.
F1 = MS and/or MSD Recovery is outside acceptance limits.
H = Sample was prepped or analyzed beyond the specified holding time.
^ = ICV, CCV, ICB, CCB, ISA, ISB, CRA, DLCK or MRL standard: Instrument related QC is outside acceptance limits.
* = LCS or LCSD is outside acceptance limits.

Created by: RJG Date: 3/14/2016
Last revision by: RJG Date: 10/24/2016
Checked by: BSS Date: 10/24/2016

Original table prepared for Slag Pond Closure Low Hazard Waste Exemption Request (SCS Project #25216054.00).

Reformatted for the Alternative Source Demonstration to include only the parameters with SSIs that were included in the leach testing by NDK, 9/14/2020; SCC 10/1/2021.

I:\25223071.00\Deliverables\April 2023 ASD NED\Appendix C 2016 Leachate Results Slag and Ash\[Table 4. Sediment_Soil_Water Leach Results-Updated.xlsx]Leach Test - SSI Parameters

Table 4a. Sediment and Soil Analytical Results - Water Leach Test Metals
WPL Nelson Dewey / SCS Engineers Project #25216054.00
 (Results are in $\mu\text{g/L}$, except where noted otherwise)

Table 4a. Sediment and Soil Analytical Results - Water Leach Test Metals
WPL Nelson Dewey / SCS Engineers Project #25216054.00

Abbreviations:
 µg/L = micrograms per liter or parts per billion (ppb)
 ML = Silt

NA = Not Analyzed
 ML-CL = Silty Clay

NE = No Standard Established
 SM = Silty Sand

GM = Silty Gravel
 SP = Poorly Graded Sand
 GP = Poorly Graded Gravel

Notes:
 1. Slag and Fly Ash samples were collected by the plant as part of permit requirements.

2. Sample was analyzed using the SPC-A Method rather than the ASTM Water Leach Method for tested parameters except for Sulfate.
 NR 140 ES+ - WAC, Chapter NR 140.10 Table 1 - Public Health Groundwater Quality Standards from July 2015 and WAC, Chapter NR 140.12 Table 2 - Public Welfare Groundwater Quality Standards from July 2015.
 NR 140 - WAC, Chapter NR 140.10 Table 1 - Public Health Groundwater Quality Standards from July 2015 and WAC, Chapter NR 140.12 Table 2 - Public Welfare Groundwater Quality Standards from July 2015.

Bold+underlined values meet or exceed NR 140 enforcement standards.

Italic+underlined values meet or exceed NR 140 preventive action limits.

Shaded values exceed NR 538 Table 1A Standards.

Red text exceeds NR 538 Table 2A Standards.

Laboratory Notes/Qualifiers:

J = Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

A = Result is less than the RL but greater than or equal to the MDL and the concentration is an approximate value.

B = Compound was found in the blank and sample.

F1 = MS end/or MSD Recovery is outside acceptance limits.

^ = ICV, CCV, ICB, ISA, ISB, CRA, DLCK or MRL standard: Instrument related QC is outside acceptance limits.

* = LCS or LCSD is outside acceptance limits.

Created by: RIG Date: 3/14/2016
 Last revision by: RIG Date: 10/24/2016
 Checked by: BS5 Date: 10/24/2016

I:\25223071.00\Deliverables\April 2023 ASD NED\Appendix C 2016 Leachate Results Slag and Ash\{Table 4. Sediment_Soil_Water Leach Results-Updated.xlsx\}4a. Leach Test - Metals

Table 4b. Sediment and Soil Analytical Results - Water Leach Test Additional Parameters
WPL Nelson Dewey / SCS Engineers Project #25216054.00
 (Results are in mg/L, except where noted otherwise)

Sample	Date	Depth (feet)	Material Type	Lab Notes	Chloride	Fluoride	Nitrite+ Nitrate	Total Kjeldahl Nitrogen	Sulfate	TDS
WPDES POND										
SED-1	8/3/2016	0-1.3	Fly Ash	--	4.3	<1.0	<0.095	0.69 J	4.4	54
SED-2	8/3/2016	0-1.0	Fly Ash	--	4.3	<1.0	<0.095	0.75	11.5	60
QC-3 (SED-2)	8/3/2016	0-1	Fly Ash	--	3.5 J	<1.0	<0.095	0.59 J	6.1	52
SED-3	7/20/2016	0-4.5	Slag	--	2.7 J	<1.0	<0.095	0.22 J	5	28
	7/20/2016	4.5-5.5	SP	--	2.5 J	<0.20	<0.095	0.22 J	<2.0	14 J
SED-4	7/19/2016	0-4.8	ML	--	10.5 J	<10.0	<0.095	1.4	11.9 J	86
GP-19	8/4/2016	8-12	SM	--	2.4 J	<1.0	<0.095	0.23 J	2 J	16 J
SLAG POND										
SED-5	7/20/2016	0-1.6	ML-OL	--	3.2 J	<1.0	<0.095	<0.22	33.3	90
SED-6	7/20/2016	0-1.0	ML	--	3.7 J	0.36 J	1.0	<0.22	59.1	130
SED-7	8/4/2016	0-3.0	Fly Ash	--	4	<1.0	<0.095	1.1	10.5	76
SED-8	8/4/2016	1.0-1.5	Fly Ash	--	3.7 J	<1.0	<0.095	1.1	12.1	74
COAL YARD										
TP-CY-1	7/19/2016	0-0.5	Coal	--	<20.0	<2.0	<0.095	0.26 J	<20.0	32
	7/19/2016	3.0-3.5	SM	--	2.8 J	<1.0	<0.095	0.28 J	<2.0	20
TP-CY-3	7/20/2016	1.9-2.1	GM	--	3.9 J	<0.20	<0.095	<0.22	2.8 J	50
TP-CY-4	7/19/2016	0-2.8	Coal	--	<20.0	<2.0	<0.095	0.81	<20.0	38
	7/19/2016	2.8-3.2	GP & SM	--	<10.0	<1.0	<0.095	<0.22	<10.0	34
	7/19/2016	3.6-4.8	Slag	--	<20.0	<2.0	<0.095	<0.22	<20.0	10 J
TP-CY-6	7/19/2016	0-0.5	Coal	--	<20.0	<2.0	<0.095	0.23 J	<20.0	54
	7/19/2016	0.7-1.0	SP	--	2.5 J	<0.20	<0.095	<0.22	2.3 J	30
TP-CY-10	7/19/2016	0-0.5	Coal	--	2.4 J	<1.0	<0.095	<0.22	11.6	48
	7/19/2016	1.0-2.0	SM	--	2.2 J	<1.0	<0.095	<0.22	2.3 J	28
TP-CY-12	7/20/2016	0-0.3	Coal	--	<20.0	<2.0	<0.095	0.26 J	<20.0	44
	7/20/2016	0.3-2.0	SP	--	2.2 J	<0.20	<0.095	<0.22	2.2 J	24
	7/20/2016	2.0-2.7	SP	--	2.3 J	<0.20	<0.095	<0.22	27.5	50
QC-1 (TP-CY-12)	7/20/2016	0.3-2.0	SP	--	2.6 J	<0.20	<0.095	<0.22	2.5 J	24
SLAG HANDLING AREA										
GP-5	8/3/2016	12.5-15	Fly Ash	--	<2.0	<1.0	0.11 J	<0.22	3.0 J	22
	8/3/2016	18-24	ML & SM	--	3.3 J	<1.0	<0.095	0.48 J	<2.0	24
GP-7	8/3/2016	7.5-18	Slag	--	2.2 J	<1.0	<0.095	0.22 J	<2.0	<8.7
QC-2 (GP-7)	8/3/2016	7.5-18	Slag	--	2.2 J	<1.0	<0.095	0.24 J	<2.0	10 J
GP-14	8/4/2016	12.5-15	Fly Ash	--	<2.0	<1.0	0.1 J	<0.22	13.4	96
SLAG SAMPLES¹										
Slag 01 ²	6/3/2013	--	Slag	--	NA	NA	NA	NA	NA	NA
Slag 01	12/23/2013	--	Slag	--	0.277 B	NA	0.923	NA	0.218	NA
NED Slag Composite 2014	7/1/2014	--	Slag	--	< 0.142	NA	< 0.045	NA	0.457 B	98 H
Slag Sample	4/14/2015	--	Slag	--	0.751	NA	< 0.045	NA	0.427	NA
FLY ASH SAMPLES¹										
NED Flyash Composite ²	2/14/2014	--	Fly Ash	--	NA	NA	NA	NA	6,530 B	NA
Week of 062815 ²	7/3/2015	--	Fly Ash	--	NA	NA	NA	NA	6,260	NA
Week of 010916	1/4/2016	--	Fly Ash	--	NA	NA	NA	NA	NA	NA
NR 140 Preventative Action Limits (PALs)					125	0.8	2	NE	125	NE
NR 140 Enforcement Standards (ESs)					250	4	10	NE	250	NE
40 CFR Part 141.62 Maximum Contaminant Levels (MCL)					NE	4	10	NE	NE	NE
NR 538 Table 1A Standards					125	0.8	2	NE	125	NE
NR 538 Table 2A Standards					1,250	8	20	NE	1,250	NE

Table 4b. Sediment and Soil Analytical Results - Water Leach Test Additional Parameters
WPL Nelson Dewey / SCS Engineers Project #25216054.00

Abbreviations:

mg/L = micrograms per liter
 ML = Silt

NE = No Standard Established
 ML-CL = Silty Clay

NA = Not Analyzed
 SM = Silty Sand

TDS = Total Dissolved Solids
 SP = Poorly Graded Sand

GM = Silty Gravel
 GP = Poorly Graded Gravel

Notes:

1. Slag and Fly Ash samples were collected by the plant as part of permit requirements.
 2. Sample was analyzed using the SPLP Leach Method rather than the ASTM Water Leach Method for tested parameters except for Sulfate.
- NR 140 ESs - Wisconsin Administrative Code (WAC), Chapter NR 140.10 Table 1 - Public Health Groundwater Quality Standards from July 2015 and WAC, Chapter NR 140.12 Table 2 - Public Welfare Groundwater Quality Standards from July 2015.
- NR 140 PALs - WAC, Chapter NR 140.10 Table 1 - Public Health Groundwater Quality Standards from July 2015 and WAC, Chapter NR 140.12 Table 2 - Public Welfare Groundwater Quality Standards from July 2015.

Bold+underlined values meet or exceed NR 140 enforcement standards.

Italic+underlined values meet or exceed NR 140 preventive action limits.

Shaded values exceed NR 538 Table 1A Standards.

Red text exceeds NR 538 Table 2A Standards.

Laboratory Notes/Qualifiers:

- J = Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.
 A = Result is less than the RL but greater than or equal to the MDL and the concentration is an approximate value.
 B = Compound was found in the blank and sample.
 F1 = MS and/or MSD Recovery is outside acceptance limits.
 H = Sample was prepped or analyzed beyond the specified holding time.
 ^ = ICV, CCV, ICB, CCB, ISA, ISB, CRI, CRA, DLCK or MRL standard: Instrument related QC is outside acceptance limits.
 * = LCS or LCSD is outside acceptance limits.

Created by:	<u>RJG</u>	Date: <u>3/14/2016</u>
Last revision by:	<u>RJG</u>	Date: <u>10/24/2016</u>
Checked by:	<u>BSS</u>	Date: <u>10/24/2016</u>

I:\25223071.00\Deliverables\April 2023 ASD NED\Appendix C 2016 Leachate Results Slag and Ash\[Table 4. Sediment_Soil_Water Leach Results-Updated.xlsx]4b. Leach Test - Parameters

Table 4c. Sediment and Soil Analytical Results - Water Leach Test Radiochemistry**WPL Nelson Dewey / SCS Engineers Project #25216054.00**

(Results are in pCi/L)

Sample	Date	Depth (feet)	Lab Notes	Radium-226	Radium-228	Total Radium
WPDES POND						
SED-4	7/19/2016	0-4.8	--	0.0858 ± 0.481 (0.922)	0.355 ± 0.483 (1.00)	0.441 ± 0.964 (1.92)
SLAG POND						
SED-6	7/20/2016	0-1.0	--	0.206 ± 0.905 (1.45)	2.97 ± 1.30 (2.14)	3.18 ± 2.21 (3.59)
COAL YARD						
TP-CY-10	7/19/2016	0-0.5	--	1.23 ± 0.996 (0.556)	0.915 ± 0.497 (0.891)	2.145 ± 1.493 (1.45)
SLAG HANDLING AREA						
GP-5	8/3/2016	12.5-15	--	0.0829 ± 0.586 (0.996)	0.447 ± 0.474 (0.981)	0.53 ± 1.06 (1.98)
GP-7	8/3/2016	7.5-18	--	-0.085 ± 0.683 (1.19)	0.446 ± 0.418 (0.843)	0.446 ± 1.1 (2.03)
NR 140 Preventive Action Limits (PALs)				NE	NE	NE
NR 140 Enforcement Standards (ESs)				NE	NE	NE
CFR 40 141.66 Maximum Contaminant Levels (MCL)				NE	NE	5
NR 538 Table 1A Standards				NE	NE	NE
NR 538 Table 2A Standards				NE	NE	NE

Abbreviations:pCi/L = picocuries per liter
ML-CL = Silty ClayNA = Not Analyzed
SM = Silty SandNE = No Standard Established
SP = Poorly Graded Sand

GM = Silty Gravel

ML = Silt

Notes:

NR 140 ESs - Wisconsin Administrative Code (WAC), Chapter NR 140.10 Table 1 - Public Health Groundwater Quality Standards from July 2015 and WAC, Chapter NR 140.12 Table 2 - Public Welfare Groundwater Quality Standards from July 2015.

NR 140 PALs - WAC, Chapter NR 140.10 Table 1 - Public Health Groundwater Quality Standards from July 2015 and WAC, Chapter NR 140.12 Table 2 - Public Welfare Groundwater Quality Standards from July 2015.

Bold+underlined values meet or exceed NR 140 enforcement standards.*Italic+underlined* values meet or exceed NR 140 preventive action limits.

Shaded values exceed NR 538 Table 1A Standards.

Red text exceeds NR 538 Table 2A Standards.

Created by: RJG Date: 3/14/2016
 Last revision by: RJG Date: 10/24/2016
 Checked by: BSS Date: 10/24/2016

I:\25223071.00\Deliverables\April 2023 ASD NED\Appendix C 2016 Leachate Results Slag and Ash\[Table 4. Sediment_Soil_Water Leach Results-Updated.xlsx]4c. Leach Test - Radium

Appendix D

Grant County Fluoride Data

**Fluoride Data in WDNR's Groundwater Retrieval Network (GRN) Database for
Water Supply Wells
Grant County, Wisconsin
Summary of Fluoride Detections**

Row Labels	Count of Result amount
FLUORIDE TOTAL	431
DETECT BETWEEN LOD & LOQ	101
NON-DETECT	46
NORMAL QUANTIFIED RESULT	284
(blank)	
(blank)	
Grand Total	431

Percent With Fluoride Detected	89%
---------------------------------------	------------

Data downloaded by NDK on 3/24/2020 (Data collected through 12/31/2019)

Fluoride Data in WDNR's Groundwater Retrieval Network (GRN) Database for Water Supply Wells**Grant County, Wisconsin****Average Detected Concentration of Fluoride, Sorted by Concentration**

Unique Well ID	Sample Count	Average Result
BF853	9	2.63
BF867	1	2.50
BF880	12	2.18
BF852	7	1.94
BF860	1	0.99
BF878	6	0.98
SJ588	1	0.91
BF879	8	0.84
BN874	2	0.53
BF851	4	0.52
BF857	5	0.51
BF882	9	0.51
CG483	8	0.40
BF859	5	0.37
AX751	9	0.37
BF858	5	0.36
BF868	7	0.29
BN872	2	0.28
NZ649	7	0.27
QL936	1	0.27
QL937	1	0.27
BF865	6	0.27
BF850	8	0.27
BF854	2	0.26
AU060	6	0.26
TG838	1	0.25
XV599	5	0.23
BF872	5	0.22
HK787	1	0.22
NS770	1	0.22
MK761	2	0.22
BF884	10	0.22
AK037	5	0.21
OK550	1	0.19
OJ246	1	0.19
BN901	9	0.18
BN869	3	0.18
QX207	1	0.18
AQ147	1	0.18
BV955	1	0.18

Fluoride Data in WDNR's Groundwater Retrieval Network (GRN) Database for Water Supply Wells**Grant County, Wisconsin****Average Detected Concentration of Fluoride, Sorted by Concentration**

Unique Well ID	Sample Count	Average Result
LM589	1	0.18
HQ513	1	0.18
BN865	4	0.18
BN908	4	0.18
KW598	8	0.17
FS460	1	0.17
UX756	1	0.17
EG571	4	0.17
BN873	2	0.17
KA785	1	0.16
LB136	1	0.16
BF877	9	0.15
LU673	1	0.15
FQ608	1	0.15
HI076	1	0.15
YN518	1	0.15
BF848	8	0.14
TN825	1	0.14
WQ163	2	0.14
BN890	9	0.14
BF887	8	0.14
BF881	1	0.14
BF862	7	0.13
BE506	9	0.13
AA984	8	0.13
RP170	5	0.13
DM678	1	0.13
UR678	1	0.13
HD743	1	0.13
HB056	1	0.13
ZU710	1	0.13
NS475	1	0.13
VJ219	1	0.13
OK579	1	0.13
GC413	1	0.13
FQ612	1	0.13
BF870	7	0.13
SY844	5	0.13
BN870	2	0.13
OJ232	2	0.13

Fluoride Data in WDNR's Groundwater Retrieval Network (GRN) Database for Water Supply Wells**Grant County, Wisconsin****Average Detected Concentration of Fluoride, Sorted by Concentration**

Result qualifier description (Multiple Items)	Sample Count	Average Result
Unique Well ID		
JD260	3	0.12
RQ362	1	0.12
BF849	6	0.12
OJ139	2	0.11
BN889	1	0.11
SB757	3	0.11
YE608	4	0.11
BN867	4	0.11
BF886	10	0.10
KA547	1	0.10
BF873	8	0.09
OE466	6	0.09
DR430	3	0.09
SJ604	1	0.09
RX881	2	0.09
CX863	1	0.09
TO277	1	0.09
BF876	4	0.09
BN864	2	0.09
BF864	2	0.08
UD453	1	0.08
EG575	3	0.08
LE533	1	0.08
QX202	2	0.08
HB215	1	0.08
LE524	1	0.08
HB164	1	0.07
TY797	1	0.07
BF875	3	0.07
UE663	1	0.04
KA154	1	0.04
Grand Total	385	0.38

Data downloaded by NDK on 3/24/2020 (Data collected through 12/31/2019)